



CHV5 DC INVERTER VRF UNITS

TECHNICAL SALES GUIDE

~50Hz

CAPACITY RANGE: 22.4~246.0kW

SUPER HIGH AMBIENT OPERATION TO 52°C





CONTENTS

| | |
|---|-----|
| 1 UNIT CHARACTERISTICS | 1 |
| 2 UNIT PARAMETERS | 5 |
| 3 ELECTRICAL SPECIFICATIONS..... | 13 |
| 4 COMBINATION MODE..... | 15 |
| 5 INTERNAL PIPING DESIGN OF THE UNITS | 17 |
| 6 UNIT CAPACITY CORRECTION | 20 |
| 7 UNIT NOISE CURVES | 99 |
| 8 UNIT GRAVITY CENTER DIAGRAMS | 101 |
| 9 UNIT INSTALLATION SPACE REQUIREMENTS | 103 |
| 10 MODEL SELECTION FOR UNIT PIPING..... | 110 |
| 11 REQUIREMENTS FOR COMMUNICATION MODE | 122 |
| 12 ELECTRICAL CONNECTION..... | 127 |
| 13 CALCULATION METHOD OF REFRIGERANT ADDED FOR ENGINEERING PIPING | 129 |
| 14 OPTIONAL COMPONENTS..... | 130 |
| 15 UNIT OPERATING RANGE | 131 |

CHV5 DC Inverter VRF Units Technical Sales Guide

1 UNIT CHARACTERISTICS

CHV5 series DC inverter VRF units: The basic models of the whole series are 8HP, 10HP, 12HP, 14HP, and 16HP , 18HP , 20HP and 22HP , and the combination model is 24HP-88HP.



Energy efficient

The products benefit from the advanced DC inverter technology, optimized air conditioner system design, and accurate intelligent control technology.

► High efficient DC inverter compressor

The DC inverter compressor is adopted for C&H DC inverter VRF units. The compressor is designed in the high pressure chamber with excellent performance to suck directly, reduce the suction superheat loss and increase the compression efficiency by 3% in comparison to the low pressure chamber compression. The motor part adopts a high efficient permanent magnet synchronous motor, the rotor is a permanent magnet, and the stator implements concentrated winding. Therefore, the efficiency far surpasses that of a common DC inverter compressor.

➤ Sensorless DC inverter fan motor

The DC convertor motor with a high back electromotive force is adopted to implement stepless speed regulation in the range of 5 Hz to 75 Hz. In contrast to the common DC convertor motor, both the operating current and motor input power are lower, but the efficiency is greatly improved.

➤ Advanced torque control technology

The technology of minimum current and maximum torque control is adopted.

The rotor reluctance torque of DC inverter compressor is effectively used to export the maximum torque at the cost of minimum current, thus reducing the motor winding loss and achieving higher energy efficiency.

The low frequency torque control is implemented.

The motor torque is directly controlled to realize operation of the DC inverter at an ultralow speed. The small torque pulsation not only meets system requirements, but also guarantees the higher degree of comfort.



Comfortable mute

C&H CHV5 air conditioning units fully consider the comfort requirement of people, and the humanized technology further perfects the degree of comfort. The wider operation range of the units ensures normal operation in sub-zero weather or hot weather. The better mute effect creates a quiet environment for work and life.

➤ Outdoor unit mute mode

◆ Night mute

The system can memorize and judge the outdoor maximum temperature. When the system operates with a low load at night, it can automatically enter the mute mode. Nine mute modes can be set for the units according to requirements of actual application scenarios.

For example, the unit can automatically enter the night operation mode after operation for 8h, and will restore the normal operation mode in 9h.

◆ Forced mute

When the unit is installed at a place with the requirement for a lower noise level, it should operate in the mute mode in the daytime and at night. In this case, three forced mute setting modes can be selected to ensure that the unit operates at the low noise mode all the time. The minimum noise value can be 45dB (A).

➤ Indoor unit mute mode

The indoor unit also adopts the DC inverter motor to implement stepless speed regulation and greatly reduce the noise level. Moreover, the wired controller can be used to set the automatic mute mode of indoor unit and enable the automatic mute function according to the indoor temperature and movements of persons. The minimum noise value can be 25dB (A).



Advanced technology to ensure stability and reliability

C&H CHV5 air conditioning units have earned a reputation in the field due to the high technical content. Thanks to research and experiments for more than one decade, all the technologies of CHV have become more matured. C&H CHV5 has been upgraded in an all-round way, including electric elements, machine elements, control technology and communication technology. Continuous revolution in technologies must bring more reliable and efficient service to users.

➤ Two-stage oil separation technology

For the patented two-stage oil separation technology (patent No. 201120003910.7), every basic module is provided with stage-1 and stage-2 oil separators. Stage-1 oil separator uses a filter expansion valve, and the separation efficiency reaches 98%. Stage-2 oil separator further separates 2% of refrigeration oil left, and the separation efficiency reaches 95%. The total oil separation efficiency reaches 99.9%.

➤ Oil return control technologies

C&H owns two major unique oil return control technologies.

CHV5 DC Inverter VRF Units Technical Sales Guide

◆ Oil return control of new generation

C&H oil return control technology of new generation integrates the pressure control oil return technology. Pressure control effectively controls oil return of the system and the oil storage status of each compressor, thus substantially increasing the service life of the compressor.

◆ Proprietary compressor oil storage technology

C&H DC inverter unit is designed with the proprietary compressor oil storage technology. The relevant parameter is judged to control the lowest oil level required for operating the compressor.

➤ Refrigerant storage and distribution technology

C&H CHV5 adopts the system loop without any reservoir to greatly reduce the refrigerant filling quantity, improve the refrigerant control precision of the system, and store the surplus refrigerant in the pipeline.

➤ Oil balance control technology

◆ Inter-module oil balance technology (patent No. 200910041723.5)

The defect of traditional scheduled oil return is eliminated. Oil can be balanced without stopping the system. The technology can judge the operating status of each module and each compressor, calculate the oil reserve of the compressor, adjust the operating status of the compressor, and implement inter-module oil balance. It can ensure reliability and comfortability of the air conditioning system without affecting the capacity output of the system.

◆ Inter-compressor oil balance technology

Refrigerant is sucked into the compression chamber of the compressor through the air suction pipe, discharged to the fully-closed compressor cavity after being compressed, and then flows through the refrigerating system via the vent pipe. According to the principle of moving fluid mechanics and the oil quantity actually required during operation of the compressor, the technology decides the height of the oil balance pipe, controls the oil level in the oil pool, ensures the minimum oil quantity required by each compressor during operation, and implements oil balance between compressors.

➤ Super-cooling control technology

is used for refrigeration to substantially reduce the cooling capacity attenuation.

The efficient heat exchange loop is used to implement heat exchanger and super-cooling control. The degree of super-cooling reaches 11°C.

The recooling loop is used to reach a temperature of 9°C and ensure the refrigerating and heating effects.

➤ Unique comfortability control

The outdoor unit is regulated using dual electronic expansion valves within the regulation range of 960 stages to accurately realize the flow control between the indoor unit module and outdoor unit module, so the system operates more stably.

➤ Heating can quickly start within 210s, and 100% heat output is provided at the first time.



Humanized engineering operation

➤ The unit is characterized by automatic address allocation and non-polarity communication.

➤ The unit can perform automatic debugging and fault detection.

CHV5 has five automatic debugging functions.

◆ Automatically allocating indoor and outdoor unit addresses

◆ Automatically checking the quantities of indoor and outdoor units

◆ Automatically detecting internal faults of units

◆ Automatically starting debugging

◆ Judging pipeline exceptions in real time

➤ The units provide three emergency functions: module, compressor and fan.

➤ The units can recover refrigerants in two modes.

→ Intelligent management

- The units are designed in the dual-energy saving operation modes.
Along with penetration of energy conservation and emission reduction and increasingly strict requirements for power utilization in cities raised by the state, a lot of cities will issue corresponding power rationing measures in the peak of power consumption, especially in summer. C&H CHV5 air conditioning units provides two energy saving modes for users to select as needed and meets the requirements for off-peak power consumption and power brownout in cities.
 - ◆ Energy saving mode 1: When the unit is set to the automatic energy saving mode during operation, the system automatically adjusts and controls the target parameter according to the operating status, and greatly reduces power consumption of the whole system. The maximum energy saving ratio is 15%.
 - ◆ Energy saving mode 2: When the unit is set to the forced energy saving mode during operation, the system forcedly limits power output of the system. The maximum energy saving ratio is 20%.
- The unit is provided with the energy consumption analysis function and corresponding solution.
- The unit supports the emergency shutdown function.
Without remote monitoring, the outdoor unit can directly intervene in the fire alarm linkage signal, and the whole system can stop immediately in case of an emergency to avoid more risk losses.
- The unit has the management function by area.

→ Ultra-long piping distance design, with the maximum piping length of 1000m

In comparison to the traditional water chilling unit, the VRF unit shows the strength of simple and convenient engineering piping. C&H CHV5 inverter VRF unit more significantly displays the strength of actual engineering piping, and the air conditioning system can be flexibly applied to various buildings more simply and freely, reducing the engineering installation cost for users.

→ A single refrigerating system, able to connect to a maximum of 80 indoor units

For most VRF units in the market, the single system can connect to a maximum of 64 units. C&H CHV5 can implement combination of module units and connect to a maximum of 80 indoor units (the quantity of connected units ranks first in the field). It is more applicable to large-sized commercial office buildings or aparthotels.

→ Wide operation range

Operating temperature range: -5°C to 52°C for cooling; -20°C to 24°C for heating.
Operating range of power supply: 3N, 320 V to 460 V, 50 Hz.

→ Module switching control

The module status automatically switches between modules every eight hours according to the operating status. This avoids long-term "waiting for work" of several modules and greatly improves reliability of the whole system.

→ High static pressure design of the outdoor unit to realize more flexible selection

The unit is provided with four levels of static pressures (0 Pa, 30 Pa, 50 Pa, and 82 Pa) for regulation. The corresponding static pressure can be selected for the outdoor unit according to the building form, and the maximum static pressure is 82 Pa. The unit especially applies to the scenario where the outdoor unit needs to be placed indoors.

CHV5 DC Inverter VRF Units Technical Sales Guide

2 UNIT PARAMETERS

2.1 Outdoor Unit

| Model | - | CHV-5S224NMX | CHV-5S280NMX | CHV-5S335NMX | CHV-5S400NMX | CHV-5S450NMX |
|--|------------|------------------------|------------------------|------------------------|------------------------|------------------------|
| Cooling capacity | kW | 22.40 | 28.00 | 33.50 | 40.00 | 45.00 |
| Heating capacity | kW | 25.00 | 31.50 | 37.50 | 45.00 | 50.00 |
| Air volume | m³/h | 11400 | 11400 | 14000 | 14000 | 14000 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 60 | 61 | 63 | 63 | 63 |
| Power supply | - | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 5.20 | 7.00 | 8.41 | 10.65 | 12.65 |
| Heating power input | kW | 5.50 | 7.30 | 9.00 | 11.10 | 13.00 |
| Cooling current input | A | 9.30 | 12.50 | 15.00 | 19.00 | 22.6 |
| Heating current input | A | 9.80 | 13.00 | 16.10 | 19.80 | 23.20 |
| Maximum power input | kW | 8.80 | 11.70 | 13.80 | 16.10 | 18.60 |
| Maximum current | A | 15.7 | 20.9 | 24.7 | 28.8 | 33.2 |
| Compressor type | - | Inverter scroll type |
| Number of compressors | N | 1 | 1 | 1 | 2 | 2 |
| Compressor refrigeration oil brand | - | FVC68D or FV-68H |
| oil charge* | Totally | L | 4.0 | 4.0 | 4.5 | 5.5 |
| | Compressor | L | 1.0 | 1.0 | 1.0 | 1.0×2 |
| | Else | L | 3.0 | 3.0 | 3.5 | 3.5 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A |
| Refrigerant fcharge volume | kg | 5.9 | 6.7 | 8.2 | 9.80 | 10.30 |
| Maximum qty of connected indoor units | unit | 13 | 16 | 19 | 23 | 26 |
| Gas pipe size | mm | Φ19.05 | Φ22.2 | Φ25.4 | Φ25.40 | Φ28.60 |
| Liquid pipe size | mm | Φ9.52 | Φ9.52 | Φ12.7 | Φ12.7 | Φ12.7 |
| Oil balance pipe size | mm | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 |
| External dimension (width) | mm | 930 | 930 | 1340 | 1340 | 1340 |
| External dimension (depth) | mm | 765 | 765 | 765 | 765 | 765 |
| External dimension (height) | mm | 1605 | 1605 | 1605 | 1605 | 1605 |
| Packaging dimension (width) | mm | 1010 | 1010 | 1420 | 1420 | 1420 |
| Packaging dimension (depth) | mm | 840 | 840 | 840 | 840 | 840 |
| Packaging dimension (height) | mm | 1775 | 1775 | 1775 | 1775 | 1775 |
| Net weight | kg | 225 | 225 | 285 | 360 | 360 |
| Gross weight | kg | 235 | 235 | 300 | 375 | 375 |

*: Total oil quantity of outdoor unit, oil storing quantity of compressor and oil storing quantity of oil balancer are listed. When replacing compressor or oil balancer, only need to charge the corresponding additional oil quantity.

| Model | - | CHV-5S504NMX | CHV-5S560NMX | CHV-5S615NMX | CHV-5S680NMX | CHV-5S730NMX |
|--|-------|------------------------|------------------------|------------------------|----------------------------|----------------------------|
| Module combination | - | - | - | - | CHV-5S280NMX+ CHV-5S400NMX | CHV-5S280NMX+ CHV-5S450NMX |
| Cooling capacity | kW | 50.4 | 56 | 61.5 | 68 | 73 |
| Heating capacity | kW | 56.5 | 63 | 69 | 76.5 | 81.5 |
| Air volume | m³/h | 16000 | 16000 | 16000 | 11400+14000 | 11400+14000 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 63 | 63 | 64 | 65 | 65 |
| Power supply | - | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 14.20 | 16.00 | 18.5 | 17.65 | 19.65 |
| Heating power input | kW | 14.10 | 16.60 | 18.9 | 18.40 | 20.30 |
| Refrigerating current input | A | 25.4 | 28.6 | 33.1 | 12.5+19.0 | 12.5+22.6 |
| Heating current input | A | 25.2 | 29.7 | 33.8 | 13.0+19.8 | 13.0+23.2 |
| Maximum power input | kW | 25.0 | 28.0 | 29.0 | 27.80 | 30.30 |
| Maximum current | A | 44.7 | 50 | 52 | 49.7 | 54.1 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge volume | kg | 11.3 | 14.3 | 14.3 | 6.7+9.8 | 6.7+10.3 |
| Maximum qty of connected indoor units | unit | 29 | 32 | 35 | 39 | 43 |
| Gas pipe size | mm | Φ28.6 | Φ28.6 | Φ28.6 | Φ28.6 | Φ31.8 |
| Liquid pipe size | mm | Φ15.9 | Φ15.9 | Φ15.9 | Φ15.9 | Φ19.05 |
| Oil balance pipe size | mm | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Model | - | CHV-5S785NMX | CHV-5S850NMX | CHV-5S900NMX | CHV-5S960NMX | CHV-5S1010NMX |
|--|-------|-------------------------------|-------------------------------|-------------------------------|-------------------------------|-------------------------------|
| Module combination | - | CHV-5S280NMX+ CHV-5S504NMX | CHV-5S280NMX +CHV-5S560NMX | CHV-5S280NMX+ CHV-5S615NMX | CHV-5S335NMX+ CHV-5S615NMX | CHV-5S400NMX+ CHV-5S615NMX |
| Cooling capacity | kW | 78.4 | 84 | 89.5 | 95 | 101.5 |
| Heating capacity | kW | 88.0 | 94.5 | 100.5 | 106.5 | 114 |
| Air volume | m³/h | 27400 | 27400 | 27400 | 30000 | 30000 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 66 | 67 | 67 | 68 | 68 |
| Power supply | - | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 21.2 | 23.0 | 25.50 | 26.91 | 29.15 |
| Heating power input | kW | 21.4 | 23.9 | 26.20 | 27.90 | 30.0 |
| Refrigerating current input | A | 37.9 | 41.1 | 45.6 | 48.1 | 52.1 |
| Heating current input | A | 38.2 | 42.7 | 46.8 | 49.9 | 53.6 |
| Maximum power input | kW | 36.7 | 39.70 | 40.7 | 42.8 | 45.10 |
| Maximum current | A | 65.6 | 71 | 72.7 | 76.5 | 80.6 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge volume | kg | 18 | 21 | 21 | 22.5 | 24.1 |
| Maximum qty of connected indoor units | unit | 46 | 50 | 53 | 56 | 59 |
| Gas pipe size | mm | Φ31.8 | Φ31.8 | Φ31.8 | Φ31.8 | Φ38.1 |
| Liquid pipe size | mm | Φ19.05 | Φ19.05 | Φ19.05 | Φ19.05 | Φ19.05 |
| Oil balance pipe size | mm | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 |

| Model | - | CHV-5S1065NMX | CHV-5S1130NMX | CHV-5S1180NMX | CHV-5S1235NMX | CHV-5S1300NMX |
|--|-------|-------------------------------|-------------------------------|-------------------------------|-------------------------------|--|
| Module combination | - | CHV-5S450NMX+ CHV-5S615NMX | CHV-5S504NMX+ CHV-5S615NMX | CHV-5S560NMX+ CHV-5S615NMX | CHV-5S615NMX+ CHV-5S615NMX | CHV-5S280NMX+ CHV-5S450NMX+ CHV-5S560NMX |
| Cooling capacity | kW | 106.5 | 111.9 | 117.5 | 123.0 | 129 |
| Heating capacity | kW | 119 | 125.5 | 132 | 138 | 144.5 |
| Air volume | m³/h | 30000 | 32000 | 32000 | 32000 | 41400 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 68 | 68 | 69 | 69 | 69 |
| Power supply | - | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 31.15 | 32.7 | 34.5 | 37 | 36.65 |
| Heating power input | kW | 31.90 | 33.0 | 35.5 | 37.8 | 36.90 |
| Refrigerating current input | A | 55.7 | 58.5 | 61.7 | 66.2 | 63.7 |
| Heating current input | A | 57 | 59 | 63.5 | 67.6 | 65.9 |
| Maximum power input | kW | 47.6 | 54 | 57 | 58 | 58.3 |
| Maximum current | A | 85 | 96.5 | 101.9 | 103.6 | 104.2 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge volume | kg | 24.6 | 25.6 | 28.6 | 28.6 | 31.3 |
| Maximum qty of connected indoor units | unit | 63 | 64 | 64 | 64 | 64 |
| Gas pipe size | mm | Φ38.1 | Φ38.1 | Φ38.1 | Φ38.1 | Φ38.1 |
| Liquid pipe size | mm | Φ19.05 | Φ19.05 | Φ19.05 | Φ19.05 | Φ19.05 |
| Oil balance pipe size | mm | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Model | - | CHV-5S1350NMX | CHV-5S1410NMX | CHV-5S1460NMX | CHV-5S1515NMX | CHV-5S1580NMX |
|--|-------|--|--|--|--|--|
| Module combination | - | CHV-5S280NMX+ CHV-5S450NMX+ CHV-5S615NMX | CHV-5S335NMX+ CHV-5S450NMX+ CHV-5S615NMX | CHV-5S280NMX+ CHV-5S560NMX+ CHV-5S615NMX | CHV-5S280NMX+ CHV-5S615NMX+ CHV-5S615NMX | CHV-5S335NMX+ CHV-5S615NMX+ CHV-5S615NMX |
| Cooling capacity | kW | 134.5 | 140 | 145.5 | 151.0 | 156.5 |
| Heating capacity | kW | 150.5 | 156.5 | 163.5 | 169.5 | 175.5 |
| Air volume | m³/h | 41400 | 44000 | 43400 | 43400 | 46000 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 69 | 69 | 69 | 70 | 70 |
| Power supply | - | 380~415V 3N~50Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 38.15 | 39.56 | 41.5 | 44.0 | 45.41 |
| Heating power input | kW | 39.20 | 40.90 | 42.8 | 45.1 | 46.80 |
| Refrigerating current input | A | 68.2 | 70.7 | 74.2 | 78.7 | 81.2 |
| Heating current input | A | 70 | 73.1 | 76.5 | 80.6 | 83.7 |
| Maximum power input | kW | 59.3 | 61.4 | 68.7 | 69.7 | 71.8 |
| Maximum current | A | 105.9 | 109.7 | 122.8 | 124.5 | 128.3 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge volume | kg | 61.5 | 32.8 | 35.3 | 35.3 | 36.8 |
| Maximum qty of connected indoor units | unit | 64 | 66 | 69 | 71 | 74 |
| Gas pipe size | mm | Φ 38.1 | Φ 41.3 | Φ 41.3 | Φ 41.3 | Φ 41.3 |
| Liquid pipe size | mm | Φ 19.05 |
| Oil balance pipe size | mm | Φ 9.52 |

| Model | - | CHV-5S1630NMX | CHV-5S1685NMX | CHV-5S1750NMX | CHV-5S1800NMX | CHV-5S1845NMX |
|--|-------|--|--|--|--|--|
| Module combination | - | CHV-5S400NMX+ CHV-5S615NMX+ CHV-5S615NMX | CHV-5S450NMX+ CHV-5S615NMX+ CHV-5S615NMX | CHV-5S504NMX+ CHV-5S615NMX+ CHV-5S615NMX | CHV-5S560NMX+ CHV-5S615NMX+ CHV-5S615NMX | CHV-5S615NMX+ CHV-5S615NMX+ CHV-5S615NMX |
| Cooling capacity | kW | 163 | 168.0 | 173.4 | 179 | 184.5 |
| Heating capacity | kW | 183 | 188 | 194.5 | 201 | 207 |
| Air volume | m³/h | 46000 | 46000 | 48000 | 48000 | 48000 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 70 | 70 | 70 | 71 | 71 |
| Power supply | - | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 47.65 | 49.65 | 51.2 | 53.0 | 55.5 |
| Heating power input | kW | 48.90 | 50.80 | 51.9 | 54.4 | 56.7 |
| Refrigerating current input | A | 85.2 | 88.8 | 91.6 | 94.8 | 99.3 |
| Heating current input | A | 87.4 | 90.8 | 92.8 | 97.3 | 101.4 |
| Maximum power input | kW | 74.10 | 76.60 | 83.0 | 86.0 | 87 |
| Maximum current | A | 132.4 | 136.8 | 148.3 | 153.7 | 155.4 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge volume | kg | 38.4 | 38.9 | 39.9 | 42.9 | 42.9 |
| Maximum qty of connected indoor units | unit | 77 | 80 | 80 | 80 | 80 |
| Gas pipe size | mm | Φ41.3 | Φ41.3 | Φ41.3 | Φ41.3 | Φ41.3 |
| Liquid pipe size | mm | Φ19.05 | Φ19.05 | Φ19.05 | Φ19.05 | Φ19.05 |
| Oil balance pipe size | mm | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Model | - | CHV-5S1908NMX | CHV-5S1962NMX | CHV-5S2016NMX | CHV-5S2072NMX | CHV-5S2128NMX |
|--|-------|---|---|---|---|--|
| Module combination | - | CHV-5S280NMX+ CHV-5S450NMX+ CHV-5S560NMX+ CHV-5S615NMX | CHV-5S280NMX+ CHV-5S504NMX+ CHV-5S560NMX+ CHV-5S615NMX | CHV-5S280NMX+ CHV-5S560NMX+ CHV-5S560NMX+ CHV-5S615NMX | CHV-5S280NMX+ CHV-5S560NMX+ CHV-5S615NMX+ CHV-5S615NMX | CHV-5S280NMX+ CHV-5S615NMX+ CHV-5S615NMX+ CHV-5S615NM |
| Cooling capacity | kW | 190.5 | 195.9 | 201.5 | 207 | 212.5 |
| Heating capacity | kW | 213.5 | 220 | 226.5 | 232.5 | 238.5 |
| Air volume | m³/h | 57400 | 59400 | 59400 | 59400 | 59400 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 72 | 73 | 73 | 73 | 73 |
| Power supply | - | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 54.15 | 55.7 | 57.5 | 60.0 | 62.5 |
| Heating power input | kW | 55.80 | 56.9 | 59.4 | 61.7 | 64.0 |
| Refrigerating current input | A | 96.8 | 99.6 | 102.8 | 107.3 | 111.8 |
| Heating current input | A | 99.7 | 101.7 | 106.2 | 110.3 | 114.4 |
| Maximum power input | kW | 87.3 | 93.7 | 96.7 | 97.7 | 98.7 |
| Maximum current | A | 156 | 167.5 | 172.9 | 174.6 | 176.3 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge volume | kg | 45.6 | 46.6 | 49.6 | 49.6 | 49.6 |
| Maximum qty of connected indoor units | unit | 80 | 80 | 80 | 80 | 80 |
| Gas pipe size | mm | Φ44.5 | Φ44.5 | Φ44.5 | Φ44.5 | Φ44.5 |
| Liquid pipe size | mm | Φ22.2 | Φ22.2 | Φ22.2 | Φ22.2 | Φ22.2 |
| Oil balance pipe size | mm | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 | Φ9.52 |

| | | | | | | | |
|--|-------|--|--|--|--|--|--|
| Model | - | CHV-5S2184NMX | CHV-5S2240NMX | CHV-5S2295NMX | CHV-5S2350NMX | CHV-5S2405NMX | CHV-5S2460NMX |
| Module combination | - | CHV-5S335NMX+CHV-5S400NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX | CHV-5S450NMX+CHV-5S504NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX | CHV-5S504NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX | CHV-5S560NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX | CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX | CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX+CHV-5S615NMX+ CHV-5S615NMX |
| Cooling capacity | kW | 218.0 | 224.5 | 229.5 | 234.9 | 240.5 | 246.0 |
| Heating capacity | kW | 244.5 | 252.0 | 257.0 | 263.5 | 270.0 | 276.0 |
| Air volume | m³/h | 62000 | 62000 | 62000 | 64000 | 64000 | 64000 |
| Maximum external static pressure of unit | Pa | 82 | 82 | 82 | 82 | 82 | 82 |
| Noise (sound pressure level) | dB(A) | 74 | 74 | 74 | 75 | 75 | 75 |
| Power supply | - | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz | 380~415V 3N~50/60Hz |
| Cooling power input | kW | 63.91 | 66.15 | 68.15 | 69.7 | 71.5 | 74.0 |
| Heating power input | kW | 65.7 | 67.8 | 69.70 | 70.8 | 73.3 | 75.6 |
| Refrigerating current input | A | 114.3 | 118.3 | 121.9 | 124.7 | 127.9 | 132.4 |
| Heating current input | A | 117.5 | 121.2 | 124.6 | 126.6 | 131.1 | 135.2 |
| Maximum power input | kW | 100.8 | 103.1 | 105.6 | 112.0 | 115.0 | 116.0 |
| Maximum current | A | 180.1 | 184.2 | 188.6 | 200.1 | 205.5 | 207.2 |
| Ambient temperature range of cooling | °C | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 | -5~52 |
| Ambient temperature range of heating | °C | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 | -20~24 |
| Refrigerant type | - | R410A | R410A | R410A | R410A | R410A | R410A |
| Refrigerant charge volume | kg | 51.1 | 52.7 | 53.2 | 54.2 | 57.2 | 57.2 |
| Maximum qty of connected indoor units | unit | 80 | 80 | 80 | 80 | 80 | 80 |
| Gas pipe size | mm | Φ 44.5 |
| Liquid pipe size | mm | Φ 22.2 |
| Oil balance pipe size | mm | Φ 9.52 |

NOTES:

- a. Rated cooling capacity test conditions: indoor 27°C DB/19°C WB, outdoor 35°C DB; connection pipe length: 5m, without height drop between units.
- b. Rated heating capacity test conditions: indoor 20°C DB, outdoor 7°C DB/6 °C WB; connection pipe length: 5m, without height drop between units.
- c. The total capacity of connected indoor units must be in the range of 50%~135% of the outdoor unit capacity. The relevant parameters can be corrected by referring to the unit capacity correction table.
- d. The above parameters are tested based on the standard connection pipe length. In the actual project, the parameters should be corrected referring to the capacity correction for the long connection pipe of units.

CHV5 DC Inverter VRF Units Technical Sales Guide

3 ELECTRICAL SPECIFICATIONS

3.1 Circuit Breaker and Wire Diameter Selection of CHV5 Series Units

| Type | Combination Mode | Power Supply Specifications | Total Capacity of Circuit Breaker (A) | Minimum Sectional Area (mm ²) of General Grounding Wire | Total Recommended Leads (Sectional Area (mm ²) × Pieces) | Circuit Breaker Capacity (A) of Each Combination Module | Minimum Sectional Area (mm ²) of Grounding Wire of Each Combination Module | Recommended Leads (Sectional Area (mm ²) × Pieces) for Each Combination Module |
|---------------|---------------------------|-----------------------------|---------------------------------------|---|--|---|--|--|
| CHV-5S224NMX | CHV-5S224NMX | 380~415V 3N~ 50/60Hz | 20 | 2.5 | 2.5×5 | 20 | 2.5 | 2.5×5 |
| CHV-5S280NMX | CHV-5S280NMX | 380~415V 3N~ 50/60Hz | 25 | 2.5 | 2.5×5 | 25 | 2.5 | 2.5×5 |
| CHV-5S335NMX | CHV-5S335NMX | 380~415V 3N~ 50/60Hz | 32 | 4.0 | 4.0×5 | 32 | 4.0 | 4.0×5 |
| CHV-5S400NMX | CHV-5S400NMX | 380~415V 3N~ 50/60Hz | 40 | 6.0 | 6.0×5 | 40 | 6.0 | 6.0×5 |
| CHV-5S450NMX | CHV-5S450NMX | 380~415V 3N~ 50/60Hz | 40 | 6.0 | 6.0×5 | 40 | 6.0 | 6.0×5 |
| CHV-5S504NMX | CHV-5S504NMX | 380~415V 3N~ 50/60Hz | 50 | 10.0 | 10.0×5 | 50 | 10.0 | 10.0×5 |
| CHV-5S560NMX | CHV-5S560NMX | 380~415V 3N~ 50/60Hz | 63 | 10.0 | 10.0×5 | 63 | 10.0 | 10.0×5 |
| CHV-5S615NMX | CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 63 | 10.0 | 10.0×5 | 63 | 10.0 | 10.0×5 |
| CHV-5S680NMX | CHV-5S280NMX+CHV-5S400NMX | 380~415V 3N~ 50/60Hz | 63 | 10.0 | 10.0×5 | 25 + 40 | 2.5 + 6.0 | 2.5×5 + 6.0×5 |
| CHV-5S730NMX | CHV-5S280NMX+CHV-5S450NMX | 380~415V 3N~ 50/60Hz | 63 | 16.0 | 16.0×5 | 25 + 40 | 2.5 + 6.0 | 2.5×5 + 6.0×5 |
| CHV-5S785NMX | CHV-5S280NMX+CHV-5S504NMX | 380~415V 3N~ 50/60Hz | 80 | 16.0 | 16.0×5 | 25 + 50 | 2.5 + 10.0 | 2.5×5 + 10.0×5 |
| CHV-5S850NMX | CHV-5S280NMX+CHV-5S560NMX | 380~415V 3N~ 50/60Hz | 80 | 16.0 | 16.0×5 | 25 + 63 | 2.5 + 10.0 | 2.5×5 + 10.0×5 |
| CHV-5S900NMX | CHV-5S280NMX+CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 100 | 16.0 | 16.0×5 | 25 + 63 | 2.5 + 10.0 | 2.5×5 + 10.0×5 |
| CHV-5S950NMX | CHV-5S335NMX+CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 100 | 16.0 | 16.0×5 | 32 + 63 | 4.0 + 10.0 | 4.0×5 + 10.0×5 |
| CHV-5S1010NMX | CHV-5S400NMX+CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 100 | 16.0 | 16.0×5 | 40 + 63 | 6.0 + 10.0 | 6.0×5 + 10.0×5 |
| CHV-5S1065NMX | CHV-5S450NMX+CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 100 | 16.0 | 16.0×5 | 40 + 63 | 6.0 + 10.0 | 6.0×5 + 10.0×5 |
| CHV-5S1130NMX | CHV-5S504NMX+CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 125 | 16.0 | 16.0×5 | 50 + 63 | 10.0 + 10.0 | 10.0×5 + 10.0×5 |
| CHV-5S1180NMX | CHV-5S560NMX+CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 125 | 16.0 | 16.0×5 | 63 + 63 | 10.0 + 10.0 | 10.0×5 + 10.0×5 |
| CHV-5S1235NMX | CHV-5S615NMX+CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 125 | 16.0 | 16.0×5 | 63 + 63 | 10.0 + 10.0 | 10.0×5 + 10.0×5 |

| | | | | | | | | |
|---------------|--|-------------------------|-----|------|--------|-----------------|--------------------------|--------------------------------|
| CHV-5S1300NMX | CHV-5S280NMX+ CHV-5S450NMX+ CHV-5S560NMX | 380~415V 3N~ 50/60Hz | 125 | 16.0 | 16.0×5 | 25 + 40 + 63 | 2.5 + 6.0 + 10.0 | 2.5×5 + 6.0×5 + 10.0×5 |
| CHV-5S1350NMX | CHV-5S280NMX+ CHV-5S450NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 125 | 16.0 | 16.0×5 | 25 + 40 + 63 | 2.5 + 6.0 + 10.0 | 2.5×5 + 6.0×5 + 10.0×5 |
| CHV-5S1405NMX | CHV-5S335NMX+ CHV-5S450NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 125 | 16.0 | 16.0×5 | 32 + 40 + 63 | 4.0 + 6.0 + 10.0 | 4.0×5 + 6.0×5 + 10.0×5 |
| CHV-5S1456NMX | CHV-5S280NMX+ CHV-5S560NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 160 | 25.0 | 25.0×5 | 25 + 63 + 63 | 2.5 + 10.0 + 10.0 | 2.5×5 + 10.0×5 + 10.0×5 |
| CHV-5S1512NMX | CHV-5S280NMX+ CHV-5S615NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 160 | 25.0 | 25.0×5 | 25 + 63 + 63 | 2.5 + 10.0 + 10.0 | 2.5×5 + 10.0×5 + 10.0×5 |
| CHV-5S1570NMX | CHV-5S335NMX+ CHV-5S615NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 160 | 25.0 | 25.0×5 | 32 + 63 + 63 | 4.0 + 10.0 + 10.0 | 4.0×5 + 10.0×5 + 10.0×5 |
| CHV-5S1650NMX | CHV-5S400NMX+ CHV-5S615NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 160 | 25.0 | 25.0×5 | 40 + 63 + 63 | 6.0 + 10.0 + 10.0 | 6.0×5 + 10.0×5 + 10.0×5 |
| CHV-5S1700NMX | CHV-5S450NMX+ CHV-5S615NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 160 | 25.0 | 25.0×5 | 40 + 63 + 63 | 6.0 + 10.0 + 10.0 | 6.0×5 + 10.0×5 + 10.0×5 |
| CHV-5S1750NMX | CHV-5S504NMX+ CHV-5S615NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 180 | 35.0 | 35.0×5 | 50 + 63 + 63 | 10.0 + 10.0 + 10.0 | 10.0×5 + 10.0×5 + 10.0×5 |
| CHV-5S1800NMX | CHV-5S560NMX+ CHV-5S615NMX+ CHV-5S615NMX | 380~415V 3N~ 50/60Hz | 180 | 35.0 | 35.0×5 | 63 + 63 + 63 | 10.0 + 10.0 + 10.0 | 10.0×5 + 10.0×5 + 10.0×5 |

NOTES:

- The circuit breaker and power cable specifications are selected according to the maximum unit power (maximum current).
- The power cable specifications are obtained under the condition that the multi-copper core cable (such as YJV copper-core XLPE insulated PVC sheathed power cable) is laid in the wire trough in an exposed manner (the ambient temperature of use is 40°C and the cable operating temperature is 90°C (IEC60364-5-523). If the use condition is different, calculate and adjust the specification according to the corresponding national standard.
- The copper core cable must be used.
- The sectional area of lead applies to the maximum distance of 15m. If the distance exceeds 5m, the sectional area of lead must be increased accordingly to prevent burnout of the lead or a fire due to current overload.

CHV5 DC Inverter VRF Units Technical Sales Guide

e. The circuit breaker specification is obtained under the condition that the ambient temperature is 40°C when the circuit breaker is operating. If the use condition is different, calculate and adjust the specification according to the instructions on circuit breaker specifications.

f. The circuit breaker should provide the magnetic trip and thermal trip functions at the same time to ensure protection in the cases of short circuit and overload.

4 COMBINATION MODE


| Model | CHV-5S224 NMX | CHV-5S280 NMX | CHV-5S335 NMX | CHV-5S400 NMX | CHV-5S450 NMX | CHV-5S504 NMX | CHV-5S560 NMX | CHV-5S615 NMX |
|---------------|---------------|---------------|---------------|---------------|---------------|---------------|---------------|---------------|
| CHV-5S224NMX | | | | | | | | |
| CHV-5S280NMX | | | | | | | | |
| CHV-5S335NMX | | | | | | | | |
| CHV-5S400NMX | | | | | | | | |
| CHV-5S450NMX | | | | | | | | |
| CHV-5S504NMX | | | | | | | | |
| CHV-5S560NMX | | | | | | | | |
| CHV-5S615NMX | | | | | | | | |
| CHV-5S680NMX | | | | | | | | |
| CHV-5S730NMX | | | | | | | | |
| CHV-5S785NMX | | | | | | | | |
| CHV-5S850NMX | | | | | | | | |
| CHV-5S900NMX | | | | | | | | |
| CHV-5S950NMX | | | | | | | | |
| CHV-5S1010NMX | | | | | | | | |
| CHV-5S1065NMX | | | | | | | | |
| CHV-5S1130NMX | | | | | | | | |
| CHV-5S1180NMX | | | | | | | | |

| | Technical Sales Guide | Technical Sales Guide | Technical Sales Guide |
|---------------|---|---|---|---|---|---|---|
| CHV-5S1235NMX | | | | | | |  |
| CHV-5S1300NMX |  | |  |  | | | |
| CHV-5S1350NMX |  | |  |  | | | |
| CHV-5S1405NMX | |  |  |  | | | |
| CHV-5S1456NMX |  | | | |  |  | |
| CHV-5S1512NMX |  | | | | | |  |
| CHV-5S1570NMX | |  | | | | |  |
| CHV-5S1650NMX | | |  | | | |  |
| CHV-5S1700NMX | | | |  | | |  |
| CHV-5S1750NMX | | | | |  | |  |
| CHV-5S1800NMX | | | | | |  |  |
| CHV-5S1845NMX | | | | | | |  |
| CHV-5S1908NMX |  | | |  |  |  | |
| CHV-5S1962NMX |  | | | |  |  |  |
| CHV-5S2016NMX |  | | | | |  |  |
| CHV-5S2072NMX |  | | | | |  |  |
| CHV-5S2128NMX |  | | | | | |  |
| CHV-5S2184NMX | |  | | | | |  |
| CHV-5S2240NMX | | |  | | | |  |
| CHV-5S2295NMX | | | |  | | |  |
| CHV-5S2350NMX | | | | |  | |  |
| CHV-5S2405NMX | | | | | |  |  |
| CHV-5S2460NMX | | | | | | |  |


CHV5 DC Inverter VRF Units Technical Sales Guide

5 INTERNAL PIPING DESIGN OF THE UNITS

1. Piping diagrams of CHV-5S224NMX, CHV-5S280NMX, and CHV-5S335NMX:

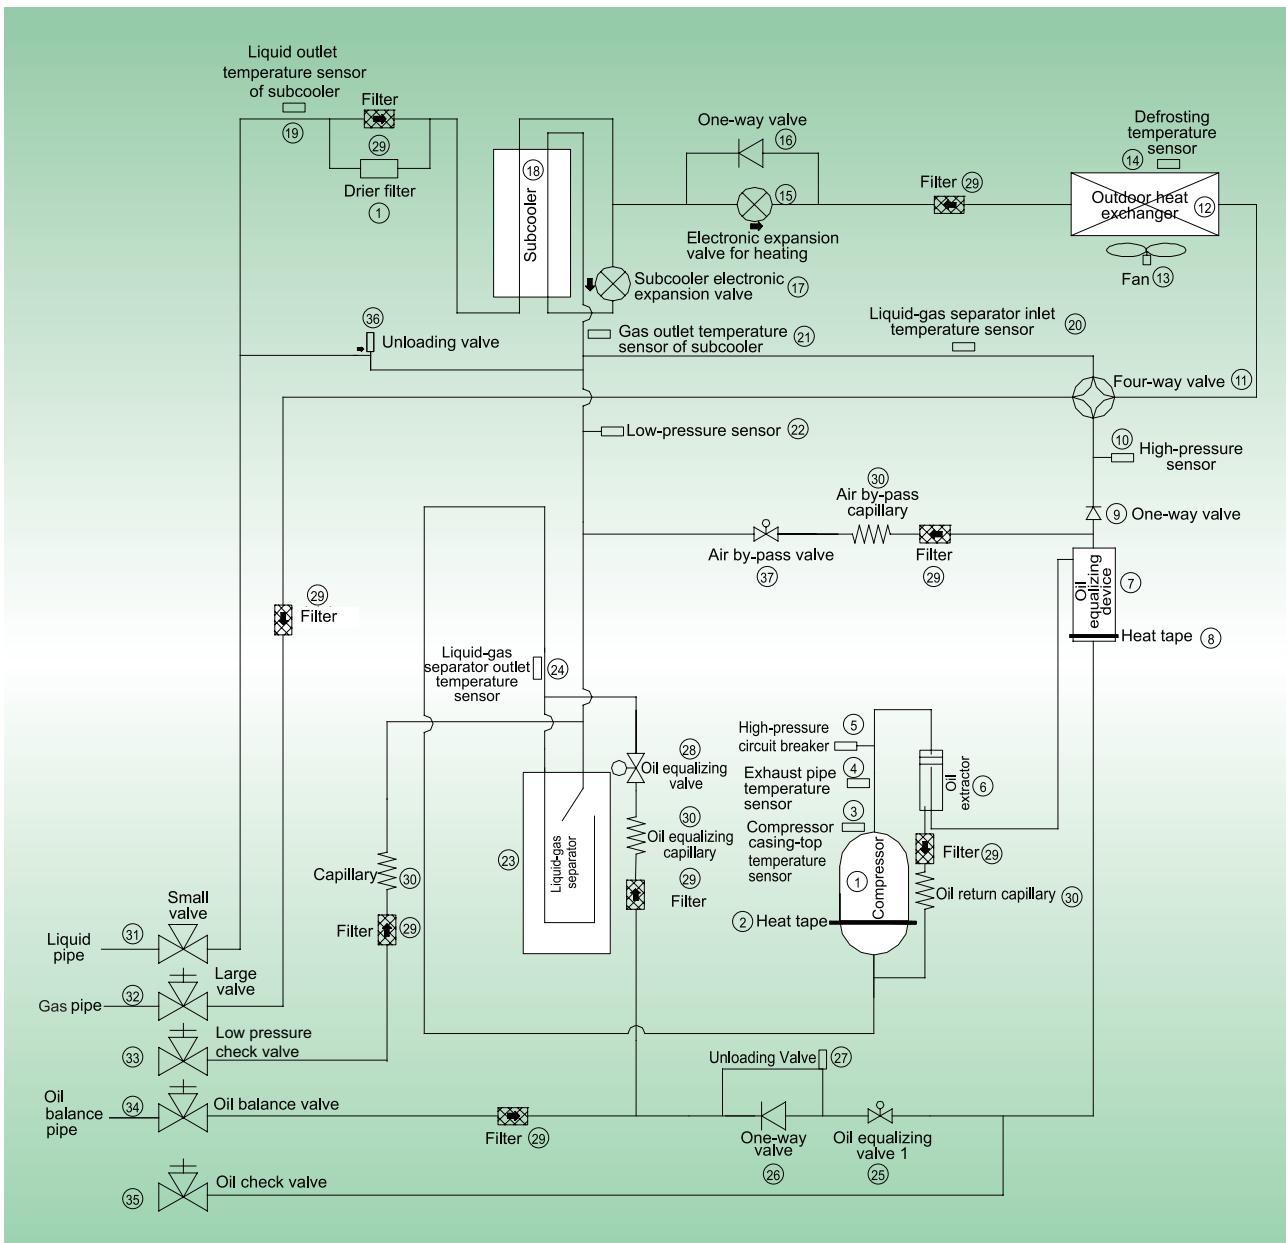


2. Piping diagrams of CHV-5S400NMX and CHV-5S450NMX:

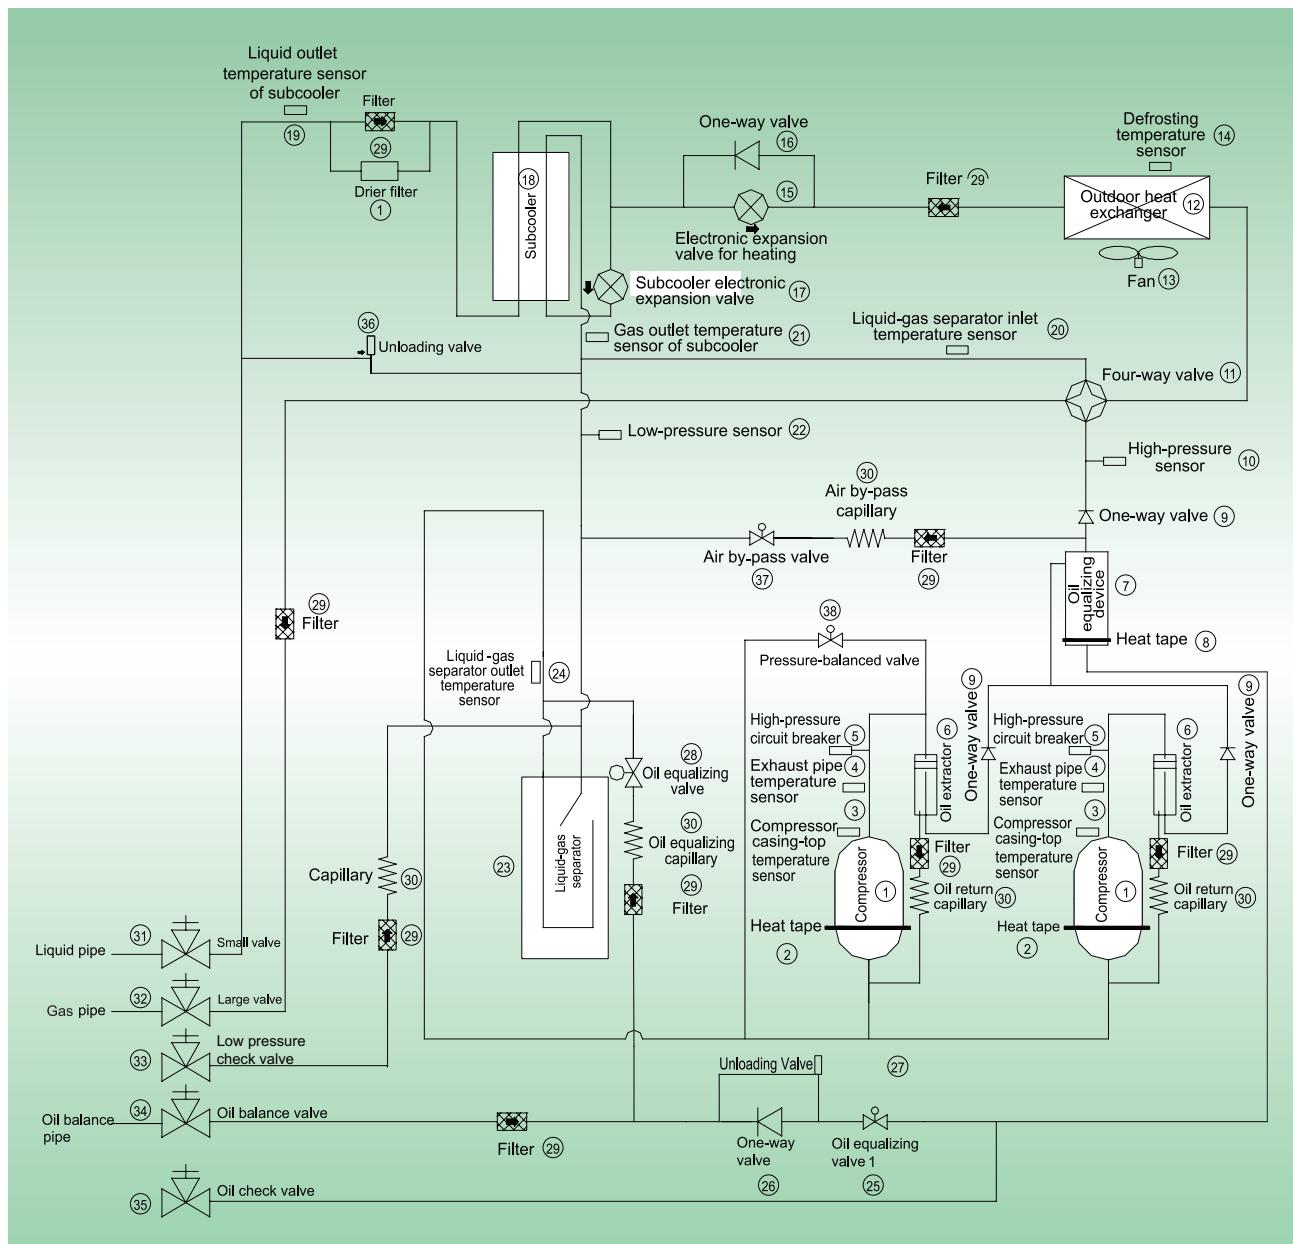

CHV5 DC Inverter VRF Units Technical Sales Guide

3. Piping diagrams of CHV-5S504NMX, CHV-5S560NMX and CHV-5S615NMX:

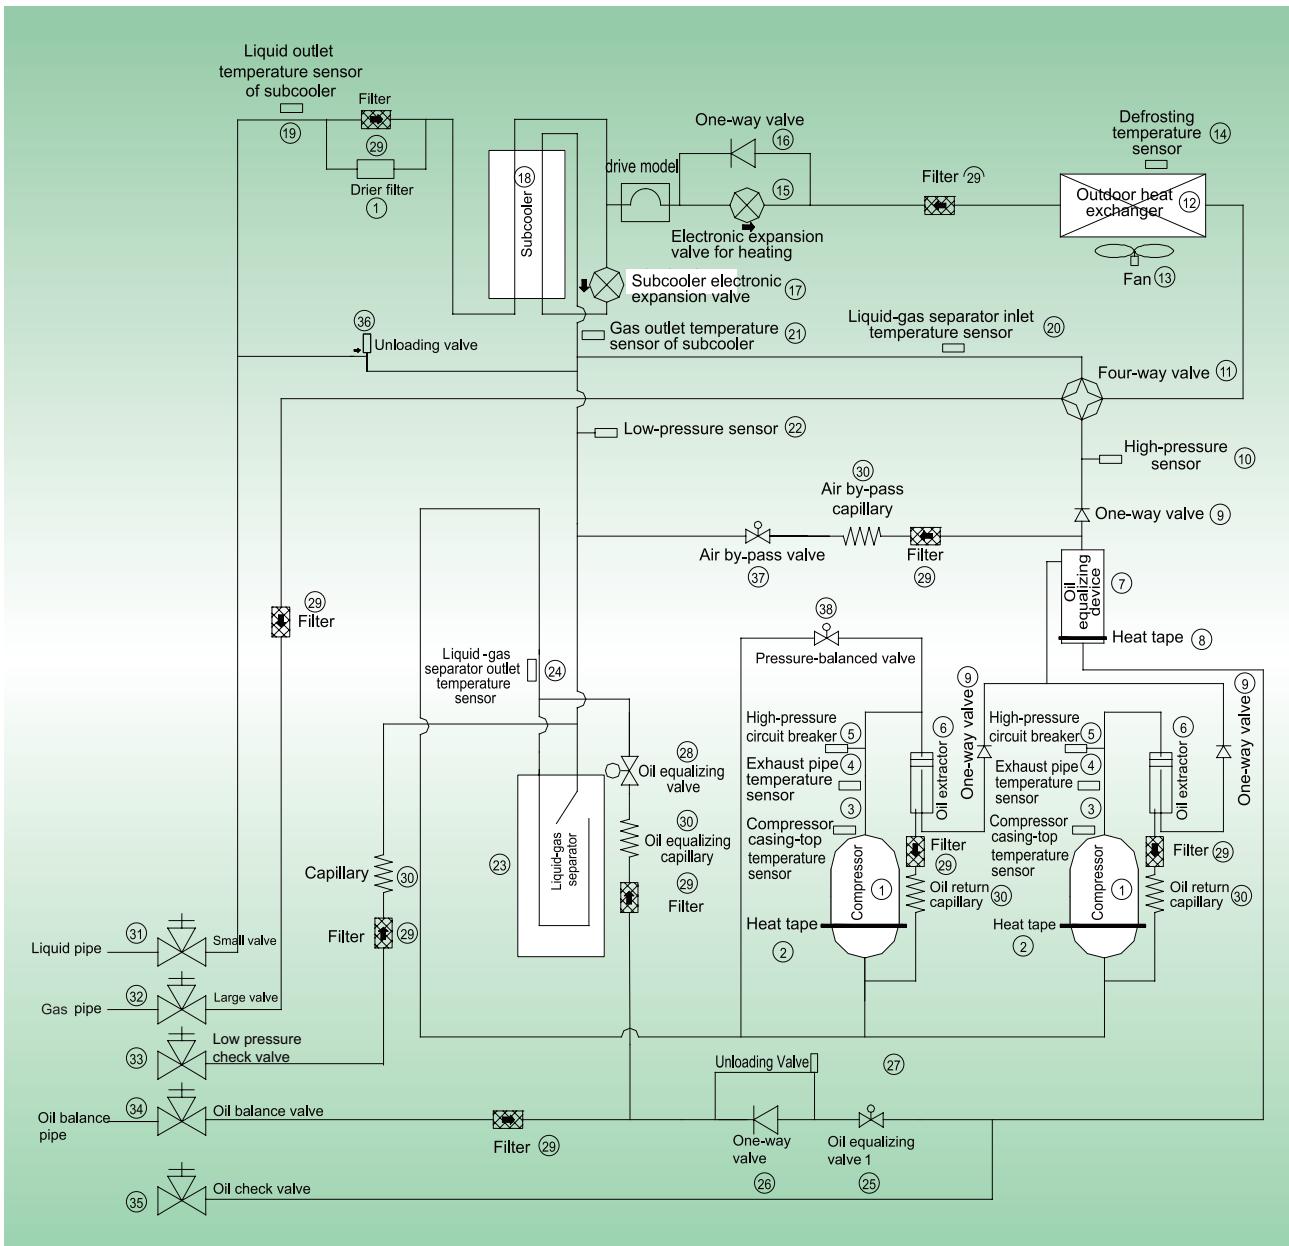

NOTE: The pressure balance valve is configured for the two compressors modules only.

6 UNIT CAPACITY CORRECTION

6.1 Correction of Capacity Along with Ambient Temperature and Configuration Ratio

- ## ► Cooling Capacity Calculation Method

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 135% | -5 | 19.7 | 2.30 | 23.4 | 2.80 | 27.2 | 2.83 | 28.2 | 2.85 | 28.8 | 2.86 | 29.5 | 2.90 | 30.4 | 2.93 |
| | 0 | 19.7 | 2.30 | 23.4 | 2.81 | 27.2 | 2.84 | 28.2 | 2.85 | 28.8 | 2.87 | 29.5 | 2.90 | 30.4 | 2.93 |
| | 4 | 19.7 | 2.31 | 23.4 | 2.82 | 27.2 | 2.85 | 28.2 | 2.87 | 28.8 | 2.88 | 29.5 | 2.91 | 30.4 | 2.95 |
| | 7 | 19.7 | 2.36 | 23.4 | 2.87 | 27.2 | 2.90 | 28.2 | 2.92 | 28.8 | 2.93 | 29.3 | 2.97 | 30.0 | 3.00 |
| | 10 | 19.7 | 2.40 | 23.4 | 2.93 | 27.2 | 3.48 | 28.2 | 3.56 | 28.6 | 3.49 | 29.3 | 3.34 | 30.0 | 3.19 |
| | 12 | 19.7 | 2.44 | 23.4 | 2.99 | 27.2 | 3.55 | 27.8 | 3.54 | 28.2 | 3.47 | 28.9 | 3.32 | 29.6 | 3.27 |
| | 14 | 19.7 | 2.49 | 23.4 | 3.04 | 27.1 | 3.60 | 27.5 | 3.53 | 27.8 | 3.45 | 28.6 | 3.42 | 29.3 | 3.46 |
| | 16 | 19.7 | 2.53 | 23.4 | 3.11 | 26.8 | 3.58 | 27.1 | 3.55 | 27.4 | 3.57 | 28.2 | 3.60 | 28.9 | 3.64 |
| | 18 | 19.7 | 2.58 | 23.4 | 3.17 | 26.4 | 3.72 | 26.7 | 3.74 | 27.1 | 3.76 | 27.8 | 3.79 | 28.6 | 3.83 |
| | 20 | 19.7 | 2.64 | 23.4 | 3.37 | 26.0 | 3.90 | 26.4 | 3.92 | 26.7 | 3.94 | 27.4 | 3.97 | 28.2 | 4.02 |
| | 21 | 19.7 | 2.71 | 23.4 | 3.49 | 25.8 | 3.99 | 26.2 | 4.01 | 26.6 | 4.03 | 27.3 | 4.07 | 28.0 | 4.11 |
| | 23 | 19.7 | 2.90 | 23.4 | 3.74 | 25.5 | 4.17 | 25.8 | 4.19 | 26.2 | 4.21 | 26.9 | 4.26 | 27.6 | 4.30 |
| | 25 | 19.7 | 3.10 | 23.4 | 4.01 | 25.1 | 4.35 | 25.5 | 4.37 | 25.8 | 4.40 | 26.6 | 4.44 | 27.3 | 4.49 |
| | 27 | 19.7 | 3.31 | 23.4 | 4.29 | 24.8 | 3.83 | 25.1 | 4.56 | 25.4 | 4.58 | 26.2 | 4.63 | 26.9 | 4.68 |
| | 29 | 19.7 | 3.53 | 23.4 | 4.58 | 24.4 | 4.72 | 24.7 | 4.75 | 25.1 | 4.77 | 25.8 | 4.82 | 26.6 | 4.87 |
| | 31 | 19.7 | 3.77 | 23.4 | 4.85 | 24.0 | 4.91 | 24.4 | 4.94 | 24.7 | 4.96 | 25.4 | 5.01 | 26.2 | 5.07 |
| | 33 | 19.7 | 4.02 | 23.0 | 5.03 | 23.7 | 5.08 | 24.0 | 5.12 | 24.4 | 5.15 | 25.1 | 5.20 | 25.8 | 5.26 |
| | 35 | 19.7 | 4.28 | 22.6 | 5.22 | 23.3 | 5.28 | 23.7 | 5.31 | 24.0 | 5.33 | 24.7 | 5.40 | 25.4 | 5.45 |
| | 37 | 19.7 | 4.56 | 22.2 | 5.40 | 23.0 | 5.47 | 23.3 | 5.50 | 23.7 | 5.53 | 24.3 | 5.59 | 25.0 | 5.66 |
| | 39 | 19.7 | 4.85 | 21.8 | 5.59 | 22.6 | 5.65 | 23.0 | 5.69 | 23.3 | 5.72 | 24.0 | 5.78 | 24.7 | 5.85 |
| | 41 | 18.6 | 5.40 | 21.4 | 6.57 | 22.1 | 6.65 | 22.5 | 6.16 | 22.8 | 6.19 | 23.5 | 6.26 | 24.2 | 6.33 |
| | 44 | 17.3 | 5.87 | 20.3 | 7.15 | 21.1 | 7.39 | 21.5 | 6.95 | 21.9 | 6.67 | 22.6 | 6.59 | 23.4 | 6.65 |
| | 47 | 16.3 | 7.81 | 19.6 | 9.51 | 20.4 | 7.76 | 20.8 | 7.06 | 21.1 | 7.10 | 21.9 | 7.07 | 22.6 | 7.14 |
| | 50 | 15.0 | 7.67 | 17.6 | 9.34 | 18.2 | 8.18 | 18.5 | 8.17 | 18.8 | 7.79 | 19.5 | 7.66 | 20.4 | 7.53 |
| | 52 | 11.3 | 6.47 | 13.1 | 7.88 | 13.6 | 6.97 | 14.0 | 6.95 | 14.4 | 6.83 | 15.6 | 6.75 | 16.5 | 6.54 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120% | -5 | 18.2 | 2.05 | 22.4 | 2.65 | 26.7 | 2.82 | 27.7 | 2.83 | 28.3 | 2.85 | 28.9 | 2.88 | 29.7 | 2.91 |
| | 0 | 18.2 | 2.05 | 22.4 | 2.66 | 26.7 | 2.82 | 27.7 | 2.84 | 28.3 | 2.85 | 28.9 | 2.88 | 29.7 | 2.91 |
| | 4 | 18.2 | 2.06 | 22.4 | 2.66 | 26.7 | 2.83 | 27.7 | 2.85 | 28.3 | 2.86 | 28.9 | 2.89 | 29.7 | 2.92 |
| | 7 | 18.2 | 2.10 | 22.4 | 2.71 | 26.7 | 2.88 | 27.7 | 2.90 | 28.3 | 2.91 | 28.7 | 2.95 | 29.3 | 2.98 |
| | 10 | 18.2 | 2.19 | 21.6 | 2.67 | 25.1 | 3.18 | 26.9 | 3.43 | 28.2 | 3.58 | 28.8 | 3.44 | 29.4 | 3.31 |
| | 12 | 18.2 | 2.23 | 21.6 | 2.72 | 25.1 | 3.24 | 26.9 | 3.50 | 27.8 | 3.56 | 28.4 | 3.43 | 29.0 | 3.29 |
| | 14 | 18.2 | 2.27 | 21.6 | 2.78 | 25.1 | 3.30 | 26.9 | 3.57 | 27.4 | 3.54 | 28.1 | 3.41 | 28.7 | 3.43 |
| | 16 | 18.2 | 2.31 | 21.6 | 2.83 | 25.1 | 3.36 | 26.7 | 3.60 | 27.0 | 3.55 | 27.7 | 3.58 | 28.3 | 3.61 |
| | 18 | 18.2 | 2.36 | 21.6 | 2.89 | 25.1 | 3.48 | 26.3 | 3.72 | 26.6 | 3.73 | 27.3 | 3.76 | 28.0 | 3.80 |
| | 20 | 18.2 | 2.40 | 21.6 | 3.00 | 25.1 | 3.74 | 26.0 | 3.90 | 26.3 | 3.91 | 27.0 | 3.95 | 27.6 | 3.98 |
| | 21 | 18.2 | 2.43 | 21.6 | 3.11 | 25.1 | 3.88 | 25.8 | 3.99 | 26.1 | 4.00 | 26.8 | 4.04 | 27.4 | 4.08 |
| | 23 | 18.2 | 2.59 | 21.6 | 3.33 | 25.1 | 4.15 | 25.4 | 4.16 | 25.8 | 4.18 | 26.4 | 4.23 | 27.0 | 4.26 |
| | 25 | 18.2 | 2.77 | 21.6 | 3.56 | 24.7 | 4.33 | 25.0 | 4.35 | 25.4 | 4.37 | 26.1 | 4.41 | 26.7 | 4.45 |
| | 27 | 18.2 | 2.96 | 21.6 | 3.81 | 24.4 | 4.51 | 24.7 | 4.54 | 25.0 | 4.56 | 25.7 | 4.60 | 26.3 | 4.64 |
| | 29 | 18.2 | 3.15 | 21.6 | 4.07 | 24.0 | 4.69 | 24.3 | 4.72 | 24.6 | 4.74 | 25.3 | 4.79 | 26.0 | 4.83 |
| | 31 | 18.2 | 3.36 | 21.6 | 4.34 | 23.7 | 4.88 | 24.0 | 4.90 | 24.3 | 4.93 | 25.0 | 4.98 | 25.6 | 5.03 |
| | 33 | 18.2 | 3.58 | 21.6 | 4.63 | 23.3 | 5.06 | 23.6 | 5.09 | 23.9 | 5.11 | 24.6 | 5.17 | 25.2 | 5.22 |
| | 35 | 18.2 | 3.81 | 21.6 | 4.94 | 22.9 | 5.24 | 23.2 | 5.27 | 23.6 | 5.30 | 24.2 | 5.36 | 24.9 | 5.41 |
| | 37 | 18.2 | 4.06 | 21.6 | 5.26 | 22.6 | 5.43 | 22.9 | 5.46 | 23.2 | 5.49 | 23.8 | 5.54 | 24.5 | 5.61 |
| | 39 | 18.2 | 4.32 | 21.5 | 5.55 | 22.2 | 5.62 | 22.5 | 5.65 | 22.8 | 5.68 | 23.5 | 5.74 | 24.2 | 5.80 |
| | 41 | 17.2 | 4.80 | 20.5 | 6.22 | 21.7 | 6.61 | 22.1 | 6.11 | 22.4 | 6.15 | 23.1 | 6.21 | 23.7 | 6.28 |
| | 44 | 16.0 | 5.22 | 19.4 | 6.76 | 20.7 | 7.34 | 21.1 | 6.91 | 21.5 | 6.62 | 22.2 | 6.53 | 22.9 | 6.60 |
| | 47 | 15.1 | 6.95 | 18.8 | 9.00 | 20.0 | 7.71 | 20.4 | 7.01 | 20.8 | 7.05 | 21.5 | 7.02 | 22.1 | 7.09 |
| | 50 | 13.8 | 6.83 | 16.8 | 8.83 | 17.9 | 8.13 | 18.2 | 8.12 | 18.5 | 7.74 | 19.1 | 7.61 | 19.9 | 7.47 |
| | 52 | 10.5 | 5.76 | 12.5 | 7.45 | 13.4 | 6.92 | 13.7 | 6.91 | 14.2 | 6.78 | 15.3 | 6.69 | 16.2 | 6.49 |

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110% | -5 | 16.6 | 1.81 | 20.6 | 2.33 | 26.4 | 2.80 | 27.2 | 2.81 | 27.7 | 2.83 | 28.3 | 2.85 | 29.1 | 2.88 |
| | 0 | 16.6 | 1.81 | 20.6 | 2.33 | 26.4 | 2.80 | 27.2 | 2.82 | 27.7 | 2.83 | 28.3 | 2.86 | 29.1 | 2.89 |
| | 4 | 16.6 | 1.82 | 20.6 | 2.34 | 26.4 | 2.81 | 27.2 | 2.83 | 27.7 | 2.84 | 28.3 | 2.87 | 29.1 | 2.90 |
| | 7 | 16.6 | 1.85 | 20.6 | 2.39 | 26.4 | 2.86 | 27.2 | 2.88 | 27.7 | 2.90 | 28.0 | 2.92 | 28.7 | 2.95 |
| | 10 | 16.6 | 1.98 | 19.8 | 2.42 | 23.0 | 2.87 | 24.6 | 3.11 | 26.2 | 3.34 | 28.2 | 3.55 | 28.9 | 3.43 |
| | 12 | 16.6 | 2.03 | 19.8 | 2.47 | 23.0 | 2.93 | 24.6 | 3.17 | 26.2 | 3.41 | 27.9 | 3.53 | 28.5 | 3.41 |
| | 14 | 16.6 | 2.06 | 19.8 | 2.51 | 23.0 | 2.99 | 24.6 | 3.22 | 26.2 | 3.47 | 27.5 | 3.53 | 28.2 | 3.40 |
| | 16 | 16.6 | 2.10 | 19.8 | 2.56 | 23.0 | 3.04 | 24.6 | 3.29 | 26.2 | 3.54 | 27.2 | 3.55 | 27.8 | 3.59 |
| | 18 | 16.6 | 2.14 | 19.8 | 2.61 | 23.0 | 3.11 | 24.6 | 3.38 | 26.2 | 3.71 | 26.8 | 3.74 | 27.4 | 3.77 |
| | 20 | 16.6 | 2.18 | 19.8 | 2.66 | 23.0 | 3.29 | 24.6 | 3.63 | 25.8 | 3.89 | 26.5 | 3.92 | 27.0 | 3.95 |
| | 21 | 16.6 | 2.20 | 19.8 | 2.74 | 23.0 | 3.41 | 24.6 | 3.76 | 25.7 | 3.98 | 26.2 | 4.01 | 26.9 | 4.04 |
| | 23 | 16.6 | 2.31 | 19.8 | 2.94 | 23.0 | 3.65 | 24.6 | 4.04 | 25.3 | 4.16 | 25.9 | 4.20 | 26.5 | 4.23 |
| | 25 | 16.6 | 2.45 | 19.8 | 3.14 | 23.0 | 3.90 | 24.6 | 4.33 | 25.0 | 4.34 | 25.5 | 4.38 | 26.2 | 4.42 |
| | 27 | 16.6 | 2.62 | 19.8 | 3.36 | 23.0 | 4.18 | 24.2 | 4.51 | 24.6 | 4.52 | 25.2 | 4.56 | 25.8 | 4.61 |
| | 29 | 16.6 | 2.80 | 19.8 | 3.58 | 23.0 | 4.47 | 23.9 | 4.69 | 24.2 | 4.71 | 24.8 | 4.75 | 25.4 | 4.79 |
| | 31 | 16.6 | 2.98 | 19.8 | 3.82 | 23.0 | 4.77 | 23.5 | 4.87 | 23.8 | 4.89 | 24.5 | 4.94 | 25.0 | 4.98 |
| | 33 | 16.6 | 3.17 | 19.8 | 4.07 | 22.9 | 5.03 | 23.2 | 5.05 | 23.5 | 5.08 | 24.1 | 5.12 | 24.7 | 5.17 |
| | 35 | 16.6 | 3.37 | 19.8 | 4.34 | 22.6 | 5.21 | 22.8 | 5.24 | 23.1 | 5.26 | 23.7 | 5.31 | 24.3 | 5.36 |
| | 37 | 16.6 | 3.59 | 19.8 | 4.62 | 22.2 | 5.40 | 22.5 | 5.42 | 22.7 | 5.45 | 23.4 | 5.50 | 23.9 | 5.55 |
| | 39 | 16.6 | 3.81 | 19.8 | 4.92 | 21.8 | 5.58 | 22.1 | 5.61 | 22.4 | 5.64 | 23.0 | 5.69 | 23.6 | 5.75 |
| | 41 | 15.7 | 4.25 | 18.8 | 5.47 | 21.4 | 6.56 | 21.7 | 6.07 | 22.0 | 6.11 | 22.5 | 6.16 | 23.2 | 6.22 |
| | 44 | 14.6 | 4.62 | 17.9 | 5.94 | 20.4 | 7.29 | 20.7 | 6.86 | 21.1 | 6.58 | 21.7 | 6.48 | 22.4 | 6.54 |
| | 47 | 13.8 | 6.15 | 17.3 | 7.91 | 19.7 | 7.66 | 20.0 | 6.96 | 20.3 | 7.00 | 21.0 | 6.96 | 21.6 | 7.03 |
| | 50 | 12.6 | 6.04 | 15.5 | 7.77 | 17.6 | 8.07 | 17.9 | 8.06 | 18.1 | 7.69 | 18.7 | 7.55 | 19.5 | 7.40 |
| | 52 | 9.6 | 5.09 | 11.5 | 6.55 | 13.2 | 6.88 | 13.5 | 6.86 | 13.9 | 6.74 | 14.9 | 6.64 | 15.8 | 6.44 |

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100% | -5 | 15.1 | 1.58 | 18.7 | 2.03 | 24.5 | 2.53 | 26.7 | 2.79 | 27.2 | 2.81 | 27.7 | 2.83 | 28.4 | 2.86 |
| | 0 | 15.1 | 1.59 | 18.7 | 2.03 | 24.5 | 2.53 | 26.7 | 2.80 | 27.2 | 2.81 | 27.7 | 2.84 | 28.4 | 2.86 |
| | 4 | 15.1 | 1.59 | 18.7 | 2.04 | 24.5 | 2.54 | 26.7 | 2.81 | 27.2 | 2.82 | 27.7 | 2.85 | 28.4 | 2.87 |
| | 7 | 15.1 | 1.62 | 18.7 | 2.08 | 24.5 | 2.59 | 26.7 | 2.86 | 27.2 | 2.88 | 27.5 | 2.90 | 28.0 | 2.93 |
| | 10 | 15.1 | 1.79 | 18.0 | 2.18 | 21.0 | 2.58 | 22.4 | 2.78 | 23.8 | 3.01 | 26.8 | 3.40 | 28.3 | 3.54 |
| | 12 | 15.1 | 1.82 | 18.0 | 2.21 | 21.0 | 2.61 | 22.4 | 2.82 | 23.8 | 3.06 | 26.8 | 3.46 | 27.9 | 3.51 |
| | 14 | 15.1 | 1.85 | 18.0 | 2.25 | 21.0 | 2.66 | 22.4 | 2.87 | 23.8 | 3.12 | 26.8 | 3.52 | 27.6 | 3.48 |
| | 16 | 15.1 | 1.89 | 18.0 | 2.30 | 21.0 | 2.72 | 22.4 | 2.94 | 23.8 | 3.19 | 26.7 | 3.60 | 27.2 | 3.56 |
| | 18 | 15.1 | 1.93 | 18.0 | 2.35 | 21.0 | 2.77 | 22.4 | 2.99 | 23.8 | 3.25 | 26.3 | 3.67 | 26.9 | 3.73 |
| | 20 | 15.1 | 1.96 | 18.0 | 2.39 | 21.0 | 2.86 | 22.4 | 3.15 | 23.8 | 3.46 | 25.9 | 3.86 | 26.5 | 3.92 |
| | 21 | 15.1 | 1.98 | 18.0 | 2.41 | 21.0 | 2.96 | 22.4 | 3.26 | 23.8 | 3.58 | 25.8 | 4.00 | 26.3 | 4.03 |
| | 23 | 15.1 | 2.03 | 18.0 | 2.57 | 21.0 | 3.18 | 22.4 | 3.50 | 23.8 | 3.85 | 25.4 | 4.23 | 25.9 | 4.27 |
| | 25 | 15.1 | 2.16 | 18.0 | 2.74 | 21.0 | 3.39 | 22.4 | 3.73 | 23.8 | 4.12 | 25.0 | 4.38 | 25.6 | 4.42 |
| | 27 | 15.1 | 2.31 | 18.0 | 2.93 | 21.0 | 3.63 | 22.4 | 4.00 | 23.8 | 4.42 | 24.6 | 4.54 | 25.2 | 4.58 |
| | 29 | 15.1 | 2.45 | 18.0 | 3.13 | 21.0 | 3.88 | 22.4 | 4.28 | 23.8 | 4.68 | 24.3 | 4.75 | 24.9 | 4.80 |
| | 31 | 15.1 | 2.61 | 18.0 | 3.33 | 21.0 | 4.14 | 22.4 | 4.61 | 23.5 | 4.87 | 23.7 | 4.95 | 24.5 | 4.99 |
| | 33 | 15.1 | 2.77 | 18.0 | 3.54 | 21.0 | 4.42 | 22.4 | 4.88 | 23.0 | 5.04 | 23.6 | 5.09 | 24.1 | 5.14 |
| | 35 | 15.1 | 2.95 | 18.0 | 3.78 | 21.0 | 4.71 | 22.4 | 5.20 | 22.6 | 5.23 | 23.2 | 5.27 | 23.7 | 5.32 |
| | 37 | 15.1 | 3.14 | 18.0 | 4.02 | 21.0 | 5.01 | 22.0 | 5.39 | 22.4 | 5.42 | 22.8 | 5.45 | 23.4 | 5.50 |
| | 39 | 15.1 | 3.34 | 18.0 | 4.28 | 21.0 | 5.34 | 21.7 | 5.57 | 21.8 | 5.59 | 22.6 | 5.63 | 22.8 | 5.68 |
| | 41 | 14.3 | 3.72 | 17.1 | 4.76 | 19.9 | 5.93 | 21.3 | 6.03 | 21.5 | 6.06 | 22.1 | 6.12 | 22.6 | 6.17 |
| | 44 | 13.3 | 4.04 | 16.2 | 5.17 | 19.0 | 6.59 | 20.4 | 6.81 | 20.7 | 6.53 | 21.2 | 6.43 | 21.8 | 6.49 |
| | 47 | 12.5 | 5.38 | 15.7 | 6.88 | 18.3 | 6.92 | 19.7 | 6.92 | 19.9 | 6.95 | 20.5 | 6.91 | 21.1 | 6.97 |
| | 50 | 11.5 | 5.28 | 14.0 | 6.76 | 16.4 | 7.30 | 17.5 | 8.01 | 17.8 | 7.63 | 18.3 | 7.49 | 19.0 | 7.34 |
| | 52 | 8.7 | 4.45 | 10.4 | 5.70 | 12.3 | 6.21 | 13.2 | 6.81 | 13.6 | 6.69 | 14.6 | 6.59 | 15.4 | 6.39 |

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 13.6 | 1.38 | 16.8 | 1.75 | 22.0 | 2.16 | 24.0 | 2.39 | 25.7 | 2.62 | 27.1 | 2.81 | 27.7 | 2.83 |
| | 0 | 13.6 | 1.38 | 16.8 | 1.75 | 22.0 | 2.16 | 24.0 | 2.39 | 25.7 | 2.63 | 27.1 | 2.81 | 27.7 | 2.84 |
| | 4 | 13.6 | 1.39 | 16.8 | 1.76 | 22.0 | 2.17 | 24.0 | 2.40 | 25.7 | 2.64 | 27.1 | 2.82 | 27.7 | 2.85 |
| | 7 | 13.6 | 1.41 | 16.8 | 1.79 | 22.0 | 2.21 | 24.0 | 2.44 | 25.7 | 2.69 | 26.9 | 2.88 | 27.4 | 2.90 |
| | 10 | 13.6 | 1.57 | 16.2 | 1.88 | 18.9 | 2.20 | 20.2 | 2.48 | 21.5 | 2.64 | 24.1 | 3.03 | 26.7 | 3.43 |
| | 12 | 13.6 | 1.59 | 16.2 | 1.91 | 18.9 | 2.23 | 20.2 | 2.51 | 21.5 | 2.69 | 24.1 | 3.08 | 26.7 | 3.47 |
| | 14 | 13.6 | 1.61 | 16.2 | 1.94 | 18.9 | 2.27 | 20.2 | 2.55 | 21.5 | 2.74 | 24.1 | 3.13 | 26.7 | 3.53 |
| | 16 | 13.6 | 1.65 | 16.2 | 1.98 | 18.9 | 2.32 | 20.2 | 2.61 | 21.5 | 2.80 | 24.1 | 3.20 | 26.6 | 3.60 |
| | 18 | 13.6 | 1.69 | 16.2 | 2.03 | 18.9 | 2.37 | 20.2 | 2.66 | 21.5 | 2.85 | 24.1 | 3.28 | 26.4 | 3.73 |
| | 20 | 13.6 | 1.71 | 16.2 | 2.06 | 18.9 | 2.44 | 20.2 | 2.71 | 21.5 | 2.97 | 24.1 | 3.52 | 25.9 | 3.88 |
| | 21 | 13.6 | 1.73 | 16.2 | 2.08 | 18.9 | 2.53 | 20.2 | 2.80 | 21.5 | 3.08 | 24.1 | 3.64 | 25.8 | 3.97 |
| | 23 | 13.6 | 1.77 | 16.2 | 2.22 | 18.9 | 2.72 | 20.2 | 3.02 | 21.5 | 3.29 | 24.1 | 3.91 | 25.4 | 4.18 |
| | 25 | 13.6 | 1.89 | 16.2 | 2.36 | 18.9 | 2.89 | 20.2 | 3.22 | 21.5 | 3.52 | 24.1 | 4.18 | 25.0 | 4.35 |
| | 27 | 13.6 | 2.02 | 16.2 | 2.52 | 18.9 | 3.10 | 20.2 | 3.43 | 21.5 | 3.77 | 24.1 | 4.46 | 24.6 | 4.54 |
| | 29 | 13.6 | 2.14 | 16.2 | 2.70 | 18.9 | 3.32 | 20.2 | 3.67 | 21.5 | 4.02 | 23.8 | 4.68 | 24.3 | 4.72 |
| | 31 | 13.6 | 2.27 | 16.2 | 2.87 | 18.9 | 3.54 | 20.2 | 3.92 | 21.5 | 4.29 | 23.4 | 4.85 | 23.9 | 4.91 |
| | 33 | 13.6 | 2.42 | 16.2 | 3.06 | 18.9 | 3.77 | 20.2 | 4.17 | 21.5 | 4.57 | 23.1 | 5.05 | 23.6 | 5.09 |
| | 35 | 13.6 | 2.57 | 16.2 | 3.26 | 18.9 | 4.02 | 20.2 | 4.44 | 21.5 | 4.89 | 22.7 | 5.23 | 23.2 | 5.28 |
| | 37 | 13.6 | 2.74 | 16.2 | 3.47 | 18.9 | 4.28 | 19.8 | 4.60 | 21.5 | 5.23 | 22.3 | 5.42 | 22.9 | 5.40 |
| | 39 | 13.6 | 2.92 | 16.2 | 3.69 | 18.9 | 4.56 | 19.5 | 4.75 | 21.5 | 5.54 | 22.0 | 5.62 | 22.5 | 5.60 |
| | 41 | 12.9 | 3.24 | 15.4 | 4.10 | 17.9 | 5.07 | 19.2 | 5.15 | 20.4 | 5.67 | 21.6 | 6.06 | 22.1 | 6.12 |
| | 44 | 12.0 | 3.52 | 14.6 | 4.46 | 17.1 | 5.63 | 18.3 | 5.82 | 19.6 | 6.11 | 20.8 | 6.38 | 21.3 | 6.44 |
| | 47 | 11.3 | 4.69 | 14.1 | 5.94 | 16.5 | 5.91 | 17.7 | 5.91 | 18.9 | 6.50 | 20.1 | 6.85 | 20.6 | 6.91 |
| | 50 | 10.3 | 4.60 | 12.6 | 5.83 | 14.7 | 6.23 | 15.8 | 6.84 | 16.8 | 7.13 | 17.9 | 7.42 | 18.6 | 7.28 |
| | 52 | 7.8 | 3.88 | 9.4 | 4.92 | 11.0 | 5.31 | 11.9 | 5.82 | 12.9 | 6.25 | 14.3 | 6.54 | 15.1 | 6.33 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80% | -5 | 12.1 | 1.19 | 15.0 | 1.47 | 19.6 | 1.83 | 21.4 | 2.01 | 22.8 | 2.20 | 25.6 | 2.61 | 27.1 | 2.80 |
| | 0 | 12.1 | 1.20 | 15.0 | 1.47 | 19.6 | 1.83 | 21.4 | 2.02 | 22.8 | 2.21 | 25.6 | 2.62 | 27.1 | 2.80 |
| | 4 | 12.1 | 1.20 | 15.0 | 1.48 | 19.6 | 1.84 | 21.4 | 2.03 | 22.8 | 2.21 | 25.6 | 2.63 | 27.1 | 2.81 |
| | 7 | 12.1 | 1.22 | 15.0 | 1.51 | 19.6 | 1.87 | 21.4 | 2.06 | 22.8 | 2.25 | 25.4 | 2.68 | 26.7 | 2.87 |
| | 10 | 12.1 | 1.42 | 14.4 | 1.70 | 16.8 | 2.00 | 17.9 | 2.16 | 19.1 | 2.31 | 21.4 | 2.64 | 23.8 | 3.07 |
| | 12 | 12.1 | 1.44 | 14.4 | 1.73 | 16.8 | 2.04 | 17.9 | 2.20 | 19.1 | 2.36 | 21.4 | 2.69 | 23.8 | 3.04 |
| | 14 | 12.1 | 1.47 | 14.4 | 1.77 | 16.8 | 2.07 | 17.9 | 2.24 | 19.1 | 2.40 | 21.4 | 2.73 | 23.8 | 3.11 |
| | 16 | 12.1 | 1.49 | 14.4 | 1.79 | 16.8 | 2.12 | 17.9 | 2.28 | 19.1 | 2.44 | 21.4 | 2.79 | 23.8 | 3.22 |
| | 18 | 12.1 | 1.52 | 14.4 | 1.83 | 16.8 | 2.16 | 17.9 | 2.33 | 19.1 | 2.48 | 21.4 | 2.86 | 23.8 | 3.45 |
| | 20 | 12.1 | 1.55 | 14.4 | 1.86 | 16.8 | 2.20 | 17.9 | 2.37 | 19.1 | 2.54 | 21.4 | 2.96 | 23.8 | 3.57 |
| | 21 | 12.1 | 1.56 | 14.4 | 1.88 | 16.8 | 2.22 | 17.9 | 2.40 | 19.1 | 2.60 | 21.4 | 3.07 | 23.8 | 3.83 |
| | 23 | 12.1 | 1.59 | 14.4 | 1.92 | 16.8 | 2.33 | 17.9 | 2.55 | 19.1 | 2.78 | 21.4 | 3.28 | 23.8 | 4.09 |
| | 25 | 12.1 | 1.64 | 14.4 | 2.04 | 16.8 | 2.49 | 17.9 | 2.73 | 19.1 | 2.96 | 21.4 | 3.51 | 23.8 | 4.37 |
| | 27 | 12.1 | 1.75 | 14.4 | 2.17 | 16.8 | 2.65 | 17.9 | 2.91 | 19.1 | 3.18 | 21.4 | 3.75 | 23.8 | 4.52 |
| | 29 | 12.1 | 1.86 | 14.4 | 2.31 | 16.8 | 2.83 | 17.9 | 3.10 | 19.0 | 3.39 | 21.4 | 4.00 | 23.8 | 4.68 |
| | 31 | 12.1 | 1.97 | 14.4 | 2.46 | 16.8 | 3.01 | 17.9 | 3.30 | 19.0 | 3.61 | 21.4 | 4.27 | 23.4 | 4.85 |
| | 33 | 12.1 | 2.10 | 14.4 | 2.74 | 16.8 | 3.20 | 17.9 | 3.52 | 19.0 | 3.85 | 21.4 | 4.56 | 23.0 | 5.03 |
| | 35 | 12.1 | 2.22 | 14.4 | 2.74 | 16.8 | 3.41 | 17.9 | 3.75 | 19.0 | 4.10 | 21.4 | 4.87 | 22.6 | 5.21 |
| | 37 | 12.1 | 2.36 | 14.4 | 2.95 | 16.8 | 3.62 | 17.6 | 3.99 | 19.0 | 4.37 | 21.4 | 5.18 | 22.3 | 5.41 |
| | 39 | 12.1 | 2.50 | 14.4 | 3.13 | 16.8 | 3.86 | 17.4 | 4.25 | 19.0 | 4.65 | 21.4 | 5.52 | 21.9 | 5.61 |
| | 41 | 11.4 | 2.80 | 13.7 | 3.45 | 15.9 | 4.29 | 17.0 | 4.35 | 18.1 | 4.75 | 20.4 | 5.64 | 21.6 | 6.05 |
| | 44 | 10.6 | 3.04 | 13.0 | 3.76 | 15.2 | 4.77 | 16.3 | 4.91 | 17.4 | 5.12 | 19.6 | 5.94 | 20.8 | 6.36 |
| | 47 | 10.0 | 4.05 | 12.5 | 5.00 | 14.7 | 5.01 | 15.7 | 4.99 | 16.7 | 5.45 | 19.0 | 6.37 | 20.1 | 6.83 |
| | 50 | 9.2 | 3.98 | 11.2 | 4.91 | 13.1 | 5.28 | 14.0 | 5.78 | 14.9 | 5.98 | 16.9 | 6.91 | 18.1 | 7.19 |
| | 52 | 7.0 | 3.36 | 8.4 | 4.14 | 9.8 | 4.50 | 10.6 | 4.91 | 11.4 | 5.25 | 13.5 | 6.08 | 14.7 | 6.26 |

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70% | -5 | 10.6 | 1.02 | 13.1 | 1.26 | 17.1 | 1.52 | 18.7 | 1.67 | 20.0 | 1.82 | 22.4 | 2.15 | 24.9 | 2.50 |
| | 0 | 10.6 | 1.02 | 13.1 | 1.26 | 17.1 | 1.53 | 18.7 | 1.67 | 20.0 | 1.83 | 22.4 | 2.15 | 24.9 | 2.50 |
| | 4 | 10.6 | 1.02 | 13.1 | 1.26 | 17.1 | 1.53 | 18.7 | 1.68 | 20.0 | 1.83 | 22.4 | 2.16 | 24.9 | 2.51 |
| | 7 | 10.6 | 1.04 | 13.1 | 1.29 | 17.1 | 1.56 | 18.7 | 1.71 | 20.0 | 1.87 | 22.2 | 2.20 | 24.5 | 2.56 |
| | 10 | 10.6 | 1.25 | 12.6 | 1.49 | 14.7 | 1.73 | 15.7 | 1.86 | 16.7 | 2.00 | 18.8 | 2.27 | 20.8 | 2.55 |
| | 12 | 10.6 | 1.27 | 12.6 | 1.51 | 14.7 | 1.77 | 15.7 | 1.90 | 16.7 | 2.03 | 18.8 | 2.31 | 20.8 | 2.60 |
| | 14 | 10.6 | 1.29 | 12.6 | 1.54 | 14.7 | 1.79 | 15.7 | 1.93 | 16.7 | 2.07 | 18.8 | 2.36 | 20.8 | 2.65 |
| | 16 | 10.6 | 1.31 | 12.6 | 1.56 | 14.7 | 1.83 | 15.7 | 1.97 | 16.7 | 2.11 | 18.8 | 2.40 | 20.8 | 2.70 |
| | 18 | 10.6 | 1.33 | 12.6 | 1.59 | 14.7 | 1.86 | 15.7 | 2.00 | 16.7 | 2.15 | 18.8 | 2.45 | 20.8 | 2.75 |
| | 20 | 10.6 | 1.35 | 12.6 | 1.62 | 14.7 | 1.90 | 15.7 | 2.04 | 16.7 | 2.19 | 18.8 | 2.50 | 20.8 | 2.83 |
| | 21 | 10.6 | 1.37 | 12.6 | 1.63 | 14.7 | 1.91 | 15.7 | 2.06 | 16.7 | 2.21 | 18.8 | 2.52 | 20.8 | 2.93 |
| | 23 | 10.6 | 1.39 | 12.6 | 1.66 | 14.7 | 1.96 | 15.7 | 2.13 | 16.7 | 2.32 | 18.8 | 2.71 | 20.8 | 3.14 |
| | 25 | 10.6 | 1.42 | 12.6 | 1.73 | 14.7 | 2.08 | 15.7 | 2.28 | 16.7 | 2.47 | 18.8 | 2.90 | 20.8 | 3.36 |
| | 27 | 10.6 | 1.50 | 12.6 | 1.84 | 14.7 | 2.22 | 15.7 | 2.43 | 16.7 | 2.64 | 18.8 | 3.10 | 20.8 | 3.59 |
| | 29 | 10.6 | 1.59 | 12.6 | 1.96 | 14.7 | 2.36 | 15.7 | 2.59 | 16.7 | 2.81 | 18.8 | 3.30 | 20.8 | 3.83 |
| | 31 | 10.6 | 1.68 | 12.6 | 2.07 | 14.7 | 2.52 | 15.7 | 2.75 | 16.7 | 2.99 | 18.8 | 3.52 | 20.8 | 4.09 |
| | 33 | 10.6 | 1.79 | 12.6 | 2.21 | 14.7 | 2.68 | 15.7 | 2.92 | 16.7 | 3.19 | 18.8 | 3.75 | 20.8 | 4.36 |
| | 35 | 10.6 | 1.89 | 12.6 | 2.34 | 14.7 | 2.84 | 15.7 | 3.11 | 16.7 | 3.39 | 18.8 | 4.00 | 20.8 | 4.65 |
| | 37 | 10.6 | 2.00 | 12.6 | 2.48 | 14.7 | 3.02 | 15.4 | 3.31 | 16.7 | 3.61 | 18.8 | 4.26 | 20.8 | 4.95 |
| | 39 | 10.6 | 2.12 | 12.6 | 2.63 | 14.7 | 3.20 | 15.2 | 3.51 | 16.7 | 3.83 | 18.8 | 4.52 | 20.8 | 5.27 |
| | 41 | 10.0 | 2.38 | 12.0 | 2.95 | 13.9 | 3.58 | 14.9 | 3.61 | 15.9 | 3.94 | 17.9 | 4.64 | 19.8 | 5.39 |
| | 44 | 9.3 | 2.59 | 11.3 | 3.21 | 13.3 | 3.97 | 14.3 | 4.08 | 15.2 | 4.24 | 17.2 | 4.87 | 19.1 | 5.67 |
| | 47 | 8.8 | 3.45 | 11.0 | 4.27 | 12.8 | 4.17 | 13.8 | 4.14 | 14.7 | 4.51 | 16.6 | 5.23 | 18.5 | 6.09 |
| | 50 | 8.0 | 3.39 | 9.8 | 4.19 | 11.5 | 4.40 | 12.3 | 4.79 | 13.1 | 4.95 | 14.8 | 5.67 | 16.6 | 6.41 |
| | 52 | 6.1 | 2.86 | 7.3 | 3.54 | 8.6 | 3.75 | 9.3 | 4.08 | 10.0 | 4.34 | 11.8 | 4.99 | 13.5 | 5.58 |

Technical Sales Guide

| Combination | Outdoor air temp (°C DB) | Indoor air temp | | | | | | | | | | | | | |
|-------------|--------------------------|-----------------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|-----------|------|
| | | 14.0°C WB | | 16.0°C WB | | 18.0°C WB | | 19.0°C WB | | 20.0°C WB | | 22.0°C WB | | 24.0°C WB | |
| | | 20.0°C DB | | 23.0°C DB | | 26.0°C DB | | 27.0°C DB | | 28.0°C DB | | 30.0°C DB | | 32.0°C DB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60% | -5 | 9.1 | 0.85 | 11.2 | 1.04 | 14.7 | 1.25 | 16.0 | 1.36 | 17.2 | 1.48 | 19.2 | 1.73 | 21.3 | 2.00 |
| | 0 | 9.1 | 0.86 | 11.2 | 1.04 | 14.7 | 1.25 | 16.0 | 1.37 | 17.2 | 1.48 | 19.2 | 1.73 | 21.3 | 2.00 |
| | 4 | 9.1 | 0.86 | 11.2 | 1.05 | 14.7 | 1.26 | 16.0 | 1.37 | 17.2 | 1.49 | 19.2 | 1.74 | 21.3 | 2.01 |
| | 7 | 9.1 | 0.88 | 11.2 | 1.07 | 14.7 | 1.28 | 16.0 | 1.40 | 17.2 | 1.52 | 19.0 | 1.77 | 21.0 | 2.04 |
| | 10 | 9.1 | 1.09 | 10.8 | 1.28 | 12.6 | 1.48 | 13.4 | 1.58 | 14.3 | 1.69 | 16.1 | 1.91 | 17.8 | 2.15 |
| | 12 | 9.1 | 1.11 | 10.8 | 1.30 | 12.6 | 1.51 | 13.4 | 1.61 | 14.3 | 1.72 | 16.1 | 1.95 | 17.8 | 2.18 |
| | 14 | 9.1 | 1.12 | 10.8 | 1.32 | 12.6 | 1.53 | 13.4 | 1.64 | 14.3 | 1.75 | 16.1 | 1.98 | 17.8 | 2.22 |
| | 16 | 9.1 | 1.14 | 10.8 | 1.34 | 12.6 | 1.56 | 13.4 | 1.67 | 14.3 | 1.78 | 16.1 | 2.02 | 17.8 | 2.26 |
| | 18 | 9.1 | 1.16 | 10.8 | 1.36 | 12.6 | 1.58 | 13.4 | 1.70 | 14.3 | 1.82 | 16.1 | 2.05 | 17.8 | 2.31 |
| | 20 | 9.1 | 1.17 | 10.8 | 1.39 | 12.6 | 1.61 | 13.4 | 1.73 | 14.3 | 1.85 | 16.1 | 2.10 | 17.8 | 2.36 |
| | 21 | 9.1 | 1.18 | 10.8 | 1.39 | 12.6 | 1.63 | 13.4 | 1.75 | 14.3 | 1.86 | 16.1 | 2.12 | 17.8 | 2.38 |
| | 23 | 9.1 | 1.20 | 10.8 | 1.42 | 12.6 | 1.65 | 13.4 | 1.78 | 14.3 | 1.90 | 16.1 | 2.20 | 17.8 | 2.53 |
| | 25 | 9.1 | 1.22 | 10.8 | 1.45 | 12.6 | 1.72 | 13.4 | 1.86 | 14.3 | 2.02 | 16.1 | 2.35 | 17.8 | 2.70 |
| | 27 | 9.1 | 1.27 | 10.8 | 1.54 | 12.6 | 1.83 | 13.4 | 1.99 | 14.3 | 2.15 | 16.1 | 2.50 | 17.8 | 2.88 |
| | 29 | 9.1 | 1.34 | 10.8 | 1.63 | 12.6 | 1.95 | 13.4 | 2.12 | 14.3 | 2.29 | 16.1 | 2.67 | 17.8 | 3.08 |
| | 31 | 9.1 | 1.42 | 10.8 | 1.73 | 12.6 | 2.07 | 13.4 | 2.25 | 14.3 | 2.44 | 16.1 | 2.84 | 17.8 | 3.27 |
| | 33 | 9.1 | 1.50 | 10.8 | 1.83 | 12.6 | 2.19 | 13.4 | 2.39 | 14.3 | 2.59 | 16.1 | 3.02 | 17.8 | 3.49 |
| | 35 | 9.1 | 1.59 | 10.8 | 1.94 | 12.6 | 2.33 | 13.4 | 2.54 | 14.3 | 2.75 | 16.1 | 3.22 | 17.8 | 3.72 |
| | 37 | 9.1 | 1.68 | 10.8 | 2.05 | 12.6 | 2.47 | 13.2 | 2.69 | 14.3 | 2.92 | 16.1 | 3.42 | 17.8 | 3.95 |
| | 39 | 9.1 | 1.77 | 10.8 | 2.17 | 12.6 | 2.61 | 13.0 | 2.85 | 14.3 | 3.11 | 16.1 | 3.63 | 17.8 | 4.21 |
| | 41 | 8.6 | 2.01 | 10.3 | 2.45 | 11.9 | 2.93 | 12.8 | 2.94 | 13.6 | 3.20 | 15.3 | 3.73 | 17.0 | 4.31 |
| | 44 | 8.0 | 2.18 | 9.7 | 2.66 | 11.4 | 3.26 | 12.2 | 3.32 | 13.1 | 3.44 | 14.7 | 3.93 | 16.4 | 4.53 |
| | 47 | 7.5 | 2.90 | 9.4 | 3.54 | 11.0 | 3.42 | 11.8 | 3.38 | 12.6 | 3.66 | 14.2 | 4.22 | 15.9 | 4.87 |
| | 50 | 6.9 | 2.85 | 8.4 | 3.48 | 9.8 | 3.61 | 10.5 | 3.91 | 11.2 | 4.02 | 12.7 | 4.57 | 14.3 | 5.13 |
| | 52 | 5.2 | 2.40 | 6.3 | 2.93 | 7.4 | 3.07 | 7.9 | 3.32 | 8.6 | 3.53 | 10.1 | 4.02 | 11.6 | 4.46 |

CHV5 DC Inverter VRF Units Technical Sales Guide

CHV-5S280NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 135% | -5 | 20.6 | 3.10 | 25.3 | 3.77 | 30.0 | 3.82 | 31.3 | 3.84 | 31.7 | 3.86 | 32.6 | 3.90 | 33.5 | 3.94 |
| | 0 | 21.6 | 3.10 | 26.3 | 3.78 | 31.0 | 3.82 | 32.3 | 3.84 | 32.7 | 3.86 | 33.6 | 3.91 | 34.5 | 3.95 |
| | 4 | 22.6 | 3.11 | 27.3 | 3.79 | 32.0 | 3.84 | 33.3 | 3.86 | 33.7 | 3.88 | 34.6 | 3.93 | 35.5 | 3.97 |
| | 7 | 23.6 | 3.17 | 28.3 | 3.86 | 33.0 | 3.91 | 34.3 | 3.93 | 34.7 | 3.95 | 35.6 | 4.00 | 36.5 | 4.04 |
| | 10 | 24.6 | 3.23 | 29.3 | 3.95 | 34.0 | 4.69 | 35.3 | 4.80 | 35.7 | 4.70 | 36.6 | 4.50 | 37.5 | 4.30 |
| | 12 | 24.6 | 3.29 | 29.3 | 4.02 | 34.0 | 4.79 | 34.8 | 4.77 | 35.3 | 4.67 | 36.1 | 4.47 | 37.0 | 4.40 |
| | 14 | 24.6 | 3.35 | 29.3 | 4.10 | 33.9 | 4.84 | 34.4 | 4.75 | 34.8 | 4.64 | 35.7 | 4.61 | 36.6 | 4.65 |
| | 16 | 24.6 | 3.41 | 29.3 | 4.18 | 33.5 | 4.82 | 33.9 | 4.79 | 34.3 | 4.80 | 35.2 | 4.85 | 36.1 | 4.90 |
| | 18 | 24.6 | 3.47 | 29.3 | 4.27 | 33.0 | 5.00 | 33.4 | 5.03 | 33.9 | 5.06 | 34.8 | 5.11 | 35.7 | 5.15 |
| | 20 | 24.6 | 3.55 | 29.3 | 4.54 | 32.5 | 5.25 | 33.0 | 5.28 | 33.4 | 5.31 | 34.3 | 5.35 | 35.2 | 5.41 |
| | 21 | 24.6 | 3.64 | 29.3 | 4.70 | 32.3 | 5.37 | 32.8 | 5.40 | 33.2 | 5.43 | 34.1 | 5.48 | 35.0 | 5.53 |
| | 23 | 24.6 | 3.91 | 29.3 | 5.04 | 31.9 | 5.62 | 32.3 | 5.65 | 32.7 | 5.67 | 33.6 | 5.73 | 34.5 | 5.79 |
| | 25 | 24.6 | 4.17 | 29.3 | 5.40 | 31.4 | 5.86 | 31.9 | 5.89 | 32.3 | 5.93 | 33.2 | 5.98 | 34.1 | 6.04 |
| | 27 | 24.6 | 4.46 | 29.3 | 5.78 | 31.0 | 5.16 | 31.4 | 6.15 | 31.8 | 6.17 | 32.7 | 6.24 | 33.6 | 6.31 |
| | 29 | 24.6 | 4.76 | 29.3 | 6.17 | 30.5 | 6.35 | 30.9 | 6.39 | 31.4 | 6.43 | 32.3 | 6.49 | 33.2 | 6.56 |
| | 31 | 24.6 | 5.08 | 29.2 | 6.53 | 30.0 | 6.61 | 30.5 | 6.65 | 30.9 | 6.67 | 31.8 | 6.75 | 32.7 | 6.83 |
| | 33 | 24.6 | 5.41 | 28.7 | 6.78 | 29.6 | 6.84 | 30.0 | 6.89 | 30.5 | 6.93 | 31.4 | 7.00 | 32.2 | 7.09 |
| | 35 | 24.6 | 5.77 | 28.2 | 7.02 | 29.1 | 7.11 | 29.6 | 7.15 | 30.0 | 7.18 | 30.9 | 7.27 | 31.8 | 7.34 |
| | 37 | 24.6 | 6.14 | 27.8 | 7.28 | 28.7 | 7.36 | 29.1 | 7.40 | 29.6 | 7.45 | 30.4 | 7.53 | 31.3 | 7.62 |
| | 39 | 24.6 | 6.53 | 27.3 | 7.52 | 28.2 | 7.61 | 28.7 | 7.66 | 29.1 | 7.70 | 30.0 | 7.79 | 30.9 | 7.88 |
| | 41 | 25.6 | 7.27 | 28.3 | 8.85 | 29.2 | 8.96 | 29.7 | 8.29 | 30.1 | 8.33 | 31.0 | 8.43 | 31.9 | 8.52 |
| | 44 | 26.6 | 7.90 | 29.3 | 9.62 | 30.2 | 9.95 | 30.7 | 9.36 | 31.1 | 8.98 | 32.0 | 8.87 | 32.9 | 8.96 |
| | 47 | 27.6 | 10.51 | 30.3 | 12.80 | 31.2 | 10.45 | 31.7 | 9.50 | 32.1 | 9.55 | 33.0 | 9.52 | 33.9 | 9.62 |
| | 50 | 28.6 | 10.32 | 31.3 | 12.57 | 32.2 | 11.02 | 32.7 | 11.00 | 33.1 | 10.49 | 34.0 | 10.32 | 34.9 | 10.14 |
| | 52 | 29.6 | 8.71 | 32.3 | 10.61 | 33.2 | 9.38 | 33.7 | 9.36 | 34.1 | 9.20 | 35.0 | 9.09 | 35.9 | 8.81 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120% | -5 | 30.6 | 2.76 | 33.3 | 3.57 | 34.2 | 3.79 | 34.7 | 3.81 | 35.1 | 3.83 | 36.0 | 3.87 | 36.9 | 3.91 |
| | 0 | 31.6 | 2.76 | 34.3 | 3.58 | 35.2 | 3.80 | 35.7 | 3.82 | 36.1 | 3.84 | 37.0 | 3.88 | 37.9 | 3.92 |
| | 4 | 32.6 | 2.77 | 35.3 | 3.59 | 36.2 | 3.81 | 36.7 | 3.83 | 37.1 | 3.85 | 38.0 | 3.89 | 38.9 | 3.94 |
| | 7 | 33.6 | 2.82 | 36.3 | 3.66 | 37.2 | 3.88 | 37.7 | 3.90 | 38.1 | 3.93 | 39.0 | 3.97 | 39.9 | 4.01 |
| | 10 | 22.7 | 2.95 | 27.0 | 3.60 | 31.4 | 4.28 | 33.6 | 4.63 | 35.2 | 4.82 | 36.0 | 4.64 | 36.8 | 4.46 |
| | 12 | 22.7 | 3.00 | 27.0 | 3.66 | 31.4 | 4.36 | 33.6 | 4.71 | 34.7 | 4.80 | 35.5 | 4.62 | 36.3 | 4.43 |
| | 14 | 22.7 | 3.06 | 27.0 | 3.74 | 31.4 | 4.45 | 33.6 | 4.80 | 34.2 | 4.77 | 35.1 | 4.59 | 35.9 | 4.62 |
| | 16 | 22.7 | 3.12 | 27.0 | 3.81 | 31.4 | 4.53 | 33.4 | 4.84 | 33.8 | 4.78 | 34.6 | 4.82 | 35.4 | 4.86 |
| | 18 | 22.7 | 3.17 | 27.0 | 3.89 | 31.4 | 4.69 | 32.9 | 5.00 | 33.3 | 5.02 | 34.1 | 5.07 | 35.0 | 5.12 |
| | 20 | 22.7 | 3.24 | 27.0 | 4.04 | 31.4 | 5.04 | 32.5 | 5.25 | 32.9 | 5.27 | 33.7 | 5.31 | 34.5 | 5.36 |
| | 21 | 22.7 | 3.27 | 27.0 | 4.18 | 31.4 | 5.22 | 32.2 | 5.37 | 32.6 | 5.39 | 33.5 | 5.44 | 34.3 | 5.49 |
| | 23 | 22.7 | 3.49 | 27.0 | 4.48 | 31.4 | 5.59 | 31.8 | 5.61 | 32.2 | 5.64 | 33.0 | 5.69 | 33.8 | 5.74 |
| | 25 | 22.7 | 3.73 | 27.0 | 4.80 | 30.9 | 5.83 | 31.3 | 5.85 | 31.7 | 5.88 | 32.6 | 5.94 | 33.4 | 5.99 |
| | 27 | 22.7 | 3.98 | 27.0 | 5.13 | 30.5 | 6.07 | 30.9 | 6.11 | 31.3 | 6.14 | 32.1 | 6.19 | 32.9 | 6.25 |
| | 29 | 22.7 | 4.25 | 27.0 | 5.48 | 30.0 | 6.32 | 30.4 | 6.35 | 30.8 | 6.38 | 31.6 | 6.45 | 32.5 | 6.50 |
| | 31 | 22.7 | 4.53 | 27.0 | 5.84 | 29.6 | 6.57 | 30.0 | 6.60 | 30.4 | 6.64 | 31.2 | 6.70 | 32.0 | 6.77 |
| | 33 | 22.7 | 4.82 | 27.0 | 6.24 | 29.1 | 6.82 | 29.5 | 6.85 | 29.9 | 6.88 | 30.7 | 6.96 | 31.5 | 7.02 |
| | 35 | 22.7 | 5.14 | 27.0 | 6.65 | 28.6 | 7.06 | 29.0 | 7.10 | 29.5 | 7.14 | 30.3 | 7.21 | 31.1 | 7.29 |
| | 37 | 22.7 | 5.47 | 27.0 | 7.08 | 28.2 | 7.32 | 28.6 | 7.35 | 29.0 | 7.39 | 29.8 | 7.47 | 30.6 | 7.55 |
| | 39 | 22.7 | 5.82 | 26.9 | 7.48 | 27.7 | 7.56 | 28.1 | 7.61 | 28.5 | 7.65 | 29.4 | 7.73 | 30.2 | 7.81 |
| | 41 | 23.7 | 6.47 | 27.9 | 8.37 | 28.7 | 8.90 | 29.1 | 8.23 | 29.5 | 8.28 | 30.4 | 8.37 | 31.2 | 8.45 |
| | 44 | 24.7 | 7.04 | 28.9 | 9.10 | 29.7 | 9.89 | 30.1 | 9.30 | 30.5 | 8.92 | 31.4 | 8.80 | 32.2 | 8.89 |
| | 47 | 25.7 | 9.36 | 29.9 | 12.12 | 30.7 | 10.38 | 31.1 | 9.44 | 31.5 | 9.49 | 32.4 | 9.45 | 33.2 | 9.55 |
| | 50 | 26.7 | 9.19 | 30.9 | 11.90 | 31.7 | 10.94 | 32.1 | 10.93 | 32.5 | 10.42 | 33.4 | 10.24 | 34.2 | 10.06 |
| | 52 | 27.7 | 7.75 | 31.9 | 10.04 | 32.7 | 9.32 | 33.1 | 9.30 | 33.5 | 9.13 | 34.4 | 9.02 | 35.2 | 8.75 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110% | -5 | 28.7 | 2.44 | 32.9 | 3.14 | 33.7 | 3.77 | 34.1 | 3.79 | 34.5 | 3.81 | 35.4 | 3.84 | 36.2 | 3.88 |
| | 0 | 29.7 | 2.44 | 33.9 | 3.14 | 34.7 | 3.77 | 35.1 | 3.79 | 35.5 | 3.81 | 36.4 | 3.85 | 37.2 | 3.89 |
| | 4 | 30.7 | 2.45 | 34.9 | 3.16 | 35.7 | 3.79 | 36.1 | 3.81 | 36.5 | 3.83 | 37.4 | 3.86 | 38.2 | 3.90 |
| | 7 | 31.7 | 2.50 | 35.9 | 3.21 | 36.7 | 3.86 | 37.1 | 3.88 | 37.5 | 3.90 | 38.4 | 3.94 | 39.2 | 3.97 |
| | 10 | 20.8 | 2.67 | 24.8 | 3.26 | 28.8 | 3.87 | 30.8 | 4.18 | 32.8 | 4.50 | 35.3 | 4.78 | 36.1 | 4.62 |
| | 12 | 20.8 | 2.73 | 24.8 | 3.32 | 28.8 | 3.95 | 30.8 | 4.27 | 32.8 | 4.59 | 34.9 | 4.76 | 35.6 | 4.59 |
| | 14 | 20.8 | 2.78 | 24.8 | 3.38 | 28.8 | 4.02 | 30.8 | 4.34 | 32.8 | 4.67 | 34.4 | 4.76 | 35.2 | 4.58 |
| | 16 | 20.8 | 2.82 | 24.8 | 3.45 | 28.8 | 4.10 | 30.8 | 4.43 | 32.8 | 4.77 | 34.0 | 4.79 | 34.7 | 4.83 |
| | 18 | 20.8 | 2.88 | 24.8 | 3.51 | 28.8 | 4.18 | 30.8 | 4.55 | 32.8 | 4.99 | 33.5 | 5.03 | 34.3 | 5.08 |
| | 20 | 20.8 | 2.94 | 24.8 | 3.59 | 28.8 | 4.43 | 30.8 | 4.89 | 32.3 | 5.24 | 33.1 | 5.28 | 33.8 | 5.32 |
| | 21 | 20.8 | 2.96 | 24.8 | 3.69 | 28.8 | 4.59 | 30.8 | 5.07 | 32.1 | 5.36 | 32.8 | 5.40 | 33.6 | 5.45 |
| | 23 | 20.8 | 3.11 | 24.8 | 3.96 | 28.8 | 4.92 | 30.8 | 5.44 | 31.6 | 5.60 | 32.4 | 5.65 | 33.1 | 5.70 |
| | 25 | 20.8 | 3.30 | 24.8 | 4.23 | 28.8 | 5.26 | 30.8 | 5.82 | 31.2 | 5.84 | 31.9 | 5.90 | 32.7 | 5.95 |
| | 27 | 20.8 | 3.53 | 24.8 | 4.52 | 28.8 | 5.63 | 30.3 | 6.07 | 30.7 | 6.09 | 31.5 | 6.15 | 32.2 | 6.20 |
| | 29 | 20.8 | 3.77 | 24.8 | 4.82 | 28.8 | 6.01 | 29.9 | 6.32 | 30.3 | 6.34 | 31.0 | 6.40 | 31.8 | 6.46 |
| | 31 | 20.8 | 4.01 | 24.8 | 5.14 | 28.8 | 6.42 | 29.4 | 6.56 | 29.8 | 6.59 | 30.6 | 6.65 | 31.3 | 6.71 |
| | 33 | 20.8 | 4.27 | 24.8 | 5.48 | 28.6 | 6.77 | 29.0 | 6.81 | 29.4 | 6.83 | 30.1 | 6.90 | 30.9 | 6.97 |
| | 35 | 20.8 | 4.54 | 24.8 | 5.84 | 28.2 | 7.01 | 28.5 | 7.05 | 28.9 | 7.09 | 29.6 | 7.16 | 30.4 | 7.22 |
| | 37 | 20.8 | 4.83 | 24.8 | 6.22 | 27.7 | 7.27 | 28.1 | 7.30 | 28.4 | 7.33 | 29.2 | 7.41 | 29.9 | 7.48 |
| | 39 | 20.8 | 5.14 | 24.8 | 6.63 | 27.2 | 7.51 | 27.6 | 7.55 | 28.0 | 7.59 | 28.7 | 7.67 | 29.5 | 7.74 |
| | 41 | 21.8 | 5.72 | 25.8 | 7.36 | 28.2 | 8.84 | 28.6 | 8.18 | 29.0 | 8.22 | 29.7 | 8.30 | 30.5 | 8.38 |
| | 44 | 22.8 | 6.22 | 26.8 | 8.01 | 29.2 | 9.82 | 29.6 | 9.24 | 30.0 | 8.86 | 30.7 | 8.73 | 31.5 | 8.81 |
| | 47 | 23.8 | 8.28 | 27.8 | 10.65 | 30.2 | 10.31 | 30.6 | 9.38 | 31.0 | 9.43 | 31.7 | 9.37 | 32.5 | 9.46 |
| | 50 | 24.8 | 8.13 | 28.8 | 10.46 | 31.2 | 10.87 | 31.6 | 10.86 | 32.0 | 10.35 | 32.7 | 10.16 | 33.5 | 9.97 |
| | 52 | 25.8 | 6.86 | 29.8 | 8.82 | 32.2 | 9.26 | 32.6 | 9.24 | 33.0 | 9.07 | 33.7 | 8.94 | 34.5 | 8.67 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|-------|----------|-------|----------|-------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100% | -5 | 26.8 | 2.13 | 30.8 | 2.73 | 33.2 | 3.40 | 33.6 | 3.76 | 34.0 | 3.78 | 34.7 | 3.81 | 35.5 | 3.85 |
| | 0 | 27.8 | 2.14 | 31.8 | 2.74 | 34.2 | 3.41 | 34.6 | 3.77 | 35.0 | 3.79 | 35.7 | 3.82 | 36.5 | 3.86 |
| | 4 | 28.8 | 2.14 | 32.8 | 2.75 | 35.2 | 3.42 | 35.6 | 3.78 | 36.0 | 3.80 | 36.7 | 3.84 | 37.5 | 3.87 |
| | 7 | 29.8 | 2.18 | 33.8 | 2.80 | 36.2 | 3.49 | 36.6 | 3.85 | 37.0 | 3.87 | 37.7 | 3.91 | 38.5 | 3.94 |
| | 10 | 18.9 | 2.42 | 22.5 | 2.94 | 26.2 | 3.47 | 28.0 | 3.75 | 29.8 | 4.05 | 33.5 | 4.58 | 35.4 | 4.76 |
| | 12 | 18.9 | 2.45 | 22.5 | 2.97 | 26.2 | 3.52 | 28.0 | 3.80 | 29.8 | 4.13 | 33.5 | 4.66 | 34.9 | 4.72 |
| | 14 | 18.9 | 2.49 | 22.5 | 3.03 | 26.2 | 3.58 | 28.0 | 3.87 | 29.8 | 4.20 | 33.5 | 4.74 | 34.5 | 4.69 |
| | 16 | 18.9 | 2.55 | 22.5 | 3.09 | 26.2 | 3.66 | 28.0 | 3.96 | 29.8 | 4.30 | 33.4 | 4.85 | 34.0 | 4.79 |
| | 18 | 18.9 | 2.60 | 22.5 | 3.16 | 26.2 | 3.73 | 28.0 | 4.03 | 29.8 | 4.38 | 32.9 | 4.94 | 33.6 | 5.02 |
| | 20 | 18.9 | 2.64 | 22.5 | 3.21 | 26.2 | 3.85 | 28.0 | 4.24 | 29.8 | 4.66 | 32.4 | 5.20 | 33.1 | 5.28 |
| | 21 | 18.9 | 2.67 | 22.5 | 3.24 | 26.2 | 3.99 | 28.0 | 4.39 | 29.8 | 4.82 | 32.2 | 5.38 | 32.9 | 5.43 |
| | 23 | 18.9 | 2.74 | 22.5 | 3.47 | 26.2 | 4.29 | 28.0 | 4.72 | 29.8 | 5.18 | 31.8 | 5.69 | 32.4 | 5.75 |
| | 25 | 18.9 | 2.91 | 22.5 | 3.69 | 26.2 | 4.56 | 28.0 | 5.02 | 29.8 | 5.54 | 31.3 | 5.90 | 32.0 | 5.95 |
| | 27 | 18.9 | 3.11 | 22.5 | 3.94 | 26.2 | 4.89 | 28.0 | 5.39 | 29.8 | 5.95 | 30.8 | 6.11 | 31.5 | 6.16 |
| | 29 | 18.9 | 3.30 | 22.5 | 4.21 | 26.2 | 5.23 | 28.0 | 5.76 | 29.7 | 6.30 | 30.4 | 6.40 | 31.1 | 6.46 |
| | 31 | 18.9 | 3.51 | 22.5 | 4.48 | 26.2 | 5.58 | 28.0 | 6.21 | 29.3 | 6.56 | 29.7 | 6.66 | 30.6 | 6.72 |
| | 33 | 18.9 | 3.73 | 22.5 | 4.77 | 26.2 | 5.95 | 28.0 | 6.57 | 28.8 | 6.79 | 29.5 | 6.85 | 30.2 | 6.92 |
| | 35 | 18.9 | 3.97 | 22.5 | 5.08 | 26.2 | 6.34 | 28.0 | 7.00 | 28.3 | 7.04 | 29.0 | 7.10 | 29.7 | 7.17 |
| | 37 | 18.9 | 4.23 | 22.5 | 5.41 | 26.2 | 6.75 | 27.5 | 7.26 | 27.9 | 7.29 | 28.6 | 7.34 | 29.3 | 7.41 |
| | 39 | 18.9 | 4.50 | 22.5 | 5.77 | 26.2 | 7.19 | 27.1 | 7.50 | 27.3 | 7.53 | 28.2 | 7.59 | 28.6 | 7.65 |
| | 41 | 18.9 | 5.00 | 22.5 | 6.41 | 26.2 | 7.99 | 26.6 | 8.13 | 26.8 | 8.17 | 27.7 | 8.24 | 28.0 | 8.31 |
| | 44 | 18.9 | 5.44 | 22.5 | 6.96 | 26.2 | 8.87 | 26.3 | 9.18 | 26.4 | 8.80 | 27.3 | 8.67 | 27.7 | 8.74 |
| | 47 | 18.9 | 7.24 | 22.5 | 9.27 | 26.2 | 9.32 | 25.8 | 9.32 | 25.9 | 9.36 | 26.8 | 9.30 | 27.2 | 9.39 |
| | 50 | 18.9 | 7.11 | 22.5 | 9.10 | 26.2 | 9.83 | 25.5 | 10.79 | 25.6 | 10.28 | 26.5 | 10.09 | 26.8 | 9.89 |
| | 52 | 18.9 | 6.00 | 22.5 | 7.68 | 26.2 | 8.37 | 25.0 | 9.18 | 25.1 | 9.01 | 26.0 | 8.88 | 26.3 | 8.60 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|-------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 18.9 | 1.86 | 22.5 | 2.35 | 26.2 | 2.91 | 24.7 | 3.21 | 24.8 | 3.53 | 25.6 | 3.78 | 26.0 | 3.81 |
| | 0 | 18.9 | 1.86 | 22.5 | 2.36 | 26.2 | 2.91 | 24.2 | 3.22 | 24.4 | 3.54 | 25.2 | 3.79 | 25.5 | 3.82 |
| | 4 | 18.9 | 1.87 | 22.5 | 2.37 | 26.2 | 2.92 | 23.9 | 3.23 | 24.0 | 3.55 | 24.8 | 3.80 | 25.2 | 3.84 |
| | 7 | 18.9 | 1.91 | 22.5 | 2.41 | 26.2 | 2.98 | 23.5 | 3.29 | 23.6 | 3.62 | 24.4 | 3.87 | 24.7 | 3.91 |
| | 10 | 17.0 | 2.11 | 20.2 | 2.53 | 23.6 | 2.97 | 25.2 | 3.34 | 26.8 | 3.56 | 30.1 | 4.08 | 33.4 | 4.62 |
| | 12 | 17.0 | 2.14 | 20.2 | 2.57 | 23.6 | 3.00 | 25.2 | 3.38 | 26.8 | 3.63 | 30.1 | 4.15 | 33.4 | 4.68 |
| | 14 | 17.0 | 2.17 | 20.2 | 2.61 | 23.6 | 3.06 | 25.2 | 3.44 | 26.8 | 3.69 | 30.1 | 4.22 | 33.4 | 4.75 |
| | 16 | 17.0 | 2.22 | 20.2 | 2.67 | 23.6 | 3.13 | 25.2 | 3.51 | 26.8 | 3.77 | 30.1 | 4.31 | 33.3 | 4.85 |
| | 18 | 17.0 | 2.27 | 20.2 | 2.73 | 23.6 | 3.19 | 25.2 | 3.58 | 26.8 | 3.84 | 30.1 | 4.41 | 33.0 | 5.02 |
| | 20 | 17.0 | 2.31 | 20.2 | 2.77 | 23.6 | 3.29 | 25.2 | 3.65 | 26.8 | 4.00 | 30.1 | 4.74 | 32.4 | 5.23 |
| | 21 | 17.0 | 2.33 | 20.2 | 2.80 | 23.6 | 3.40 | 25.2 | 3.78 | 26.8 | 4.14 | 30.1 | 4.90 | 32.2 | 5.35 |
| | 23 | 17.0 | 2.39 | 20.2 | 2.99 | 23.6 | 3.66 | 25.2 | 4.06 | 26.8 | 4.43 | 30.1 | 5.27 | 31.7 | 5.62 |
| | 25 | 17.0 | 2.54 | 20.2 | 3.18 | 23.6 | 3.89 | 25.2 | 4.33 | 26.8 | 4.74 | 30.1 | 5.63 | 31.3 | 5.85 |
| | 27 | 17.0 | 2.72 | 20.2 | 3.40 | 23.6 | 4.18 | 25.2 | 4.63 | 26.8 | 5.08 | 30.1 | 6.01 | 30.8 | 6.11 |
| | 29 | 17.0 | 2.88 | 20.2 | 3.63 | 23.6 | 4.47 | 25.2 | 4.94 | 26.8 | 5.42 | 29.8 | 6.30 | 30.4 | 6.36 |
| | 31 | 17.0 | 3.06 | 20.2 | 3.87 | 23.6 | 4.76 | 25.2 | 5.27 | 26.8 | 5.78 | 29.3 | 6.53 | 29.9 | 6.62 |
| | 33 | 17.0 | 3.26 | 20.2 | 4.12 | 23.6 | 5.08 | 25.2 | 5.61 | 26.8 | 6.15 | 28.9 | 6.79 | 29.5 | 6.86 |
| | 35 | 17.0 | 3.46 | 20.2 | 4.38 | 23.6 | 5.41 | 25.2 | 5.98 | 26.8 | 6.58 | 28.4 | 7.04 | 29.0 | 7.10 |
| | 37 | 17.0 | 3.69 | 20.2 | 4.67 | 23.6 | 5.77 | 24.7 | 6.20 | 26.8 | 7.04 | 27.9 | 7.29 | 28.6 | 7.27 |
| | 39 | 17.0 | 3.93 | 20.2 | 4.97 | 23.6 | 6.14 | 24.4 | 6.40 | 26.8 | 7.46 | 27.5 | 7.56 | 28.1 | 7.54 |
| | 41 | 17.0 | 4.36 | 20.2 | 5.53 | 23.6 | 6.82 | 24.0 | 6.94 | 26.8 | 7.63 | 28.5 | 8.17 | 29.1 | 8.24 |
| | 44 | 17.0 | 4.75 | 20.2 | 6.01 | 23.6 | 7.58 | 23.6 | 7.84 | 26.8 | 8.23 | 29.5 | 8.59 | 30.1 | 8.67 |
| | 47 | 17.0 | 6.32 | 20.2 | 7.99 | 23.6 | 7.96 | 23.2 | 7.96 | 26.8 | 8.75 | 30.5 | 9.22 | 31.1 | 9.31 |
| | 50 | 17.0 | 6.20 | 20.2 | 7.85 | 23.6 | 8.39 | 22.9 | 9.21 | 26.8 | 9.61 | 31.5 | 10.00 | 32.1 | 9.80 |
| | 52 | 17.0 | 5.23 | 20.2 | 6.62 | 23.6 | 7.15 | 22.5 | 7.84 | 26.8 | 8.42 | 32.5 | 8.80 | 33.1 | 8.52 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80% | -5 | 17.0 | 1.61 | 20.2 | 1.98 | 23.6 | 2.46 | 22.2 | 2.71 | 26.8 | 2.96 | 33.5 | 3.52 | 34.1 | 3.77 |
| | 0 | 17.0 | 1.61 | 20.2 | 1.99 | 23.6 | 2.47 | 21.8 | 2.72 | 26.8 | 2.97 | 34.5 | 3.53 | 35.1 | 3.78 |
| | 4 | 17.0 | 1.62 | 20.2 | 1.99 | 23.6 | 2.48 | 21.5 | 2.73 | 26.8 | 2.98 | 35.5 | 3.54 | 36.1 | 3.79 |
| | 7 | 17.0 | 1.65 | 20.2 | 2.03 | 23.6 | 2.52 | 21.1 | 2.78 | 26.8 | 3.04 | 36.5 | 3.60 | 37.1 | 3.86 |
| | 10 | 15.1 | 1.92 | 18.0 | 2.29 | 21.0 | 2.70 | 22.4 | 2.91 | 23.8 | 3.11 | 26.8 | 3.56 | 29.7 | 4.13 |
| | 12 | 15.1 | 1.94 | 18.0 | 2.33 | 21.0 | 2.75 | 22.4 | 2.96 | 23.8 | 3.17 | 26.8 | 3.62 | 29.7 | 4.10 |
| | 14 | 15.1 | 1.98 | 18.0 | 2.38 | 21.0 | 2.79 | 22.4 | 3.01 | 23.8 | 3.23 | 26.8 | 3.68 | 29.7 | 4.19 |
| | 16 | 15.1 | 2.01 | 18.0 | 2.42 | 21.0 | 2.85 | 22.4 | 3.07 | 23.8 | 3.28 | 26.8 | 3.76 | 29.7 | 4.34 |
| | 18 | 15.1 | 2.05 | 18.0 | 2.46 | 21.0 | 2.92 | 22.4 | 3.13 | 23.8 | 3.34 | 26.8 | 3.85 | 29.7 | 4.64 |
| | 20 | 15.1 | 2.09 | 18.0 | 2.51 | 21.0 | 2.96 | 22.4 | 3.19 | 23.8 | 3.42 | 26.8 | 3.99 | 29.7 | 4.81 |
| | 21 | 15.1 | 2.11 | 18.0 | 2.53 | 21.0 | 2.99 | 22.4 | 3.23 | 23.8 | 3.50 | 26.8 | 4.13 | 29.7 | 5.15 |
| | 23 | 15.1 | 2.14 | 18.0 | 2.59 | 21.0 | 3.13 | 22.4 | 3.44 | 23.8 | 3.74 | 26.8 | 4.42 | 29.7 | 5.51 |
| | 25 | 15.1 | 2.21 | 18.0 | 2.75 | 21.0 | 3.35 | 22.4 | 3.67 | 23.8 | 3.99 | 26.8 | 4.73 | 29.7 | 5.88 |
| | 27 | 15.1 | 2.35 | 18.0 | 2.93 | 21.0 | 3.57 | 22.4 | 3.92 | 23.8 | 4.28 | 26.8 | 5.05 | 29.7 | 6.09 |
| | 29 | 15.1 | 2.50 | 18.0 | 3.12 | 21.0 | 3.80 | 22.4 | 4.17 | 23.8 | 4.57 | 26.8 | 5.39 | 29.7 | 6.31 |
| | 31 | 15.1 | 2.65 | 18.0 | 3.31 | 21.0 | 4.05 | 22.4 | 4.45 | 23.8 | 4.87 | 26.8 | 5.75 | 29.2 | 6.54 |
| | 33 | 15.1 | 2.82 | 18.0 | 3.69 | 21.0 | 4.31 | 22.4 | 4.74 | 23.8 | 5.18 | 26.8 | 6.14 | 28.8 | 6.77 |
| | 35 | 15.1 | 2.99 | 18.0 | 3.69 | 21.0 | 4.59 | 22.4 | 5.05 | 23.8 | 5.52 | 26.8 | 6.55 | 28.3 | 7.02 |
| | 37 | 15.1 | 3.17 | 18.0 | 3.97 | 21.0 | 4.88 | 22.0 | 5.38 | 23.8 | 5.88 | 26.8 | 6.98 | 27.9 | 7.28 |
| | 39 | 15.1 | 3.36 | 18.0 | 4.22 | 21.0 | 5.19 | 21.7 | 5.73 | 23.8 | 6.26 | 26.8 | 7.43 | 27.4 | 7.55 |
| | 41 | 15.1 | 3.77 | 18.0 | 4.65 | 21.0 | 5.78 | 21.3 | 5.86 | 23.8 | 6.40 | 26.8 | 7.60 | 28.4 | 8.14 |
| | 44 | 15.1 | 4.10 | 18.0 | 5.06 | 21.0 | 6.42 | 21.0 | 6.62 | 23.8 | 6.90 | 26.8 | 7.99 | 29.4 | 8.56 |
| | 47 | 15.1 | 5.46 | 18.0 | 6.73 | 21.0 | 6.74 | 20.6 | 6.72 | 23.8 | 7.34 | 26.8 | 8.58 | 30.4 | 9.20 |
| | 50 | 15.1 | 5.36 | 18.0 | 6.61 | 21.0 | 7.11 | 20.4 | 7.78 | 23.8 | 8.06 | 26.8 | 9.30 | 31.4 | 9.69 |
| | 52 | 15.1 | 4.52 | 18.0 | 5.57 | 21.0 | 6.06 | 20.0 | 6.62 | 23.8 | 7.07 | 26.8 | 8.19 | 32.4 | 8.42 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70% | -5 | 15.1 | 1.37 | 18.0 | 1.69 | 21.0 | 2.05 | 19.7 | 2.25 | 23.8 | 2.45 | 26.8 | 2.89 | 33.4 | 3.36 |
| | 0 | 15.1 | 1.37 | 18.0 | 1.70 | 21.0 | 2.06 | 19.4 | 2.25 | 23.8 | 2.46 | 26.8 | 2.89 | 34.4 | 3.37 |
| | 4 | 15.1 | 1.38 | 18.0 | 1.70 | 21.0 | 2.06 | 19.1 | 2.26 | 23.8 | 2.47 | 26.8 | 2.91 | 35.4 | 3.38 |
| | 7 | 15.1 | 1.40 | 18.0 | 1.73 | 21.0 | 2.10 | 18.8 | 2.31 | 23.8 | 2.51 | 26.8 | 2.96 | 36.4 | 3.44 |
| | 10 | 13.2 | 1.69 | 15.7 | 2.00 | 18.3 | 2.33 | 19.6 | 2.51 | 20.9 | 2.69 | 23.4 | 3.06 | 26.0 | 3.44 |
| | 12 | 13.2 | 1.71 | 15.7 | 2.03 | 18.3 | 2.38 | 19.6 | 2.56 | 20.9 | 2.74 | 23.4 | 3.12 | 26.0 | 3.50 |
| | 14 | 13.2 | 1.74 | 15.7 | 2.07 | 18.3 | 2.42 | 19.6 | 2.60 | 20.9 | 2.78 | 23.4 | 3.17 | 26.0 | 3.57 |
| | 16 | 13.2 | 1.77 | 15.7 | 2.11 | 18.3 | 2.46 | 19.6 | 2.65 | 20.9 | 2.84 | 23.4 | 3.23 | 26.0 | 3.63 |
| | 18 | 13.2 | 1.79 | 15.7 | 2.14 | 18.3 | 2.51 | 19.6 | 2.70 | 20.9 | 2.89 | 23.4 | 3.29 | 26.0 | 3.71 |
| | 20 | 13.2 | 1.82 | 15.7 | 2.18 | 18.3 | 2.56 | 19.6 | 2.75 | 20.9 | 2.95 | 23.4 | 3.36 | 26.0 | 3.81 |
| | 21 | 13.2 | 1.84 | 15.7 | 2.20 | 18.3 | 2.58 | 19.6 | 2.78 | 20.9 | 2.97 | 23.4 | 3.40 | 26.0 | 3.95 |
| | 23 | 13.2 | 1.87 | 15.7 | 2.24 | 18.3 | 2.63 | 19.6 | 2.87 | 20.9 | 3.12 | 23.4 | 3.65 | 26.0 | 4.23 |
| | 25 | 13.2 | 1.91 | 15.7 | 2.33 | 18.3 | 2.80 | 19.6 | 3.07 | 20.9 | 3.33 | 23.4 | 3.91 | 26.0 | 4.52 |
| | 27 | 13.2 | 2.02 | 15.7 | 2.48 | 18.3 | 2.99 | 19.6 | 3.27 | 20.9 | 3.56 | 23.4 | 4.17 | 26.0 | 4.83 |
| | 29 | 13.2 | 2.14 | 15.7 | 2.63 | 18.3 | 3.18 | 19.6 | 3.48 | 20.9 | 3.79 | 23.4 | 4.45 | 26.0 | 5.16 |
| | 31 | 13.2 | 2.27 | 15.7 | 2.79 | 18.3 | 3.39 | 19.6 | 3.70 | 20.9 | 4.03 | 23.4 | 4.74 | 26.0 | 5.50 |
| | 33 | 13.2 | 2.41 | 15.7 | 2.97 | 18.3 | 3.61 | 19.6 | 3.94 | 20.9 | 4.30 | 23.4 | 5.05 | 26.0 | 5.87 |
| | 35 | 13.2 | 2.55 | 15.7 | 3.15 | 18.3 | 3.82 | 19.6 | 4.19 | 20.9 | 4.57 | 23.4 | 5.38 | 26.0 | 6.26 |
| | 37 | 13.2 | 2.69 | 15.7 | 3.34 | 18.3 | 4.07 | 19.2 | 4.46 | 20.9 | 4.86 | 23.4 | 5.73 | 26.0 | 6.66 |
| | 39 | 13.2 | 2.85 | 15.7 | 3.54 | 18.3 | 4.31 | 19.0 | 4.73 | 20.9 | 5.16 | 23.4 | 6.09 | 26.0 | 7.10 |
| | 41 | 13.2 | 3.21 | 15.7 | 3.97 | 18.3 | 4.82 | 18.6 | 4.86 | 20.9 | 5.30 | 23.4 | 6.24 | 26.0 | 7.26 |
| | 44 | 13.2 | 3.49 | 15.7 | 4.32 | 18.3 | 5.35 | 18.4 | 5.49 | 20.9 | 5.71 | 23.4 | 6.56 | 26.0 | 7.64 |
| | 47 | 13.2 | 4.65 | 15.7 | 5.75 | 18.3 | 5.62 | 18.1 | 5.57 | 20.9 | 6.08 | 23.4 | 7.05 | 26.0 | 8.20 |
| | 50 | 13.2 | 4.56 | 15.7 | 5.64 | 18.3 | 5.93 | 17.8 | 6.45 | 20.9 | 6.67 | 23.4 | 7.64 | 26.0 | 8.64 |
| | 52 | 13.2 | 3.85 | 15.7 | 4.76 | 18.3 | 5.05 | 17.5 | 5.49 | 20.9 | 5.85 | 23.4 | 6.73 | 26.0 | 7.51 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60% | -5 | 13.2 | 1.15 | 15.7 | 1.40 | 18.3 | 1.68 | 17.3 | 1.84 | 20.9 | 1.99 | 23.4 | 2.33 | 26.0 | 2.69 |
| | 0 | 13.2 | 1.15 | 15.7 | 1.41 | 18.3 | 1.69 | 17.0 | 1.84 | 20.9 | 2.00 | 23.4 | 2.33 | 26.0 | 2.69 |
| | 4 | 13.2 | 1.16 | 15.7 | 1.41 | 18.3 | 1.69 | 16.7 | 1.85 | 20.9 | 2.00 | 23.4 | 2.34 | 26.0 | 2.70 |
| | 7 | 13.2 | 1.18 | 15.7 | 1.44 | 18.3 | 1.72 | 16.4 | 1.88 | 20.9 | 2.04 | 23.4 | 2.38 | 26.0 | 2.75 |
| | 10 | 11.3 | 1.46 | 13.5 | 1.72 | 15.7 | 1.99 | 16.8 | 2.13 | 17.9 | 2.28 | 20.1 | 2.58 | 22.3 | 2.89 |
| | 12 | 11.3 | 1.49 | 13.5 | 1.75 | 15.7 | 2.03 | 16.8 | 2.17 | 17.9 | 2.31 | 20.1 | 2.62 | 22.3 | 2.94 |
| | 14 | 11.3 | 1.51 | 13.5 | 1.77 | 15.7 | 2.06 | 16.8 | 2.21 | 17.9 | 2.36 | 20.1 | 2.67 | 22.3 | 2.99 |
| | 16 | 11.3 | 1.53 | 13.5 | 1.80 | 15.7 | 2.10 | 16.8 | 2.25 | 17.9 | 2.40 | 20.1 | 2.72 | 22.3 | 3.05 |
| | 18 | 11.3 | 1.56 | 13.5 | 1.83 | 15.7 | 2.13 | 16.8 | 2.28 | 17.9 | 2.44 | 20.1 | 2.77 | 22.3 | 3.11 |
| | 20 | 11.3 | 1.58 | 13.5 | 1.87 | 15.7 | 2.17 | 16.8 | 2.33 | 17.9 | 2.49 | 20.1 | 2.82 | 22.3 | 3.17 |
| | 21 | 11.3 | 1.60 | 13.5 | 1.88 | 15.7 | 2.19 | 16.8 | 2.35 | 17.9 | 2.51 | 20.1 | 2.85 | 22.3 | 3.20 |
| | 23 | 11.3 | 1.61 | 13.5 | 1.92 | 15.7 | 2.23 | 16.8 | 2.40 | 17.9 | 2.56 | 20.1 | 2.96 | 22.3 | 3.41 |
| | 25 | 11.3 | 1.64 | 13.5 | 1.95 | 15.7 | 2.31 | 16.8 | 2.51 | 17.9 | 2.72 | 20.1 | 3.16 | 22.3 | 3.63 |
| | 27 | 11.3 | 1.71 | 13.5 | 2.07 | 15.7 | 2.46 | 16.8 | 2.68 | 17.9 | 2.90 | 20.1 | 3.37 | 22.3 | 3.88 |
| | 29 | 11.3 | 1.80 | 13.5 | 2.19 | 15.7 | 2.62 | 16.8 | 2.85 | 17.9 | 3.09 | 20.1 | 3.60 | 22.3 | 4.14 |
| | 31 | 11.3 | 1.92 | 13.5 | 2.33 | 15.7 | 2.78 | 16.8 | 3.03 | 17.9 | 3.29 | 20.1 | 3.82 | 22.3 | 4.41 |
| | 33 | 11.3 | 2.02 | 13.5 | 2.46 | 15.7 | 2.95 | 16.8 | 3.22 | 17.9 | 3.49 | 20.1 | 4.07 | 22.3 | 4.70 |
| | 35 | 11.3 | 2.14 | 13.5 | 2.61 | 15.7 | 3.13 | 16.8 | 3.42 | 17.9 | 3.71 | 20.1 | 4.33 | 22.3 | 5.00 |
| | 37 | 11.3 | 2.27 | 13.5 | 2.77 | 15.7 | 3.32 | 16.5 | 3.62 | 17.9 | 3.94 | 20.1 | 4.61 | 22.3 | 5.32 |
| | 39 | 11.3 | 2.39 | 13.5 | 2.93 | 15.7 | 3.52 | 16.3 | 3.84 | 17.9 | 4.18 | 20.1 | 4.89 | 22.3 | 5.66 |
| | 41 | 11.3 | 2.70 | 13.5 | 3.29 | 15.7 | 3.95 | 16.0 | 3.96 | 17.9 | 4.30 | 20.1 | 5.03 | 22.3 | 5.80 |
| | 44 | 11.3 | 2.94 | 13.5 | 3.58 | 15.7 | 4.39 | 15.8 | 4.48 | 17.9 | 4.64 | 20.1 | 5.29 | 22.3 | 6.10 |
| | 47 | 11.3 | 3.91 | 13.5 | 4.77 | 15.7 | 4.61 | 15.5 | 4.54 | 17.9 | 4.93 | 20.1 | 5.68 | 22.3 | 6.55 |
| | 50 | 11.3 | 3.84 | 13.5 | 4.68 | 15.7 | 4.86 | 15.3 | 5.26 | 17.9 | 5.42 | 20.1 | 6.15 | 22.3 | 6.90 |
| | 52 | 11.3 | 3.24 | 13.5 | 3.95 | 15.7 | 4.14 | 15.0 | 4.48 | 17.9 | 4.75 | 20.1 | 5.42 | 22.3 | 6.00 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 50% | -5 | 11.3 | 0.95 | 13.5 | 1.14 | 15.7 | 1.35 | 14.8 | 1.46 | 17.9 | 1.58 | 20.1 | 1.82 | 22.3 | 2.09 |
| | 0 | 11.3 | 0.95 | 13.5 | 1.14 | 15.7 | 1.35 | 14.5 | 1.46 | 17.9 | 1.58 | 20.1 | 1.83 | 22.3 | 2.09 |
| | 4 | 11.3 | 0.96 | 13.5 | 1.15 | 15.7 | 1.36 | 14.3 | 1.47 | 17.9 | 1.59 | 20.1 | 1.84 | 22.3 | 2.10 |
| | 7 | 11.3 | 0.98 | 13.5 | 1.17 | 15.7 | 1.38 | 14.1 | 1.50 | 17.9 | 1.61 | 20.1 | 1.87 | 22.3 | 2.14 |
| | 10 | 9.5 | 1.26 | 11.2 | 1.46 | 13.1 | 1.67 | 14.0 | 1.78 | 14.9 | 1.89 | 16.7 | 2.12 | 18.6 | 2.37 |
| | 12 | 9.5 | 1.27 | 11.2 | 1.48 | 13.1 | 1.70 | 14.0 | 1.80 | 14.9 | 1.93 | 16.7 | 2.16 | 18.6 | 2.41 |
| | 14 | 9.5 | 1.29 | 11.2 | 1.50 | 13.1 | 1.72 | 14.0 | 1.84 | 14.9 | 1.95 | 16.7 | 2.20 | 18.6 | 2.45 |
| | 16 | 9.5 | 1.31 | 11.2 | 1.52 | 13.1 | 1.75 | 14.0 | 1.87 | 14.9 | 1.98 | 16.7 | 2.24 | 18.6 | 2.49 |
| | 18 | 9.5 | 1.33 | 11.2 | 1.55 | 13.1 | 1.77 | 14.0 | 1.90 | 14.9 | 2.02 | 16.7 | 2.28 | 18.6 | 2.54 |
| | 20 | 9.5 | 1.35 | 11.2 | 1.57 | 13.1 | 1.80 | 14.0 | 1.94 | 14.9 | 2.06 | 16.7 | 2.32 | 18.6 | 2.59 |
| | 21 | 9.5 | 1.36 | 11.2 | 1.59 | 13.1 | 1.82 | 14.0 | 1.94 | 14.9 | 2.08 | 16.7 | 2.34 | 18.6 | 2.61 |
| | 23 | 9.5 | 1.38 | 11.2 | 1.60 | 13.1 | 1.85 | 14.0 | 1.98 | 14.9 | 2.11 | 16.7 | 2.38 | 18.6 | 2.67 |
| | 25 | 9.5 | 1.40 | 11.2 | 1.63 | 13.1 | 1.89 | 14.0 | 2.02 | 14.9 | 2.18 | 16.7 | 2.50 | 18.6 | 2.85 |
| | 27 | 9.5 | 1.43 | 11.2 | 1.70 | 13.1 | 1.99 | 14.0 | 2.15 | 14.9 | 2.31 | 16.7 | 2.66 | 18.6 | 3.04 |
| | 29 | 9.5 | 1.50 | 11.2 | 1.79 | 13.1 | 2.11 | 14.0 | 2.28 | 14.8 | 2.46 | 16.7 | 2.83 | 18.6 | 3.24 |
| | 31 | 9.5 | 1.59 | 11.2 | 1.90 | 13.1 | 2.26 | 14.0 | 2.43 | 14.8 | 2.61 | 16.7 | 3.01 | 18.6 | 3.45 |
| | 33 | 9.5 | 1.68 | 11.2 | 2.01 | 13.1 | 2.38 | 14.0 | 2.57 | 14.8 | 2.78 | 16.7 | 3.20 | 18.6 | 3.66 |
| | 35 | 9.5 | 1.77 | 11.2 | 2.12 | 13.1 | 2.51 | 14.0 | 2.72 | 14.8 | 2.94 | 16.7 | 3.40 | 18.6 | 3.89 |
| | 37 | 9.5 | 1.87 | 11.2 | 2.25 | 13.1 | 2.66 | 13.7 | 2.88 | 14.8 | 3.12 | 16.7 | 3.61 | 18.6 | 4.13 |
| | 39 | 9.5 | 1.97 | 11.2 | 2.37 | 13.1 | 2.81 | 13.6 | 3.05 | 14.8 | 3.30 | 16.7 | 3.82 | 18.6 | 4.39 |
| | 41 | 9.5 | 2.24 | 11.2 | 2.68 | 13.1 | 3.16 | 13.3 | 3.15 | 14.8 | 3.41 | 16.7 | 3.94 | 18.6 | 4.51 |
| | 44 | 9.5 | 2.43 | 11.2 | 2.91 | 13.1 | 3.52 | 13.1 | 3.56 | 14.8 | 3.67 | 16.7 | 4.15 | 18.6 | 4.74 |
| | 47 | 9.5 | 3.24 | 11.2 | 3.87 | 13.1 | 3.69 | 12.9 | 3.62 | 14.8 | 3.90 | 16.7 | 4.45 | 18.6 | 5.09 |
| | 50 | 9.5 | 3.18 | 11.2 | 3.80 | 13.1 | 3.89 | 12.7 | 4.19 | 14.8 | 4.29 | 16.7 | 4.83 | 18.6 | 5.37 |
| | 52 | 9.5 | 2.68 | 11.2 | 3.21 | 13.1 | 3.31 | 12.5 | 3.56 | 14.8 | 3.76 | 16.7 | 4.25 | 18.6 | 4.67 |

CHV-5S335NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 135% | -5 | 29.4 | 3.72 | 35.1 | 4.53 | 40.7 | 4.58 | 42.2 | 4.61 | 43.1 | 4.63 | 44.1 | 4.68 | 45.5 | 4.73 |
| | 0 | 29.4 | 3.72 | 35.1 | 4.54 | 40.7 | 4.59 | 42.2 | 4.61 | 43.1 | 4.64 | 44.1 | 4.69 | 45.5 | 4.74 |
| | 4 | 29.4 | 3.74 | 35.1 | 4.55 | 40.7 | 4.61 | 42.2 | 4.63 | 43.1 | 4.66 | 44.1 | 4.71 | 45.5 | 4.76 |
| | 7 | 29.4 | 3.81 | 35.1 | 4.64 | 40.7 | 4.69 | 42.2 | 4.72 | 43.1 | 4.74 | 43.8 | 4.80 | 44.9 | 4.85 |
| | 10 | 29.4 | 3.87 | 35.1 | 4.74 | 40.7 | 5.63 | 42.2 | 5.76 | 42.7 | 5.64 | 43.8 | 5.40 | 44.9 | 5.16 |
| | 12 | 29.4 | 3.94 | 35.1 | 4.83 | 40.7 | 5.74 | 41.6 | 5.72 | 42.2 | 5.61 | 43.2 | 5.36 | 44.3 | 5.28 |
| | 14 | 29.4 | 4.02 | 35.1 | 4.92 | 40.6 | 5.81 | 41.2 | 5.70 | 41.6 | 5.57 | 42.7 | 5.53 | 43.8 | 5.59 |
| | 16 | 29.4 | 4.09 | 35.1 | 5.02 | 40.1 | 5.79 | 40.6 | 5.74 | 41.0 | 5.77 | 42.1 | 5.82 | 43.2 | 5.88 |
| | 18 | 29.4 | 4.17 | 35.1 | 5.12 | 39.5 | 6.00 | 40.0 | 6.04 | 40.6 | 6.07 | 41.6 | 6.13 | 42.7 | 6.19 |
| | 20 | 29.4 | 4.26 | 35.1 | 5.45 | 38.9 | 6.30 | 39.5 | 6.33 | 40.0 | 6.37 | 41.0 | 6.42 | 42.1 | 6.49 |
| | 21 | 29.4 | 4.37 | 35.1 | 5.64 | 38.6 | 6.45 | 39.2 | 6.48 | 39.7 | 6.51 | 40.8 | 6.58 | 41.9 | 6.64 |
| | 23 | 29.4 | 4.69 | 35.1 | 6.05 | 38.2 | 6.74 | 38.6 | 6.78 | 39.1 | 6.81 | 40.2 | 6.88 | 41.3 | 6.95 |
| | 25 | 29.4 | 5.01 | 35.1 | 6.48 | 37.6 | 7.04 | 38.2 | 7.07 | 38.6 | 7.12 | 39.7 | 7.18 | 40.8 | 7.25 |
| | 27 | 29.4 | 5.35 | 35.1 | 6.93 | 37.1 | 6.20 | 37.6 | 7.38 | 38.0 | 7.41 | 39.1 | 7.49 | 40.2 | 7.57 |
| | 29 | 29.4 | 5.71 | 35.1 | 7.41 | 36.5 | 7.63 | 37.0 | 7.67 | 37.6 | 7.72 | 38.6 | 7.80 | 39.7 | 7.87 |
| | 31 | 29.4 | 6.10 | 34.9 | 7.84 | 35.9 | 7.93 | 36.5 | 7.98 | 37.0 | 8.01 | 38.0 | 8.10 | 39.1 | 8.19 |
| | 33 | 29.4 | 6.49 | 34.3 | 8.13 | 35.4 | 8.21 | 35.9 | 8.27 | 36.5 | 8.32 | 37.6 | 8.41 | 38.5 | 8.51 |
| | 35 | 29.4 | 6.92 | 33.7 | 8.43 | 34.8 | 8.53 | 35.4 | 8.58 | 35.9 | 8.62 | 37.0 | 8.72 | 38.0 | 8.81 |
| | 37 | 29.4 | 7.36 | 33.3 | 8.74 | 34.3 | 8.84 | 34.8 | 8.88 | 35.4 | 8.94 | 36.4 | 9.04 | 37.4 | 9.14 |
| | 39 | 29.4 | 7.84 | 32.7 | 9.03 | 33.7 | 9.13 | 34.3 | 9.19 | 34.8 | 9.25 | 35.9 | 9.35 | 37.0 | 9.46 |
| | 41 | 27.8 | 8.72 | 32.1 | 10.62 | 33.1 | 10.75 | 33.7 | 9.95 | 34.1 | 10.00 | 35.2 | 10.12 | 36.3 | 10.23 |
| | 44 | 25.9 | 9.48 | 30.4 | 11.55 | 31.5 | 11.94 | 32.2 | 11.24 | 32.8 | 10.78 | 33.9 | 10.64 | 35.0 | 10.75 |
| | 47 | 24.4 | 12.62 | 29.4 | 15.37 | 30.5 | 12.54 | 31.1 | 11.41 | 31.6 | 11.47 | 32.7 | 11.43 | 33.9 | 11.55 |
| | 50 | 22.4 | 12.39 | 26.3 | 15.09 | 27.2 | 13.22 | 27.7 | 13.21 | 28.2 | 12.59 | 29.2 | 12.39 | 30.4 | 12.16 |
| | 52 | 17.0 | 10.45 | 19.6 | 12.73 | 20.4 | 11.26 | 20.9 | 11.24 | 21.5 | 11.04 | 23.3 | 10.91 | 24.7 | 10.58 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120% | -5 | 27.2 | 3.31 | 33.6 | 4.28 | 40.0 | 4.55 | 41.4 | 4.58 | 42.4 | 4.60 | 43.3 | 4.65 | 44.5 | 4.70 |
| | 0 | 27.2 | 3.32 | 33.6 | 4.29 | 40.0 | 4.56 | 41.4 | 4.58 | 42.4 | 4.61 | 43.3 | 4.66 | 44.5 | 4.71 |
| | 4 | 27.2 | 3.33 | 33.6 | 4.31 | 40.0 | 4.58 | 41.4 | 4.60 | 42.4 | 4.63 | 43.3 | 4.67 | 44.5 | 4.72 |
| | 7 | 27.2 | 3.39 | 33.6 | 4.39 | 40.0 | 4.66 | 41.4 | 4.69 | 42.4 | 4.71 | 42.9 | 4.76 | 43.9 | 4.81 |
| | 10 | 27.2 | 3.53 | 32.3 | 4.32 | 37.6 | 5.13 | 40.2 | 5.55 | 42.1 | 5.79 | 43.1 | 5.56 | 44.0 | 5.35 |
| | 12 | 27.2 | 3.60 | 32.3 | 4.40 | 37.6 | 5.23 | 40.2 | 5.65 | 41.5 | 5.76 | 42.5 | 5.54 | 43.4 | 5.31 |
| | 14 | 27.2 | 3.67 | 32.3 | 4.49 | 37.6 | 5.34 | 40.2 | 5.77 | 40.9 | 5.72 | 42.0 | 5.51 | 43.0 | 5.54 |
| | 16 | 27.2 | 3.74 | 32.3 | 4.58 | 37.6 | 5.44 | 40.0 | 5.81 | 40.4 | 5.73 | 41.4 | 5.79 | 42.4 | 5.83 |
| | 18 | 27.2 | 3.81 | 32.3 | 4.67 | 37.6 | 5.63 | 39.4 | 6.00 | 39.8 | 6.03 | 40.8 | 6.08 | 41.9 | 6.14 |
| | 20 | 27.2 | 3.89 | 32.3 | 4.85 | 37.6 | 6.05 | 38.9 | 6.30 | 39.4 | 6.32 | 40.3 | 6.38 | 41.3 | 6.44 |
| | 21 | 27.2 | 3.92 | 32.3 | 5.02 | 37.6 | 6.27 | 38.5 | 6.45 | 39.0 | 6.47 | 40.1 | 6.53 | 41.0 | 6.59 |
| | 23 | 27.2 | 4.19 | 32.3 | 5.38 | 37.6 | 6.71 | 38.0 | 6.73 | 38.5 | 6.76 | 39.5 | 6.83 | 40.4 | 6.89 |
| | 25 | 27.2 | 4.48 | 32.3 | 5.76 | 37.0 | 7.00 | 37.4 | 7.02 | 37.9 | 7.06 | 39.0 | 7.13 | 40.0 | 7.19 |
| | 27 | 27.2 | 4.78 | 32.3 | 6.15 | 36.5 | 7.29 | 37.0 | 7.33 | 37.4 | 7.36 | 38.4 | 7.43 | 39.4 | 7.50 |
| | 29 | 27.2 | 5.10 | 32.3 | 6.57 | 35.9 | 7.58 | 36.4 | 7.63 | 36.8 | 7.66 | 37.8 | 7.74 | 38.9 | 7.81 |
| | 31 | 27.2 | 5.44 | 32.3 | 7.01 | 35.4 | 7.89 | 35.9 | 7.92 | 36.4 | 7.96 | 37.3 | 8.04 | 38.3 | 8.12 |
| | 33 | 27.2 | 5.79 | 32.3 | 7.49 | 34.8 | 8.18 | 35.3 | 8.23 | 35.8 | 8.26 | 36.7 | 8.35 | 37.7 | 8.43 |
| | 35 | 27.2 | 6.16 | 32.3 | 7.98 | 34.2 | 8.47 | 34.7 | 8.52 | 35.3 | 8.57 | 36.3 | 8.66 | 37.2 | 8.75 |
| | 37 | 27.2 | 6.56 | 32.3 | 8.50 | 33.7 | 8.78 | 34.2 | 8.83 | 34.7 | 8.87 | 35.7 | 8.96 | 36.6 | 9.06 |
| | 39 | 27.2 | 6.98 | 32.2 | 8.97 | 33.1 | 9.08 | 33.6 | 9.13 | 34.1 | 9.18 | 35.2 | 9.28 | 36.1 | 9.37 |
| | 41 | 25.7 | 7.77 | 30.7 | 10.05 | 32.5 | 10.68 | 33.0 | 9.88 | 33.6 | 9.94 | 34.5 | 10.04 | 35.5 | 10.15 |
| | 44 | 23.9 | 8.44 | 29.1 | 10.93 | 31.0 | 11.86 | 31.6 | 11.16 | 32.2 | 10.71 | 33.2 | 10.56 | 34.2 | 10.67 |
| | 47 | 22.5 | 11.24 | 28.1 | 14.54 | 29.9 | 12.46 | 30.5 | 11.33 | 31.1 | 11.39 | 32.1 | 11.34 | 33.1 | 11.46 |
| | 50 | 20.6 | 11.03 | 25.2 | 14.28 | 26.7 | 13.14 | 27.2 | 13.12 | 27.7 | 12.51 | 28.6 | 12.29 | 29.8 | 12.07 |
| | 52 | 15.6 | 9.31 | 18.7 | 12.04 | 20.0 | 11.19 | 20.5 | 11.16 | 21.2 | 10.96 | 22.8 | 10.82 | 24.2 | 10.50 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110% | -5 | 24.9 | 2.93 | 30.8 | 3.77 | 39.4 | 4.52 | 40.7 | 4.54 | 41.5 | 4.57 | 42.3 | 4.61 | 43.5 | 4.65 |
| | 0 | 24.9 | 2.93 | 30.8 | 3.77 | 39.4 | 4.53 | 40.7 | 4.55 | 41.5 | 4.58 | 42.3 | 4.62 | 43.5 | 4.66 |
| | 4 | 24.9 | 2.94 | 30.8 | 3.79 | 39.4 | 4.55 | 40.7 | 4.57 | 41.5 | 4.59 | 42.3 | 4.64 | 43.5 | 4.68 |
| | 7 | 24.9 | 3.00 | 30.8 | 3.86 | 39.4 | 4.63 | 40.7 | 4.65 | 41.5 | 4.68 | 41.9 | 4.72 | 42.9 | 4.77 |
| | 10 | 24.9 | 3.21 | 29.7 | 3.91 | 34.5 | 4.65 | 36.8 | 5.02 | 39.2 | 5.40 | 42.2 | 5.73 | 43.2 | 5.54 |
| | 12 | 24.9 | 3.27 | 29.7 | 3.99 | 34.5 | 4.74 | 36.8 | 5.12 | 39.2 | 5.51 | 41.8 | 5.71 | 42.6 | 5.51 |
| | 14 | 24.9 | 3.33 | 29.7 | 4.06 | 34.5 | 4.83 | 36.8 | 5.21 | 39.2 | 5.61 | 41.2 | 5.71 | 42.1 | 5.50 |
| | 16 | 24.9 | 3.39 | 29.7 | 4.14 | 34.5 | 4.92 | 36.8 | 5.31 | 39.2 | 5.72 | 40.7 | 5.74 | 41.5 | 5.80 |
| | 18 | 24.9 | 3.46 | 29.7 | 4.21 | 34.5 | 5.02 | 36.8 | 5.46 | 39.2 | 5.99 | 40.1 | 6.04 | 41.0 | 6.10 |
| | 20 | 24.9 | 3.52 | 29.7 | 4.31 | 34.5 | 5.31 | 36.8 | 5.87 | 38.6 | 6.29 | 39.6 | 6.33 | 40.4 | 6.39 |
| | 21 | 24.9 | 3.56 | 29.7 | 4.43 | 34.5 | 5.51 | 36.8 | 6.08 | 38.4 | 6.44 | 39.2 | 6.48 | 40.2 | 6.54 |
| | 23 | 24.9 | 3.73 | 29.7 | 4.75 | 34.5 | 5.90 | 36.8 | 6.53 | 37.8 | 6.72 | 38.8 | 6.79 | 39.6 | 6.84 |
| | 25 | 24.9 | 3.97 | 29.7 | 5.08 | 34.5 | 6.31 | 36.8 | 6.99 | 37.3 | 7.01 | 38.2 | 7.08 | 39.1 | 7.14 |
| | 27 | 24.9 | 4.24 | 29.7 | 5.43 | 34.5 | 6.75 | 36.3 | 7.29 | 36.7 | 7.31 | 37.7 | 7.38 | 38.5 | 7.44 |
| | 29 | 24.9 | 4.52 | 29.7 | 5.79 | 34.5 | 7.22 | 35.8 | 7.58 | 36.3 | 7.61 | 37.1 | 7.68 | 38.0 | 7.75 |
| | 31 | 24.9 | 4.82 | 29.7 | 6.17 | 34.5 | 7.70 | 35.2 | 7.87 | 35.7 | 7.91 | 36.6 | 7.98 | 37.4 | 8.06 |
| | 33 | 24.9 | 5.12 | 29.7 | 6.58 | 34.2 | 8.12 | 34.7 | 8.17 | 35.2 | 8.20 | 36.0 | 8.28 | 37.0 | 8.36 |
| | 35 | 24.9 | 5.45 | 29.7 | 7.01 | 33.7 | 8.42 | 34.1 | 8.46 | 34.6 | 8.51 | 35.4 | 8.59 | 36.4 | 8.67 |
| | 37 | 24.9 | 5.80 | 29.7 | 7.47 | 33.1 | 8.72 | 33.6 | 8.76 | 34.0 | 8.80 | 34.9 | 8.89 | 35.8 | 8.97 |
| | 39 | 24.9 | 6.16 | 29.7 | 7.95 | 32.5 | 9.02 | 33.0 | 9.06 | 33.5 | 9.11 | 34.3 | 9.20 | 35.3 | 9.29 |
| | 41 | 23.5 | 6.87 | 28.2 | 8.84 | 32.1 | 10.61 | 32.4 | 9.82 | 32.9 | 9.87 | 33.7 | 9.96 | 34.7 | 10.05 |
| | 44 | 21.9 | 7.47 | 26.7 | 9.61 | 30.5 | 11.79 | 31.0 | 11.09 | 31.6 | 10.64 | 32.4 | 10.48 | 33.5 | 10.57 |
| | 47 | 20.7 | 9.93 | 25.8 | 12.79 | 29.5 | 12.37 | 29.9 | 11.26 | 30.4 | 11.32 | 31.3 | 11.25 | 32.4 | 11.35 |
| | 50 | 18.9 | 9.76 | 23.1 | 12.55 | 26.3 | 13.05 | 26.7 | 13.03 | 27.1 | 12.42 | 28.0 | 12.20 | 29.1 | 11.96 |
| | 52 | 14.3 | 8.23 | 17.2 | 10.59 | 19.7 | 11.11 | 20.1 | 11.09 | 20.7 | 10.89 | 22.3 | 10.74 | 23.6 | 10.40 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100% | -5 | 22.6 | 2.56 | 28.0 | 3.28 | 36.6 | 4.09 | 39.9 | 4.51 | 40.6 | 4.54 | 41.4 | 4.58 | 42.4 | 4.62 |
| | 0 | 22.6 | 2.56 | 28.0 | 3.28 | 36.6 | 4.09 | 39.9 | 4.52 | 40.6 | 4.55 | 41.4 | 4.59 | 42.4 | 4.63 |
| | 4 | 22.6 | 2.57 | 28.0 | 3.29 | 36.6 | 4.11 | 39.9 | 4.54 | 40.6 | 4.56 | 41.4 | 4.60 | 42.4 | 4.64 |
| | 7 | 22.6 | 2.62 | 28.0 | 3.36 | 36.6 | 4.18 | 39.9 | 4.62 | 40.6 | 4.65 | 41.1 | 4.69 | 41.9 | 4.73 |
| | 10 | 22.6 | 2.90 | 26.9 | 3.52 | 31.3 | 4.17 | 33.5 | 4.50 | 35.6 | 4.86 | 40.1 | 5.50 | 42.3 | 5.72 |
| | 12 | 22.6 | 2.94 | 26.9 | 3.57 | 31.3 | 4.22 | 33.5 | 4.56 | 35.6 | 4.95 | 40.1 | 5.60 | 41.7 | 5.67 |
| | 14 | 22.6 | 2.99 | 26.9 | 3.63 | 31.3 | 4.30 | 33.5 | 4.64 | 35.6 | 5.04 | 40.1 | 5.69 | 41.3 | 5.63 |
| | 16 | 22.6 | 3.06 | 26.9 | 3.71 | 31.3 | 4.39 | 33.5 | 4.75 | 35.6 | 5.16 | 39.9 | 5.82 | 40.7 | 5.75 |
| | 18 | 22.6 | 3.13 | 26.9 | 3.80 | 31.3 | 4.48 | 33.5 | 4.84 | 35.6 | 5.26 | 39.4 | 5.93 | 40.2 | 6.02 |
| | 20 | 22.6 | 3.17 | 26.9 | 3.86 | 31.3 | 4.63 | 33.5 | 5.09 | 35.6 | 5.59 | 38.8 | 6.24 | 39.6 | 6.34 |
| | 21 | 22.6 | 3.21 | 26.9 | 3.89 | 31.3 | 4.78 | 33.5 | 5.27 | 35.6 | 5.78 | 38.5 | 6.46 | 39.4 | 6.52 |
| | 23 | 22.6 | 3.29 | 26.9 | 4.16 | 31.3 | 5.14 | 33.5 | 5.66 | 35.6 | 6.22 | 38.1 | 6.83 | 38.8 | 6.90 |
| | 25 | 22.6 | 3.50 | 26.9 | 4.43 | 31.3 | 5.47 | 33.5 | 6.03 | 35.6 | 6.65 | 37.4 | 7.08 | 38.3 | 7.15 |
| | 27 | 22.6 | 3.74 | 26.9 | 4.73 | 31.3 | 5.87 | 33.5 | 6.47 | 35.6 | 7.14 | 36.8 | 7.33 | 37.7 | 7.40 |
| | 29 | 22.6 | 3.96 | 26.9 | 5.05 | 31.3 | 6.28 | 33.5 | 6.92 | 35.5 | 7.56 | 36.3 | 7.68 | 37.2 | 7.75 |
| | 31 | 22.6 | 4.21 | 26.9 | 5.38 | 31.3 | 6.69 | 33.5 | 7.45 | 35.1 | 7.87 | 35.5 | 8.00 | 36.6 | 8.07 |
| | 33 | 22.6 | 4.48 | 26.9 | 5.73 | 31.3 | 7.14 | 33.5 | 7.89 | 34.5 | 8.15 | 35.3 | 8.23 | 36.1 | 8.30 |
| | 35 | 22.6 | 4.77 | 26.9 | 6.10 | 31.3 | 7.61 | 33.5 | 8.41 | 33.9 | 8.45 | 34.7 | 8.52 | 35.5 | 8.60 |
| | 37 | 22.6 | 5.08 | 26.9 | 6.50 | 31.3 | 8.10 | 32.9 | 8.71 | 33.4 | 8.75 | 34.2 | 8.81 | 35.0 | 8.89 |
| | 39 | 22.6 | 5.41 | 26.9 | 6.92 | 31.3 | 8.63 | 32.5 | 9.00 | 32.6 | 9.04 | 33.7 | 9.11 | 34.2 | 9.19 |
| | 41 | 21.4 | 6.00 | 25.6 | 7.69 | 29.8 | 9.59 | 31.8 | 9.75 | 32.2 | 9.80 | 33.0 | 9.89 | 33.8 | 9.98 |
| | 44 | 19.9 | 6.53 | 24.2 | 8.36 | 28.4 | 10.65 | 30.5 | 11.01 | 30.9 | 10.56 | 31.8 | 10.40 | 32.7 | 10.49 |
| | 47 | 18.8 | 8.69 | 23.4 | 11.12 | 27.4 | 11.18 | 29.4 | 11.18 | 29.8 | 11.24 | 30.7 | 11.17 | 31.6 | 11.27 |
| | 50 | 17.2 | 8.53 | 21.0 | 10.92 | 24.5 | 11.79 | 26.2 | 12.95 | 26.6 | 12.34 | 27.4 | 12.11 | 28.4 | 11.87 |
| | 52 | 13.0 | 7.20 | 15.6 | 9.21 | 18.3 | 10.04 | 19.8 | 11.01 | 20.3 | 10.81 | 21.8 | 10.66 | 23.1 | 10.32 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 20.4 | 2.23 | 25.2 | 2.83 | 33.0 | 3.49 | 36.0 | 3.86 | 38.5 | 4.24 | 40.6 | 4.54 | 41.5 | 4.58 |
| | 0 | 20.4 | 2.24 | 25.2 | 2.83 | 33.0 | 3.50 | 36.0 | 3.86 | 38.5 | 4.25 | 40.6 | 4.55 | 41.5 | 4.59 |
| | 4 | 20.4 | 2.25 | 25.2 | 2.84 | 33.0 | 3.51 | 36.0 | 3.88 | 38.5 | 4.26 | 40.6 | 4.56 | 41.5 | 4.60 |
| | 7 | 20.4 | 2.29 | 25.2 | 2.89 | 33.0 | 3.57 | 36.0 | 3.95 | 38.5 | 4.34 | 40.2 | 4.65 | 40.9 | 4.69 |
| | 10 | 20.4 | 2.53 | 24.2 | 3.04 | 28.2 | 3.56 | 30.1 | 4.01 | 32.1 | 4.27 | 36.1 | 4.89 | 39.9 | 5.54 |
| | 12 | 20.4 | 2.56 | 24.2 | 3.08 | 28.2 | 3.61 | 30.1 | 4.06 | 32.1 | 4.35 | 36.1 | 4.98 | 39.9 | 5.61 |
| | 14 | 20.4 | 2.61 | 24.2 | 3.13 | 28.2 | 3.67 | 30.1 | 4.12 | 32.1 | 4.43 | 36.1 | 5.06 | 39.9 | 5.71 |
| | 16 | 20.4 | 2.67 | 24.2 | 3.20 | 28.2 | 3.75 | 30.1 | 4.22 | 32.1 | 4.53 | 36.1 | 5.18 | 39.8 | 5.82 |
| | 18 | 20.4 | 2.73 | 24.2 | 3.28 | 28.2 | 3.82 | 30.1 | 4.30 | 32.1 | 4.61 | 36.1 | 5.30 | 39.5 | 6.03 |
| | 20 | 20.4 | 2.77 | 24.2 | 3.33 | 28.2 | 3.95 | 30.1 | 4.39 | 32.1 | 4.81 | 36.1 | 5.69 | 38.8 | 6.28 |
| | 21 | 20.4 | 2.80 | 24.2 | 3.36 | 28.2 | 4.08 | 30.1 | 4.53 | 32.1 | 4.97 | 36.1 | 5.88 | 38.5 | 6.42 |
| | 23 | 20.4 | 2.87 | 24.2 | 3.59 | 28.2 | 4.39 | 30.1 | 4.87 | 32.1 | 5.32 | 36.1 | 6.32 | 37.9 | 6.75 |
| | 25 | 20.4 | 3.05 | 24.2 | 3.82 | 28.2 | 4.67 | 30.1 | 5.20 | 32.1 | 5.69 | 36.1 | 6.76 | 37.4 | 7.02 |
| | 27 | 20.4 | 3.26 | 24.2 | 4.08 | 28.2 | 5.01 | 30.1 | 5.55 | 32.1 | 6.09 | 36.1 | 7.21 | 36.8 | 7.33 |
| | 29 | 20.4 | 3.45 | 24.2 | 4.36 | 28.2 | 5.36 | 30.1 | 5.93 | 32.1 | 6.50 | 35.7 | 7.56 | 36.4 | 7.63 |
| | 31 | 20.4 | 3.67 | 24.2 | 4.64 | 28.2 | 5.72 | 30.1 | 6.33 | 32.1 | 6.94 | 35.1 | 7.84 | 35.8 | 7.94 |
| | 33 | 20.4 | 3.91 | 24.2 | 4.94 | 28.2 | 6.09 | 30.1 | 6.73 | 32.1 | 7.38 | 34.6 | 8.15 | 35.3 | 8.23 |
| | 35 | 20.4 | 4.16 | 24.2 | 5.26 | 28.2 | 6.50 | 30.1 | 7.18 | 32.1 | 7.90 | 34.0 | 8.45 | 34.7 | 8.53 |
| | 37 | 20.4 | 4.43 | 24.2 | 5.60 | 28.2 | 6.92 | 29.6 | 7.44 | 32.1 | 8.45 | 33.4 | 8.75 | 34.2 | 8.73 |
| | 39 | 20.4 | 4.72 | 24.2 | 5.97 | 28.2 | 7.37 | 29.2 | 7.68 | 32.1 | 8.96 | 32.9 | 9.08 | 33.6 | 9.05 |
| | 41 | 19.2 | 5.24 | 23.0 | 6.63 | 26.8 | 8.19 | 28.7 | 8.33 | 30.5 | 9.16 | 32.3 | 9.80 | 33.1 | 9.89 |
| | 44 | 17.9 | 5.70 | 21.8 | 7.21 | 25.5 | 9.10 | 27.4 | 9.41 | 29.3 | 9.87 | 31.1 | 10.31 | 31.9 | 10.40 |
| | 47 | 16.9 | 7.58 | 21.1 | 9.59 | 24.7 | 9.55 | 26.5 | 9.55 | 28.2 | 10.50 | 30.1 | 11.07 | 30.9 | 11.17 |
| | 50 | 15.5 | 7.44 | 18.9 | 9.42 | 22.0 | 10.07 | 23.6 | 11.06 | 25.2 | 11.53 | 26.8 | 12.00 | 27.8 | 11.77 |
| | 52 | 11.7 | 6.28 | 14.1 | 7.95 | 16.5 | 8.58 | 17.8 | 9.41 | 19.3 | 10.11 | 21.4 | 10.56 | 22.6 | 10.23 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 80% | -5 | 18.1 | 1.93 | 22.4 | 2.38 | 29.3 | 2.96 | 32.0 | 3.25 | 34.1 | 3.56 | 38.3 | 4.22 | 40.5 | 4.52 |
| | 0 | 18.1 | 1.93 | 22.4 | 2.38 | 29.3 | 2.96 | 32.0 | 3.26 | 34.1 | 3.56 | 38.3 | 4.23 | 40.5 | 4.53 |
| | 4 | 18.1 | 1.94 | 22.4 | 2.39 | 29.3 | 2.97 | 32.0 | 3.27 | 34.1 | 3.58 | 38.3 | 4.25 | 40.5 | 4.55 |
| | 7 | 18.1 | 1.98 | 22.4 | 2.44 | 29.3 | 3.03 | 32.0 | 3.33 | 34.1 | 3.64 | 38.0 | 4.33 | 39.9 | 4.63 |
| | 10 | 18.1 | 2.30 | 21.5 | 2.75 | 25.1 | 3.24 | 26.8 | 3.49 | 28.5 | 3.74 | 32.1 | 4.27 | 35.5 | 4.96 |
| | 12 | 18.1 | 2.33 | 21.5 | 2.80 | 25.1 | 3.30 | 26.8 | 3.56 | 28.5 | 3.81 | 32.1 | 4.34 | 35.5 | 4.92 |
| | 14 | 18.1 | 2.38 | 21.5 | 2.86 | 25.1 | 3.35 | 26.8 | 3.61 | 28.5 | 3.88 | 32.1 | 4.42 | 35.5 | 5.03 |
| | 16 | 18.1 | 2.41 | 21.5 | 2.90 | 25.1 | 3.42 | 26.8 | 3.68 | 28.5 | 3.94 | 32.1 | 4.52 | 35.5 | 5.21 |
| | 18 | 18.1 | 2.46 | 21.5 | 2.96 | 25.1 | 3.50 | 26.8 | 3.76 | 28.5 | 4.01 | 32.1 | 4.62 | 35.5 | 5.57 |
| | 20 | 18.1 | 2.50 | 21.5 | 3.01 | 25.1 | 3.56 | 26.8 | 3.83 | 28.5 | 4.10 | 32.1 | 4.79 | 35.5 | 5.78 |
| | 21 | 18.1 | 2.53 | 21.5 | 3.04 | 25.1 | 3.59 | 26.8 | 3.87 | 28.5 | 4.20 | 32.1 | 4.96 | 35.5 | 6.18 |
| | 23 | 18.1 | 2.57 | 21.5 | 3.10 | 25.1 | 3.76 | 26.8 | 4.12 | 28.5 | 4.49 | 32.1 | 5.30 | 35.5 | 6.61 |
| | 25 | 18.1 | 2.65 | 21.5 | 3.30 | 25.1 | 4.02 | 26.8 | 4.41 | 28.5 | 4.79 | 32.1 | 5.68 | 35.5 | 7.06 |
| | 27 | 18.1 | 2.82 | 21.5 | 3.51 | 25.1 | 4.28 | 26.8 | 4.70 | 28.5 | 5.14 | 32.1 | 6.06 | 35.5 | 7.31 |
| | 29 | 18.1 | 3.00 | 21.5 | 3.74 | 25.1 | 4.57 | 26.8 | 5.01 | 28.4 | 5.48 | 32.1 | 6.47 | 35.5 | 7.57 |
| | 31 | 18.1 | 3.18 | 21.5 | 3.98 | 25.1 | 4.86 | 26.8 | 5.34 | 28.4 | 5.84 | 32.1 | 6.90 | 34.9 | 7.85 |
| | 33 | 18.1 | 3.39 | 21.5 | 4.43 | 25.1 | 5.18 | 26.8 | 5.69 | 28.4 | 6.22 | 32.1 | 7.37 | 34.5 | 8.13 |
| | 35 | 18.1 | 3.59 | 21.5 | 4.43 | 25.1 | 5.51 | 26.8 | 6.06 | 28.4 | 6.63 | 32.1 | 7.86 | 33.9 | 8.43 |
| | 37 | 18.1 | 3.81 | 21.5 | 4.77 | 25.1 | 5.86 | 26.3 | 6.46 | 28.4 | 7.06 | 32.1 | 8.38 | 33.4 | 8.74 |
| | 39 | 18.1 | 4.03 | 21.5 | 5.06 | 25.1 | 6.23 | 26.0 | 6.87 | 28.4 | 7.51 | 32.1 | 8.92 | 32.8 | 9.06 |
| | 41 | 17.1 | 4.53 | 20.5 | 5.58 | 23.8 | 6.94 | 25.5 | 7.03 | 27.0 | 7.69 | 30.5 | 9.12 | 32.3 | 9.77 |
| | 44 | 15.9 | 4.92 | 19.4 | 6.07 | 22.7 | 7.71 | 24.4 | 7.94 | 26.0 | 8.28 | 29.4 | 9.59 | 31.1 | 10.28 |
| | 47 | 15.0 | 6.55 | 18.7 | 8.08 | 21.9 | 8.09 | 23.5 | 8.06 | 25.0 | 8.81 | 28.4 | 10.30 | 30.1 | 11.04 |
| | 50 | 13.7 | 6.43 | 16.8 | 7.93 | 19.6 | 8.53 | 21.0 | 9.33 | 22.3 | 9.67 | 25.3 | 11.17 | 27.1 | 11.63 |
| | 52 | 10.4 | 5.42 | 12.5 | 6.69 | 14.7 | 7.27 | 15.8 | 7.94 | 17.1 | 8.48 | 20.2 | 9.83 | 22.0 | 10.11 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 70% | -5 | 15.8 | 1.64 | 19.6 | 2.03 | 25.6 | 2.46 | 28.0 | 2.70 | 29.9 | 2.94 | 33.5 | 3.47 | 37.2 | 4.03 |
| | 0 | 15.8 | 1.65 | 19.6 | 2.04 | 25.6 | 2.47 | 28.0 | 2.71 | 29.9 | 2.95 | 33.5 | 3.47 | 37.2 | 4.04 |
| | 4 | 15.8 | 1.65 | 19.6 | 2.04 | 25.6 | 2.48 | 28.0 | 2.72 | 29.9 | 2.96 | 33.5 | 3.49 | 37.2 | 4.06 |
| | 7 | 15.8 | 1.68 | 19.6 | 2.08 | 25.6 | 2.52 | 28.0 | 2.77 | 29.9 | 3.02 | 33.2 | 3.55 | 36.7 | 4.13 |
| | 10 | 15.8 | 2.03 | 18.8 | 2.40 | 21.9 | 2.80 | 23.4 | 3.01 | 25.0 | 3.23 | 28.0 | 3.67 | 31.1 | 4.12 |
| | 12 | 15.8 | 2.05 | 18.8 | 2.44 | 21.9 | 2.86 | 23.4 | 3.07 | 25.0 | 3.29 | 28.0 | 3.74 | 31.1 | 4.20 |
| | 14 | 15.8 | 2.08 | 18.8 | 2.48 | 21.9 | 2.90 | 23.4 | 3.12 | 25.0 | 3.34 | 28.0 | 3.81 | 31.1 | 4.28 |
| | 16 | 15.8 | 2.12 | 18.8 | 2.53 | 21.9 | 2.96 | 23.4 | 3.18 | 25.0 | 3.41 | 28.0 | 3.87 | 31.1 | 4.36 |
| | 18 | 15.8 | 2.15 | 18.8 | 2.57 | 21.9 | 3.01 | 23.4 | 3.24 | 25.0 | 3.47 | 28.0 | 3.95 | 31.1 | 4.45 |
| | 20 | 15.8 | 2.19 | 18.8 | 2.62 | 21.9 | 3.07 | 23.4 | 3.30 | 25.0 | 3.53 | 28.0 | 4.03 | 31.1 | 4.58 |
| | 21 | 15.8 | 2.21 | 18.8 | 2.64 | 21.9 | 3.09 | 23.4 | 3.33 | 25.0 | 3.57 | 28.0 | 4.08 | 31.1 | 4.74 |
| | 23 | 15.8 | 2.24 | 18.8 | 2.69 | 21.9 | 3.16 | 23.4 | 3.44 | 25.0 | 3.75 | 28.0 | 4.38 | 31.1 | 5.08 |
| | 25 | 15.8 | 2.29 | 18.8 | 2.80 | 21.9 | 3.37 | 23.4 | 3.68 | 25.0 | 4.00 | 28.0 | 4.69 | 31.1 | 5.43 |
| | 27 | 15.8 | 2.42 | 18.8 | 2.98 | 21.9 | 3.59 | 23.4 | 3.92 | 25.0 | 4.27 | 28.0 | 5.01 | 31.1 | 5.80 |
| | 29 | 15.8 | 2.57 | 18.8 | 3.16 | 21.9 | 3.82 | 23.4 | 4.18 | 25.0 | 4.54 | 28.0 | 5.34 | 31.1 | 6.20 |
| | 31 | 15.8 | 2.72 | 18.8 | 3.35 | 21.9 | 4.07 | 23.4 | 4.44 | 25.0 | 4.84 | 28.0 | 5.69 | 31.1 | 6.61 |
| | 33 | 15.8 | 2.89 | 18.8 | 3.57 | 21.9 | 4.33 | 23.4 | 4.72 | 25.0 | 5.16 | 28.0 | 6.06 | 31.1 | 7.05 |
| | 35 | 15.8 | 3.06 | 18.8 | 3.78 | 21.9 | 4.59 | 23.4 | 5.03 | 25.0 | 5.48 | 28.0 | 6.46 | 31.1 | 7.51 |
| | 37 | 15.8 | 3.23 | 18.8 | 4.01 | 21.9 | 4.88 | 23.0 | 5.35 | 25.0 | 5.83 | 28.0 | 6.88 | 31.1 | 8.00 |
| | 39 | 15.8 | 3.42 | 18.8 | 4.25 | 21.9 | 5.18 | 22.7 | 5.68 | 25.0 | 6.20 | 28.0 | 7.31 | 31.1 | 8.52 |
| | 41 | 15.0 | 3.85 | 17.9 | 4.77 | 20.8 | 5.78 | 22.3 | 5.84 | 23.7 | 6.36 | 26.7 | 7.49 | 29.6 | 8.71 |
| | 44 | 13.9 | 4.19 | 17.0 | 5.18 | 19.9 | 6.42 | 21.3 | 6.59 | 22.8 | 6.85 | 25.7 | 7.88 | 28.6 | 9.16 |
| | 47 | 13.1 | 5.58 | 16.4 | 6.90 | 19.2 | 6.75 | 20.6 | 6.69 | 22.0 | 7.29 | 24.8 | 8.46 | 27.7 | 9.84 |
| | 50 | 12.0 | 5.48 | 14.7 | 6.77 | 17.1 | 7.11 | 18.4 | 7.75 | 19.6 | 8.01 | 22.2 | 9.17 | 24.9 | 10.37 |
| | 52 | 9.1 | 4.62 | 10.9 | 5.71 | 12.8 | 6.06 | 13.8 | 6.59 | 15.0 | 7.02 | 17.7 | 8.07 | 20.2 | 9.01 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 60% | -5 | 13.6 | 1.38 | 16.8 | 1.69 | 22.0 | 2.02 | 24.0 | 2.20 | 25.7 | 2.39 | 28.7 | 2.79 | 31.9 | 3.22 |
| | 0 | 13.6 | 1.38 | 16.8 | 1.69 | 22.0 | 2.02 | 24.0 | 2.21 | 25.7 | 2.40 | 28.7 | 2.80 | 31.9 | 3.23 |
| | 4 | 13.6 | 1.39 | 16.8 | 1.69 | 22.0 | 2.03 | 24.0 | 2.21 | 25.7 | 2.40 | 28.7 | 2.81 | 31.9 | 3.24 |
| | 7 | 13.6 | 1.41 | 16.8 | 1.73 | 22.0 | 2.07 | 24.0 | 2.26 | 25.7 | 2.45 | 28.5 | 2.86 | 31.5 | 3.30 |
| | 10 | 13.6 | 1.76 | 16.2 | 2.06 | 18.8 | 2.39 | 20.1 | 2.56 | 21.4 | 2.73 | 24.0 | 3.09 | 26.7 | 3.47 |
| | 12 | 13.6 | 1.79 | 16.2 | 2.10 | 18.8 | 2.44 | 20.1 | 2.61 | 21.4 | 2.78 | 24.0 | 3.15 | 26.7 | 3.52 |
| | 14 | 13.6 | 1.81 | 16.2 | 2.13 | 18.8 | 2.47 | 20.1 | 2.65 | 21.4 | 2.83 | 24.0 | 3.21 | 26.7 | 3.59 |
| | 16 | 13.6 | 1.84 | 16.2 | 2.16 | 18.8 | 2.52 | 20.1 | 2.70 | 21.4 | 2.88 | 24.0 | 3.26 | 26.7 | 3.66 |
| | 18 | 13.6 | 1.87 | 16.2 | 2.20 | 18.8 | 2.56 | 20.1 | 2.74 | 21.4 | 2.93 | 24.0 | 3.32 | 26.7 | 3.73 |
| | 20 | 13.6 | 1.89 | 16.2 | 2.24 | 18.8 | 2.61 | 20.1 | 2.80 | 21.4 | 2.99 | 24.0 | 3.39 | 26.7 | 3.81 |
| | 21 | 13.6 | 1.91 | 16.2 | 2.25 | 18.8 | 2.63 | 20.1 | 2.82 | 21.4 | 3.01 | 24.0 | 3.42 | 26.7 | 3.84 |
| | 23 | 13.6 | 1.94 | 16.2 | 2.30 | 18.8 | 2.67 | 20.1 | 2.88 | 21.4 | 3.07 | 24.0 | 3.56 | 26.7 | 4.09 |
| | 25 | 13.6 | 1.97 | 16.2 | 2.35 | 18.8 | 2.78 | 20.1 | 3.01 | 21.4 | 3.26 | 24.0 | 3.80 | 26.7 | 4.36 |
| | 27 | 13.6 | 2.05 | 16.2 | 2.48 | 18.8 | 2.96 | 20.1 | 3.22 | 21.4 | 3.48 | 24.0 | 4.04 | 26.7 | 4.66 |
| | 29 | 13.6 | 2.16 | 16.2 | 2.63 | 18.8 | 3.15 | 20.1 | 3.42 | 21.4 | 3.70 | 24.0 | 4.32 | 26.7 | 4.97 |
| | 31 | 13.6 | 2.30 | 16.2 | 2.80 | 18.8 | 3.34 | 20.1 | 3.64 | 21.4 | 3.94 | 24.0 | 4.59 | 26.7 | 5.29 |
| | 33 | 13.6 | 2.42 | 16.2 | 2.96 | 18.8 | 3.55 | 20.1 | 3.86 | 21.4 | 4.19 | 24.0 | 4.88 | 26.7 | 5.64 |
| | 35 | 13.6 | 2.57 | 16.2 | 3.14 | 18.8 | 3.76 | 20.1 | 4.10 | 21.4 | 4.45 | 24.0 | 5.20 | 26.7 | 6.00 |
| | 37 | 13.6 | 2.72 | 16.2 | 3.32 | 18.8 | 3.99 | 19.7 | 4.35 | 21.4 | 4.72 | 24.0 | 5.53 | 26.7 | 6.39 |
| | 39 | 13.6 | 2.87 | 16.2 | 3.51 | 18.8 | 4.23 | 19.5 | 4.61 | 21.4 | 5.02 | 24.0 | 5.87 | 26.7 | 6.80 |
| | 41 | 12.8 | 3.24 | 15.3 | 3.95 | 17.9 | 4.74 | 19.1 | 4.76 | 20.3 | 5.17 | 22.9 | 6.03 | 25.4 | 6.97 |
| | 44 | 11.9 | 3.52 | 14.5 | 4.30 | 17.0 | 5.27 | 18.3 | 5.37 | 19.5 | 5.57 | 22.0 | 6.34 | 24.5 | 7.33 |
| | 47 | 11.3 | 4.69 | 14.1 | 5.72 | 16.5 | 5.53 | 17.6 | 5.45 | 18.8 | 5.92 | 21.3 | 6.81 | 23.7 | 7.87 |
| | 50 | 10.3 | 4.60 | 12.6 | 5.62 | 14.7 | 5.83 | 15.7 | 6.32 | 16.8 | 6.50 | 19.0 | 7.38 | 21.3 | 8.29 |
| | 52 | 7.8 | 3.88 | 9.4 | 4.74 | 11.0 | 4.97 | 11.9 | 5.37 | 12.8 | 5.70 | 15.1 | 6.50 | 17.3 | 7.21 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 50% | -5 | 11.3 | 1.14 | 14.0 | 1.37 | 18.3 | 1.62 | 20.0 | 1.75 | 21.3 | 1.89 | 23.9 | 2.19 | 26.6 | 2.51 |
| | 0 | 11.3 | 1.15 | 14.0 | 1.37 | 18.3 | 1.62 | 20.0 | 1.76 | 21.3 | 1.90 | 23.9 | 2.19 | 26.6 | 2.51 |
| | 4 | 11.3 | 1.15 | 14.0 | 1.38 | 18.3 | 1.63 | 20.0 | 1.76 | 21.3 | 1.90 | 23.9 | 2.20 | 26.6 | 2.52 |
| | 7 | 11.3 | 1.17 | 14.0 | 1.40 | 18.3 | 1.66 | 20.0 | 1.79 | 21.3 | 1.94 | 23.7 | 2.24 | 26.2 | 2.57 |
| | 10 | 11.3 | 1.52 | 13.5 | 1.76 | 15.7 | 2.01 | 16.7 | 2.14 | 17.8 | 2.27 | 20.0 | 2.55 | 22.3 | 2.84 |
| | 12 | 11.3 | 1.53 | 13.5 | 1.78 | 15.7 | 2.04 | 16.7 | 2.16 | 17.8 | 2.31 | 20.0 | 2.59 | 22.3 | 2.89 |
| | 14 | 11.3 | 1.55 | 13.5 | 1.80 | 15.7 | 2.06 | 16.7 | 2.21 | 17.8 | 2.35 | 20.0 | 2.64 | 22.3 | 2.95 |
| | 16 | 11.3 | 1.57 | 13.5 | 1.82 | 15.7 | 2.10 | 16.7 | 2.24 | 17.8 | 2.38 | 20.0 | 2.69 | 22.3 | 2.99 |
| | 18 | 11.3 | 1.60 | 13.5 | 1.86 | 15.7 | 2.13 | 16.7 | 2.28 | 17.8 | 2.42 | 20.0 | 2.73 | 22.3 | 3.05 |
| | 20 | 11.3 | 1.62 | 13.5 | 1.88 | 15.7 | 2.16 | 16.7 | 2.32 | 17.8 | 2.47 | 20.0 | 2.79 | 22.3 | 3.10 |
| | 21 | 11.3 | 1.63 | 13.5 | 1.90 | 15.7 | 2.19 | 16.7 | 2.33 | 17.8 | 2.49 | 20.0 | 2.81 | 22.3 | 3.14 |
| | 23 | 11.3 | 1.65 | 13.5 | 1.93 | 15.7 | 2.22 | 16.7 | 2.38 | 17.8 | 2.54 | 20.0 | 2.86 | 22.3 | 3.21 |
| | 25 | 11.3 | 1.68 | 13.5 | 1.96 | 15.7 | 2.27 | 16.7 | 2.42 | 17.8 | 2.62 | 20.0 | 3.00 | 22.3 | 3.42 |
| | 27 | 11.3 | 1.71 | 13.5 | 2.04 | 15.7 | 2.39 | 16.7 | 2.58 | 17.8 | 2.78 | 20.0 | 3.20 | 22.3 | 3.65 |
| | 29 | 11.3 | 1.80 | 13.5 | 2.15 | 15.7 | 2.54 | 16.7 | 2.74 | 17.8 | 2.96 | 20.0 | 3.40 | 22.3 | 3.89 |
| | 31 | 11.3 | 1.90 | 13.5 | 2.28 | 15.7 | 2.71 | 16.7 | 2.91 | 17.8 | 3.14 | 20.0 | 3.61 | 22.3 | 4.14 |
| | 33 | 11.3 | 2.02 | 13.5 | 2.41 | 15.7 | 2.86 | 16.7 | 3.08 | 17.8 | 3.33 | 20.0 | 3.84 | 22.3 | 4.40 |
| | 35 | 11.3 | 2.13 | 13.5 | 2.55 | 15.7 | 3.01 | 16.7 | 3.26 | 17.8 | 3.52 | 20.0 | 4.08 | 22.3 | 4.67 |
| | 37 | 11.3 | 2.24 | 13.5 | 2.70 | 15.7 | 3.20 | 16.5 | 3.46 | 17.8 | 3.74 | 20.0 | 4.33 | 22.3 | 4.96 |
| | 39 | 11.3 | 2.37 | 13.5 | 2.84 | 15.7 | 3.38 | 16.2 | 3.66 | 17.8 | 3.97 | 20.0 | 4.59 | 22.3 | 5.27 |
| | 41 | 10.7 | 2.68 | 12.8 | 3.21 | 14.9 | 3.80 | 15.9 | 3.79 | 16.9 | 4.09 | 19.1 | 4.73 | 21.2 | 5.41 |
| | 44 | 9.9 | 2.92 | 12.1 | 3.49 | 14.2 | 4.22 | 15.2 | 4.27 | 16.2 | 4.40 | 18.3 | 4.98 | 20.5 | 5.69 |
| | 47 | 9.4 | 3.88 | 11.7 | 4.65 | 13.7 | 4.43 | 14.7 | 4.34 | 15.6 | 4.69 | 17.7 | 5.34 | 19.8 | 6.12 |
| | 50 | 8.6 | 3.81 | 10.5 | 4.56 | 12.2 | 4.67 | 13.1 | 5.03 | 13.9 | 5.14 | 15.8 | 5.79 | 17.8 | 6.44 |
| | 52 | 6.5 | 3.22 | 7.8 | 3.85 | 9.2 | 3.98 | 9.9 | 4.27 | 10.7 | 4.51 | 12.6 | 5.10 | 14.5 | 5.60 |

CHV-5S400NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 135% | -5 | 35.1 | 4.71 | 41.9 | 5.73 | 48.6 | 5.80 | 50.4 | 5.83 | 51.4 | 5.86 | 52.7 | 5.93 | 54.3 | 6.00 |
| | 0 | 35.1 | 4.72 | 41.9 | 5.74 | 48.6 | 5.81 | 50.4 | 5.84 | 51.4 | 5.88 | 52.7 | 5.94 | 54.3 | 6.01 |
| | 4 | 35.1 | 4.73 | 41.9 | 5.77 | 48.6 | 5.83 | 50.4 | 5.87 | 51.4 | 5.90 | 52.7 | 5.97 | 54.3 | 6.03 |
| | 7 | 35.1 | 4.82 | 41.9 | 5.87 | 48.6 | 5.94 | 50.4 | 5.97 | 51.4 | 6.01 | 52.3 | 6.08 | 53.6 | 6.14 |
| | 10 | 35.1 | 4.91 | 41.9 | 6.00 | 48.6 | 7.13 | 50.4 | 7.29 | 51.0 | 7.15 | 52.3 | 6.84 | 53.6 | 6.53 |
| | 12 | 35.1 | 4.99 | 41.9 | 6.11 | 48.6 | 7.28 | 49.7 | 7.25 | 50.4 | 7.10 | 51.6 | 6.79 | 52.9 | 6.69 |
| | 14 | 35.1 | 5.09 | 41.9 | 6.23 | 48.4 | 7.36 | 49.1 | 7.22 | 49.7 | 7.06 | 51.0 | 7.00 | 52.3 | 7.07 |
| | 16 | 35.1 | 5.18 | 41.9 | 6.36 | 47.9 | 7.33 | 48.4 | 7.28 | 49.0 | 7.30 | 50.3 | 7.38 | 51.6 | 7.45 |
| | 18 | 35.1 | 5.28 | 41.9 | 6.49 | 47.1 | 7.61 | 47.7 | 7.65 | 48.4 | 7.69 | 49.7 | 7.76 | 51.0 | 7.84 |
| | 20 | 35.1 | 5.40 | 41.9 | 6.90 | 46.4 | 7.98 | 47.1 | 8.02 | 47.7 | 8.06 | 49.0 | 8.14 | 50.3 | 8.22 |
| | 21 | 35.1 | 5.54 | 41.9 | 7.15 | 46.1 | 8.17 | 46.9 | 8.21 | 47.4 | 8.25 | 48.7 | 8.34 | 50.0 | 8.41 |
| | 23 | 35.1 | 5.94 | 41.9 | 7.66 | 45.6 | 8.54 | 46.1 | 8.58 | 46.7 | 8.62 | 48.0 | 8.71 | 49.3 | 8.80 |
| | 25 | 35.1 | 6.34 | 41.9 | 8.21 | 44.9 | 8.91 | 45.6 | 8.95 | 46.1 | 9.01 | 47.4 | 9.10 | 48.7 | 9.18 |
| | 27 | 35.1 | 6.77 | 41.9 | 8.78 | 44.3 | 7.85 | 44.9 | 9.34 | 45.4 | 9.38 | 46.7 | 9.49 | 48.0 | 9.59 |
| | 29 | 35.1 | 7.23 | 41.9 | 9.38 | 43.6 | 9.66 | 44.1 | 9.71 | 44.9 | 9.77 | 46.1 | 9.87 | 47.4 | 9.97 |
| | 31 | 35.1 | 7.72 | 41.7 | 9.93 | 42.9 | 10.05 | 43.6 | 10.10 | 44.1 | 10.15 | 45.4 | 10.26 | 46.7 | 10.38 |
| | 33 | 35.1 | 8.22 | 41.0 | 10.30 | 42.3 | 10.40 | 42.9 | 10.48 | 43.6 | 10.53 | 44.9 | 10.65 | 46.0 | 10.78 |
| | 35 | 35.1 | 8.77 | 40.3 | 10.68 | 41.6 | 10.81 | 42.3 | 10.86 | 42.9 | 10.92 | 44.1 | 11.05 | 45.4 | 11.16 |
| | 37 | 35.1 | 9.33 | 39.7 | 11.06 | 41.0 | 11.19 | 41.6 | 11.25 | 42.3 | 11.32 | 43.4 | 11.45 | 44.7 | 11.58 |
| | 39 | 35.1 | 9.93 | 39.0 | 11.44 | 40.3 | 11.57 | 41.0 | 11.64 | 41.6 | 11.71 | 42.9 | 11.84 | 44.1 | 11.98 |
| | 41 | 33.2 | 11.05 | 38.3 | 13.45 | 39.5 | 13.61 | 40.2 | 12.60 | 40.8 | 12.67 | 42.0 | 12.82 | 43.3 | 12.95 |
| | 44 | 30.9 | 12.01 | 36.3 | 14.63 | 37.6 | 15.13 | 38.5 | 14.23 | 39.1 | 13.65 | 40.4 | 13.48 | 41.8 | 13.62 |
| | 47 | 29.2 | 15.98 | 35.0 | 19.46 | 36.4 | 15.88 | 37.1 | 14.45 | 37.7 | 14.52 | 39.1 | 14.47 | 40.4 | 14.63 |
| | 50 | 26.7 | 15.69 | 31.4 | 19.11 | 32.5 | 16.75 | 33.1 | 16.73 | 33.6 | 15.94 | 34.9 | 15.69 | 36.3 | 15.41 |
| | 52 | 20.2 | 13.24 | 23.4 | 16.12 | 24.3 | 14.26 | 24.9 | 14.23 | 25.7 | 13.98 | 27.8 | 13.81 | 29.5 | 13.40 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 120% | -5 | 32.4 | 4.19 | 40.1 | 5.42 | 47.7 | 5.76 | 49.4 | 5.79 | 50.6 | 5.83 | 51.7 | 5.89 | 53.1 | 5.95 |
| | 0 | 32.4 | 4.20 | 40.1 | 5.44 | 47.7 | 5.77 | 49.4 | 5.81 | 50.6 | 5.84 | 51.7 | 5.90 | 53.1 | 5.96 |
| | 4 | 32.4 | 4.22 | 40.1 | 5.46 | 47.7 | 5.80 | 49.4 | 5.83 | 50.6 | 5.86 | 51.7 | 5.92 | 53.1 | 5.98 |
| | 7 | 32.4 | 4.29 | 40.1 | 5.56 | 47.7 | 5.90 | 49.4 | 5.94 | 50.6 | 5.97 | 51.3 | 6.03 | 52.4 | 6.09 |
| | 10 | 32.4 | 4.48 | 38.6 | 5.47 | 44.9 | 6.50 | 48.0 | 7.03 | 50.3 | 7.33 | 51.4 | 7.05 | 52.6 | 6.77 |
| | 12 | 32.4 | 4.56 | 38.6 | 5.57 | 44.9 | 6.63 | 48.0 | 7.16 | 49.6 | 7.29 | 50.7 | 7.02 | 51.9 | 6.73 |
| | 14 | 32.4 | 4.65 | 38.6 | 5.68 | 44.9 | 6.76 | 48.0 | 7.30 | 48.9 | 7.25 | 50.1 | 6.97 | 51.3 | 7.02 |
| | 16 | 32.4 | 4.74 | 38.6 | 5.80 | 44.9 | 6.89 | 47.7 | 7.36 | 48.3 | 7.26 | 49.4 | 7.33 | 50.6 | 7.39 |
| | 18 | 32.4 | 4.82 | 38.6 | 5.91 | 44.9 | 7.13 | 47.0 | 7.61 | 47.6 | 7.63 | 48.7 | 7.71 | 50.0 | 7.78 |
| | 20 | 32.4 | 4.92 | 38.6 | 6.14 | 44.9 | 7.66 | 46.4 | 7.98 | 47.0 | 8.01 | 48.1 | 8.08 | 49.3 | 8.15 |
| | 21 | 32.4 | 4.97 | 38.6 | 6.36 | 44.9 | 7.94 | 46.0 | 8.17 | 46.6 | 8.19 | 47.9 | 8.27 | 49.0 | 8.35 |
| | 23 | 32.4 | 5.31 | 38.6 | 6.82 | 44.9 | 8.50 | 45.4 | 8.52 | 46.0 | 8.57 | 47.1 | 8.65 | 48.3 | 8.72 |
| | 25 | 32.4 | 5.67 | 38.6 | 7.29 | 44.1 | 8.87 | 44.7 | 8.90 | 45.3 | 8.94 | 46.6 | 9.03 | 47.7 | 9.11 |
| | 27 | 32.4 | 6.06 | 38.6 | 7.79 | 43.6 | 9.23 | 44.1 | 9.28 | 44.7 | 9.33 | 45.9 | 9.41 | 47.0 | 9.50 |
| | 29 | 32.4 | 6.46 | 38.6 | 8.32 | 42.9 | 9.60 | 43.4 | 9.66 | 44.0 | 9.70 | 45.1 | 9.80 | 46.4 | 9.89 |
| | 31 | 32.4 | 6.89 | 38.6 | 8.88 | 42.3 | 9.99 | 42.9 | 10.03 | 43.4 | 10.09 | 44.6 | 10.19 | 45.7 | 10.29 |
| | 33 | 32.4 | 7.33 | 38.6 | 9.49 | 41.6 | 10.36 | 42.1 | 10.42 | 42.7 | 10.46 | 43.9 | 10.58 | 45.0 | 10.68 |
| | 35 | 32.4 | 7.81 | 38.6 | 10.10 | 40.9 | 10.73 | 41.4 | 10.79 | 42.1 | 10.85 | 43.3 | 10.96 | 44.4 | 11.08 |
| | 37 | 32.4 | 8.31 | 38.6 | 10.76 | 40.3 | 11.12 | 40.9 | 11.18 | 41.4 | 11.24 | 42.6 | 11.35 | 43.7 | 11.48 |
| | 39 | 32.4 | 8.84 | 38.4 | 11.37 | 39.6 | 11.49 | 40.1 | 11.57 | 40.7 | 11.62 | 42.0 | 11.75 | 43.1 | 11.87 |
| | 41 | 30.6 | 9.84 | 36.6 | 12.73 | 38.8 | 13.52 | 39.4 | 12.52 | 40.1 | 12.58 | 41.2 | 12.72 | 42.3 | 12.85 |
| | 44 | 28.5 | 10.69 | 34.7 | 13.84 | 37.0 | 15.03 | 37.7 | 14.14 | 38.5 | 13.56 | 39.7 | 13.38 | 40.9 | 13.52 |
| | 47 | 26.9 | 14.23 | 33.6 | 18.42 | 35.8 | 15.78 | 36.4 | 14.35 | 37.1 | 14.43 | 38.3 | 14.36 | 39.5 | 14.51 |
| | 50 | 24.6 | 13.97 | 30.1 | 18.08 | 31.9 | 16.64 | 32.4 | 16.62 | 33.1 | 15.84 | 34.2 | 15.57 | 35.5 | 15.29 |
| | 52 | 18.7 | 11.79 | 22.4 | 15.25 | 23.9 | 14.17 | 24.4 | 14.14 | 25.3 | 13.89 | 27.3 | 13.70 | 28.9 | 13.29 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 110% | -5 | 29.7 | 3.71 | 36.8 | 4.77 | 47.1 | 5.73 | 48.6 | 5.76 | 49.5 | 5.79 | 50.5 | 5.84 | 51.9 | 5.90 |
| | 0 | 29.7 | 3.71 | 36.8 | 4.78 | 47.1 | 5.74 | 48.6 | 5.77 | 49.5 | 5.80 | 50.5 | 5.85 | 51.9 | 5.91 |
| | 4 | 29.7 | 3.73 | 36.8 | 4.80 | 47.1 | 5.76 | 48.6 | 5.79 | 49.5 | 5.82 | 50.5 | 5.87 | 51.9 | 5.93 |
| | 7 | 29.7 | 3.80 | 36.8 | 4.89 | 47.1 | 5.86 | 48.6 | 5.90 | 49.5 | 5.93 | 50.1 | 5.98 | 51.2 | 6.04 |
| | 10 | 29.7 | 4.06 | 35.4 | 4.95 | 41.1 | 5.88 | 44.0 | 6.36 | 46.9 | 6.84 | 50.4 | 7.26 | 51.6 | 7.02 |
| | 12 | 29.7 | 4.15 | 35.4 | 5.05 | 41.1 | 6.00 | 44.0 | 6.49 | 46.9 | 6.97 | 49.9 | 7.23 | 50.9 | 6.97 |
| | 14 | 29.7 | 4.22 | 35.4 | 5.14 | 41.1 | 6.11 | 44.0 | 6.60 | 46.9 | 7.10 | 49.1 | 7.23 | 50.3 | 6.96 |
| | 16 | 29.7 | 4.29 | 35.4 | 5.24 | 41.1 | 6.23 | 44.0 | 6.73 | 46.9 | 7.25 | 48.6 | 7.28 | 49.6 | 7.35 |
| | 18 | 29.7 | 4.38 | 35.4 | 5.34 | 41.1 | 6.36 | 44.0 | 6.92 | 46.9 | 7.59 | 47.9 | 7.65 | 49.0 | 7.72 |
| | 20 | 29.7 | 4.46 | 35.4 | 5.45 | 41.1 | 6.73 | 44.0 | 7.43 | 46.1 | 7.96 | 47.3 | 8.02 | 48.3 | 8.09 |
| | 21 | 29.7 | 4.51 | 35.4 | 5.61 | 41.1 | 6.97 | 44.0 | 7.71 | 45.9 | 8.15 | 46.9 | 8.21 | 48.0 | 8.28 |
| | 23 | 29.7 | 4.72 | 35.4 | 6.01 | 41.1 | 7.48 | 44.0 | 8.27 | 45.1 | 8.51 | 46.3 | 8.60 | 47.3 | 8.67 |
| | 25 | 29.7 | 5.02 | 35.4 | 6.43 | 41.1 | 7.99 | 44.0 | 8.85 | 44.6 | 8.88 | 45.6 | 8.97 | 46.7 | 9.04 |
| | 27 | 29.7 | 5.37 | 35.4 | 6.87 | 41.1 | 8.55 | 43.3 | 9.23 | 43.9 | 9.26 | 45.0 | 9.34 | 46.0 | 9.43 |
| | 29 | 29.7 | 5.73 | 35.4 | 7.33 | 41.1 | 9.14 | 42.7 | 9.60 | 43.3 | 9.64 | 44.3 | 9.73 | 45.4 | 9.82 |
| | 31 | 29.7 | 6.10 | 35.4 | 7.82 | 41.1 | 9.76 | 42.0 | 9.97 | 42.6 | 10.02 | 43.7 | 10.10 | 44.7 | 10.20 |
| | 33 | 29.7 | 6.49 | 35.4 | 8.34 | 40.9 | 10.29 | 41.4 | 10.35 | 42.0 | 10.39 | 43.0 | 10.49 | 44.1 | 10.59 |
| | 35 | 29.7 | 6.90 | 35.4 | 8.88 | 40.3 | 10.66 | 40.7 | 10.72 | 41.3 | 10.78 | 42.3 | 10.88 | 43.4 | 10.98 |
| | 37 | 29.7 | 7.35 | 35.4 | 9.46 | 39.6 | 11.05 | 40.1 | 11.09 | 40.6 | 11.15 | 41.7 | 11.26 | 42.7 | 11.37 |
| | 39 | 29.7 | 7.81 | 35.4 | 10.07 | 38.9 | 11.42 | 39.4 | 11.48 | 40.0 | 11.54 | 41.0 | 11.65 | 42.1 | 11.77 |
| | 41 | 28.1 | 8.70 | 33.7 | 11.19 | 38.3 | 13.43 | 38.7 | 12.43 | 39.3 | 12.50 | 40.3 | 12.62 | 41.4 | 12.73 |
| | 44 | 26.1 | 9.46 | 31.9 | 12.17 | 36.5 | 14.93 | 37.1 | 14.04 | 37.7 | 13.47 | 38.7 | 13.27 | 40.0 | 13.39 |
| | 47 | 24.7 | 12.58 | 30.8 | 16.19 | 35.3 | 15.67 | 35.7 | 14.26 | 36.3 | 14.33 | 37.4 | 14.25 | 38.7 | 14.38 |
| | 50 | 22.6 | 12.36 | 27.6 | 15.90 | 31.5 | 16.53 | 31.9 | 16.51 | 32.4 | 15.73 | 33.4 | 15.45 | 34.7 | 15.15 |
| | 52 | 17.1 | 10.42 | 20.5 | 13.41 | 23.6 | 14.07 | 24.0 | 14.04 | 24.8 | 13.79 | 26.6 | 13.60 | 28.2 | 13.17 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 100% | -5 | 27.0 | 3.24 | 33.4 | 4.15 | 43.7 | 5.17 | 47.7 | 5.72 | 48.5 | 5.75 | 49.4 | 5.80 | 50.7 | 5.85 |
| | 0 | 27.0 | 3.25 | 33.4 | 4.16 | 43.7 | 5.18 | 47.7 | 5.73 | 48.5 | 5.76 | 49.4 | 5.81 | 50.7 | 5.86 |
| | 4 | 27.0 | 3.26 | 33.4 | 4.17 | 43.7 | 5.20 | 47.7 | 5.75 | 48.5 | 5.78 | 49.4 | 5.83 | 50.7 | 5.88 |
| | 7 | 27.0 | 3.32 | 33.4 | 4.25 | 43.7 | 5.30 | 47.7 | 5.86 | 48.5 | 5.89 | 49.0 | 5.94 | 50.0 | 5.99 |
| | 10 | 27.0 | 3.67 | 32.1 | 4.46 | 37.4 | 5.28 | 40.0 | 5.70 | 42.6 | 6.15 | 47.8 | 6.97 | 50.6 | 7.24 |
| | 12 | 27.0 | 3.72 | 32.1 | 4.52 | 37.4 | 5.35 | 40.0 | 5.77 | 42.6 | 6.27 | 47.8 | 7.09 | 49.8 | 7.18 |
| | 14 | 27.0 | 3.79 | 32.1 | 4.60 | 37.4 | 5.44 | 40.0 | 5.88 | 42.6 | 6.39 | 47.8 | 7.21 | 49.3 | 7.12 |
| | 16 | 27.0 | 3.87 | 32.1 | 4.70 | 37.4 | 5.56 | 40.0 | 6.01 | 42.6 | 6.53 | 47.7 | 7.37 | 48.6 | 7.29 |
| | 18 | 27.0 | 3.96 | 32.1 | 4.81 | 37.4 | 5.67 | 40.0 | 6.13 | 42.6 | 6.66 | 47.0 | 7.51 | 48.0 | 7.63 |
| | 20 | 27.0 | 4.02 | 32.1 | 4.88 | 37.4 | 5.86 | 40.0 | 6.45 | 42.6 | 7.08 | 46.3 | 7.91 | 47.3 | 8.03 |
| | 21 | 27.0 | 4.06 | 32.1 | 4.93 | 37.4 | 6.06 | 40.0 | 6.67 | 42.6 | 7.33 | 46.0 | 8.18 | 47.0 | 8.25 |
| | 23 | 27.0 | 4.16 | 32.1 | 5.27 | 37.4 | 6.51 | 40.0 | 7.17 | 42.6 | 7.88 | 45.4 | 8.66 | 46.3 | 8.73 |
| | 25 | 27.0 | 4.43 | 32.1 | 5.61 | 37.4 | 6.93 | 40.0 | 7.63 | 42.6 | 8.43 | 44.7 | 8.97 | 45.7 | 9.05 |
| | 27 | 27.0 | 4.73 | 32.1 | 5.99 | 37.4 | 7.44 | 40.0 | 8.19 | 42.6 | 9.04 | 44.0 | 9.28 | 45.0 | 9.37 |
| | 29 | 27.0 | 5.01 | 32.1 | 6.40 | 37.4 | 7.95 | 40.0 | 8.76 | 42.4 | 9.58 | 43.4 | 9.73 | 44.4 | 9.82 |
| | 31 | 27.0 | 5.33 | 32.1 | 6.81 | 37.4 | 8.48 | 40.0 | 9.44 | 41.9 | 9.96 | 42.4 | 10.13 | 43.7 | 10.22 |
| | 33 | 27.0 | 5.67 | 32.1 | 7.26 | 37.4 | 9.04 | 40.0 | 9.99 | 41.1 | 10.33 | 42.2 | 10.42 | 43.1 | 10.51 |
| | 35 | 27.0 | 6.04 | 32.1 | 7.73 | 37.4 | 9.64 | 40.0 | 10.65 | 40.4 | 10.70 | 41.4 | 10.80 | 42.4 | 10.89 |
| | 37 | 27.0 | 6.43 | 32.1 | 8.23 | 37.4 | 10.26 | 39.3 | 11.03 | 39.9 | 11.09 | 40.8 | 11.16 | 41.8 | 11.26 |
| | 39 | 27.0 | 6.85 | 32.1 | 8.77 | 37.4 | 10.93 | 38.8 | 11.40 | 39.0 | 11.45 | 40.3 | 11.53 | 40.8 | 11.64 |
| | 41 | 25.5 | 7.61 | 30.5 | 9.74 | 35.6 | 12.14 | 38.0 | 12.35 | 38.4 | 12.41 | 39.4 | 12.52 | 40.4 | 12.64 |
| | 44 | 23.8 | 8.27 | 28.9 | 10.59 | 33.9 | 13.49 | 36.4 | 13.95 | 36.9 | 13.38 | 37.9 | 13.17 | 39.0 | 13.29 |
| | 47 | 22.4 | 11.00 | 28.0 | 14.09 | 32.8 | 14.17 | 35.1 | 14.16 | 35.6 | 14.23 | 36.6 | 14.14 | 37.7 | 14.27 |
| | 50 | 20.5 | 10.80 | 25.1 | 13.83 | 29.2 | 14.94 | 31.3 | 16.40 | 31.7 | 15.62 | 32.7 | 15.33 | 33.9 | 15.03 |
| | 52 | 15.6 | 9.11 | 18.6 | 11.67 | 21.9 | 12.72 | 23.6 | 13.95 | 24.3 | 13.70 | 26.1 | 13.50 | 27.6 | 13.07 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 24.3 | 2.83 | 30.1 | 3.58 | 39.4 | 4.42 | 42.9 | 4.88 | 46.0 | 5.37 | 48.5 | 5.75 | 49.5 | 5.80 |
| | 0 | 24.3 | 2.83 | 30.1 | 3.59 | 39.4 | 4.43 | 42.9 | 4.89 | 46.0 | 5.38 | 48.5 | 5.76 | 49.5 | 5.81 |
| | 4 | 24.3 | 2.84 | 30.1 | 3.60 | 39.4 | 4.44 | 42.9 | 4.91 | 46.0 | 5.40 | 48.5 | 5.78 | 49.5 | 5.83 |
| | 7 | 24.3 | 2.90 | 30.1 | 3.67 | 39.4 | 4.53 | 42.9 | 5.00 | 46.0 | 5.50 | 48.1 | 5.89 | 48.9 | 5.94 |
| | 10 | 24.3 | 3.21 | 28.9 | 3.85 | 33.7 | 4.51 | 36.0 | 5.08 | 38.3 | 5.41 | 43.1 | 6.19 | 47.7 | 7.02 |
| | 12 | 24.3 | 3.25 | 28.9 | 3.90 | 33.7 | 4.57 | 36.0 | 5.15 | 38.3 | 5.51 | 43.1 | 6.30 | 47.7 | 7.11 |
| | 14 | 24.3 | 3.30 | 28.9 | 3.97 | 33.7 | 4.65 | 36.0 | 5.22 | 38.3 | 5.61 | 43.1 | 6.41 | 47.7 | 7.23 |
| | 16 | 24.3 | 3.38 | 28.9 | 4.06 | 33.7 | 4.75 | 36.0 | 5.34 | 38.3 | 5.73 | 43.1 | 6.56 | 47.6 | 7.37 |
| | 18 | 24.3 | 3.45 | 28.9 | 4.15 | 33.7 | 4.84 | 36.0 | 5.44 | 38.3 | 5.84 | 43.1 | 6.71 | 47.1 | 7.63 |
| | 20 | 24.3 | 3.51 | 28.9 | 4.21 | 33.7 | 5.00 | 36.0 | 5.56 | 38.3 | 6.09 | 43.1 | 7.21 | 46.3 | 7.95 |
| | 21 | 24.3 | 3.54 | 28.9 | 4.25 | 33.7 | 5.17 | 36.0 | 5.74 | 38.3 | 6.30 | 43.1 | 7.45 | 46.0 | 8.13 |
| | 23 | 24.3 | 3.63 | 28.9 | 4.54 | 33.7 | 5.56 | 36.0 | 6.17 | 38.3 | 6.74 | 43.1 | 8.01 | 45.3 | 8.55 |
| | 25 | 24.3 | 3.86 | 28.9 | 4.83 | 33.7 | 5.92 | 36.0 | 6.59 | 38.3 | 7.21 | 43.1 | 8.56 | 44.7 | 8.90 |
| | 27 | 24.3 | 4.13 | 28.9 | 5.17 | 33.7 | 6.35 | 36.0 | 7.03 | 38.3 | 7.72 | 43.1 | 9.14 | 44.0 | 9.29 |
| | 29 | 24.3 | 4.37 | 28.9 | 5.52 | 33.7 | 6.79 | 36.0 | 7.51 | 38.3 | 8.24 | 42.6 | 9.58 | 43.4 | 9.66 |
| | 31 | 24.3 | 4.65 | 28.9 | 5.88 | 33.7 | 7.24 | 36.0 | 8.02 | 38.3 | 8.79 | 41.9 | 9.93 | 42.7 | 10.06 |
| | 33 | 24.3 | 4.95 | 28.9 | 6.26 | 33.7 | 7.72 | 36.0 | 8.53 | 38.3 | 9.35 | 41.3 | 10.33 | 42.1 | 10.42 |
| | 35 | 24.3 | 5.27 | 28.9 | 6.67 | 33.7 | 8.23 | 36.0 | 9.09 | 38.3 | 10.00 | 40.6 | 10.70 | 41.4 | 10.80 |
| | 37 | 24.3 | 5.61 | 28.9 | 7.10 | 33.7 | 8.76 | 35.4 | 9.42 | 38.3 | 10.70 | 39.9 | 11.09 | 40.9 | 11.06 |
| | 39 | 24.3 | 5.97 | 28.9 | 7.56 | 33.7 | 9.33 | 34.9 | 9.73 | 38.3 | 11.34 | 39.3 | 11.50 | 40.1 | 11.47 |
| | 41 | 23.0 | 6.64 | 27.5 | 8.40 | 32.0 | 10.37 | 34.2 | 10.55 | 36.4 | 11.60 | 38.6 | 12.42 | 39.5 | 12.53 |
| | 44 | 21.4 | 7.21 | 26.0 | 9.13 | 30.5 | 11.52 | 32.8 | 11.91 | 35.0 | 12.50 | 37.2 | 13.06 | 38.1 | 13.17 |
| | 47 | 20.2 | 9.60 | 25.2 | 12.15 | 29.5 | 12.10 | 31.6 | 12.09 | 33.7 | 13.30 | 35.9 | 14.02 | 36.9 | 14.15 |
| | 50 | 18.5 | 9.43 | 22.6 | 11.93 | 26.3 | 12.76 | 28.2 | 14.00 | 30.1 | 14.60 | 32.1 | 15.20 | 33.1 | 14.90 |
| | 52 | 14.0 | 7.95 | 16.8 | 10.07 | 19.7 | 10.86 | 21.2 | 11.91 | 23.0 | 12.80 | 25.6 | 13.38 | 26.9 | 12.96 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80% | -5 | 21.6 | 2.44 | 26.7 | 3.01 | 35.0 | 3.75 | 38.2 | 4.12 | 40.7 | 4.51 | 45.7 | 5.35 | 48.3 | 5.73 |
| | 0 | 21.6 | 2.45 | 26.7 | 3.02 | 35.0 | 3.75 | 38.2 | 4.13 | 40.7 | 4.51 | 45.7 | 5.36 | 48.3 | 5.74 |
| | 4 | 21.6 | 2.46 | 26.7 | 3.03 | 35.0 | 3.77 | 38.2 | 4.15 | 40.7 | 4.53 | 45.7 | 5.38 | 48.3 | 5.76 |
| | 7 | 21.6 | 2.50 | 26.7 | 3.09 | 35.0 | 3.84 | 38.2 | 4.22 | 40.7 | 4.62 | 45.3 | 5.48 | 47.7 | 5.87 |
| | 10 | 21.6 | 2.91 | 25.7 | 3.49 | 29.9 | 4.10 | 32.0 | 4.42 | 34.1 | 4.73 | 38.3 | 5.41 | 42.4 | 6.28 |
| | 12 | 21.6 | 2.96 | 25.7 | 3.54 | 29.9 | 4.18 | 32.0 | 4.51 | 34.1 | 4.82 | 38.3 | 5.50 | 42.4 | 6.23 |
| | 14 | 21.6 | 3.01 | 25.7 | 3.62 | 29.9 | 4.25 | 32.0 | 4.58 | 34.1 | 4.91 | 38.3 | 5.60 | 42.4 | 6.37 |
| | 16 | 21.6 | 3.06 | 25.7 | 3.67 | 29.9 | 4.33 | 32.0 | 4.66 | 34.1 | 4.99 | 38.3 | 5.72 | 42.4 | 6.60 |
| | 18 | 21.6 | 3.11 | 25.7 | 3.75 | 29.9 | 4.43 | 32.0 | 4.76 | 34.1 | 5.08 | 38.3 | 5.85 | 42.4 | 7.06 |
| | 20 | 21.6 | 3.17 | 25.7 | 3.82 | 29.9 | 4.51 | 32.0 | 4.85 | 34.1 | 5.20 | 38.3 | 6.06 | 42.4 | 7.31 |
| | 21 | 21.6 | 3.20 | 25.7 | 3.85 | 29.9 | 4.55 | 32.0 | 4.91 | 34.1 | 5.32 | 38.3 | 6.28 | 42.4 | 7.83 |
| | 23 | 21.6 | 3.26 | 25.7 | 3.93 | 29.9 | 4.76 | 32.0 | 5.22 | 34.1 | 5.68 | 38.3 | 6.72 | 42.4 | 8.38 |
| | 25 | 21.6 | 3.36 | 25.7 | 4.18 | 29.9 | 5.09 | 32.0 | 5.58 | 34.1 | 6.07 | 38.3 | 7.19 | 42.4 | 8.94 |
| | 27 | 21.6 | 3.57 | 25.7 | 4.45 | 29.9 | 5.42 | 32.0 | 5.96 | 34.1 | 6.51 | 38.3 | 7.68 | 42.4 | 9.25 |
| | 29 | 21.6 | 3.80 | 25.7 | 4.74 | 29.9 | 5.78 | 32.0 | 6.34 | 33.9 | 6.94 | 38.3 | 8.19 | 42.4 | 9.59 |
| | 31 | 21.6 | 4.03 | 25.7 | 5.04 | 29.9 | 6.16 | 32.0 | 6.76 | 33.9 | 7.40 | 38.3 | 8.74 | 41.7 | 9.94 |
| | 33 | 21.6 | 4.29 | 25.7 | 5.61 | 29.9 | 6.56 | 32.0 | 7.20 | 33.9 | 7.88 | 38.3 | 9.33 | 41.1 | 10.30 |
| | 35 | 21.6 | 4.55 | 25.7 | 5.61 | 29.9 | 6.97 | 32.0 | 7.68 | 33.9 | 8.39 | 38.3 | 9.96 | 40.4 | 10.67 |
| | 37 | 21.6 | 4.82 | 25.7 | 6.04 | 29.9 | 7.42 | 31.4 | 8.18 | 33.9 | 8.94 | 38.3 | 10.61 | 39.9 | 11.07 |
| | 39 | 21.6 | 5.11 | 25.7 | 6.41 | 29.9 | 7.89 | 31.0 | 8.71 | 33.9 | 9.52 | 38.3 | 11.30 | 39.1 | 11.48 |
| | 41 | 20.4 | 5.73 | 24.4 | 7.07 | 28.5 | 8.79 | 30.4 | 8.91 | 32.3 | 9.73 | 36.4 | 11.55 | 38.5 | 12.38 |
| | 44 | 19.0 | 6.23 | 23.1 | 7.69 | 27.1 | 9.76 | 29.1 | 10.06 | 31.0 | 10.49 | 35.1 | 12.15 | 37.2 | 13.02 |
| | 47 | 17.9 | 8.29 | 22.4 | 10.23 | 26.2 | 10.25 | 28.1 | 10.21 | 29.9 | 11.16 | 33.9 | 13.05 | 36.0 | 13.98 |
| | 50 | 16.4 | 8.14 | 20.1 | 10.04 | 23.4 | 10.81 | 25.1 | 11.82 | 26.6 | 12.25 | 30.2 | 14.14 | 32.3 | 14.73 |
| | 52 | 12.4 | 6.87 | 14.9 | 8.47 | 17.5 | 9.21 | 18.9 | 10.06 | 20.4 | 10.74 | 24.1 | 12.45 | 26.3 | 12.81 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70% | -5 | 18.9 | 2.08 | 23.4 | 2.57 | 30.6 | 3.12 | 33.4 | 3.42 | 35.8 | 3.73 | 40.0 | 4.39 | 44.4 | 5.11 |
| | 0 | 18.9 | 2.08 | 23.4 | 2.58 | 30.6 | 3.13 | 33.4 | 3.43 | 35.8 | 3.74 | 40.0 | 4.40 | 44.4 | 5.12 |
| | 4 | 18.9 | 2.09 | 23.4 | 2.59 | 30.6 | 3.14 | 33.4 | 3.44 | 35.8 | 3.75 | 40.0 | 4.42 | 44.4 | 5.14 |
| | 7 | 18.9 | 2.13 | 23.4 | 2.64 | 30.6 | 3.20 | 33.4 | 3.50 | 35.8 | 3.82 | 39.7 | 4.50 | 43.8 | 5.23 |
| | 10 | 18.9 | 2.57 | 22.5 | 3.04 | 26.2 | 3.54 | 28.0 | 3.82 | 29.8 | 4.09 | 33.5 | 4.65 | 37.1 | 5.22 |
| | 12 | 18.9 | 2.60 | 22.5 | 3.09 | 26.2 | 3.62 | 28.0 | 3.89 | 29.8 | 4.16 | 33.5 | 4.74 | 37.1 | 5.32 |
| | 14 | 18.9 | 2.64 | 22.5 | 3.14 | 26.2 | 3.67 | 28.0 | 3.95 | 29.8 | 4.23 | 33.5 | 4.82 | 37.1 | 5.42 |
| | 16 | 18.9 | 2.68 | 22.5 | 3.20 | 26.2 | 3.75 | 28.0 | 4.03 | 29.8 | 4.32 | 33.5 | 4.91 | 37.1 | 5.52 |
| | 18 | 18.9 | 2.73 | 22.5 | 3.26 | 26.2 | 3.82 | 28.0 | 4.10 | 29.8 | 4.39 | 33.5 | 5.01 | 37.1 | 5.64 |
| | 20 | 18.9 | 2.77 | 22.5 | 3.31 | 26.2 | 3.89 | 28.0 | 4.18 | 29.8 | 4.48 | 33.5 | 5.11 | 37.1 | 5.80 |
| | 21 | 18.9 | 2.80 | 22.5 | 3.34 | 26.2 | 3.92 | 28.0 | 4.22 | 29.8 | 4.52 | 33.5 | 5.17 | 37.1 | 6.00 |
| | 23 | 18.9 | 2.84 | 22.5 | 3.40 | 26.2 | 4.00 | 28.0 | 4.36 | 29.8 | 4.75 | 33.5 | 5.55 | 37.1 | 6.43 |
| | 25 | 18.9 | 2.90 | 22.5 | 3.54 | 26.2 | 4.26 | 28.0 | 4.66 | 29.8 | 5.07 | 33.5 | 5.94 | 37.1 | 6.87 |
| | 27 | 18.9 | 3.07 | 22.5 | 3.77 | 26.2 | 4.55 | 28.0 | 4.97 | 29.8 | 5.41 | 33.5 | 6.34 | 37.1 | 7.35 |
| | 29 | 18.9 | 3.26 | 22.5 | 4.00 | 26.2 | 4.84 | 28.0 | 5.30 | 29.8 | 5.75 | 33.5 | 6.76 | 37.1 | 7.85 |
| | 31 | 18.9 | 3.44 | 22.5 | 4.25 | 26.2 | 5.15 | 28.0 | 5.63 | 29.8 | 6.13 | 33.5 | 7.20 | 37.1 | 8.37 |
| | 33 | 18.9 | 3.66 | 22.5 | 4.52 | 26.2 | 5.48 | 28.0 | 5.98 | 29.8 | 6.53 | 33.5 | 7.68 | 37.1 | 8.93 |
| | 35 | 18.9 | 3.87 | 22.5 | 4.79 | 26.2 | 5.81 | 28.0 | 6.37 | 29.8 | 6.95 | 33.5 | 8.18 | 37.1 | 9.51 |
| | 37 | 18.9 | 4.09 | 22.5 | 5.08 | 26.2 | 6.18 | 27.5 | 6.77 | 29.8 | 7.39 | 33.5 | 8.71 | 37.1 | 10.13 |
| | 39 | 18.9 | 4.33 | 22.5 | 5.38 | 26.2 | 6.56 | 27.1 | 7.19 | 29.8 | 7.85 | 33.5 | 9.26 | 37.1 | 10.79 |
| | 41 | 17.9 | 4.88 | 21.4 | 6.04 | 24.9 | 7.32 | 26.6 | 7.39 | 28.3 | 8.06 | 31.9 | 9.49 | 35.4 | 11.04 |
| | 44 | 16.6 | 5.31 | 20.3 | 6.57 | 23.7 | 8.14 | 25.5 | 8.35 | 27.2 | 8.68 | 30.7 | 9.98 | 34.2 | 11.61 |
| | 47 | 15.7 | 7.06 | 19.6 | 8.74 | 22.9 | 8.54 | 24.6 | 8.47 | 26.2 | 9.24 | 29.6 | 10.72 | 33.1 | 12.46 |
| | 50 | 14.4 | 6.94 | 17.6 | 8.58 | 20.5 | 9.01 | 21.9 | 9.81 | 23.4 | 10.14 | 26.5 | 11.61 | 29.7 | 13.13 |
| | 52 | 10.9 | 5.85 | 13.1 | 7.24 | 15.3 | 7.67 | 16.5 | 8.35 | 17.9 | 8.89 | 21.1 | 10.22 | 24.1 | 11.42 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60% | -5 | 16.2 | 1.75 | 20.0 | 2.13 | 26.2 | 2.56 | 28.6 | 2.79 | 30.6 | 3.03 | 34.3 | 3.54 | 38.1 | 4.08 |
| | 0 | 16.2 | 1.75 | 20.0 | 2.14 | 26.2 | 2.56 | 28.6 | 2.79 | 30.6 | 3.03 | 34.3 | 3.54 | 38.1 | 4.09 |
| | 4 | 16.2 | 1.76 | 20.0 | 2.15 | 26.2 | 2.57 | 28.6 | 2.81 | 30.6 | 3.05 | 34.3 | 3.56 | 38.1 | 4.11 |
| | 7 | 16.2 | 1.79 | 20.0 | 2.19 | 26.2 | 2.62 | 28.6 | 2.86 | 30.6 | 3.10 | 34.0 | 3.62 | 37.6 | 4.18 |
| | 10 | 16.2 | 2.22 | 19.3 | 2.61 | 22.5 | 3.03 | 24.0 | 3.24 | 25.5 | 3.46 | 28.7 | 3.92 | 31.9 | 4.39 |
| | 12 | 16.2 | 2.27 | 19.3 | 2.65 | 22.5 | 3.09 | 24.0 | 3.30 | 25.5 | 3.52 | 28.7 | 3.99 | 31.9 | 4.46 |
| | 14 | 16.2 | 2.30 | 19.3 | 2.70 | 22.5 | 3.13 | 24.0 | 3.36 | 25.5 | 3.59 | 28.7 | 4.06 | 31.9 | 4.55 |
| | 16 | 16.2 | 2.32 | 19.3 | 2.74 | 22.5 | 3.19 | 24.0 | 3.42 | 25.5 | 3.64 | 28.7 | 4.13 | 31.9 | 4.64 |
| | 18 | 16.2 | 2.37 | 19.3 | 2.78 | 22.5 | 3.24 | 24.0 | 3.47 | 25.5 | 3.72 | 28.7 | 4.20 | 31.9 | 4.72 |
| | 20 | 16.2 | 2.40 | 19.3 | 2.84 | 22.5 | 3.30 | 24.0 | 3.54 | 25.5 | 3.79 | 28.7 | 4.29 | 31.9 | 4.82 |
| | 21 | 16.2 | 2.43 | 19.3 | 2.86 | 22.5 | 3.33 | 24.0 | 3.57 | 25.5 | 3.82 | 28.7 | 4.33 | 31.9 | 4.86 |
| | 23 | 16.2 | 2.45 | 19.3 | 2.91 | 22.5 | 3.39 | 24.0 | 3.64 | 25.5 | 3.89 | 28.7 | 4.51 | 31.9 | 5.18 |
| | 25 | 16.2 | 2.50 | 19.3 | 2.97 | 22.5 | 3.52 | 24.0 | 3.82 | 25.5 | 4.13 | 28.7 | 4.81 | 31.9 | 5.52 |
| | 27 | 16.2 | 2.60 | 19.3 | 3.14 | 22.5 | 3.75 | 24.0 | 4.08 | 25.5 | 4.41 | 28.7 | 5.12 | 31.9 | 5.90 |
| | 29 | 16.2 | 2.74 | 19.3 | 3.33 | 22.5 | 3.99 | 24.0 | 4.33 | 25.5 | 4.69 | 28.7 | 5.47 | 31.9 | 6.30 |
| | 31 | 16.2 | 2.91 | 19.3 | 3.54 | 22.5 | 4.23 | 24.0 | 4.61 | 25.5 | 4.99 | 28.7 | 5.81 | 31.9 | 6.70 |
| | 33 | 16.2 | 3.07 | 19.3 | 3.75 | 22.5 | 4.49 | 24.0 | 4.89 | 25.5 | 5.31 | 28.7 | 6.18 | 31.9 | 7.15 |
| | 35 | 16.2 | 3.26 | 19.3 | 3.97 | 22.5 | 4.76 | 24.0 | 5.19 | 25.5 | 5.64 | 28.7 | 6.59 | 31.9 | 7.61 |
| | 37 | 16.2 | 3.44 | 19.3 | 4.20 | 22.5 | 5.05 | 23.6 | 5.51 | 25.5 | 5.98 | 28.7 | 7.00 | 31.9 | 8.09 |
| | 39 | 16.2 | 3.63 | 19.3 | 4.45 | 22.5 | 5.35 | 23.3 | 5.84 | 25.5 | 6.36 | 28.7 | 7.43 | 31.9 | 8.61 |
| | 41 | 15.3 | 4.10 | 18.3 | 5.01 | 21.3 | 6.00 | 22.8 | 6.03 | 24.3 | 6.54 | 27.3 | 7.64 | 30.4 | 8.82 |
| | 44 | 14.3 | 4.46 | 17.4 | 5.45 | 20.3 | 6.67 | 21.8 | 6.81 | 23.3 | 7.05 | 26.3 | 8.04 | 29.3 | 9.28 |
| | 47 | 13.4 | 5.94 | 16.8 | 7.25 | 19.7 | 7.00 | 21.1 | 6.91 | 22.5 | 7.50 | 25.4 | 8.63 | 28.4 | 9.96 |
| | 50 | 12.3 | 5.83 | 15.0 | 7.12 | 17.5 | 7.38 | 18.8 | 8.00 | 20.0 | 8.23 | 22.7 | 9.35 | 25.5 | 10.50 |
| | 52 | 9.3 | 4.92 | 11.2 | 6.00 | 13.1 | 6.29 | 14.2 | 6.81 | 15.3 | 7.22 | 18.1 | 8.23 | 20.7 | 9.13 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 50% | -5 | 13.5 | 1.45 | 16.7 | 1.73 | 21.9 | 2.05 | 23.9 | 2.22 | 25.5 | 2.40 | 28.6 | 2.77 | 31.8 | 3.17 |
| | 0 | 13.5 | 1.45 | 16.7 | 1.74 | 21.9 | 2.05 | 23.9 | 2.22 | 25.5 | 2.40 | 28.6 | 2.78 | 31.8 | 3.18 |
| | 4 | 13.5 | 1.46 | 16.7 | 1.74 | 21.9 | 2.06 | 23.9 | 2.23 | 25.5 | 2.41 | 28.6 | 2.79 | 31.8 | 3.19 |
| | 7 | 13.5 | 1.48 | 16.7 | 1.78 | 21.9 | 2.10 | 23.9 | 2.27 | 25.5 | 2.45 | 28.3 | 2.84 | 31.3 | 3.25 |
| | 10 | 13.5 | 1.92 | 16.1 | 2.22 | 18.7 | 2.54 | 20.0 | 2.71 | 21.3 | 2.87 | 23.9 | 3.23 | 26.6 | 3.60 |
| | 12 | 13.5 | 1.94 | 16.1 | 2.25 | 18.7 | 2.58 | 20.0 | 2.74 | 21.3 | 2.93 | 23.9 | 3.29 | 26.6 | 3.66 |
| | 14 | 13.5 | 1.97 | 16.1 | 2.28 | 18.7 | 2.61 | 20.0 | 2.80 | 21.3 | 2.97 | 23.9 | 3.34 | 26.6 | 3.73 |
| | 16 | 13.5 | 1.99 | 16.1 | 2.31 | 18.7 | 2.65 | 20.0 | 2.84 | 21.3 | 3.01 | 23.9 | 3.40 | 26.6 | 3.79 |
| | 18 | 13.5 | 2.02 | 16.1 | 2.35 | 18.7 | 2.70 | 20.0 | 2.88 | 21.3 | 3.07 | 23.9 | 3.46 | 26.6 | 3.86 |
| | 20 | 13.5 | 2.05 | 16.1 | 2.38 | 18.7 | 2.74 | 20.0 | 2.94 | 21.3 | 3.13 | 23.9 | 3.53 | 26.6 | 3.93 |
| | 21 | 13.5 | 2.07 | 16.1 | 2.41 | 18.7 | 2.77 | 20.0 | 2.96 | 21.3 | 3.16 | 23.9 | 3.56 | 26.6 | 3.97 |
| | 23 | 13.5 | 2.10 | 16.1 | 2.44 | 18.7 | 2.81 | 20.0 | 3.01 | 21.3 | 3.21 | 23.9 | 3.62 | 26.6 | 4.06 |
| | 25 | 13.5 | 2.12 | 16.1 | 2.48 | 18.7 | 2.87 | 20.0 | 3.07 | 21.3 | 3.31 | 23.9 | 3.80 | 26.6 | 4.33 |
| | 27 | 13.5 | 2.17 | 16.1 | 2.58 | 18.7 | 3.03 | 20.0 | 3.27 | 21.3 | 3.52 | 23.9 | 4.05 | 26.6 | 4.62 |
| | 29 | 13.5 | 2.28 | 16.1 | 2.73 | 18.7 | 3.21 | 20.0 | 3.47 | 21.2 | 3.75 | 23.9 | 4.31 | 26.6 | 4.92 |
| | 31 | 13.5 | 2.41 | 16.1 | 2.88 | 18.7 | 3.43 | 20.0 | 3.69 | 21.2 | 3.97 | 23.9 | 4.58 | 26.6 | 5.24 |
| | 33 | 13.5 | 2.55 | 16.1 | 3.06 | 18.7 | 3.62 | 20.0 | 3.90 | 21.2 | 4.22 | 23.9 | 4.86 | 26.6 | 5.57 |
| | 35 | 13.5 | 2.70 | 16.1 | 3.23 | 18.7 | 3.82 | 20.0 | 4.13 | 21.2 | 4.46 | 23.9 | 5.17 | 26.6 | 5.91 |
| | 37 | 13.5 | 2.84 | 16.1 | 3.42 | 18.7 | 4.05 | 19.6 | 4.38 | 21.2 | 4.74 | 23.9 | 5.48 | 26.6 | 6.29 |
| | 39 | 13.5 | 3.00 | 16.1 | 3.60 | 18.7 | 4.28 | 19.4 | 4.64 | 21.2 | 5.02 | 23.9 | 5.81 | 26.6 | 6.67 |
| | 41 | 12.8 | 3.40 | 15.3 | 4.07 | 17.8 | 4.81 | 19.0 | 4.79 | 20.2 | 5.18 | 22.8 | 5.99 | 25.3 | 6.86 |
| | 44 | 11.9 | 3.70 | 14.5 | 4.42 | 16.9 | 5.34 | 18.2 | 5.41 | 19.4 | 5.58 | 21.9 | 6.30 | 24.4 | 7.21 |
| | 47 | 11.2 | 4.92 | 14.0 | 5.89 | 16.4 | 5.61 | 17.6 | 5.50 | 18.7 | 5.94 | 21.2 | 6.77 | 23.6 | 7.74 |
| | 50 | 10.3 | 4.83 | 12.5 | 5.78 | 14.6 | 5.92 | 15.7 | 6.36 | 16.7 | 6.52 | 18.9 | 7.34 | 21.3 | 8.16 |
| | 52 | 7.8 | 4.07 | 9.3 | 4.88 | 10.9 | 5.04 | 11.8 | 5.41 | 12.7 | 5.71 | 15.1 | 6.46 | 17.3 | 7.09 |

CHV-5S450NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 135% | -5 | 39.5 | 5.59 | 47.1 | 6.81 | 54.6 | 6.89 | 56.7 | 6.93 | 57.9 | 6.97 | 59.3 | 7.05 | 61.1 | 7.12 |
| | 0 | 39.5 | 5.60 | 47.1 | 6.82 | 54.6 | 6.91 | 56.7 | 6.94 | 57.9 | 6.98 | 59.3 | 7.06 | 61.1 | 7.14 |
| | 4 | 39.5 | 5.63 | 47.1 | 6.85 | 54.6 | 6.93 | 56.7 | 6.97 | 57.9 | 7.01 | 59.3 | 7.09 | 61.1 | 7.16 |
| | 7 | 39.5 | 5.73 | 47.1 | 6.98 | 54.6 | 7.06 | 56.7 | 7.10 | 57.9 | 7.14 | 58.8 | 7.22 | 60.3 | 7.30 |
| | 10 | 39.5 | 5.83 | 47.1 | 7.13 | 54.6 | 8.47 | 56.7 | 8.66 | 57.4 | 8.49 | 58.8 | 8.13 | 60.3 | 7.76 |
| | 12 | 39.5 | 5.93 | 47.1 | 7.26 | 54.6 | 8.64 | 55.9 | 8.61 | 56.7 | 8.44 | 58.0 | 8.06 | 59.5 | 7.95 |
| | 14 | 39.5 | 6.05 | 47.1 | 7.40 | 54.5 | 8.75 | 55.3 | 8.58 | 55.9 | 8.39 | 57.4 | 8.32 | 58.8 | 8.41 |
| | 16 | 39.5 | 6.16 | 47.1 | 7.55 | 53.8 | 8.71 | 54.5 | 8.64 | 55.1 | 8.68 | 56.6 | 8.76 | 58.0 | 8.85 |
| | 18 | 39.5 | 6.27 | 47.1 | 7.71 | 53.0 | 9.04 | 53.7 | 9.09 | 54.5 | 9.14 | 55.9 | 9.22 | 57.4 | 9.31 |
| | 20 | 39.5 | 6.41 | 47.1 | 8.20 | 52.2 | 9.48 | 53.0 | 9.53 | 53.7 | 9.58 | 55.1 | 9.67 | 56.6 | 9.77 |
| | 21 | 39.5 | 6.58 | 47.1 | 8.49 | 51.9 | 9.70 | 52.7 | 9.75 | 53.4 | 9.80 | 54.8 | 9.91 | 56.2 | 9.99 |
| | 23 | 39.5 | 7.06 | 47.1 | 9.10 | 51.3 | 10.14 | 51.9 | 10.20 | 52.6 | 10.25 | 54.0 | 10.35 | 55.4 | 10.45 |
| | 25 | 39.5 | 7.54 | 47.1 | 9.75 | 50.5 | 10.59 | 51.3 | 10.64 | 51.9 | 10.71 | 53.4 | 10.81 | 54.8 | 10.91 |
| | 27 | 39.5 | 8.05 | 47.1 | 10.43 | 49.8 | 9.33 | 50.5 | 11.10 | 51.1 | 11.15 | 52.6 | 11.27 | 54.0 | 11.39 |
| | 29 | 39.5 | 8.59 | 47.1 | 11.15 | 49.0 | 11.47 | 49.7 | 11.54 | 50.5 | 11.61 | 51.9 | 11.73 | 53.4 | 11.85 |
| | 31 | 39.5 | 9.17 | 46.9 | 11.80 | 48.2 | 11.94 | 49.0 | 12.00 | 49.7 | 12.05 | 51.1 | 12.19 | 52.6 | 12.33 |
| | 33 | 39.5 | 9.77 | 46.1 | 12.24 | 47.6 | 12.36 | 48.2 | 12.45 | 49.0 | 12.51 | 50.5 | 12.65 | 51.7 | 12.80 |
| | 35 | 39.5 | 10.42 | 45.3 | 12.69 | 46.8 | 12.84 | 47.6 | 12.91 | 48.2 | 12.98 | 49.7 | 13.13 | 51.1 | 13.26 |
| | 37 | 39.5 | 11.08 | 44.7 | 13.15 | 46.1 | 13.30 | 46.8 | 13.37 | 47.6 | 13.45 | 48.9 | 13.61 | 50.3 | 13.76 |
| | 39 | 39.5 | 11.80 | 43.9 | 13.59 | 45.3 | 13.74 | 46.1 | 13.83 | 46.8 | 13.91 | 48.2 | 14.07 | 49.7 | 14.24 |
| | 41 | 37.4 | 13.13 | 43.1 | 15.98 | 44.4 | 16.18 | 45.2 | 14.97 | 45.9 | 15.05 | 47.3 | 15.23 | 48.7 | 15.39 |
| | 44 | 34.8 | 14.27 | 40.8 | 17.38 | 42.3 | 17.97 | 43.3 | 16.91 | 44.0 | 16.22 | 45.5 | 16.02 | 47.0 | 16.18 |
| | 47 | 32.8 | 18.99 | 39.4 | 23.13 | 40.9 | 18.87 | 41.8 | 17.17 | 42.4 | 17.26 | 43.9 | 17.20 | 45.5 | 17.38 |
| | 50 | 30.0 | 18.65 | 35.3 | 22.71 | 36.5 | 19.90 | 37.2 | 19.88 | 37.8 | 18.94 | 39.2 | 18.64 | 40.9 | 18.31 |
| | 52 | 22.8 | 15.73 | 26.3 | 19.15 | 27.4 | 16.95 | 28.1 | 16.91 | 28.9 | 16.61 | 31.3 | 16.41 | 33.2 | 15.92 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120% | -5 | 36.5 | 4.98 | 45.1 | 6.45 | 53.7 | 6.85 | 55.6 | 6.89 | 56.9 | 6.92 | 58.2 | 7.00 | 59.7 | 7.07 |
| | 0 | 36.5 | 4.99 | 45.1 | 6.46 | 53.7 | 6.86 | 55.6 | 6.90 | 56.9 | 6.93 | 58.2 | 7.01 | 59.7 | 7.08 |
| | 4 | 36.5 | 5.01 | 45.1 | 6.48 | 53.7 | 6.89 | 55.6 | 6.92 | 56.9 | 6.96 | 58.2 | 7.03 | 59.7 | 7.11 |
| | 7 | 36.5 | 5.10 | 45.1 | 6.60 | 53.7 | 7.01 | 55.6 | 7.05 | 56.9 | 7.09 | 57.7 | 7.16 | 58.9 | 7.24 |
| | 10 | 36.5 | 5.32 | 43.4 | 6.50 | 50.5 | 7.72 | 54.0 | 8.35 | 56.6 | 8.71 | 57.9 | 8.37 | 59.1 | 8.05 |
| | 12 | 36.5 | 5.42 | 43.4 | 6.62 | 50.5 | 7.88 | 54.0 | 8.51 | 55.8 | 8.66 | 57.1 | 8.34 | 58.3 | 8.00 |
| | 14 | 36.5 | 5.52 | 43.4 | 6.75 | 50.5 | 8.03 | 54.0 | 8.68 | 55.0 | 8.61 | 56.4 | 8.29 | 57.7 | 8.34 |
| | 16 | 36.5 | 5.63 | 43.4 | 6.89 | 50.5 | 8.18 | 53.7 | 8.75 | 54.3 | 8.63 | 55.6 | 8.71 | 56.9 | 8.78 |
| | 18 | 36.5 | 5.73 | 43.4 | 7.02 | 50.5 | 8.47 | 52.9 | 9.04 | 53.5 | 9.07 | 54.8 | 9.16 | 56.2 | 9.24 |
| | 20 | 36.5 | 5.85 | 43.4 | 7.30 | 50.5 | 9.10 | 52.2 | 9.48 | 52.9 | 9.51 | 54.2 | 9.60 | 55.4 | 9.68 |
| | 21 | 36.5 | 5.90 | 43.4 | 7.55 | 50.5 | 9.43 | 51.7 | 9.70 | 52.4 | 9.74 | 53.8 | 9.82 | 55.1 | 9.92 |
| | 23 | 36.5 | 6.31 | 43.4 | 8.10 | 50.5 | 10.09 | 51.1 | 10.13 | 51.7 | 10.18 | 53.0 | 10.28 | 54.3 | 10.37 |
| | 25 | 36.5 | 6.73 | 43.4 | 8.66 | 49.7 | 10.54 | 50.3 | 10.57 | 50.9 | 10.62 | 52.4 | 10.72 | 53.7 | 10.83 |
| | 27 | 36.5 | 7.20 | 43.4 | 9.26 | 49.0 | 10.96 | 49.7 | 11.03 | 50.3 | 11.08 | 51.6 | 11.18 | 52.9 | 11.29 |
| | 29 | 36.5 | 7.67 | 43.4 | 9.89 | 48.2 | 11.41 | 48.9 | 11.47 | 49.5 | 11.53 | 50.8 | 11.65 | 52.2 | 11.75 |
| | 31 | 36.5 | 8.18 | 43.4 | 10.55 | 47.6 | 11.87 | 48.2 | 11.92 | 48.9 | 11.99 | 50.1 | 12.11 | 51.4 | 12.22 |
| | 33 | 36.5 | 8.71 | 43.4 | 11.27 | 46.8 | 12.31 | 47.4 | 12.38 | 48.1 | 12.43 | 49.3 | 12.57 | 50.6 | 12.69 |
| | 35 | 36.5 | 9.28 | 43.4 | 12.00 | 46.0 | 12.75 | 46.6 | 12.82 | 47.4 | 12.89 | 48.7 | 13.03 | 50.0 | 13.16 |
| | 37 | 36.5 | 9.87 | 43.4 | 12.79 | 45.3 | 13.21 | 46.0 | 13.28 | 46.6 | 13.35 | 47.9 | 13.49 | 49.2 | 13.64 |
| | 39 | 36.5 | 10.50 | 43.2 | 13.50 | 44.5 | 13.66 | 45.2 | 13.74 | 45.8 | 13.81 | 47.2 | 13.96 | 48.5 | 14.10 |
| | 41 | 34.5 | 11.69 | 41.2 | 15.12 | 43.7 | 16.07 | 44.3 | 14.87 | 45.1 | 14.95 | 46.4 | 15.11 | 47.6 | 15.27 |
| | 44 | 32.1 | 12.71 | 39.1 | 16.44 | 41.6 | 17.85 | 42.4 | 16.80 | 43.3 | 16.11 | 44.6 | 15.89 | 46.0 | 16.06 |
| | 47 | 30.3 | 16.91 | 37.8 | 21.88 | 40.2 | 18.75 | 40.9 | 17.05 | 41.7 | 17.14 | 43.1 | 17.06 | 44.5 | 17.24 |
| | 50 | 27.7 | 16.60 | 33.8 | 21.49 | 35.9 | 19.77 | 36.5 | 19.75 | 37.2 | 18.82 | 38.5 | 18.50 | 40.0 | 18.16 |
| | 52 | 21.0 | 14.01 | 25.2 | 18.12 | 26.9 | 16.83 | 27.5 | 16.80 | 28.4 | 16.50 | 30.7 | 16.28 | 32.5 | 15.80 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110% | -5 | 33.4 | 4.40 | 41.4 | 5.67 | 53.0 | 6.80 | 54.6 | 6.84 | 55.7 | 6.88 | 56.8 | 6.94 | 58.4 | 7.00 |
| | 0 | 33.4 | 4.41 | 41.4 | 5.68 | 53.0 | 6.82 | 54.6 | 6.85 | 55.7 | 6.89 | 56.8 | 6.95 | 58.4 | 7.02 |
| | 4 | 33.4 | 4.43 | 41.4 | 5.70 | 53.0 | 6.84 | 54.6 | 6.88 | 55.7 | 6.91 | 56.8 | 6.98 | 58.4 | 7.04 |
| | 7 | 33.4 | 4.51 | 41.4 | 5.80 | 53.0 | 6.97 | 54.6 | 7.00 | 55.7 | 7.04 | 56.3 | 7.11 | 57.6 | 7.17 |
| | 10 | 33.4 | 4.83 | 39.9 | 5.88 | 46.3 | 6.99 | 49.5 | 7.55 | 52.7 | 8.13 | 56.7 | 8.63 | 58.0 | 8.34 |
| | 12 | 33.4 | 4.93 | 39.9 | 6.00 | 46.3 | 7.13 | 49.5 | 7.71 | 52.7 | 8.29 | 56.1 | 8.59 | 57.2 | 8.29 |
| | 14 | 33.4 | 5.01 | 39.9 | 6.10 | 46.3 | 7.26 | 49.5 | 7.84 | 52.7 | 8.44 | 55.3 | 8.59 | 56.6 | 8.27 |
| | 16 | 33.4 | 5.10 | 39.9 | 6.22 | 46.3 | 7.40 | 49.5 | 8.00 | 52.7 | 8.61 | 54.6 | 8.64 | 55.8 | 8.73 |
| | 18 | 33.4 | 5.20 | 39.9 | 6.34 | 46.3 | 7.55 | 49.5 | 8.22 | 52.7 | 9.02 | 53.8 | 9.09 | 55.1 | 9.17 |
| | 20 | 33.4 | 5.30 | 39.9 | 6.48 | 46.3 | 8.00 | 49.5 | 8.83 | 51.9 | 9.46 | 53.2 | 9.53 | 54.3 | 9.62 |
| | 21 | 33.4 | 5.35 | 39.9 | 6.67 | 46.3 | 8.29 | 49.5 | 9.16 | 51.6 | 9.68 | 52.7 | 9.75 | 54.0 | 9.84 |
| | 23 | 33.4 | 5.61 | 39.9 | 7.14 | 46.3 | 8.88 | 49.5 | 9.82 | 50.8 | 10.11 | 52.1 | 10.21 | 53.2 | 10.30 |
| | 25 | 33.4 | 5.97 | 39.9 | 7.64 | 46.3 | 9.50 | 49.5 | 10.52 | 50.1 | 10.55 | 51.3 | 10.66 | 52.6 | 10.74 |
| | 27 | 33.4 | 6.38 | 39.9 | 8.17 | 46.3 | 10.16 | 48.7 | 10.96 | 49.3 | 11.00 | 50.6 | 11.10 | 51.7 | 11.20 |
| | 29 | 33.4 | 6.80 | 39.9 | 8.71 | 46.3 | 10.86 | 48.1 | 11.41 | 48.7 | 11.46 | 49.8 | 11.56 | 51.1 | 11.66 |
| | 31 | 33.4 | 7.25 | 39.9 | 9.29 | 46.3 | 11.59 | 47.2 | 11.85 | 47.9 | 11.90 | 49.2 | 12.00 | 50.3 | 12.12 |
| | 33 | 33.4 | 7.71 | 39.9 | 9.91 | 46.0 | 12.22 | 46.6 | 12.29 | 47.2 | 12.34 | 48.4 | 12.46 | 49.7 | 12.58 |
| | 35 | 33.4 | 8.20 | 39.9 | 10.55 | 45.3 | 12.67 | 45.8 | 12.74 | 46.4 | 12.80 | 47.6 | 12.92 | 48.9 | 13.04 |
| | 37 | 33.4 | 8.73 | 39.9 | 11.24 | 44.5 | 13.13 | 45.2 | 13.18 | 45.6 | 13.25 | 46.9 | 13.38 | 48.1 | 13.50 |
| | 39 | 33.4 | 9.28 | 39.9 | 11.97 | 43.7 | 13.57 | 44.4 | 13.64 | 45.0 | 13.71 | 46.1 | 13.84 | 47.4 | 13.98 |
| | 41 | 31.6 | 10.33 | 37.9 | 13.30 | 43.1 | 15.96 | 43.5 | 14.77 | 44.2 | 14.85 | 45.3 | 14.99 | 46.6 | 15.13 |
| | 44 | 29.4 | 11.24 | 35.9 | 14.46 | 41.0 | 17.74 | 41.7 | 16.68 | 42.4 | 16.01 | 43.6 | 15.77 | 44.9 | 15.91 |
| | 47 | 27.7 | 14.95 | 34.7 | 19.24 | 39.7 | 18.62 | 40.2 | 16.94 | 40.9 | 17.03 | 42.1 | 16.93 | 43.5 | 17.09 |
| | 50 | 25.4 | 14.68 | 31.1 | 18.89 | 35.4 | 19.64 | 35.9 | 19.61 | 36.5 | 18.69 | 37.6 | 18.35 | 39.1 | 18.00 |
| | 52 | 19.3 | 12.38 | 23.1 | 15.94 | 26.5 | 16.72 | 27.0 | 16.68 | 27.9 | 16.39 | 30.0 | 16.15 | 31.8 | 15.65 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100% | -5 | 30.4 | 3.85 | 37.6 | 4.93 | 49.2 | 6.15 | 53.7 | 6.79 | 54.6 | 6.83 | 55.6 | 6.89 | 57.0 | 6.95 |
| | 0 | 30.4 | 3.86 | 37.6 | 4.94 | 49.2 | 6.16 | 53.7 | 6.81 | 54.6 | 6.84 | 55.6 | 6.90 | 57.0 | 6.96 |
| | 4 | 30.4 | 3.87 | 37.6 | 4.96 | 49.2 | 6.18 | 53.7 | 6.83 | 54.6 | 6.87 | 55.6 | 6.93 | 57.0 | 6.99 |
| | 7 | 30.4 | 3.94 | 37.6 | 5.05 | 49.2 | 6.30 | 53.7 | 6.96 | 54.6 | 6.99 | 55.2 | 7.06 | 56.2 | 7.12 |
| | 10 | 30.4 | 4.37 | 36.2 | 5.30 | 42.1 | 6.27 | 45.0 | 6.77 | 47.9 | 7.31 | 53.8 | 8.28 | 56.9 | 8.60 |
| | 12 | 30.4 | 4.42 | 36.2 | 5.37 | 42.1 | 6.35 | 45.0 | 6.86 | 47.9 | 7.45 | 53.8 | 8.42 | 56.1 | 8.53 |
| | 14 | 30.4 | 4.50 | 36.2 | 5.47 | 42.1 | 6.46 | 45.0 | 6.99 | 47.9 | 7.59 | 53.8 | 8.57 | 55.4 | 8.47 |
| | 16 | 30.4 | 4.60 | 36.2 | 5.59 | 42.1 | 6.61 | 45.0 | 7.14 | 47.9 | 7.76 | 53.6 | 8.76 | 54.6 | 8.66 |
| | 18 | 30.4 | 4.70 | 36.2 | 5.71 | 42.1 | 6.74 | 45.0 | 7.28 | 47.9 | 7.91 | 52.9 | 8.93 | 54.0 | 9.06 |
| | 20 | 30.4 | 4.78 | 36.2 | 5.80 | 42.1 | 6.96 | 45.0 | 7.67 | 47.9 | 8.42 | 52.1 | 9.40 | 53.2 | 9.54 |
| | 21 | 30.4 | 4.82 | 36.2 | 5.86 | 42.1 | 7.20 | 45.0 | 7.93 | 47.9 | 8.70 | 51.7 | 9.72 | 52.9 | 9.81 |
| | 23 | 30.4 | 4.95 | 36.2 | 6.26 | 42.1 | 7.74 | 45.0 | 8.52 | 47.9 | 9.36 | 51.1 | 10.28 | 52.1 | 10.38 |
| | 25 | 30.4 | 5.26 | 36.2 | 6.66 | 42.1 | 8.23 | 45.0 | 9.07 | 47.9 | 10.01 | 50.3 | 10.66 | 51.4 | 10.75 |
| | 27 | 30.4 | 5.62 | 36.2 | 7.12 | 42.1 | 8.83 | 45.0 | 9.73 | 47.9 | 10.74 | 49.5 | 11.03 | 50.6 | 11.13 |
| | 29 | 30.4 | 5.96 | 36.2 | 7.60 | 42.1 | 9.45 | 45.0 | 10.41 | 47.7 | 11.38 | 48.8 | 11.56 | 49.9 | 11.67 |
| | 31 | 30.4 | 6.34 | 36.2 | 8.10 | 42.1 | 10.07 | 45.0 | 11.21 | 47.1 | 11.84 | 47.7 | 12.03 | 49.2 | 12.14 |
| | 33 | 30.4 | 6.74 | 36.2 | 8.62 | 42.1 | 10.74 | 45.0 | 11.87 | 46.3 | 12.27 | 47.5 | 12.38 | 48.5 | 12.49 |
| | 35 | 30.4 | 7.17 | 36.2 | 9.18 | 42.1 | 11.45 | 45.0 | 12.65 | 45.5 | 12.71 | 46.6 | 12.83 | 47.7 | 12.94 |
| | 37 | 30.4 | 7.64 | 36.2 | 9.78 | 42.1 | 12.19 | 44.2 | 13.11 | 44.9 | 13.17 | 45.9 | 13.26 | 47.0 | 13.38 |
| | 39 | 30.4 | 8.13 | 36.2 | 10.41 | 42.1 | 12.99 | 43.6 | 13.54 | 43.8 | 13.61 | 45.3 | 13.70 | 45.9 | 13.83 |
| | 41 | 28.7 | 9.04 | 34.4 | 11.57 | 40.0 | 14.43 | 42.8 | 14.68 | 43.3 | 14.75 | 44.3 | 14.88 | 45.5 | 15.02 |
| | 44 | 26.7 | 9.82 | 32.5 | 12.58 | 38.1 | 16.03 | 40.9 | 16.57 | 41.5 | 15.89 | 42.7 | 15.65 | 43.9 | 15.79 |
| | 47 | 25.2 | 13.07 | 31.5 | 16.74 | 36.8 | 16.83 | 39.5 | 16.83 | 40.0 | 16.91 | 41.2 | 16.81 | 42.5 | 16.96 |
| | 50 | 23.1 | 12.84 | 28.2 | 16.44 | 32.9 | 17.75 | 35.2 | 19.48 | 35.7 | 18.56 | 36.8 | 18.22 | 38.2 | 17.86 |
| | 52 | 17.5 | 10.83 | 21.0 | 13.87 | 24.6 | 15.11 | 26.5 | 16.57 | 27.3 | 16.27 | 29.3 | 16.04 | 31.0 | 15.53 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 27.3 | 3.36 | 33.8 | 4.25 | 44.3 | 5.25 | 48.3 | 5.80 | 51.7 | 6.38 | 54.5 | 6.83 | 55.7 | 6.89 |
| | 0 | 27.3 | 3.37 | 33.8 | 4.26 | 44.3 | 5.26 | 48.3 | 5.81 | 51.7 | 6.39 | 54.5 | 6.84 | 55.7 | 6.90 |
| | 4 | 27.3 | 3.38 | 33.8 | 4.28 | 44.3 | 5.28 | 48.3 | 5.83 | 51.7 | 6.42 | 54.5 | 6.87 | 55.7 | 6.93 |
| | 7 | 27.3 | 3.44 | 33.8 | 4.36 | 44.3 | 5.38 | 48.3 | 5.94 | 51.7 | 6.54 | 54.1 | 6.99 | 55.0 | 7.06 |
| | 10 | 27.3 | 3.81 | 32.5 | 4.57 | 37.9 | 5.36 | 40.5 | 6.03 | 43.1 | 6.42 | 48.4 | 7.36 | 53.7 | 8.34 |
| | 12 | 27.3 | 3.86 | 32.5 | 4.63 | 37.9 | 5.43 | 40.5 | 6.11 | 43.1 | 6.55 | 48.4 | 7.49 | 53.7 | 8.45 |
| | 14 | 27.3 | 3.93 | 32.5 | 4.71 | 37.9 | 5.52 | 40.5 | 6.21 | 43.1 | 6.66 | 48.4 | 7.62 | 53.7 | 8.59 |
| | 16 | 27.3 | 4.01 | 32.5 | 4.82 | 37.9 | 5.64 | 40.5 | 6.35 | 43.1 | 6.81 | 48.4 | 7.79 | 53.5 | 8.75 |
| | 18 | 27.3 | 4.10 | 32.5 | 4.93 | 37.9 | 5.75 | 40.5 | 6.47 | 43.1 | 6.94 | 48.4 | 7.97 | 53.0 | 9.07 |
| | 20 | 27.3 | 4.17 | 32.5 | 5.00 | 37.9 | 5.94 | 40.5 | 6.60 | 43.1 | 7.23 | 48.4 | 8.56 | 52.1 | 9.45 |
| | 21 | 27.3 | 4.21 | 32.5 | 5.05 | 37.9 | 6.15 | 40.5 | 6.82 | 43.1 | 7.48 | 48.4 | 8.86 | 51.7 | 9.66 |
| | 23 | 27.3 | 4.32 | 32.5 | 5.40 | 37.9 | 6.61 | 40.5 | 7.34 | 43.1 | 8.01 | 48.4 | 9.51 | 50.9 | 10.16 |
| | 25 | 27.3 | 4.59 | 32.5 | 5.74 | 37.9 | 7.03 | 40.5 | 7.83 | 43.1 | 8.57 | 48.4 | 10.17 | 50.3 | 10.57 |
| | 27 | 27.3 | 4.91 | 32.5 | 6.14 | 37.9 | 7.54 | 40.5 | 8.35 | 43.1 | 9.17 | 48.4 | 10.86 | 49.5 | 11.03 |
| | 29 | 27.3 | 5.20 | 32.5 | 6.56 | 37.9 | 8.07 | 40.5 | 8.93 | 43.1 | 9.79 | 47.9 | 11.38 | 48.9 | 11.48 |
| | 31 | 27.3 | 5.53 | 32.5 | 6.98 | 37.9 | 8.60 | 40.5 | 9.53 | 43.1 | 10.45 | 47.1 | 11.79 | 48.1 | 11.95 |
| | 33 | 27.3 | 5.88 | 32.5 | 7.44 | 37.9 | 9.17 | 40.5 | 10.13 | 43.1 | 11.11 | 46.4 | 12.27 | 47.4 | 12.38 |
| | 35 | 27.3 | 6.26 | 32.5 | 7.92 | 37.9 | 9.78 | 40.5 | 10.80 | 43.1 | 11.88 | 45.6 | 12.72 | 46.6 | 12.83 |
| | 37 | 27.3 | 6.66 | 32.5 | 8.43 | 37.9 | 10.41 | 39.8 | 11.19 | 43.1 | 12.72 | 44.8 | 13.17 | 46.0 | 13.14 |
| | 39 | 27.3 | 7.10 | 32.5 | 8.98 | 37.9 | 11.09 | 39.2 | 11.56 | 43.1 | 13.48 | 44.2 | 13.66 | 45.2 | 13.62 |
| | 41 | 25.8 | 7.88 | 30.9 | 9.98 | 36.0 | 12.32 | 38.5 | 12.53 | 41.0 | 13.79 | 43.5 | 14.75 | 44.4 | 14.88 |
| | 44 | 24.1 | 8.57 | 29.3 | 10.85 | 34.3 | 13.69 | 36.9 | 14.15 | 39.3 | 14.86 | 41.8 | 15.51 | 42.9 | 15.65 |
| | 47 | 22.7 | 11.41 | 28.3 | 14.44 | 33.2 | 14.37 | 35.6 | 14.37 | 37.9 | 15.81 | 40.4 | 16.66 | 41.5 | 16.81 |
| | 50 | 20.8 | 11.20 | 25.4 | 14.18 | 29.6 | 15.16 | 31.7 | 16.64 | 33.8 | 17.35 | 36.1 | 18.06 | 37.3 | 17.71 |
| | 52 | 15.7 | 9.45 | 18.9 | 11.96 | 22.2 | 12.91 | 23.9 | 14.15 | 25.9 | 15.21 | 28.8 | 15.90 | 30.3 | 15.40 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80% | -5 | 24.3 | 2.90 | 30.1 | 3.58 | 39.4 | 4.45 | 42.9 | 4.90 | 45.8 | 5.35 | 51.4 | 6.35 | 54.3 | 6.81 |
| | 0 | 24.3 | 2.91 | 30.1 | 3.59 | 39.4 | 4.46 | 42.9 | 4.91 | 45.8 | 5.36 | 51.4 | 6.37 | 54.3 | 6.82 |
| | 4 | 24.3 | 2.92 | 30.1 | 3.60 | 39.4 | 4.47 | 42.9 | 4.93 | 45.8 | 5.38 | 51.4 | 6.39 | 54.3 | 6.85 |
| | 7 | 24.3 | 2.97 | 30.1 | 3.67 | 39.4 | 4.56 | 42.9 | 5.02 | 45.8 | 5.48 | 51.0 | 6.51 | 53.6 | 6.97 |
| | 10 | 24.3 | 3.46 | 28.9 | 4.14 | 33.7 | 4.88 | 36.0 | 5.25 | 38.3 | 5.62 | 43.1 | 6.42 | 47.7 | 7.46 |
| | 12 | 24.3 | 3.51 | 28.9 | 4.21 | 33.7 | 4.96 | 36.0 | 5.35 | 38.3 | 5.73 | 43.1 | 6.54 | 47.7 | 7.40 |
| | 14 | 24.3 | 3.58 | 28.9 | 4.30 | 33.7 | 5.05 | 36.0 | 5.44 | 38.3 | 5.84 | 43.1 | 6.65 | 47.7 | 7.57 |
| | 16 | 24.3 | 3.63 | 28.9 | 4.36 | 33.7 | 5.15 | 36.0 | 5.54 | 38.3 | 5.93 | 43.1 | 6.80 | 47.7 | 7.84 |
| | 18 | 24.3 | 3.70 | 28.9 | 4.45 | 33.7 | 5.27 | 36.0 | 5.66 | 38.3 | 6.04 | 43.1 | 6.95 | 47.7 | 8.39 |
| | 20 | 24.3 | 3.77 | 28.9 | 4.54 | 33.7 | 5.35 | 36.0 | 5.76 | 38.3 | 6.18 | 43.1 | 7.20 | 47.7 | 8.69 |
| | 21 | 24.3 | 3.80 | 28.9 | 4.57 | 33.7 | 5.40 | 36.0 | 5.83 | 38.3 | 6.32 | 43.1 | 7.46 | 47.7 | 9.30 |
| | 23 | 24.3 | 3.87 | 28.9 | 4.67 | 33.7 | 5.66 | 36.0 | 6.21 | 38.3 | 6.75 | 43.1 | 7.98 | 47.7 | 9.95 |
| | 25 | 24.3 | 3.99 | 28.9 | 4.96 | 33.7 | 6.05 | 36.0 | 6.63 | 38.3 | 7.21 | 43.1 | 8.55 | 47.7 | 10.62 |
| | 27 | 24.3 | 4.25 | 28.9 | 5.29 | 33.7 | 6.44 | 36.0 | 7.08 | 38.3 | 7.73 | 43.1 | 9.12 | 47.7 | 10.99 |
| | 29 | 24.3 | 4.52 | 28.9 | 5.63 | 33.7 | 6.87 | 36.0 | 7.54 | 38.2 | 8.25 | 43.1 | 9.74 | 47.7 | 11.39 |
| | 31 | 24.3 | 4.79 | 28.9 | 5.98 | 33.7 | 7.31 | 36.0 | 8.03 | 38.2 | 8.79 | 43.1 | 10.39 | 46.9 | 11.81 |
| | 33 | 24.3 | 5.10 | 28.9 | 6.67 | 33.7 | 7.79 | 36.0 | 8.56 | 38.2 | 9.36 | 43.1 | 11.09 | 46.3 | 12.24 |
| | 35 | 24.3 | 5.40 | 28.9 | 6.67 | 33.7 | 8.29 | 36.0 | 9.12 | 38.2 | 9.97 | 43.1 | 11.83 | 45.5 | 12.68 |
| | 37 | 24.3 | 5.73 | 28.9 | 7.18 | 33.7 | 8.81 | 35.4 | 9.71 | 38.2 | 10.62 | 43.1 | 12.60 | 44.8 | 13.15 |
| | 39 | 24.3 | 6.07 | 28.9 | 7.62 | 33.7 | 9.38 | 34.9 | 10.35 | 38.2 | 11.31 | 43.1 | 13.42 | 44.0 | 13.63 |
| | 41 | 23.0 | 6.81 | 27.5 | 8.40 | 32.0 | 10.44 | 34.2 | 10.58 | 36.3 | 11.56 | 41.0 | 13.73 | 43.3 | 14.71 |
| | 44 | 21.4 | 7.40 | 26.0 | 9.13 | 30.5 | 11.60 | 32.8 | 11.95 | 34.9 | 12.46 | 39.4 | 14.44 | 41.8 | 15.47 |
| | 47 | 20.2 | 9.85 | 25.2 | 12.15 | 29.5 | 12.18 | 31.6 | 12.13 | 33.6 | 13.26 | 38.1 | 15.50 | 40.5 | 16.61 |
| | 50 | 18.5 | 9.67 | 22.6 | 11.93 | 26.3 | 12.84 | 28.2 | 14.05 | 30.0 | 14.56 | 34.0 | 16.80 | 36.4 | 17.50 |
| | 52 | 14.0 | 8.16 | 16.8 | 10.07 | 19.7 | 10.94 | 21.2 | 11.95 | 22.9 | 12.76 | 27.1 | 14.79 | 29.6 | 15.21 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70% | -5 | 21.3 | 2.47 | 26.3 | 3.06 | 34.4 | 3.71 | 37.6 | 4.07 | 40.2 | 4.43 | 45.0 | 5.22 | 49.9 | 6.07 |
| | 0 | 21.3 | 2.48 | 26.3 | 3.06 | 34.4 | 3.72 | 37.6 | 4.07 | 40.2 | 4.44 | 45.0 | 5.23 | 49.9 | 6.08 |
| | 4 | 21.3 | 2.49 | 26.3 | 3.08 | 34.4 | 3.73 | 37.6 | 4.09 | 40.2 | 4.46 | 45.0 | 5.25 | 49.9 | 6.10 |
| | 7 | 21.3 | 2.53 | 26.3 | 3.13 | 34.4 | 3.80 | 37.6 | 4.16 | 40.2 | 4.54 | 44.6 | 5.35 | 49.3 | 6.22 |
| | 10 | 21.3 | 3.05 | 25.3 | 3.61 | 29.5 | 4.21 | 31.5 | 4.54 | 33.5 | 4.86 | 37.7 | 5.52 | 41.8 | 6.21 |
| | 12 | 21.3 | 3.09 | 25.3 | 3.67 | 29.5 | 4.30 | 31.5 | 4.62 | 33.5 | 4.94 | 37.7 | 5.63 | 41.8 | 6.33 |
| | 14 | 21.3 | 3.14 | 25.3 | 3.73 | 29.5 | 4.36 | 31.5 | 4.69 | 33.5 | 5.03 | 37.7 | 5.73 | 41.8 | 6.44 |
| | 16 | 21.3 | 3.19 | 25.3 | 3.80 | 29.5 | 4.45 | 31.5 | 4.79 | 33.5 | 5.13 | 37.7 | 5.83 | 41.8 | 6.56 |
| | 18 | 21.3 | 3.24 | 25.3 | 3.87 | 29.5 | 4.54 | 31.5 | 4.88 | 33.5 | 5.22 | 37.7 | 5.95 | 41.8 | 6.70 |
| | 20 | 21.3 | 3.29 | 25.3 | 3.94 | 29.5 | 4.62 | 31.5 | 4.96 | 33.5 | 5.32 | 37.7 | 6.07 | 41.8 | 6.89 |
| | 21 | 21.3 | 3.32 | 25.3 | 3.97 | 29.5 | 4.65 | 31.5 | 5.01 | 33.5 | 5.37 | 37.7 | 6.14 | 41.8 | 7.13 |
| | 23 | 21.3 | 3.38 | 25.3 | 4.04 | 29.5 | 4.76 | 31.5 | 5.18 | 33.5 | 5.64 | 37.7 | 6.60 | 41.8 | 7.64 |
| | 25 | 21.3 | 3.44 | 25.3 | 4.21 | 29.5 | 5.06 | 31.5 | 5.54 | 33.5 | 6.02 | 37.7 | 7.06 | 41.8 | 8.17 |
| | 27 | 21.3 | 3.65 | 25.3 | 4.48 | 29.5 | 5.40 | 31.5 | 5.90 | 33.5 | 6.43 | 37.7 | 7.54 | 41.8 | 8.73 |
| | 29 | 21.3 | 3.87 | 25.3 | 4.76 | 29.5 | 5.75 | 31.5 | 6.29 | 33.5 | 6.84 | 37.7 | 8.03 | 41.8 | 9.33 |
| | 31 | 21.3 | 4.09 | 25.3 | 5.05 | 29.5 | 6.12 | 31.5 | 6.68 | 33.5 | 7.28 | 37.7 | 8.56 | 41.8 | 9.94 |
| | 33 | 21.3 | 4.35 | 25.3 | 5.37 | 29.5 | 6.51 | 31.5 | 7.11 | 33.5 | 7.76 | 37.7 | 9.12 | 41.8 | 10.61 |
| | 35 | 21.3 | 4.60 | 25.3 | 5.69 | 29.5 | 6.91 | 31.5 | 7.57 | 33.5 | 8.25 | 37.7 | 9.72 | 41.8 | 11.30 |
| | 37 | 21.3 | 4.86 | 25.3 | 6.04 | 29.5 | 7.35 | 30.9 | 8.05 | 33.5 | 8.78 | 37.7 | 10.35 | 41.8 | 12.04 |
| | 39 | 21.3 | 5.15 | 25.3 | 6.39 | 29.5 | 7.79 | 30.5 | 8.54 | 33.5 | 9.33 | 37.7 | 11.00 | 41.8 | 12.82 |
| | 41 | 20.1 | 5.80 | 24.0 | 7.18 | 28.0 | 8.70 | 29.9 | 8.78 | 31.9 | 9.57 | 35.9 | 11.27 | 39.8 | 13.11 |
| | 44 | 18.7 | 6.31 | 22.8 | 7.80 | 26.7 | 9.67 | 28.7 | 9.92 | 30.6 | 10.32 | 34.5 | 11.86 | 38.4 | 13.79 |
| | 47 | 17.6 | 8.39 | 22.0 | 10.38 | 25.8 | 10.15 | 27.7 | 10.07 | 29.5 | 10.98 | 33.3 | 12.73 | 37.2 | 14.81 |
| | 50 | 16.2 | 8.24 | 19.7 | 10.19 | 23.0 | 10.70 | 24.7 | 11.66 | 26.3 | 12.05 | 29.8 | 13.80 | 33.4 | 15.60 |
| | 52 | 12.2 | 6.95 | 14.7 | 8.60 | 17.2 | 9.11 | 18.6 | 9.92 | 20.1 | 10.56 | 23.7 | 12.15 | 27.2 | 13.56 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60% | -5 | 18.2 | 2.08 | 22.5 | 2.54 | 29.5 | 3.04 | 32.2 | 3.31 | 34.5 | 3.60 | 38.6 | 4.20 | 42.8 | 4.85 |
| | 0 | 18.2 | 2.08 | 22.5 | 2.54 | 29.5 | 3.05 | 32.2 | 3.32 | 34.5 | 3.60 | 38.6 | 4.21 | 42.8 | 4.86 |
| | 4 | 18.2 | 2.09 | 22.5 | 2.55 | 29.5 | 3.06 | 32.2 | 3.33 | 34.5 | 3.62 | 38.6 | 4.23 | 42.8 | 4.88 |
| | 7 | 18.2 | 2.13 | 22.5 | 2.60 | 29.5 | 3.11 | 32.2 | 3.39 | 34.5 | 3.69 | 38.2 | 4.30 | 42.3 | 4.97 |
| | 10 | 18.2 | 2.64 | 21.7 | 3.10 | 25.3 | 3.60 | 27.0 | 3.85 | 28.7 | 4.11 | 32.3 | 4.65 | 35.8 | 5.22 |
| | 12 | 18.2 | 2.69 | 21.7 | 3.15 | 25.3 | 3.67 | 27.0 | 3.92 | 28.7 | 4.18 | 32.3 | 4.74 | 35.8 | 5.30 |
| | 14 | 18.2 | 2.73 | 21.7 | 3.21 | 25.3 | 3.72 | 27.0 | 3.99 | 28.7 | 4.26 | 32.3 | 4.83 | 35.8 | 5.40 |
| | 16 | 18.2 | 2.76 | 21.7 | 3.26 | 25.3 | 3.79 | 27.0 | 4.06 | 28.7 | 4.33 | 32.3 | 4.91 | 35.8 | 5.51 |
| | 18 | 18.2 | 2.81 | 21.7 | 3.31 | 25.3 | 3.85 | 27.0 | 4.13 | 28.7 | 4.42 | 32.3 | 5.00 | 35.8 | 5.61 |
| | 20 | 18.2 | 2.85 | 21.7 | 3.38 | 25.3 | 3.92 | 27.0 | 4.21 | 28.7 | 4.50 | 32.3 | 5.10 | 35.8 | 5.73 |
| | 21 | 18.2 | 2.88 | 21.7 | 3.39 | 25.3 | 3.96 | 27.0 | 4.25 | 28.7 | 4.54 | 32.3 | 5.15 | 35.8 | 5.78 |
| | 23 | 18.2 | 2.92 | 21.7 | 3.46 | 25.3 | 4.02 | 27.0 | 4.33 | 28.7 | 4.62 | 32.3 | 5.35 | 35.8 | 6.16 |
| | 25 | 18.2 | 2.97 | 21.7 | 3.53 | 25.3 | 4.18 | 27.0 | 4.54 | 28.7 | 4.91 | 32.3 | 5.71 | 35.8 | 6.56 |
| | 27 | 18.2 | 3.09 | 21.7 | 3.73 | 25.3 | 4.45 | 27.0 | 4.84 | 28.7 | 5.23 | 32.3 | 6.09 | 35.8 | 7.01 |
| | 29 | 18.2 | 3.26 | 21.7 | 3.96 | 25.3 | 4.74 | 27.0 | 5.15 | 28.7 | 5.58 | 32.3 | 6.50 | 35.8 | 7.48 |
| | 31 | 18.2 | 3.46 | 21.7 | 4.21 | 25.3 | 5.03 | 27.0 | 5.47 | 28.7 | 5.93 | 32.3 | 6.91 | 35.8 | 7.96 |
| | 33 | 18.2 | 3.65 | 21.7 | 4.45 | 25.3 | 5.34 | 27.0 | 5.81 | 28.7 | 6.31 | 32.3 | 7.35 | 35.8 | 8.49 |
| | 35 | 18.2 | 3.87 | 21.7 | 4.72 | 25.3 | 5.66 | 27.0 | 6.17 | 28.7 | 6.70 | 32.3 | 7.83 | 35.8 | 9.04 |
| | 37 | 18.2 | 4.09 | 21.7 | 5.00 | 25.3 | 6.00 | 26.5 | 6.55 | 28.7 | 7.11 | 32.3 | 8.32 | 35.8 | 9.62 |
| | 39 | 18.2 | 4.31 | 21.7 | 5.29 | 25.3 | 6.36 | 26.2 | 6.94 | 28.7 | 7.55 | 32.3 | 8.83 | 35.8 | 10.23 |
| | 41 | 17.2 | 4.88 | 20.6 | 5.95 | 24.0 | 7.13 | 25.7 | 7.16 | 27.3 | 7.77 | 30.7 | 9.08 | 34.2 | 10.48 |
| | 44 | 16.0 | 5.30 | 19.5 | 6.47 | 22.9 | 7.92 | 24.6 | 8.09 | 26.2 | 8.38 | 29.6 | 9.55 | 33.0 | 11.02 |
| | 47 | 15.1 | 7.06 | 18.9 | 8.61 | 22.1 | 8.32 | 23.7 | 8.21 | 25.3 | 8.91 | 28.6 | 10.25 | 31.9 | 11.84 |
| | 50 | 13.9 | 6.93 | 16.9 | 8.45 | 19.7 | 8.77 | 21.1 | 9.51 | 22.6 | 9.78 | 25.5 | 11.11 | 28.7 | 12.47 |
| | 52 | 10.5 | 5.84 | 12.6 | 7.13 | 14.8 | 7.47 | 15.9 | 8.09 | 17.2 | 8.58 | 20.3 | 9.78 | 23.3 | 10.84 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 50% | -5 | 15.2 | 1.72 | 18.8 | 2.06 | 24.6 | 2.44 | 26.8 | 2.64 | 28.6 | 2.85 | 32.1 | 3.30 | 35.7 | 3.77 |
| | 0 | 15.2 | 1.72 | 18.8 | 2.06 | 24.6 | 2.44 | 26.8 | 2.64 | 28.6 | 2.85 | 32.1 | 3.30 | 35.7 | 3.78 |
| | 4 | 15.2 | 1.73 | 18.8 | 2.07 | 24.6 | 2.45 | 26.8 | 2.65 | 28.6 | 2.86 | 32.1 | 3.31 | 35.7 | 3.79 |
| | 7 | 15.2 | 1.76 | 18.8 | 2.11 | 24.6 | 2.49 | 26.8 | 2.70 | 28.6 | 2.92 | 31.9 | 3.38 | 35.2 | 3.86 |
| | 10 | 15.2 | 2.28 | 18.1 | 2.64 | 21.1 | 3.02 | 22.5 | 3.22 | 23.9 | 3.41 | 26.9 | 3.84 | 29.9 | 4.28 |
| | 12 | 15.2 | 2.30 | 18.1 | 2.68 | 21.1 | 3.07 | 22.5 | 3.26 | 23.9 | 3.48 | 26.9 | 3.90 | 29.9 | 4.35 |
| | 14 | 15.2 | 2.34 | 18.1 | 2.71 | 21.1 | 3.10 | 22.5 | 3.32 | 23.9 | 3.53 | 26.9 | 3.97 | 29.9 | 4.43 |
| | 16 | 15.2 | 2.37 | 18.1 | 2.75 | 21.1 | 3.15 | 22.5 | 3.38 | 23.9 | 3.58 | 26.9 | 4.04 | 29.9 | 4.50 |
| | 18 | 15.2 | 2.40 | 18.1 | 2.80 | 21.1 | 3.21 | 22.5 | 3.43 | 23.9 | 3.65 | 26.9 | 4.11 | 29.9 | 4.59 |
| | 20 | 15.2 | 2.44 | 18.1 | 2.83 | 21.1 | 3.26 | 22.5 | 3.50 | 23.9 | 3.72 | 26.9 | 4.19 | 29.9 | 4.67 |
| | 21 | 15.2 | 2.46 | 18.1 | 2.86 | 21.1 | 3.29 | 22.5 | 3.51 | 23.9 | 3.75 | 26.9 | 4.23 | 29.9 | 4.72 |
| | 23 | 15.2 | 2.49 | 18.1 | 2.90 | 21.1 | 3.34 | 22.5 | 3.58 | 23.9 | 3.82 | 26.9 | 4.30 | 29.9 | 4.83 |
| | 25 | 15.2 | 2.52 | 18.1 | 2.95 | 21.1 | 3.41 | 22.5 | 3.65 | 23.9 | 3.94 | 26.9 | 4.52 | 29.9 | 5.15 |
| | 27 | 15.2 | 2.57 | 18.1 | 3.07 | 21.1 | 3.60 | 22.5 | 3.89 | 23.9 | 4.18 | 26.9 | 4.81 | 29.9 | 5.49 |
| | 29 | 15.2 | 2.71 | 18.1 | 3.24 | 21.1 | 3.82 | 22.5 | 4.13 | 23.9 | 4.45 | 26.9 | 5.12 | 29.9 | 5.85 |
| | 31 | 15.2 | 2.86 | 18.1 | 3.43 | 21.1 | 4.07 | 22.5 | 4.38 | 23.9 | 4.72 | 26.9 | 5.44 | 29.9 | 6.22 |
| | 33 | 15.2 | 3.03 | 18.1 | 3.63 | 21.1 | 4.30 | 22.5 | 4.64 | 23.9 | 5.01 | 26.9 | 5.78 | 29.9 | 6.62 |
| | 35 | 15.2 | 3.21 | 18.1 | 3.84 | 21.1 | 4.54 | 22.5 | 4.91 | 23.9 | 5.30 | 26.9 | 6.14 | 29.9 | 7.02 |
| | 37 | 15.2 | 3.38 | 18.1 | 4.06 | 21.1 | 4.81 | 22.1 | 5.20 | 23.9 | 5.63 | 26.9 | 6.51 | 29.9 | 7.47 |
| | 39 | 15.2 | 3.56 | 18.1 | 4.28 | 21.1 | 5.08 | 21.8 | 5.51 | 23.9 | 5.97 | 26.9 | 6.91 | 29.9 | 7.93 |
| | 41 | 14.4 | 4.04 | 17.2 | 4.83 | 20.0 | 5.71 | 21.4 | 5.70 | 22.7 | 6.15 | 25.6 | 7.12 | 28.5 | 8.15 |
| | 44 | 13.4 | 4.39 | 16.3 | 5.26 | 19.1 | 6.35 | 20.5 | 6.43 | 21.8 | 6.63 | 24.6 | 7.49 | 27.5 | 8.57 |
| | 47 | 12.6 | 5.84 | 15.7 | 6.99 | 18.4 | 6.67 | 19.8 | 6.53 | 21.0 | 7.05 | 23.8 | 8.04 | 26.6 | 9.20 |
| | 50 | 11.5 | 5.74 | 14.1 | 6.87 | 16.4 | 7.03 | 17.6 | 7.56 | 18.7 | 7.74 | 21.3 | 8.72 | 23.9 | 9.69 |
| | 52 | 8.7 | 4.84 | 10.5 | 5.79 | 12.3 | 5.99 | 13.3 | 6.43 | 14.3 | 6.79 | 17.0 | 7.67 | 19.4 | 8.43 |

CHV5 DC Inverter VRF Units Technical Sales Guide

CHV-5S504NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 135% | -5 | 44.3 | 6.28 | 52.7 | 7.65 | 61.2 | 7.74 | 63.5 | 7.78 | 64.8 | 7.82 | 66.4 | 7.91 | 68.4 | 8.00 |
| | 0 | 44.3 | 6.29 | 52.7 | 7.66 | 61.2 | 7.75 | 63.5 | 7.80 | 64.8 | 7.84 | 66.4 | 7.93 | 68.4 | 8.01 |
| | 4 | 44.3 | 6.32 | 52.7 | 7.69 | 61.2 | 7.78 | 63.5 | 7.82 | 64.8 | 7.87 | 66.4 | 7.96 | 68.4 | 8.04 |
| | 7 | 44.3 | 6.43 | 52.7 | 7.83 | 61.2 | 7.93 | 63.5 | 7.97 | 64.8 | 8.01 | 65.9 | 8.11 | 67.5 | 8.19 |
| | 10 | 44.3 | 6.55 | 52.7 | 8.00 | 61.2 | 9.51 | 63.5 | 9.72 | 64.3 | 9.53 | 65.9 | 9.13 | 67.5 | 8.71 |
| | 12 | 44.3 | 6.66 | 52.7 | 8.15 | 61.2 | 9.70 | 62.6 | 9.67 | 63.5 | 9.47 | 65.0 | 9.05 | 66.6 | 8.92 |
| | 14 | 44.3 | 6.79 | 52.7 | 8.31 | 61.0 | 9.82 | 61.9 | 9.63 | 62.6 | 9.42 | 64.3 | 9.34 | 65.9 | 9.44 |
| | 16 | 44.3 | 6.91 | 52.7 | 8.48 | 60.3 | 9.78 | 61.0 | 9.70 | 61.7 | 9.74 | 63.4 | 9.84 | 65.0 | 9.93 |
| | 18 | 44.3 | 7.04 | 52.7 | 8.65 | 59.4 | 10.14 | 60.1 | 10.20 | 61.0 | 10.26 | 62.6 | 10.35 | 64.3 | 10.45 |
| | 20 | 44.3 | 7.20 | 52.7 | 9.21 | 58.5 | 10.64 | 59.4 | 10.70 | 60.1 | 10.76 | 61.7 | 10.85 | 63.4 | 10.97 |
| | 21 | 44.3 | 7.39 | 52.7 | 9.53 | 58.1 | 10.89 | 59.0 | 10.95 | 59.8 | 11.01 | 61.4 | 11.12 | 63.0 | 11.22 |
| | 23 | 44.3 | 7.92 | 52.7 | 10.22 | 57.4 | 11.39 | 58.1 | 11.45 | 58.9 | 11.50 | 60.5 | 11.62 | 62.1 | 11.73 |
| | 25 | 44.3 | 8.46 | 52.7 | 10.95 | 56.5 | 11.89 | 57.4 | 11.94 | 58.1 | 12.02 | 59.8 | 12.13 | 61.4 | 12.25 |
| | 27 | 44.3 | 9.03 | 52.7 | 11.71 | 55.8 | 10.47 | 56.5 | 12.46 | 57.2 | 12.52 | 58.9 | 12.65 | 60.5 | 12.79 |
| | 29 | 44.3 | 9.65 | 52.7 | 12.52 | 54.9 | 12.88 | 55.6 | 12.96 | 56.5 | 13.03 | 58.1 | 13.17 | 59.8 | 13.30 |
| | 31 | 44.3 | 10.30 | 52.6 | 13.24 | 54.0 | 13.40 | 54.9 | 13.47 | 55.6 | 13.53 | 57.2 | 13.69 | 58.9 | 13.84 |
| | 33 | 44.3 | 10.97 | 51.7 | 13.74 | 53.3 | 13.88 | 54.0 | 13.97 | 54.9 | 14.05 | 56.5 | 14.20 | 58.0 | 14.37 |
| | 35 | 44.3 | 11.69 | 50.8 | 14.24 | 52.4 | 14.41 | 53.3 | 14.49 | 54.0 | 14.57 | 55.6 | 14.74 | 57.2 | 14.89 |
| | 37 | 44.3 | 12.44 | 50.0 | 14.76 | 51.7 | 14.93 | 52.4 | 15.01 | 53.3 | 15.10 | 54.7 | 15.27 | 56.3 | 15.45 |
| | 39 | 44.3 | 13.24 | 49.1 | 15.25 | 50.8 | 15.43 | 51.7 | 15.52 | 52.4 | 15.62 | 54.0 | 15.79 | 55.6 | 15.98 |
| | 41 | 41.8 | 14.74 | 48.2 | 17.94 | 49.8 | 18.16 | 50.6 | 16.81 | 51.4 | 16.90 | 53.0 | 17.10 | 54.5 | 17.27 |
| | 44 | 39.0 | 16.02 | 45.7 | 19.51 | 47.4 | 20.18 | 48.5 | 18.98 | 49.3 | 18.21 | 50.9 | 17.98 | 52.7 | 18.17 |
| | 47 | 36.8 | 21.32 | 44.2 | 25.96 | 45.8 | 21.19 | 46.8 | 19.27 | 47.5 | 19.37 | 49.2 | 19.31 | 50.9 | 19.51 |
| | 50 | 33.7 | 20.93 | 39.6 | 25.49 | 40.9 | 22.34 | 41.7 | 22.31 | 42.4 | 21.27 | 43.9 | 20.93 | 45.8 | 20.55 |
| | 52 | 25.5 | 17.66 | 29.4 | 21.50 | 30.6 | 19.02 | 31.4 | 18.98 | 32.4 | 18.64 | 35.0 | 18.42 | 37.2 | 17.87 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120% | -5 | 40.9 | 5.59 | 50.5 | 7.24 | 60.1 | 7.69 | 62.3 | 7.73 | 63.7 | 7.77 | 65.1 | 7.85 | 66.9 | 7.93 |
| | 0 | 40.9 | 5.60 | 50.5 | 7.25 | 60.1 | 7.70 | 62.3 | 7.74 | 63.7 | 7.78 | 65.1 | 7.87 | 66.9 | 7.95 |
| | 4 | 40.9 | 5.62 | 50.5 | 7.28 | 60.1 | 7.73 | 62.3 | 7.77 | 63.7 | 7.81 | 65.1 | 7.90 | 66.9 | 7.98 |
| | 7 | 40.9 | 5.73 | 50.5 | 7.41 | 60.1 | 7.87 | 62.3 | 7.92 | 63.7 | 7.96 | 64.6 | 8.04 | 66.0 | 8.13 |
| | 10 | 40.9 | 5.97 | 48.6 | 7.29 | 56.5 | 8.67 | 60.5 | 9.38 | 63.4 | 9.78 | 64.8 | 9.40 | 66.2 | 9.03 |
| | 12 | 40.9 | 6.09 | 48.6 | 7.43 | 56.5 | 8.84 | 60.5 | 9.55 | 62.5 | 9.72 | 63.9 | 9.36 | 65.3 | 8.98 |
| | 14 | 40.9 | 6.20 | 48.6 | 7.58 | 56.5 | 9.01 | 60.5 | 9.74 | 61.6 | 9.67 | 63.2 | 9.30 | 64.6 | 9.36 |
| | 16 | 40.9 | 6.32 | 48.6 | 7.73 | 56.5 | 9.19 | 60.1 | 9.82 | 60.8 | 9.68 | 62.3 | 9.78 | 63.7 | 9.86 |
| | 18 | 40.9 | 6.43 | 48.6 | 7.89 | 56.5 | 9.51 | 59.2 | 10.14 | 59.9 | 10.18 | 61.4 | 10.28 | 63.0 | 10.37 |
| | 20 | 40.9 | 6.57 | 48.6 | 8.19 | 56.5 | 10.22 | 58.5 | 10.64 | 59.2 | 10.68 | 60.7 | 10.78 | 62.1 | 10.87 |
| | 21 | 40.9 | 6.62 | 48.6 | 8.48 | 56.5 | 10.58 | 58.0 | 10.89 | 58.7 | 10.93 | 60.3 | 11.02 | 61.7 | 11.14 |
| | 23 | 40.9 | 7.08 | 48.6 | 9.09 | 56.5 | 11.33 | 57.2 | 11.37 | 58.0 | 11.43 | 59.4 | 11.54 | 60.8 | 11.64 |
| | 25 | 40.9 | 7.56 | 48.6 | 9.72 | 55.6 | 11.83 | 56.3 | 11.87 | 57.1 | 11.92 | 58.7 | 12.04 | 60.1 | 12.15 |
| | 27 | 40.9 | 8.08 | 48.6 | 10.39 | 54.9 | 12.31 | 55.6 | 12.38 | 56.3 | 12.44 | 57.8 | 12.56 | 59.2 | 12.67 |
| | 29 | 40.9 | 8.61 | 48.6 | 11.10 | 54.0 | 12.80 | 54.7 | 12.88 | 55.4 | 12.94 | 56.9 | 13.07 | 58.5 | 13.19 |
| | 31 | 40.9 | 9.19 | 48.6 | 11.85 | 53.3 | 13.32 | 54.0 | 13.38 | 54.7 | 13.46 | 56.2 | 13.59 | 57.6 | 13.72 |
| | 33 | 40.9 | 9.78 | 48.6 | 12.65 | 52.4 | 13.82 | 53.1 | 13.90 | 53.8 | 13.95 | 55.3 | 14.11 | 56.7 | 14.24 |
| | 35 | 40.9 | 10.41 | 48.6 | 13.47 | 51.5 | 14.32 | 52.2 | 14.39 | 53.1 | 14.47 | 54.5 | 14.62 | 56.0 | 14.78 |
| | 37 | 40.9 | 11.08 | 48.6 | 14.36 | 50.8 | 14.83 | 51.5 | 14.91 | 52.2 | 14.99 | 53.6 | 15.14 | 55.1 | 15.31 |
| | 39 | 40.9 | 11.79 | 48.4 | 15.16 | 49.9 | 15.33 | 50.6 | 15.43 | 51.3 | 15.50 | 52.9 | 15.68 | 54.4 | 15.83 |
| | 41 | 38.6 | 13.12 | 46.2 | 16.98 | 48.9 | 18.04 | 49.6 | 16.70 | 50.5 | 16.79 | 51.9 | 16.96 | 53.3 | 17.14 |
| | 44 | 36.0 | 14.26 | 43.7 | 18.46 | 46.6 | 20.04 | 47.5 | 18.86 | 48.5 | 18.09 | 50.0 | 17.84 | 51.5 | 18.03 |
| | 47 | 33.9 | 18.98 | 42.3 | 24.56 | 45.0 | 21.05 | 45.8 | 19.14 | 46.7 | 19.24 | 48.3 | 19.16 | 49.8 | 19.36 |
| | 50 | 31.1 | 18.64 | 37.9 | 24.12 | 40.2 | 22.19 | 40.9 | 22.17 | 41.7 | 21.13 | 43.1 | 20.76 | 44.8 | 20.39 |
| | 52 | 23.5 | 15.72 | 28.2 | 20.35 | 30.1 | 18.90 | 30.8 | 18.86 | 31.9 | 18.52 | 34.4 | 18.28 | 36.4 | 17.73 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110% | -5 | 37.4 | 4.94 | 46.4 | 6.36 | 59.3 | 7.64 | 61.2 | 7.68 | 62.4 | 7.72 | 63.6 | 7.79 | 65.4 | 7.86 |
| | 0 | 37.4 | 4.95 | 46.4 | 6.37 | 59.3 | 7.65 | 61.2 | 7.69 | 62.4 | 7.73 | 63.6 | 7.81 | 65.4 | 7.88 |
| | 4 | 37.4 | 4.97 | 46.4 | 6.40 | 59.3 | 7.68 | 61.2 | 7.72 | 62.4 | 7.76 | 63.6 | 7.83 | 65.4 | 7.91 |
| | 7 | 37.4 | 5.06 | 46.4 | 6.52 | 59.3 | 7.82 | 61.2 | 7.86 | 62.4 | 7.91 | 63.1 | 7.98 | 64.5 | 8.05 |
| | 10 | 37.4 | 5.42 | 44.6 | 6.60 | 51.8 | 7.85 | 55.4 | 8.48 | 59.0 | 9.13 | 63.5 | 9.68 | 65.0 | 9.36 |
| | 12 | 37.4 | 5.53 | 44.6 | 6.74 | 51.8 | 8.00 | 55.4 | 8.65 | 59.0 | 9.30 | 62.8 | 9.65 | 64.1 | 9.30 |
| | 14 | 37.4 | 5.63 | 44.6 | 6.85 | 51.8 | 8.15 | 55.4 | 8.80 | 59.0 | 9.47 | 61.9 | 9.65 | 63.4 | 9.28 |
| | 16 | 37.4 | 5.72 | 44.6 | 6.99 | 51.8 | 8.31 | 55.4 | 8.98 | 59.0 | 9.67 | 61.2 | 9.70 | 62.5 | 9.80 |
| | 18 | 37.4 | 5.84 | 44.6 | 7.12 | 51.8 | 8.48 | 55.4 | 9.23 | 59.0 | 10.13 | 60.3 | 10.20 | 61.7 | 10.30 |
| | 20 | 37.4 | 5.95 | 44.6 | 7.27 | 51.8 | 8.98 | 55.4 | 9.91 | 58.1 | 10.62 | 59.6 | 10.70 | 60.8 | 10.79 |
| | 21 | 37.4 | 6.01 | 44.6 | 7.48 | 51.8 | 9.30 | 55.4 | 10.28 | 57.8 | 10.87 | 59.0 | 10.95 | 60.5 | 11.04 |
| | 23 | 37.4 | 6.30 | 44.6 | 8.02 | 51.8 | 9.97 | 55.4 | 11.02 | 56.9 | 11.35 | 58.3 | 11.46 | 59.6 | 11.56 |
| | 25 | 37.4 | 6.70 | 44.6 | 8.57 | 51.8 | 10.66 | 55.4 | 11.81 | 56.2 | 11.85 | 57.4 | 11.96 | 58.9 | 12.06 |
| | 27 | 37.4 | 7.16 | 44.6 | 9.17 | 51.8 | 11.41 | 54.5 | 12.31 | 55.3 | 12.35 | 56.7 | 12.46 | 58.0 | 12.57 |
| | 29 | 37.4 | 7.64 | 44.6 | 9.78 | 51.8 | 12.19 | 53.8 | 12.80 | 54.5 | 12.86 | 55.8 | 12.98 | 57.2 | 13.09 |
| | 31 | 37.4 | 8.13 | 44.6 | 10.43 | 51.8 | 13.02 | 52.9 | 13.30 | 53.6 | 13.36 | 55.1 | 13.47 | 56.3 | 13.61 |
| | 33 | 37.4 | 8.65 | 44.6 | 11.12 | 51.5 | 13.72 | 52.2 | 13.80 | 52.9 | 13.86 | 54.2 | 13.99 | 55.6 | 14.13 |
| | 35 | 37.4 | 9.21 | 44.6 | 11.85 | 50.8 | 14.22 | 51.3 | 14.30 | 52.0 | 14.37 | 53.3 | 14.51 | 54.7 | 14.64 |
| | 37 | 37.4 | 9.80 | 44.6 | 12.61 | 49.9 | 14.74 | 50.6 | 14.80 | 51.1 | 14.87 | 52.6 | 15.02 | 53.8 | 15.16 |
| | 39 | 37.4 | 10.41 | 44.6 | 13.44 | 49.0 | 15.24 | 49.7 | 15.31 | 50.4 | 15.39 | 51.7 | 15.54 | 53.1 | 15.69 |
| | 41 | 35.4 | 11.60 | 42.4 | 14.93 | 48.2 | 17.92 | 48.8 | 16.59 | 49.5 | 16.67 | 50.7 | 16.83 | 52.1 | 16.98 |
| | 44 | 32.9 | 12.61 | 40.2 | 16.23 | 45.9 | 19.91 | 46.7 | 18.73 | 47.5 | 17.97 | 48.8 | 17.70 | 50.3 | 17.86 |
| | 47 | 31.1 | 16.78 | 38.8 | 21.60 | 44.4 | 20.90 | 45.0 | 19.02 | 45.8 | 19.12 | 47.2 | 19.01 | 48.7 | 19.18 |
| | 50 | 28.5 | 16.48 | 34.8 | 21.21 | 39.6 | 22.04 | 40.2 | 22.02 | 40.8 | 20.99 | 42.1 | 20.60 | 43.8 | 20.21 |
| | 52 | 21.6 | 13.90 | 25.9 | 17.89 | 29.7 | 18.77 | 30.3 | 18.73 | 31.2 | 18.40 | 33.6 | 18.14 | 35.6 | 17.57 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100% | -5 | 34.0 | 4.32 | 42.1 | 5.54 | 55.1 | 6.90 | 60.1 | 7.63 | 61.1 | 7.66 | 62.3 | 7.73 | 63.8 | 7.80 |
| | 0 | 34.0 | 4.33 | 42.1 | 5.55 | 55.1 | 6.91 | 60.1 | 7.64 | 61.1 | 7.68 | 62.3 | 7.75 | 63.8 | 7.82 |
| | 4 | 34.0 | 4.35 | 42.1 | 5.57 | 55.1 | 6.94 | 60.1 | 7.67 | 61.1 | 7.71 | 62.3 | 7.78 | 63.8 | 7.85 |
| | 7 | 34.0 | 4.43 | 42.1 | 5.67 | 55.1 | 7.07 | 60.1 | 7.81 | 61.1 | 7.85 | 61.8 | 7.92 | 63.0 | 7.99 |
| | 10 | 34.0 | 4.90 | 40.5 | 5.95 | 47.2 | 7.04 | 50.4 | 7.60 | 53.6 | 8.21 | 60.3 | 9.29 | 63.7 | 9.66 |
| | 12 | 34.0 | 4.96 | 40.5 | 6.03 | 47.2 | 7.13 | 50.4 | 7.70 | 53.6 | 8.37 | 60.3 | 9.45 | 62.8 | 9.58 |
| | 14 | 34.0 | 5.05 | 40.5 | 6.14 | 47.2 | 7.26 | 50.4 | 7.84 | 53.6 | 8.52 | 60.3 | 9.62 | 62.1 | 9.50 |
| | 16 | 34.0 | 5.16 | 40.5 | 6.27 | 47.2 | 7.42 | 50.4 | 8.02 | 53.6 | 8.71 | 60.1 | 9.83 | 61.2 | 9.72 |
| | 18 | 34.0 | 5.28 | 40.5 | 6.41 | 47.2 | 7.56 | 50.4 | 8.18 | 53.6 | 8.88 | 59.2 | 10.02 | 60.5 | 10.17 |
| | 20 | 34.0 | 5.36 | 40.5 | 6.51 | 47.2 | 7.81 | 50.4 | 8.61 | 53.6 | 9.45 | 58.3 | 10.55 | 59.6 | 10.71 |
| | 21 | 34.0 | 5.41 | 40.5 | 6.58 | 47.2 | 8.08 | 50.4 | 8.90 | 53.6 | 9.77 | 58.0 | 10.91 | 59.2 | 11.01 |
| | 23 | 34.0 | 5.55 | 40.5 | 7.03 | 47.2 | 8.69 | 50.4 | 9.57 | 53.6 | 10.51 | 57.3 | 11.54 | 58.3 | 11.65 |
| | 25 | 34.0 | 5.91 | 40.5 | 7.48 | 47.2 | 9.24 | 50.4 | 10.18 | 53.6 | 11.24 | 56.3 | 11.96 | 57.6 | 12.07 |
| | 27 | 34.0 | 6.31 | 40.5 | 7.99 | 47.2 | 9.92 | 50.4 | 10.92 | 53.6 | 12.06 | 55.4 | 12.38 | 56.7 | 12.50 |
| | 29 | 34.0 | 6.69 | 40.5 | 8.53 | 47.2 | 10.61 | 50.4 | 11.68 | 53.5 | 12.77 | 54.7 | 12.98 | 55.9 | 13.10 |
| | 31 | 34.0 | 7.11 | 40.5 | 9.09 | 47.2 | 11.31 | 50.4 | 12.59 | 52.8 | 13.29 | 53.4 | 13.51 | 55.1 | 13.63 |
| | 33 | 34.0 | 7.57 | 40.5 | 9.68 | 47.2 | 12.06 | 50.4 | 13.32 | 51.8 | 13.77 | 53.2 | 13.90 | 54.3 | 14.02 |
| | 35 | 34.0 | 8.05 | 40.5 | 10.31 | 47.2 | 12.85 | 50.4 | 14.20 | 50.9 | 14.27 | 52.2 | 14.40 | 53.4 | 14.53 |
| | 37 | 34.0 | 8.57 | 40.5 | 10.98 | 47.2 | 13.69 | 49.5 | 14.71 | 50.3 | 14.79 | 51.4 | 14.89 | 52.7 | 15.03 |
| | 39 | 34.0 | 9.13 | 40.5 | 11.69 | 47.2 | 14.58 | 48.8 | 15.20 | 49.1 | 15.27 | 50.8 | 15.38 | 51.4 | 15.52 |
| | 41 | 32.1 | 10.14 | 38.5 | 12.99 | 44.8 | 16.19 | 47.9 | 16.47 | 48.4 | 16.56 | 49.7 | 16.71 | 50.9 | 16.86 |
| | 44 | 29.9 | 11.03 | 36.4 | 14.12 | 42.7 | 17.99 | 45.9 | 18.60 | 46.5 | 17.84 | 47.8 | 17.57 | 49.2 | 17.73 |
| | 47 | 28.2 | 14.68 | 35.2 | 18.79 | 41.3 | 18.89 | 44.3 | 18.89 | 44.8 | 18.98 | 46.2 | 18.87 | 47.5 | 19.04 |
| | 50 | 25.9 | 14.41 | 31.6 | 18.45 | 36.8 | 19.92 | 39.5 | 21.87 | 40.0 | 20.84 | 41.2 | 20.45 | 42.7 | 20.05 |
| | 52 | 19.6 | 12.16 | 23.5 | 15.56 | 27.6 | 16.97 | 29.7 | 18.60 | 30.6 | 18.27 | 32.9 | 18.00 | 34.7 | 17.44 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 30.6 | 3.77 | 37.9 | 4.77 | 49.6 | 5.89 | 54.1 | 6.51 | 57.9 | 7.16 | 61.0 | 7.67 | 62.4 | 7.73 |
| | 0 | 30.6 | 3.78 | 37.9 | 4.78 | 49.6 | 5.91 | 54.1 | 6.53 | 57.9 | 7.18 | 61.0 | 7.68 | 62.4 | 7.75 |
| | 4 | 30.6 | 3.79 | 37.9 | 4.80 | 49.6 | 5.93 | 54.1 | 6.55 | 57.9 | 7.20 | 61.0 | 7.71 | 62.4 | 7.78 |
| | 7 | 30.6 | 3.86 | 37.9 | 4.89 | 49.6 | 6.04 | 54.1 | 6.67 | 57.9 | 7.34 | 60.5 | 7.85 | 61.6 | 7.92 |
| | 10 | 30.6 | 4.28 | 36.4 | 5.13 | 42.4 | 6.01 | 45.4 | 6.77 | 48.3 | 7.21 | 54.3 | 8.26 | 60.1 | 9.36 |
| | 12 | 30.6 | 4.33 | 36.4 | 5.20 | 42.4 | 6.09 | 45.4 | 6.86 | 48.3 | 7.35 | 54.3 | 8.41 | 60.1 | 9.49 |
| | 14 | 30.6 | 4.41 | 36.4 | 5.29 | 42.4 | 6.20 | 45.4 | 6.97 | 48.3 | 7.48 | 54.3 | 8.55 | 60.1 | 9.64 |
| | 16 | 30.6 | 4.51 | 36.4 | 5.41 | 42.4 | 6.34 | 45.4 | 7.12 | 48.3 | 7.65 | 54.3 | 8.74 | 59.9 | 9.83 |
| | 18 | 30.6 | 4.61 | 36.4 | 5.53 | 42.4 | 6.46 | 45.4 | 7.26 | 48.3 | 7.80 | 54.3 | 8.95 | 59.4 | 10.18 |
| | 20 | 30.6 | 4.68 | 36.4 | 5.62 | 42.4 | 6.67 | 45.4 | 7.41 | 48.3 | 8.12 | 54.3 | 9.61 | 58.3 | 10.61 |
| | 21 | 30.6 | 4.72 | 36.4 | 5.67 | 42.4 | 6.90 | 45.4 | 7.66 | 48.3 | 8.40 | 54.3 | 9.94 | 58.0 | 10.85 |
| | 23 | 30.6 | 4.85 | 36.4 | 6.06 | 42.4 | 7.42 | 45.4 | 8.23 | 48.3 | 8.99 | 54.3 | 10.68 | 57.1 | 11.40 |
| | 25 | 30.6 | 5.15 | 36.4 | 6.45 | 42.4 | 7.89 | 45.4 | 8.79 | 48.3 | 9.62 | 54.3 | 11.42 | 56.3 | 11.87 |
| | 27 | 30.6 | 5.51 | 36.4 | 6.89 | 42.4 | 8.47 | 45.4 | 9.38 | 48.3 | 10.29 | 54.3 | 12.19 | 55.4 | 12.39 |
| | 29 | 30.6 | 5.83 | 36.4 | 7.36 | 42.4 | 9.06 | 45.4 | 10.02 | 48.3 | 10.99 | 53.6 | 12.77 | 54.7 | 12.89 |
| | 31 | 30.6 | 6.21 | 36.4 | 7.84 | 42.4 | 9.66 | 45.4 | 10.69 | 48.3 | 11.73 | 52.7 | 13.24 | 53.8 | 13.41 |
| | 33 | 30.6 | 6.60 | 36.4 | 8.35 | 42.4 | 10.30 | 45.4 | 11.38 | 48.3 | 12.47 | 52.0 | 13.78 | 53.1 | 13.90 |
| | 35 | 30.6 | 7.02 | 36.4 | 8.89 | 42.4 | 10.98 | 45.4 | 12.13 | 48.3 | 13.34 | 51.1 | 14.28 | 52.2 | 14.40 |
| | 37 | 30.6 | 7.48 | 36.4 | 9.47 | 42.4 | 11.69 | 44.5 | 12.57 | 48.3 | 14.28 | 50.2 | 14.79 | 51.5 | 14.75 |
| | 39 | 30.6 | 7.97 | 36.4 | 10.08 | 42.4 | 12.45 | 43.9 | 12.98 | 48.3 | 15.13 | 49.5 | 15.34 | 50.6 | 15.30 |
| | 41 | 28.9 | 8.85 | 34.6 | 11.20 | 40.3 | 13.83 | 43.1 | 14.07 | 45.9 | 15.48 | 48.7 | 16.56 | 49.7 | 16.71 |
| | 44 | 26.9 | 9.62 | 32.8 | 12.18 | 38.4 | 15.37 | 41.3 | 15.89 | 44.1 | 16.68 | 46.8 | 17.42 | 48.0 | 17.57 |
| | 47 | 25.4 | 12.80 | 31.7 | 16.21 | 37.1 | 16.14 | 39.8 | 16.13 | 42.5 | 17.74 | 45.2 | 18.70 | 46.5 | 18.87 |
| | 50 | 23.3 | 12.57 | 28.4 | 15.91 | 33.1 | 17.01 | 35.5 | 18.68 | 37.9 | 19.48 | 40.4 | 20.27 | 41.8 | 19.88 |
| | 52 | 17.6 | 10.61 | 21.1 | 13.42 | 24.8 | 14.49 | 26.8 | 15.89 | 29.0 | 17.08 | 32.2 | 17.84 | 33.9 | 17.28 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80% | -5 | 27.2 | 3.26 | 33.7 | 4.02 | 44.1 | 5.00 | 48.1 | 5.50 | 51.3 | 6.01 | 57.6 | 7.13 | 60.9 | 7.64 |
| | 0 | 27.2 | 3.26 | 33.7 | 4.03 | 44.1 | 5.00 | 48.1 | 5.51 | 51.3 | 6.02 | 57.6 | 7.15 | 60.9 | 7.66 |
| | 4 | 27.2 | 3.28 | 33.7 | 4.04 | 44.1 | 5.02 | 48.1 | 5.53 | 51.3 | 6.04 | 57.6 | 7.17 | 60.9 | 7.69 |
| | 7 | 27.2 | 3.34 | 33.7 | 4.12 | 44.1 | 5.12 | 48.1 | 5.63 | 51.3 | 6.16 | 57.1 | 7.31 | 60.1 | 7.83 |
| | 10 | 27.2 | 3.89 | 32.4 | 4.65 | 37.7 | 5.47 | 40.3 | 5.90 | 42.9 | 6.31 | 48.2 | 7.21 | 53.5 | 8.37 |
| | 12 | 27.2 | 3.94 | 32.4 | 4.73 | 37.7 | 5.57 | 40.3 | 6.01 | 42.9 | 6.43 | 48.2 | 7.34 | 53.5 | 8.31 |
| | 14 | 27.2 | 4.02 | 32.4 | 4.82 | 37.7 | 5.67 | 40.3 | 6.11 | 42.9 | 6.55 | 48.2 | 7.46 | 53.5 | 8.49 |
| | 16 | 27.2 | 4.08 | 32.4 | 4.90 | 37.7 | 5.78 | 40.3 | 6.22 | 42.9 | 6.65 | 48.2 | 7.63 | 53.5 | 8.80 |
| | 18 | 27.2 | 4.15 | 32.4 | 5.00 | 37.7 | 5.91 | 40.3 | 6.35 | 42.9 | 6.78 | 48.2 | 7.80 | 53.5 | 9.41 |
| | 20 | 27.2 | 4.23 | 32.4 | 5.09 | 37.7 | 6.01 | 40.3 | 6.47 | 42.9 | 6.93 | 48.2 | 8.09 | 53.5 | 9.76 |
| | 21 | 27.2 | 4.27 | 32.4 | 5.13 | 37.7 | 6.07 | 40.3 | 6.55 | 42.9 | 7.09 | 48.2 | 8.38 | 53.5 | 10.45 |
| | 23 | 27.2 | 4.34 | 32.4 | 5.24 | 37.7 | 6.35 | 40.3 | 6.97 | 42.9 | 7.58 | 48.2 | 8.96 | 53.5 | 11.17 |
| | 25 | 27.2 | 4.48 | 32.4 | 5.57 | 37.7 | 6.79 | 40.3 | 7.45 | 42.9 | 8.09 | 48.2 | 9.60 | 53.5 | 11.92 |
| | 27 | 27.2 | 4.77 | 32.4 | 5.93 | 37.7 | 7.23 | 40.3 | 7.94 | 42.9 | 8.68 | 48.2 | 10.24 | 53.5 | 12.34 |
| | 29 | 27.2 | 5.07 | 32.4 | 6.32 | 37.7 | 7.71 | 40.3 | 8.46 | 42.8 | 9.26 | 48.2 | 10.93 | 53.5 | 12.79 |
| | 31 | 27.2 | 5.38 | 32.4 | 6.72 | 37.7 | 8.21 | 40.3 | 9.01 | 42.8 | 9.87 | 48.2 | 11.66 | 52.6 | 13.25 |
| | 33 | 27.2 | 5.72 | 32.4 | 7.48 | 37.7 | 8.75 | 40.3 | 9.60 | 42.8 | 10.51 | 48.2 | 12.45 | 51.8 | 13.73 |
| | 35 | 27.2 | 6.07 | 32.4 | 7.48 | 37.7 | 9.30 | 40.3 | 10.24 | 42.8 | 11.19 | 48.2 | 13.28 | 50.9 | 14.23 |
| | 37 | 27.2 | 6.43 | 32.4 | 8.06 | 37.7 | 9.90 | 39.6 | 10.91 | 42.8 | 11.92 | 48.2 | 14.15 | 50.2 | 14.76 |
| | 39 | 27.2 | 6.81 | 32.4 | 8.56 | 37.7 | 10.53 | 39.1 | 11.61 | 42.8 | 12.69 | 48.2 | 15.07 | 49.3 | 15.31 |
| | 41 | 25.7 | 7.64 | 30.8 | 9.43 | 35.8 | 11.72 | 38.3 | 11.88 | 40.7 | 12.98 | 45.9 | 15.41 | 48.5 | 16.51 |
| | 44 | 24.0 | 8.31 | 29.2 | 10.25 | 34.1 | 13.02 | 36.7 | 13.41 | 39.0 | 13.99 | 44.2 | 16.21 | 46.9 | 17.36 |
| | 47 | 22.6 | 11.06 | 28.2 | 13.64 | 33.0 | 13.67 | 35.4 | 13.62 | 37.6 | 14.89 | 42.7 | 17.40 | 45.3 | 18.65 |
| | 50 | 20.7 | 10.86 | 25.3 | 13.40 | 29.5 | 14.42 | 31.6 | 15.77 | 33.6 | 16.34 | 38.1 | 18.86 | 40.8 | 19.64 |
| | 52 | 15.7 | 9.16 | 18.8 | 11.30 | 22.1 | 12.28 | 23.8 | 13.41 | 25.7 | 14.33 | 30.4 | 16.61 | 33.1 | 17.08 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70% | -5 | 23.8 | 2.78 | 29.5 | 3.43 | 38.6 | 4.16 | 42.1 | 4.56 | 45.1 | 4.97 | 50.4 | 5.86 | 55.9 | 6.81 |
| | 0 | 23.8 | 2.78 | 29.5 | 3.44 | 38.6 | 4.17 | 42.1 | 4.57 | 45.1 | 4.98 | 50.4 | 5.87 | 55.9 | 6.83 |
| | 4 | 23.8 | 2.79 | 29.5 | 3.45 | 38.6 | 4.19 | 42.1 | 4.59 | 45.1 | 5.00 | 50.4 | 5.89 | 55.9 | 6.85 |
| | 7 | 23.8 | 2.84 | 29.5 | 3.52 | 38.6 | 4.26 | 42.1 | 4.67 | 45.1 | 5.10 | 50.0 | 6.00 | 55.2 | 6.98 |
| | 10 | 23.8 | 3.43 | 28.3 | 4.06 | 33.0 | 4.73 | 35.3 | 5.09 | 37.5 | 5.45 | 42.2 | 6.20 | 46.8 | 6.97 |
| | 12 | 23.8 | 3.46 | 28.3 | 4.12 | 33.0 | 4.82 | 35.3 | 5.19 | 37.5 | 5.55 | 42.2 | 6.32 | 46.8 | 7.10 |
| | 14 | 23.8 | 3.52 | 28.3 | 4.19 | 33.0 | 4.90 | 35.3 | 5.26 | 37.5 | 5.65 | 42.2 | 6.43 | 46.8 | 7.23 |
| | 16 | 23.8 | 3.58 | 28.3 | 4.27 | 33.0 | 5.00 | 35.3 | 5.38 | 37.5 | 5.76 | 42.2 | 6.55 | 46.8 | 7.37 |
| | 18 | 23.8 | 3.64 | 28.3 | 4.34 | 33.0 | 5.09 | 35.3 | 5.47 | 37.5 | 5.86 | 42.2 | 6.68 | 46.8 | 7.52 |
| | 20 | 23.8 | 3.69 | 28.3 | 4.42 | 33.0 | 5.19 | 35.3 | 5.57 | 37.5 | 5.97 | 42.2 | 6.81 | 46.8 | 7.73 |
| | 21 | 23.8 | 3.73 | 28.3 | 4.46 | 33.0 | 5.23 | 35.3 | 5.63 | 37.5 | 6.03 | 42.2 | 6.89 | 46.8 | 8.00 |
| | 23 | 23.8 | 3.79 | 28.3 | 4.54 | 33.0 | 5.34 | 35.3 | 5.82 | 37.5 | 6.34 | 42.2 | 7.41 | 46.8 | 8.57 |
| | 25 | 23.8 | 3.87 | 28.3 | 4.73 | 33.0 | 5.68 | 35.3 | 6.22 | 37.5 | 6.76 | 42.2 | 7.92 | 46.8 | 9.17 |
| | 27 | 23.8 | 4.10 | 28.3 | 5.03 | 33.0 | 6.07 | 35.3 | 6.62 | 37.5 | 7.22 | 42.2 | 8.46 | 46.8 | 9.80 |
| | 29 | 23.8 | 4.34 | 28.3 | 5.34 | 33.0 | 6.45 | 35.3 | 7.06 | 37.5 | 7.68 | 42.2 | 9.01 | 46.8 | 10.47 |
| | 31 | 23.8 | 4.59 | 28.3 | 5.67 | 33.0 | 6.87 | 35.3 | 7.50 | 37.5 | 8.17 | 42.2 | 9.61 | 46.8 | 11.16 |
| | 33 | 23.8 | 4.88 | 28.3 | 6.03 | 33.0 | 7.31 | 35.3 | 7.98 | 37.5 | 8.71 | 42.2 | 10.24 | 46.8 | 11.91 |
| | 35 | 23.8 | 5.17 | 28.3 | 6.39 | 33.0 | 7.75 | 35.3 | 8.50 | 37.5 | 9.26 | 42.2 | 10.91 | 46.8 | 12.69 |
| | 37 | 23.8 | 5.45 | 28.3 | 6.78 | 33.0 | 8.25 | 34.6 | 9.03 | 37.5 | 9.86 | 42.2 | 11.62 | 46.8 | 13.51 |
| | 39 | 23.8 | 5.78 | 28.3 | 7.18 | 33.0 | 8.75 | 34.2 | 9.59 | 37.5 | 10.47 | 42.2 | 12.35 | 46.8 | 14.39 |
| | 41 | 22.5 | 6.51 | 26.9 | 8.05 | 31.4 | 9.77 | 33.5 | 9.86 | 35.7 | 10.75 | 40.2 | 12.66 | 44.6 | 14.72 |
| | 44 | 21.0 | 7.08 | 25.5 | 8.76 | 29.9 | 10.85 | 32.1 | 11.13 | 34.3 | 11.58 | 38.7 | 13.31 | 43.1 | 15.48 |
| | 47 | 19.8 | 9.42 | 24.7 | 11.65 | 28.9 | 11.39 | 31.0 | 11.30 | 33.0 | 12.32 | 37.3 | 14.29 | 41.7 | 16.62 |
| | 50 | 18.1 | 9.25 | 22.1 | 11.44 | 25.8 | 12.02 | 27.6 | 13.09 | 29.5 | 13.53 | 33.3 | 15.49 | 37.4 | 17.51 |
| | 52 | 13.7 | 7.80 | 16.4 | 9.65 | 19.3 | 10.23 | 20.8 | 11.13 | 22.5 | 11.86 | 26.6 | 13.64 | 30.4 | 15.23 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|------|----------|------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60% | -5 | 20.4 | 2.33 | 25.2 | 2.85 | 33.1 | 3.41 | 36.1 | 3.72 | 38.6 | 4.04 | 43.2 | 4.72 | 48.0 | 5.45 |
| | 0 | 20.4 | 2.34 | 25.2 | 2.85 | 33.1 | 3.42 | 36.1 | 3.73 | 38.6 | 4.05 | 43.2 | 4.73 | 48.0 | 5.46 |
| | 4 | 20.4 | 2.35 | 25.2 | 2.86 | 33.1 | 3.43 | 36.1 | 3.74 | 38.6 | 4.06 | 43.2 | 4.74 | 48.0 | 5.48 |
| | 7 | 20.4 | 2.39 | 25.2 | 2.92 | 33.1 | 3.49 | 36.1 | 3.81 | 38.6 | 4.14 | 42.8 | 4.83 | 47.3 | 5.58 |
| | 10 | 20.4 | 2.97 | 24.3 | 3.48 | 28.3 | 4.04 | 30.2 | 4.33 | 32.2 | 4.61 | 36.2 | 5.23 | 40.1 | 5.86 |
| | 12 | 20.4 | 3.02 | 24.3 | 3.54 | 28.3 | 4.12 | 30.2 | 4.40 | 32.2 | 4.69 | 36.2 | 5.32 | 40.1 | 5.95 |
| | 14 | 20.4 | 3.06 | 24.3 | 3.60 | 28.3 | 4.17 | 30.2 | 4.48 | 32.2 | 4.79 | 36.2 | 5.42 | 40.1 | 6.07 |
| | 16 | 20.4 | 3.10 | 24.3 | 3.66 | 28.3 | 4.25 | 30.2 | 4.56 | 32.2 | 4.86 | 36.2 | 5.51 | 40.1 | 6.18 |
| | 18 | 20.4 | 3.16 | 24.3 | 3.71 | 28.3 | 4.33 | 30.2 | 4.63 | 32.2 | 4.96 | 36.2 | 5.61 | 40.1 | 6.30 |
| | 20 | 20.4 | 3.20 | 24.3 | 3.79 | 28.3 | 4.40 | 30.2 | 4.73 | 32.2 | 5.05 | 36.2 | 5.72 | 40.1 | 6.43 |
| | 21 | 20.4 | 3.23 | 24.3 | 3.81 | 28.3 | 4.44 | 30.2 | 4.77 | 32.2 | 5.09 | 36.2 | 5.78 | 40.1 | 6.49 |
| | 23 | 20.4 | 3.27 | 24.3 | 3.89 | 28.3 | 4.52 | 30.2 | 4.86 | 32.2 | 5.19 | 36.2 | 6.01 | 40.1 | 6.91 |
| | 25 | 20.4 | 3.33 | 24.3 | 3.96 | 28.3 | 4.69 | 30.2 | 5.09 | 32.2 | 5.51 | 36.2 | 6.41 | 40.1 | 7.37 |
| | 27 | 20.4 | 3.46 | 24.3 | 4.19 | 28.3 | 5.00 | 30.2 | 5.44 | 32.2 | 5.88 | 36.2 | 6.83 | 40.1 | 7.87 |
| | 29 | 20.4 | 3.66 | 24.3 | 4.44 | 28.3 | 5.32 | 30.2 | 5.78 | 32.2 | 6.26 | 36.2 | 7.29 | 40.1 | 8.40 |
| | 31 | 20.4 | 3.89 | 24.3 | 4.73 | 28.3 | 5.65 | 30.2 | 6.14 | 32.2 | 6.66 | 36.2 | 7.75 | 40.1 | 8.94 |
| | 33 | 20.4 | 4.10 | 24.3 | 5.00 | 28.3 | 5.99 | 30.2 | 6.53 | 32.2 | 7.08 | 36.2 | 8.25 | 40.1 | 9.53 |
| | 35 | 20.4 | 4.34 | 24.3 | 5.30 | 28.3 | 6.35 | 30.2 | 6.93 | 32.2 | 7.52 | 36.2 | 8.79 | 40.1 | 10.14 |
| | 37 | 20.4 | 4.59 | 24.3 | 5.61 | 28.3 | 6.74 | 29.7 | 7.35 | 32.2 | 7.98 | 36.2 | 9.34 | 40.1 | 10.79 |
| | 39 | 20.4 | 4.84 | 24.3 | 5.93 | 28.3 | 7.14 | 29.3 | 7.79 | 32.2 | 8.48 | 36.2 | 9.91 | 40.1 | 11.48 |
| | 41 | 19.3 | 5.47 | 23.1 | 6.68 | 26.9 | 8.01 | 28.7 | 8.04 | 30.6 | 8.73 | 34.4 | 10.19 | 38.3 | 11.77 |
| | 44 | 18.0 | 5.95 | 21.9 | 7.26 | 25.6 | 8.90 | 27.5 | 9.08 | 29.4 | 9.40 | 33.1 | 10.72 | 36.9 | 12.38 |
| | 47 | 16.9 | 7.92 | 21.1 | 9.67 | 24.8 | 9.34 | 26.6 | 9.22 | 28.3 | 10.00 | 32.0 | 11.51 | 35.7 | 13.29 |
| | 50 | 15.5 | 7.78 | 19.0 | 9.49 | 22.1 | 9.85 | 23.7 | 10.67 | 25.3 | 10.98 | 28.6 | 12.48 | 32.1 | 14.00 |
| | 52 | 11.8 | 6.56 | 14.1 | 8.01 | 16.6 | 8.39 | 17.8 | 9.08 | 19.3 | 9.63 | 22.8 | 10.98 | 26.1 | 12.17 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Indoor air temp. | | | | | | | | | | | | | | | | |
|------------------|-----------------------------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|-------|
| Combination | Outdoor air temp. (°CDB) | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | | |
| | | TC | PI | |
| 50% | -5 | kW | kW | |
| | | 17.0 | 1.93 | 21.0 | 2.31 | 27.5 | 2.73 | 30.1 | 2.96 | 32.1 | 3.20 | 36.0 | 3.70 | 40.0 | 4.23 | |
| | | 0 | 17.0 | 1.94 | 21.0 | 2.32 | 27.5 | 2.74 | 30.1 | 2.97 | 32.1 | 3.20 | 36.0 | 3.71 | 40.0 | 4.24 |
| | | 4 | 17.0 | 1.94 | 21.0 | 2.33 | 27.5 | 2.75 | 30.1 | 2.98 | 32.1 | 3.21 | 36.0 | 3.72 | 40.0 | 4.26 |
| | | 7 | 17.0 | 1.98 | 21.0 | 2.37 | 27.5 | 2.80 | 30.1 | 3.03 | 32.1 | 3.27 | 35.7 | 3.79 | 39.5 | 4.34 |
| | | 10 | 17.0 | 2.56 | 20.2 | 2.97 | 23.6 | 3.39 | 25.2 | 3.62 | 26.8 | 3.83 | 30.1 | 4.31 | 33.5 | 4.80 |
| | | 12 | 17.0 | 2.58 | 20.2 | 3.00 | 23.6 | 3.45 | 25.2 | 3.66 | 26.8 | 3.90 | 30.1 | 4.38 | 33.5 | 4.88 |
| | | 14 | 17.0 | 2.62 | 20.2 | 3.04 | 23.6 | 3.48 | 25.2 | 3.73 | 26.8 | 3.96 | 30.1 | 4.46 | 33.5 | 4.98 |
| | | 16 | 17.0 | 2.66 | 20.2 | 3.08 | 23.6 | 3.54 | 25.2 | 3.79 | 26.8 | 4.02 | 30.1 | 4.54 | 33.5 | 5.05 |
| | | 18 | 17.0 | 2.70 | 20.2 | 3.14 | 23.6 | 3.60 | 25.2 | 3.85 | 26.8 | 4.10 | 30.1 | 4.61 | 33.5 | 5.15 |
| | | 20 | 17.0 | 2.74 | 20.2 | 3.18 | 23.6 | 3.66 | 25.2 | 3.92 | 26.8 | 4.17 | 30.1 | 4.71 | 33.5 | 5.24 |
| | | 21 | 17.0 | 2.76 | 20.2 | 3.22 | 23.6 | 3.69 | 25.2 | 3.94 | 26.8 | 4.21 | 30.1 | 4.75 | 33.5 | 5.30 |
| | | 23 | 17.0 | 2.79 | 20.2 | 3.25 | 23.6 | 3.75 | 25.2 | 4.02 | 26.8 | 4.29 | 30.1 | 4.82 | 33.5 | 5.42 |
| | | 25 | 17.0 | 2.83 | 20.2 | 3.31 | 23.6 | 3.83 | 25.2 | 4.10 | 26.8 | 4.42 | 30.1 | 5.07 | 33.5 | 5.78 |
| | | 27 | 17.0 | 2.89 | 20.2 | 3.45 | 23.6 | 4.04 | 25.2 | 4.36 | 26.8 | 4.69 | 30.1 | 5.40 | 33.5 | 6.16 |
| | | 29 | 17.0 | 3.04 | 20.2 | 3.64 | 23.6 | 4.29 | 25.2 | 4.63 | 26.7 | 5.00 | 30.1 | 5.74 | 33.5 | 6.57 |
| | | 31 | 17.0 | 3.22 | 20.2 | 3.85 | 23.6 | 4.57 | 25.2 | 4.92 | 26.7 | 5.30 | 30.1 | 6.11 | 33.5 | 6.99 |
| | | 33 | 17.0 | 3.41 | 20.2 | 4.08 | 23.6 | 4.82 | 25.2 | 5.21 | 26.7 | 5.63 | 30.1 | 6.49 | 33.5 | 7.43 |
| | | 35 | 17.0 | 3.60 | 20.2 | 4.31 | 23.6 | 5.09 | 25.2 | 5.51 | 26.7 | 5.95 | 30.1 | 6.89 | 33.5 | 7.89 |
| | | 37 | 17.0 | 3.79 | 20.2 | 4.56 | 23.6 | 5.40 | 24.7 | 5.84 | 26.7 | 6.32 | 30.1 | 7.31 | 33.5 | 8.38 |
| | | 39 | 17.0 | 4.00 | 20.2 | 4.80 | 23.6 | 5.70 | 24.4 | 6.18 | 26.7 | 6.70 | 30.1 | 7.75 | 33.5 | 8.90 |
| | | 41 | 16.1 | 4.53 | 19.2 | 5.43 | 22.4 | 6.41 | 24.0 | 6.39 | 25.4 | 6.90 | 28.7 | 7.99 | 31.9 | 9.15 |
| | | 44 | 15.0 | 4.93 | 18.2 | 5.90 | 21.3 | 7.13 | 22.9 | 7.22 | 24.4 | 7.44 | 27.6 | 8.41 | 30.8 | 9.62 |
| | | 47 | 14.1 | 6.56 | 17.6 | 7.85 | 20.6 | 7.48 | 22.1 | 7.33 | 23.5 | 7.92 | 26.7 | 9.03 | 29.8 | 10.33 |
| | | 50 | 12.9 | 6.44 | 15.8 | 7.71 | 18.4 | 7.89 | 19.7 | 8.49 | 21.0 | 8.69 | 23.8 | 9.78 | 26.8 | 10.88 |
| | | 52 | 9.8 | 5.43 | 11.7 | 6.50 | 13.8 | 6.72 | 14.9 | 7.22 | 16.0 | 7.62 | 19.0 | 8.61 | 21.8 | 9.46 |

CHV-5S560NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Indoor air temp. | | | | | | | | | | | | | | | | |
|------------------|-----------------------------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|----------|------|-------|
| Combination | Outdoor air temp. (°CDB) | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | | |
| | | TC | PI | |
| 135% | -5 | kW | kW | |
| | | 49.2 | 7.07 | 58.6 | 8.61 | 68.0 | 8.72 | 70.6 | 8.76 | 72.0 | 8.81 | 73.8 | 8.91 | 76.0 | 9.01 | |
| | | 0 | 49.2 | 7.09 | 58.6 | 8.63 | 68.0 | 8.73 | 70.6 | 8.78 | 72.0 | 8.83 | 73.8 | 8.93 | 76.0 | 9.02 |
| | | 4 | 49.2 | 7.11 | 58.6 | 8.66 | 68.0 | 8.77 | 70.6 | 8.81 | 72.0 | 8.86 | 73.8 | 8.96 | 76.0 | 9.06 |
| | | 7 | 49.2 | 7.25 | 58.6 | 8.82 | 68.0 | 8.93 | 70.6 | 8.98 | 72.0 | 9.02 | 73.2 | 9.13 | 75.0 | 9.23 |
| | | 10 | 49.2 | 7.37 | 58.6 | 9.01 | 68.0 | 10.72 | 70.6 | 10.95 | 71.4 | 10.74 | 73.2 | 10.28 | 75.0 | 9.81 |
| | | 12 | 49.2 | 7.50 | 58.6 | 9.18 | 68.0 | 10.93 | 69.6 | 10.89 | 70.6 | 10.67 | 72.2 | 10.20 | 74.0 | 10.05 |
| | | 14 | 49.2 | 7.65 | 58.6 | 9.36 | 67.8 | 11.06 | 68.8 | 10.84 | 69.6 | 10.61 | 71.4 | 10.52 | 73.2 | 10.63 |
| | | 16 | 49.2 | 7.78 | 58.6 | 9.55 | 67.0 | 11.02 | 67.8 | 10.93 | 68.6 | 10.97 | 70.4 | 11.08 | 72.2 | 11.19 |
| | | 18 | 49.2 | 7.93 | 58.6 | 9.75 | 66.0 | 11.43 | 66.8 | 11.49 | 67.8 | 11.56 | 69.6 | 11.66 | 71.4 | 11.77 |
| | | 20 | 49.2 | 8.11 | 58.6 | 10.37 | 65.0 | 11.99 | 66.0 | 12.05 | 66.8 | 12.12 | 68.6 | 12.22 | 70.4 | 12.35 |
| | | 21 | 49.2 | 8.32 | 58.6 | 10.74 | 64.6 | 12.27 | 65.6 | 12.33 | 66.4 | 12.40 | 68.2 | 12.53 | 70.0 | 12.63 |
| | | 23 | 49.2 | 8.93 | 58.6 | 11.51 | 63.8 | 12.83 | 64.6 | 12.89 | 65.4 | 12.96 | 67.2 | 13.09 | 69.0 | 13.22 |
| | | 25 | 49.2 | 9.53 | 58.6 | 12.33 | 62.8 | 13.39 | 63.8 | 13.45 | 64.6 | 13.54 | 66.4 | 13.67 | 68.2 | 13.80 |
| | | 27 | 49.2 | 10.18 | 58.6 | 13.19 | 62.0 | 11.79 | 62.8 | 14.04 | 63.6 | 14.10 | 65.4 | 14.25 | 67.2 | 14.40 |
| | | 29 | 49.2 | 10.87 | 58.6 | 14.10 | 61.0 | 14.51 | 61.8 | 14.60 | 62.8 | 14.68 | 64.6 | 14.83 | 66.4 | 14.98 |
| | | 31 | 49.2 | 11.60 | 58.4 | 14.92 | 60.0 | 15.09 | 61.0 | 15.18 | 61.8 | 15.24 | 63.6 | 15.42 | 65.4 | 15.59 |
| | | 33 | 49.2 | 12.35 | 57.4 | 15.48 | 59.2 | 15.63 | 60.0 | 15.74 | 61.0 | 15.83 | 62.8 | 16.00 | 64.4 | 16.19 |
| | | 35 | 49.2 | 13.17 | 56.4 | 16.04 | 58.2 | 16.23 | 59.2 | 16.32 | 60.0 | 16.41 | 61.8 | 16.60 | 63.6 | 16.77 |
| | | 37 | 49.2 | 14.01 | 55.6 | 16.62 | 57.4 | 16.82 | 58.2 | 16.90 | 59.2 | 17.01 | 60.8 | 17.20 | 62.6 | 17.40 |
| | | 39 | 49.2 | 14.92 | 54.6 | 17.18 | 56.4 | 17.38 | 57.4 | 17.49 | 58.2 | 17.59 | 60.0 | 17.79 | 61.8 | 18.00 |
| | | 41 | 46.5 | 16.60 | 53.6 | 20.21 | 55.3 | 20.46 | 56.3 | 18.93 | 57.1 | 19.03 | 58.8 | 19.26 | 60.6 | 19.46 |
| | | 44 | 43.3 | 18.05 | 50.8 | 21.98 | 52.7 | 22.73 | 53.9 | 21.38 | 54.8 | 20.51 | 56.6 | 20.25 | 58.5 | 20.46 |
| | | 47 | 40.8 | 24.01 | 49.1 | 29.24 | 50.9 | 23.86 | 52.0 | 21.71 | 52.8 | 21.82 | 54.7 | 21.75 | 56.6 | 21.97 |
| | | 50 | 37.4 | 23.58 | 44.0 | 28.71 | 45.5 | 25.16 | 46.4 | 25.13 | 47.1 | 23.95 | 48.8 | 23.57 | 50.9 | 23.15 |
| | | 52 | 28.3 | 19.89 | 32.7 | 24.22 | 34.0 | 21.43 | 34.9 | 21.38 | 36.0 | 21.00 | 38.9 | 20.75 | 41.3 | 20.13 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120% | -5 | 45.4 | 6.30 | 56.1 | 8.15 | 66.8 | 8.66 | 69.2 | 8.71 | 70.8 | 8.75 | 72.4 | 8.85 | 74.3 | 8.94 |
| | 0 | 45.4 | 6.31 | 56.1 | 8.17 | 66.8 | 8.68 | 69.2 | 8.72 | 70.8 | 8.77 | 72.4 | 8.86 | 74.3 | 8.95 |
| | 4 | 45.4 | 6.33 | 56.1 | 8.20 | 66.8 | 8.71 | 69.2 | 8.76 | 70.8 | 8.80 | 72.4 | 8.89 | 74.3 | 8.99 |
| | 7 | 45.4 | 6.45 | 56.1 | 8.35 | 66.8 | 8.87 | 69.2 | 8.92 | 70.8 | 8.96 | 71.8 | 9.06 | 73.3 | 9.15 |
| | 10 | 45.4 | 6.73 | 54.0 | 8.21 | 62.8 | 9.77 | 67.2 | 10.56 | 70.4 | 11.02 | 72.0 | 10.59 | 73.6 | 10.18 |
| | 12 | 45.4 | 6.86 | 54.0 | 8.37 | 62.8 | 9.96 | 67.2 | 10.76 | 69.4 | 10.95 | 71.0 | 10.54 | 72.6 | 10.11 |
| | 14 | 45.4 | 6.99 | 54.0 | 8.54 | 62.8 | 10.15 | 67.2 | 10.97 | 68.4 | 10.89 | 70.2 | 10.48 | 71.8 | 10.54 |
| | 16 | 45.4 | 7.11 | 54.0 | 8.71 | 62.8 | 10.35 | 66.8 | 11.06 | 67.6 | 10.91 | 69.2 | 11.02 | 70.8 | 11.10 |
| | 18 | 45.4 | 7.24 | 54.0 | 8.88 | 62.8 | 10.72 | 65.8 | 11.43 | 66.6 | 11.47 | 68.2 | 11.58 | 70.0 | 11.69 |
| | 20 | 45.4 | 7.40 | 54.0 | 9.23 | 62.8 | 11.51 | 65.0 | 11.99 | 65.8 | 12.03 | 67.4 | 12.14 | 69.0 | 12.25 |
| | 21 | 45.4 | 7.46 | 54.0 | 9.55 | 62.8 | 11.92 | 64.4 | 12.27 | 65.2 | 12.31 | 67.0 | 12.42 | 68.6 | 12.55 |
| | 23 | 45.4 | 7.98 | 54.0 | 10.24 | 62.8 | 12.76 | 63.6 | 12.81 | 64.4 | 12.87 | 66.0 | 13.00 | 67.6 | 13.11 |
| | 25 | 45.4 | 8.52 | 54.0 | 10.95 | 61.8 | 13.32 | 62.6 | 13.37 | 63.4 | 13.43 | 65.2 | 13.56 | 66.8 | 13.69 |
| | 27 | 45.4 | 9.10 | 54.0 | 11.71 | 61.0 | 13.86 | 61.8 | 13.95 | 62.6 | 14.01 | 64.2 | 14.14 | 65.8 | 14.27 |
| | 29 | 45.4 | 9.70 | 54.0 | 12.50 | 60.0 | 14.42 | 60.8 | 14.51 | 61.6 | 14.57 | 63.2 | 14.73 | 65.0 | 14.85 |
| | 31 | 45.4 | 10.35 | 54.0 | 13.35 | 59.2 | 15.01 | 60.0 | 15.07 | 60.8 | 15.16 | 62.4 | 15.31 | 64.0 | 15.46 |
| | 33 | 45.4 | 11.02 | 54.0 | 14.25 | 58.2 | 15.57 | 59.0 | 15.65 | 59.8 | 15.72 | 61.4 | 15.89 | 63.0 | 16.04 |
| | 35 | 45.4 | 11.73 | 54.0 | 15.18 | 57.2 | 16.13 | 58.0 | 16.21 | 59.0 | 16.30 | 60.6 | 16.47 | 62.2 | 16.64 |
| | 37 | 45.4 | 12.48 | 54.0 | 16.17 | 56.4 | 16.71 | 57.2 | 16.80 | 58.0 | 16.88 | 59.6 | 17.05 | 61.2 | 17.25 |
| | 39 | 45.4 | 13.28 | 53.8 | 17.08 | 55.4 | 17.27 | 56.2 | 17.38 | 57.0 | 17.46 | 58.8 | 17.66 | 60.4 | 17.83 |
| | 41 | 42.9 | 14.78 | 51.3 | 19.12 | 54.4 | 20.32 | 55.1 | 18.81 | 56.1 | 18.91 | 57.7 | 19.11 | 59.3 | 19.31 |
| | 44 | 40.0 | 16.07 | 48.6 | 20.79 | 51.8 | 22.58 | 52.8 | 21.24 | 53.9 | 20.37 | 55.5 | 20.10 | 57.2 | 20.31 |
| | 47 | 37.7 | 21.38 | 47.0 | 27.67 | 50.1 | 23.71 | 50.9 | 21.56 | 51.9 | 21.68 | 53.6 | 21.58 | 55.4 | 21.80 |
| | 50 | 34.5 | 20.99 | 42.1 | 27.17 | 44.7 | 25.00 | 45.4 | 24.97 | 46.3 | 23.80 | 47.9 | 23.39 | 49.8 | 22.97 |
| | 52 | 26.2 | 17.71 | 31.3 | 22.92 | 33.5 | 21.29 | 34.2 | 21.24 | 35.4 | 20.86 | 38.2 | 20.59 | 40.4 | 19.97 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110% | -5 | 41.6 | 5.57 | 51.5 | 7.17 | 65.9 | 8.60 | 68.0 | 8.65 | 69.4 | 8.69 | 70.7 | 8.78 | 72.7 | 8.86 |
| | 0 | 41.6 | 5.58 | 51.5 | 7.18 | 65.9 | 8.62 | 68.0 | 8.66 | 69.4 | 8.71 | 70.7 | 8.79 | 72.7 | 8.87 |
| | 4 | 41.6 | 5.60 | 51.5 | 7.21 | 65.9 | 8.65 | 68.0 | 8.70 | 69.4 | 8.74 | 70.7 | 8.82 | 72.7 | 8.91 |
| | 7 | 41.6 | 5.70 | 51.5 | 7.34 | 65.9 | 8.81 | 68.0 | 8.86 | 69.4 | 8.91 | 70.1 | 8.99 | 71.7 | 9.07 |
| | 10 | 41.6 | 6.10 | 49.6 | 7.44 | 57.6 | 8.84 | 61.6 | 9.55 | 65.6 | 10.28 | 70.6 | 10.91 | 72.2 | 10.54 |
| | 12 | 41.6 | 6.23 | 49.6 | 7.59 | 57.6 | 9.01 | 61.6 | 9.75 | 65.6 | 10.48 | 69.8 | 10.87 | 71.2 | 10.48 |
| | 14 | 41.6 | 6.34 | 49.6 | 7.72 | 57.6 | 9.18 | 61.6 | 9.92 | 65.6 | 10.67 | 68.8 | 10.87 | 70.4 | 10.46 |
| | 16 | 41.6 | 6.45 | 49.6 | 7.87 | 57.6 | 9.36 | 61.6 | 10.11 | 65.6 | 10.89 | 68.0 | 10.93 | 69.4 | 11.04 |
| | 18 | 41.6 | 6.58 | 49.6 | 8.02 | 57.6 | 9.55 | 61.6 | 10.39 | 65.6 | 11.41 | 67.0 | 11.49 | 68.6 | 11.60 |
| | 20 | 41.6 | 6.71 | 49.6 | 8.19 | 57.6 | 10.11 | 61.6 | 11.17 | 64.6 | 11.97 | 66.2 | 12.05 | 67.6 | 12.16 |
| | 21 | 41.6 | 6.77 | 49.6 | 8.43 | 57.6 | 10.48 | 61.6 | 11.58 | 64.2 | 12.25 | 65.6 | 12.33 | 67.2 | 12.44 |
| | 23 | 41.6 | 7.09 | 49.6 | 9.03 | 57.6 | 11.23 | 61.6 | 12.42 | 63.2 | 12.79 | 64.8 | 12.91 | 66.2 | 13.02 |
| | 25 | 41.6 | 7.55 | 49.6 | 9.66 | 57.6 | 12.01 | 61.6 | 13.30 | 62.4 | 13.35 | 63.8 | 13.48 | 65.4 | 13.58 |
| | 27 | 41.6 | 8.06 | 49.6 | 10.33 | 57.6 | 12.85 | 60.6 | 13.86 | 61.4 | 13.91 | 63.0 | 14.04 | 64.4 | 14.16 |
| | 29 | 41.6 | 8.60 | 49.6 | 11.02 | 57.6 | 13.73 | 59.8 | 14.42 | 60.6 | 14.49 | 62.0 | 14.62 | 63.6 | 14.75 |
| | 31 | 41.6 | 9.16 | 49.6 | 11.75 | 57.6 | 14.66 | 58.8 | 14.98 | 59.6 | 15.05 | 61.2 | 15.18 | 62.6 | 15.33 |
| | 33 | 41.6 | 9.75 | 49.6 | 12.53 | 57.2 | 15.46 | 58.0 | 15.54 | 58.8 | 15.61 | 60.2 | 15.76 | 61.8 | 15.91 |
| | 35 | 41.6 | 10.37 | 49.6 | 13.35 | 56.4 | 16.02 | 57.0 | 16.11 | 57.8 | 16.19 | 59.2 | 16.34 | 60.8 | 16.49 |
| | 37 | 41.6 | 11.04 | 49.6 | 14.21 | 55.4 | 16.60 | 56.2 | 16.67 | 56.8 | 16.75 | 58.4 | 16.92 | 59.8 | 17.08 |
| | 39 | 41.6 | 11.73 | 49.6 | 15.14 | 54.4 | 17.16 | 55.2 | 17.25 | 56.0 | 17.33 | 57.4 | 17.51 | 59.0 | 17.68 |
| | 41 | 39.3 | 13.07 | 47.1 | 16.82 | 53.6 | 20.18 | 54.2 | 18.68 | 55.0 | 18.78 | 56.4 | 18.96 | 57.9 | 19.13 |
| | 44 | 36.6 | 14.21 | 44.6 | 18.28 | 51.0 | 22.43 | 51.9 | 21.10 | 52.8 | 20.24 | 54.2 | 19.94 | 55.9 | 20.12 |
| | 47 | 34.5 | 18.91 | 43.2 | 24.33 | 49.4 | 23.55 | 50.0 | 21.42 | 50.9 | 21.53 | 52.4 | 21.41 | 54.1 | 21.61 |
| | 50 | 31.6 | 18.56 | 38.7 | 23.89 | 44.0 | 24.83 | 44.6 | 24.80 | 45.4 | 23.64 | 46.8 | 23.21 | 48.6 | 22.76 |
| | 52 | 24.0 | 15.66 | 28.8 | 20.15 | 33.0 | 21.15 | 33.6 | 21.10 | 34.7 | 20.73 | 37.3 | 20.43 | 39.5 | 19.79 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100% | -5 | 37.8 | 4.87 | 46.8 | 6.24 | 61.2 | 7.77 | 66.8 | 8.59 | 67.9 | 8.63 | 69.2 | 8.71 | 70.9 | 8.79 |
| | 0 | 37.8 | 4.88 | 46.8 | 6.25 | 61.2 | 7.79 | 66.8 | 8.61 | 67.9 | 8.65 | 69.2 | 8.73 | 70.9 | 8.81 |
| | 4 | 37.8 | 4.90 | 46.8 | 6.27 | 61.2 | 7.82 | 66.8 | 8.64 | 67.9 | 8.68 | 69.2 | 8.76 | 70.9 | 8.84 |
| | 7 | 37.8 | 4.99 | 46.8 | 6.39 | 61.2 | 7.96 | 66.8 | 8.80 | 67.9 | 8.84 | 68.6 | 8.92 | 70.0 | 9.00 |
| | 10 | 37.8 | 5.52 | 45.0 | 6.71 | 52.4 | 7.93 | 56.0 | 8.56 | 59.6 | 9.25 | 67.0 | 10.47 | 70.8 | 10.88 |
| | 12 | 37.8 | 5.59 | 45.0 | 6.79 | 52.4 | 8.04 | 56.0 | 8.68 | 59.6 | 9.43 | 67.0 | 10.65 | 69.8 | 10.79 |
| | 14 | 37.8 | 5.69 | 45.0 | 6.91 | 52.4 | 8.17 | 56.0 | 8.84 | 59.6 | 9.60 | 67.0 | 10.83 | 69.0 | 10.70 |
| | 16 | 37.8 | 5.82 | 45.0 | 7.07 | 52.4 | 8.36 | 56.0 | 9.03 | 59.6 | 9.82 | 66.8 | 11.07 | 68.0 | 10.95 |
| | 18 | 37.8 | 5.95 | 45.0 | 7.23 | 52.4 | 8.52 | 56.0 | 9.21 | 59.6 | 10.01 | 65.8 | 11.29 | 67.2 | 11.46 |
| | 20 | 37.8 | 6.04 | 45.0 | 7.34 | 52.4 | 8.80 | 56.0 | 9.69 | 59.6 | 10.64 | 64.8 | 11.88 | 66.2 | 12.06 |
| | 21 | 37.8 | 6.10 | 45.0 | 7.41 | 52.4 | 9.10 | 56.0 | 10.02 | 59.6 | 11.01 | 64.4 | 12.29 | 65.8 | 12.40 |
| | 23 | 37.8 | 6.26 | 45.0 | 7.92 | 52.4 | 9.79 | 56.0 | 10.78 | 59.6 | 11.84 | 63.6 | 13.00 | 64.8 | 13.12 |
| | 25 | 37.8 | 6.66 | 45.0 | 8.42 | 52.4 | 10.41 | 56.0 | 11.47 | 59.6 | 12.66 | 62.6 | 13.48 | 64.0 | 13.60 |
| | 27 | 37.8 | 7.11 | 45.0 | 9.00 | 52.4 | 11.17 | 56.0 | 12.30 | 59.6 | 13.58 | 61.6 | 13.95 | 63.0 | 14.08 |
| | 29 | 37.8 | 7.53 | 45.0 | 9.61 | 52.4 | 11.95 | 56.0 | 13.16 | 59.4 | 14.39 | 60.8 | 14.62 | 62.2 | 14.75 |
| | 31 | 37.8 | 8.01 | 45.0 | 10.24 | 52.4 | 12.74 | 56.0 | 14.18 | 58.7 | 14.97 | 59.4 | 15.22 | 61.2 | 15.35 |
| | 33 | 37.8 | 8.52 | 45.0 | 10.90 | 52.4 | 13.58 | 56.0 | 15.01 | 57.6 | 15.51 | 59.1 | 15.65 | 60.4 | 15.80 |
| | 35 | 37.8 | 9.07 | 45.0 | 11.61 | 52.4 | 14.48 | 56.0 | 16.00 | 56.6 | 16.08 | 58.0 | 16.22 | 59.4 | 16.37 |
| | 37 | 37.8 | 9.66 | 45.0 | 12.37 | 52.4 | 15.42 | 55.0 | 16.57 | 55.9 | 16.66 | 57.1 | 16.77 | 58.5 | 16.92 |
| | 39 | 37.8 | 10.29 | 45.0 | 13.17 | 52.4 | 16.42 | 54.3 | 17.12 | 54.5 | 17.21 | 56.4 | 17.33 | 57.1 | 17.48 |
| | 41 | 35.7 | 11.43 | 42.7 | 14.63 | 49.8 | 18.24 | 53.2 | 18.56 | 53.8 | 18.65 | 55.2 | 18.82 | 56.6 | 18.99 |
| | 44 | 33.3 | 12.42 | 40.5 | 15.91 | 47.4 | 20.27 | 51.0 | 20.96 | 51.7 | 20.10 | 53.1 | 19.79 | 54.6 | 19.97 |
| | 47 | 31.4 | 16.53 | 39.1 | 21.17 | 45.8 | 21.28 | 49.2 | 21.28 | 49.8 | 21.38 | 51.3 | 21.25 | 52.8 | 21.44 |
| | 50 | 28.7 | 16.23 | 35.1 | 20.78 | 40.9 | 22.44 | 43.8 | 24.64 | 44.4 | 23.47 | 45.8 | 23.04 | 47.5 | 22.59 |
| | 52 | 21.8 | 13.69 | 26.1 | 17.53 | 30.7 | 19.11 | 33.0 | 20.96 | 34.0 | 20.58 | 36.5 | 20.28 | 38.6 | 19.64 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 34.0 | 4.25 | 42.1 | 5.38 | 55.1 | 6.64 | 60.1 | 7.34 | 64.4 | 8.07 | 67.8 | 8.63 | 69.3 | 8.71 |
| | 0 | 34.0 | 4.26 | 42.1 | 5.39 | 55.1 | 6.65 | 60.1 | 7.35 | 64.4 | 8.09 | 67.8 | 8.65 | 69.3 | 8.73 |
| | 4 | 34.0 | 4.27 | 42.1 | 5.41 | 55.1 | 6.68 | 60.1 | 7.38 | 64.4 | 8.12 | 67.8 | 8.68 | 69.3 | 8.76 |
| | 7 | 34.0 | 4.35 | 42.1 | 5.51 | 55.1 | 6.80 | 60.1 | 7.51 | 64.4 | 8.27 | 67.3 | 8.84 | 68.4 | 8.92 |
| | 10 | 34.0 | 4.82 | 40.5 | 5.78 | 47.2 | 6.77 | 50.4 | 7.63 | 53.6 | 8.12 | 60.3 | 9.31 | 66.8 | 10.55 |
| | 12 | 34.0 | 4.88 | 40.5 | 5.86 | 47.2 | 6.86 | 50.4 | 7.73 | 53.6 | 8.28 | 60.3 | 9.47 | 66.8 | 10.68 |
| | 14 | 34.0 | 4.96 | 40.5 | 5.96 | 47.2 | 6.98 | 50.4 | 7.85 | 53.6 | 8.42 | 60.3 | 9.63 | 66.8 | 10.86 |
| | 16 | 34.0 | 5.08 | 40.5 | 6.10 | 47.2 | 7.14 | 50.4 | 8.03 | 53.6 | 8.61 | 60.3 | 9.85 | 66.6 | 11.07 |
| | 18 | 34.0 | 5.19 | 40.5 | 6.23 | 47.2 | 7.28 | 50.4 | 8.18 | 53.6 | 8.78 | 60.3 | 10.08 | 66.0 | 11.47 |
| | 20 | 34.0 | 5.27 | 40.5 | 6.33 | 47.2 | 7.52 | 50.4 | 8.35 | 53.6 | 9.15 | 60.3 | 10.83 | 64.8 | 11.95 |
| | 21 | 34.0 | 5.32 | 40.5 | 6.39 | 47.2 | 7.77 | 50.4 | 8.63 | 53.6 | 9.46 | 60.3 | 11.20 | 64.4 | 12.22 |
| | 23 | 34.0 | 5.46 | 40.5 | 6.83 | 47.2 | 8.36 | 50.4 | 9.28 | 53.6 | 10.13 | 60.3 | 12.03 | 63.4 | 12.85 |
| | 25 | 34.0 | 5.81 | 40.5 | 7.26 | 47.2 | 8.89 | 50.4 | 9.90 | 53.6 | 10.83 | 60.3 | 12.86 | 62.6 | 13.37 |
| | 27 | 34.0 | 6.20 | 40.5 | 7.76 | 47.2 | 9.54 | 50.4 | 10.56 | 53.6 | 11.60 | 60.3 | 13.73 | 61.6 | 13.95 |
| | 29 | 34.0 | 6.57 | 40.5 | 8.29 | 47.2 | 10.20 | 50.4 | 11.29 | 53.6 | 12.38 | 59.6 | 14.39 | 60.8 | 14.52 |
| | 31 | 34.0 | 6.99 | 40.5 | 8.83 | 47.2 | 10.88 | 50.4 | 12.05 | 53.6 | 13.21 | 58.6 | 14.91 | 59.8 | 15.11 |
| | 33 | 34.0 | 7.44 | 40.5 | 9.40 | 47.2 | 11.60 | 50.4 | 12.81 | 53.6 | 14.05 | 57.8 | 15.52 | 59.0 | 15.66 |
| | 35 | 34.0 | 7.91 | 40.5 | 10.01 | 47.2 | 12.36 | 50.4 | 13.66 | 53.6 | 15.03 | 56.8 | 16.08 | 58.0 | 16.22 |
| | 37 | 34.0 | 8.43 | 40.5 | 10.67 | 47.2 | 13.17 | 49.5 | 14.15 | 53.6 | 16.08 | 55.8 | 16.66 | 57.2 | 16.61 |
| | 39 | 34.0 | 8.97 | 40.5 | 11.36 | 47.2 | 14.02 | 48.8 | 14.62 | 53.6 | 17.04 | 55.0 | 17.28 | 56.2 | 17.23 |
| | 41 | 32.1 | 9.97 | 38.5 | 12.62 | 44.8 | 15.58 | 47.9 | 15.85 | 51.0 | 17.43 | 54.1 | 18.65 | 55.3 | 18.82 |
| | 44 | 29.9 | 10.84 | 36.4 | 13.72 | 42.7 | 17.31 | 45.9 | 17.90 | 49.0 | 18.79 | 52.0 | 19.62 | 53.4 | 19.79 |
| | 47 | 28.2 | 14.42 | 35.2 | 18.26 | 41.3 | 18.18 | 44.3 | 18.17 | 47.2 | 19.99 | 50.3 | 21.06 | 51.6 | 21.25 |
| | 50 | 25.9 | 14.16 | 31.6 | 17.93 | 36.8 | 19.16 | 39.5 | 21.04 | 42.1 | 21.94 | 44.9 | 22.83 | 46.4 | 22.39 |
| | 52 | 19.6 | 11.95 | 23.5 | 15.12 | 27.6 | 16.32 | 29.7 | 17.90 | 32.2 | 19.24 | 35.8 | 20.10 | 37.7 | 19.47 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80% | -5 | 30.2 | 3.67 | 37.4 | 4.53 | 49.0 | 5.63 | 53.4 | 6.19 | 57.0 | 6.77 | 64.0 | 8.04 | 67.6 | 8.61 |
| | 0 | 30.2 | 3.68 | 37.4 | 4.54 | 49.0 | 5.64 | 53.4 | 6.21 | 57.0 | 6.78 | 64.0 | 8.05 | 67.6 | 8.63 |
| | 4 | 30.2 | 3.69 | 37.4 | 4.55 | 49.0 | 5.66 | 53.4 | 6.23 | 57.0 | 6.81 | 64.0 | 8.08 | 67.6 | 8.66 |
| | 7 | 30.2 | 3.76 | 37.4 | 4.64 | 49.0 | 5.76 | 53.4 | 6.34 | 57.0 | 6.93 | 63.5 | 8.23 | 66.7 | 8.82 |
| | 10 | 30.2 | 4.38 | 36.0 | 5.24 | 41.9 | 6.17 | 44.8 | 6.64 | 47.7 | 7.11 | 53.6 | 8.12 | 59.4 | 9.43 |
| | 12 | 30.2 | 4.44 | 36.0 | 5.33 | 41.9 | 6.27 | 44.8 | 6.77 | 47.7 | 7.25 | 53.6 | 8.26 | 59.4 | 9.36 |
| | 14 | 30.2 | 4.53 | 36.0 | 5.43 | 41.9 | 6.38 | 44.8 | 6.88 | 47.7 | 7.38 | 53.6 | 8.41 | 59.4 | 9.57 |
| | 16 | 30.2 | 4.59 | 36.0 | 5.52 | 41.9 | 6.51 | 44.8 | 7.01 | 47.7 | 7.49 | 53.6 | 8.60 | 59.4 | 9.92 |
| | 18 | 30.2 | 4.68 | 36.0 | 5.63 | 41.9 | 6.66 | 44.8 | 7.16 | 47.7 | 7.64 | 53.6 | 8.79 | 59.4 | 10.61 |
| | 20 | 30.2 | 4.76 | 36.0 | 5.73 | 41.9 | 6.77 | 44.8 | 7.29 | 47.7 | 7.81 | 53.6 | 9.11 | 59.4 | 10.99 |
| | 21 | 30.2 | 4.81 | 36.0 | 5.78 | 41.9 | 6.83 | 44.8 | 7.37 | 47.7 | 7.99 | 53.6 | 9.44 | 59.4 | 11.77 |
| | 23 | 30.2 | 4.89 | 36.0 | 5.91 | 41.9 | 7.16 | 44.8 | 7.85 | 47.7 | 8.54 | 53.6 | 10.09 | 59.4 | 12.58 |
| | 25 | 30.2 | 5.05 | 36.0 | 6.27 | 41.9 | 7.65 | 44.8 | 8.39 | 47.7 | 9.12 | 53.6 | 10.81 | 59.4 | 13.43 |
| | 27 | 30.2 | 5.37 | 36.0 | 6.68 | 41.9 | 8.15 | 44.8 | 8.95 | 47.7 | 9.78 | 53.6 | 11.53 | 59.4 | 13.90 |
| | 29 | 30.2 | 5.71 | 36.0 | 7.11 | 41.9 | 8.69 | 44.8 | 9.53 | 47.5 | 10.43 | 53.6 | 12.31 | 59.4 | 14.41 |
| | 31 | 30.2 | 6.06 | 36.0 | 7.57 | 41.9 | 9.25 | 44.8 | 10.15 | 47.5 | 11.12 | 53.6 | 13.14 | 58.4 | 14.93 |
| | 33 | 30.2 | 6.45 | 36.0 | 8.43 | 41.9 | 9.85 | 44.8 | 10.82 | 47.5 | 11.84 | 53.6 | 14.02 | 57.6 | 15.47 |
| | 35 | 30.2 | 6.83 | 36.0 | 8.43 | 41.9 | 10.48 | 44.8 | 11.53 | 47.5 | 12.61 | 53.6 | 14.96 | 56.6 | 16.03 |
| | 37 | 30.2 | 7.24 | 36.0 | 9.08 | 41.9 | 11.15 | 44.0 | 12.28 | 47.5 | 13.43 | 53.6 | 15.94 | 55.8 | 16.63 |
| | 39 | 30.2 | 7.68 | 36.0 | 9.64 | 41.9 | 11.86 | 43.4 | 13.08 | 47.5 | 14.30 | 53.6 | 16.97 | 54.8 | 17.24 |
| | 41 | 28.6 | 8.61 | 34.2 | 10.62 | 39.8 | 13.20 | 42.6 | 13.38 | 45.2 | 14.62 | 51.0 | 17.36 | 53.9 | 18.60 |
| | 44 | 26.6 | 9.36 | 32.4 | 11.55 | 37.9 | 14.67 | 40.8 | 15.11 | 43.4 | 15.76 | 49.1 | 18.26 | 52.1 | 19.56 |
| | 47 | 25.1 | 12.46 | 31.3 | 15.37 | 36.7 | 15.40 | 39.3 | 15.34 | 41.8 | 16.77 | 47.4 | 19.60 | 50.4 | 21.00 |
| | 50 | 23.0 | 12.23 | 28.1 | 15.09 | 32.7 | 16.24 | 35.1 | 17.76 | 37.3 | 18.41 | 42.3 | 21.25 | 45.3 | 22.12 |
| | 52 | 17.4 | 10.32 | 20.9 | 12.73 | 24.5 | 13.83 | 26.4 | 15.11 | 28.5 | 16.14 | 33.8 | 18.71 | 36.8 | 19.24 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70% | -5 | 26.5 | 3.13 | 32.7 | 3.87 | 42.9 | 4.69 | 46.7 | 5.14 | 50.1 | 5.60 | 56.0 | 6.60 | 62.1 | 7.68 |
| | 0 | 26.5 | 3.13 | 32.7 | 3.87 | 42.9 | 4.70 | 46.7 | 5.15 | 50.1 | 5.61 | 56.0 | 6.61 | 62.1 | 7.69 |
| | 4 | 26.5 | 3.14 | 32.7 | 3.89 | 42.9 | 4.72 | 46.7 | 5.17 | 50.1 | 5.63 | 56.0 | 6.64 | 62.1 | 7.72 |
| | 7 | 26.5 | 3.20 | 32.7 | 3.96 | 42.9 | 4.80 | 46.7 | 5.26 | 50.1 | 5.74 | 55.5 | 6.76 | 61.3 | 7.86 |
| | 10 | 26.5 | 3.86 | 31.5 | 4.57 | 36.7 | 5.33 | 39.2 | 5.73 | 41.7 | 6.14 | 46.9 | 6.99 | 52.0 | 7.85 |
| | 12 | 26.5 | 3.90 | 31.5 | 4.64 | 36.7 | 5.43 | 39.2 | 5.84 | 41.7 | 6.25 | 46.9 | 7.11 | 52.0 | 8.00 |
| | 14 | 26.5 | 3.97 | 31.5 | 4.72 | 36.7 | 5.52 | 39.2 | 5.93 | 41.7 | 6.36 | 46.9 | 7.24 | 52.0 | 8.15 |
| | 16 | 26.5 | 4.03 | 31.5 | 4.81 | 36.7 | 5.63 | 39.2 | 6.06 | 41.7 | 6.49 | 46.9 | 7.37 | 52.0 | 8.30 |
| | 18 | 26.5 | 4.10 | 31.5 | 4.89 | 36.7 | 5.73 | 39.2 | 6.17 | 41.7 | 6.60 | 46.9 | 7.52 | 52.0 | 8.47 |
| | 20 | 26.5 | 4.16 | 31.5 | 4.98 | 36.7 | 5.84 | 39.2 | 6.27 | 41.7 | 6.73 | 46.9 | 7.68 | 52.0 | 8.71 |
| | 21 | 26.5 | 4.20 | 31.5 | 5.02 | 36.7 | 5.89 | 39.2 | 6.34 | 41.7 | 6.79 | 46.9 | 7.76 | 52.0 | 9.01 |
| | 23 | 26.5 | 4.27 | 31.5 | 5.11 | 36.7 | 6.02 | 39.2 | 6.55 | 41.7 | 7.14 | 46.9 | 8.34 | 52.0 | 9.66 |
| | 25 | 26.5 | 4.36 | 31.5 | 5.33 | 36.7 | 6.40 | 39.2 | 7.01 | 41.7 | 7.61 | 46.9 | 8.93 | 52.0 | 10.33 |
| | 27 | 26.5 | 4.61 | 31.5 | 5.67 | 36.7 | 6.83 | 39.2 | 7.46 | 41.7 | 8.13 | 46.9 | 9.53 | 52.0 | 11.04 |
| | 29 | 26.5 | 4.89 | 31.5 | 6.02 | 36.7 | 7.27 | 39.2 | 7.96 | 41.7 | 8.65 | 46.9 | 10.15 | 52.0 | 11.79 |
| | 31 | 26.5 | 5.17 | 31.5 | 6.38 | 36.7 | 7.74 | 39.2 | 8.45 | 41.7 | 9.21 | 46.9 | 10.82 | 52.0 | 12.57 |
| | 33 | 26.5 | 5.50 | 31.5 | 6.79 | 36.7 | 8.24 | 39.2 | 8.99 | 41.7 | 9.81 | 46.9 | 11.53 | 52.0 | 13.41 |
| | 35 | 26.5 | 5.82 | 31.5 | 7.20 | 36.7 | 8.73 | 39.2 | 9.57 | 41.7 | 10.44 | 46.9 | 12.29 | 52.0 | 14.29 |
| | 37 | 26.5 | 6.14 | 31.5 | 7.63 | 36.7 | 9.29 | 38.5 | 10.18 | 41.7 | 11.10 | 46.9 | 13.09 | 52.0 | 15.22 |
| | 39 | 26.5 | 6.51 | 31.5 | 8.09 | 36.7 | 9.85 | 38.0 | 10.80 | 41.7 | 11.79 | 46.9 | 13.91 | 52.0 | 16.21 |
| | 41 | 25.0 | 7.33 | 29.9 | 9.07 | 34.9 | 11.00 | 37.3 | 11.10 | 39.7 | 12.10 | 44.6 | 14.26 | 49.6 | 16.58 |
| | 44 | 23.3 | 7.98 | 28.3 | 9.87 | 33.2 | 12.22 | 35.7 | 12.54 | 38.1 | 13.04 | 42.9 | 14.99 | 47.8 | 17.44 |
| | 47 | 22.0 | 10.61 | 27.4 | 13.13 | 32.1 | 12.84 | 34.4 | 12.73 | 36.7 | 13.88 | 41.5 | 16.10 | 46.3 | 18.73 |
| | 50 | 20.1 | 10.42 | 24.6 | 12.89 | 28.6 | 13.53 | 30.7 | 14.74 | 32.7 | 15.24 | 37.0 | 17.45 | 41.6 | 19.73 |
| | 52 | 15.2 | 8.79 | 18.3 | 10.87 | 21.5 | 11.53 | 23.1 | 12.54 | 25.0 | 13.36 | 29.5 | 15.36 | 33.8 | 17.15 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60% | -5 | 22.7 | 2.63 | 28.1 | 3.21 | 36.7 | 3.84 | 40.1 | 4.19 | 42.9 | 4.55 | 48.0 | 5.31 | 53.3 | 6.14 |
| | 0 | 22.7 | 2.63 | 28.1 | 3.21 | 36.7 | 3.85 | 40.1 | 4.20 | 42.9 | 4.56 | 48.0 | 5.32 | 53.3 | 6.15 |
| | 4 | 22.7 | 2.64 | 28.1 | 3.22 | 36.7 | 3.87 | 40.1 | 4.21 | 42.9 | 4.58 | 48.0 | 5.34 | 53.3 | 6.17 |
| | 7 | 22.7 | 2.69 | 28.1 | 3.28 | 36.7 | 3.94 | 40.1 | 4.29 | 42.9 | 4.66 | 47.6 | 5.44 | 52.6 | 6.28 |
| | 10 | 22.7 | 3.34 | 27.0 | 3.92 | 31.4 | 4.55 | 33.6 | 4.87 | 35.8 | 5.20 | 40.2 | 5.89 | 44.6 | 6.60 |
| | 12 | 22.7 | 3.41 | 27.0 | 3.99 | 31.4 | 4.64 | 33.6 | 4.96 | 35.8 | 5.28 | 40.2 | 5.99 | 44.6 | 6.71 |
| | 14 | 22.7 | 3.45 | 27.0 | 4.05 | 31.4 | 4.70 | 33.6 | 5.05 | 35.8 | 5.39 | 40.2 | 6.10 | 44.6 | 6.83 |
| | 16 | 22.7 | 3.49 | 27.0 | 4.12 | 31.4 | 4.79 | 33.6 | 5.13 | 35.8 | 5.48 | 40.2 | 6.21 | 44.6 | 6.96 |
| | 18 | 22.7 | 3.56 | 27.0 | 4.18 | 31.4 | 4.87 | 33.6 | 5.22 | 35.8 | 5.58 | 40.2 | 6.32 | 44.6 | 7.09 |
| | 20 | 22.7 | 3.60 | 27.0 | 4.27 | 31.4 | 4.96 | 33.6 | 5.33 | 35.8 | 5.69 | 40.2 | 6.45 | 44.6 | 7.24 |
| | 21 | 22.7 | 3.64 | 27.0 | 4.29 | 31.4 | 5.00 | 33.6 | 5.37 | 35.8 | 5.73 | 40.2 | 6.51 | 44.6 | 7.31 |
| | 23 | 22.7 | 3.69 | 27.0 | 4.38 | 31.4 | 5.09 | 33.6 | 5.48 | 35.8 | 5.84 | 40.2 | 6.77 | 44.6 | 7.78 |
| | 25 | 22.7 | 3.75 | 27.0 | 4.46 | 31.4 | 5.28 | 33.6 | 5.73 | 35.8 | 6.21 | 40.2 | 7.22 | 44.6 | 8.30 |
| | 27 | 22.7 | 3.90 | 27.0 | 4.72 | 31.4 | 5.63 | 33.6 | 6.12 | 35.8 | 6.62 | 40.2 | 7.70 | 44.6 | 8.86 |
| | 29 | 22.7 | 4.12 | 27.0 | 5.00 | 31.4 | 5.99 | 33.6 | 6.51 | 35.8 | 7.05 | 40.2 | 8.21 | 44.6 | 9.46 |
| | 31 | 22.7 | 4.38 | 27.0 | 5.33 | 31.4 | 6.36 | 33.6 | 6.92 | 35.8 | 7.50 | 40.2 | 8.73 | 44.6 | 10.07 |
| | 33 | 22.7 | 4.61 | 27.0 | 5.63 | 31.4 | 6.75 | 33.6 | 7.35 | 35.8 | 7.98 | 40.2 | 9.29 | 44.6 | 10.74 |
| | 35 | 22.7 | 4.89 | 27.0 | 5.97 | 31.4 | 7.16 | 33.6 | 7.80 | 35.8 | 8.47 | 40.2 | 9.90 | 44.6 | 11.43 |
| | 37 | 22.7 | 5.17 | 27.0 | 6.32 | 31.4 | 7.59 | 33.0 | 8.28 | 35.8 | 8.99 | 40.2 | 10.52 | 44.6 | 12.16 |
| | 39 | 22.7 | 5.45 | 27.0 | 6.68 | 31.4 | 8.04 | 32.6 | 8.77 | 35.8 | 9.55 | 40.2 | 11.17 | 44.6 | 12.94 |
| | 41 | 21.4 | 6.17 | 25.6 | 7.52 | 29.9 | 9.02 | 31.9 | 9.05 | 34.0 | 9.83 | 38.3 | 11.48 | 42.5 | 13.26 |
| | 44 | 20.0 | 6.70 | 24.3 | 8.18 | 28.5 | 10.02 | 30.6 | 10.22 | 32.6 | 10.59 | 36.8 | 12.07 | 41.0 | 13.94 |
| | 47 | 18.8 | 8.92 | 23.5 | 10.89 | 27.5 | 10.52 | 29.5 | 10.38 | 31.5 | 11.27 | 35.6 | 12.96 | 39.7 | 14.97 |
| | 50 | 17.2 | 8.76 | 21.1 | 10.69 | 24.6 | 11.09 | 26.3 | 12.02 | 28.1 | 12.37 | 31.7 | 14.05 | 35.7 | 15.77 |
| | 52 | 13.1 | 7.39 | 15.7 | 9.02 | 18.4 | 9.45 | 19.8 | 10.22 | 21.5 | 10.85 | 25.3 | 12.37 | 29.0 | 13.71 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|------|----------|------|----------|------|----------|------|----------|------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 50% | -5 | 18.9 | 2.18 | 23.4 | 2.60 | 30.6 | 3.08 | 33.4 | 3.33 | 35.6 | 3.60 | 40.0 | 4.17 | 44.5 | 4.77 |
| | 0 | 18.9 | 2.18 | 23.4 | 2.61 | 30.6 | 3.09 | 33.4 | 3.34 | 35.6 | 3.61 | 40.0 | 4.18 | 44.5 | 4.78 |
| | 4 | 18.9 | 2.19 | 23.4 | 2.62 | 30.6 | 3.10 | 33.4 | 3.35 | 35.6 | 3.62 | 40.0 | 4.19 | 44.5 | 4.80 |
| | 7 | 18.9 | 2.23 | 23.4 | 2.67 | 30.6 | 3.15 | 33.4 | 3.42 | 35.6 | 3.69 | 39.7 | 4.27 | 43.9 | 4.89 |
| | 10 | 18.9 | 2.89 | 22.5 | 3.34 | 26.2 | 3.82 | 28.0 | 4.07 | 29.8 | 4.31 | 33.5 | 4.85 | 37.2 | 5.41 |
| | 12 | 18.9 | 2.91 | 22.5 | 3.38 | 26.2 | 3.88 | 28.0 | 4.12 | 29.8 | 4.40 | 33.5 | 4.94 | 37.2 | 5.50 |
| | 14 | 18.9 | 2.95 | 22.5 | 3.43 | 26.2 | 3.92 | 28.0 | 4.20 | 29.8 | 4.46 | 33.5 | 5.02 | 37.2 | 5.61 |
| | 16 | 18.9 | 3.00 | 22.5 | 3.47 | 26.2 | 3.99 | 28.0 | 4.27 | 29.8 | 4.53 | 33.5 | 5.11 | 37.2 | 5.69 |
| | 18 | 18.9 | 3.04 | 22.5 | 3.54 | 26.2 | 4.05 | 28.0 | 4.33 | 29.8 | 4.61 | 33.5 | 5.20 | 37.2 | 5.80 |
| | 20 | 18.9 | 3.08 | 22.5 | 3.58 | 26.2 | 4.12 | 28.0 | 4.42 | 29.8 | 4.70 | 33.5 | 5.30 | 37.2 | 5.91 |
| | 21 | 18.9 | 3.10 | 22.5 | 3.62 | 26.2 | 4.16 | 28.0 | 4.44 | 29.8 | 4.74 | 33.5 | 5.35 | 37.2 | 5.97 |
| | 23 | 18.9 | 3.15 | 22.5 | 3.67 | 26.2 | 4.23 | 28.0 | 4.53 | 29.8 | 4.83 | 33.5 | 5.43 | 37.2 | 6.10 |
| | 25 | 18.9 | 3.19 | 22.5 | 3.73 | 26.2 | 4.31 | 28.0 | 4.61 | 29.8 | 4.98 | 33.5 | 5.71 | 37.2 | 6.51 |
| | 27 | 18.9 | 3.26 | 22.5 | 3.88 | 26.2 | 4.55 | 28.0 | 4.92 | 29.8 | 5.28 | 33.5 | 6.08 | 37.2 | 6.94 |
| | 29 | 18.9 | 3.43 | 22.5 | 4.10 | 26.2 | 4.83 | 28.0 | 5.22 | 29.7 | 5.63 | 33.5 | 6.47 | 37.2 | 7.40 |
| | 31 | 18.9 | 3.62 | 22.5 | 4.33 | 26.2 | 5.15 | 28.0 | 5.54 | 29.7 | 5.97 | 33.5 | 6.88 | 37.2 | 7.87 |
| | 33 | 18.9 | 3.84 | 22.5 | 4.59 | 26.2 | 5.43 | 28.0 | 5.86 | 29.7 | 6.34 | 33.5 | 7.31 | 37.2 | 8.37 |
| | 35 | 18.9 | 4.05 | 22.5 | 4.85 | 26.2 | 5.73 | 28.0 | 6.21 | 29.7 | 6.71 | 33.5 | 7.76 | 37.2 | 8.88 |
| | 37 | 18.9 | 4.27 | 22.5 | 5.13 | 26.2 | 6.08 | 27.5 | 6.58 | 29.7 | 7.11 | 33.5 | 8.24 | 37.2 | 9.44 |
| | 39 | 18.9 | 4.51 | 22.5 | 5.41 | 26.2 | 6.42 | 27.1 | 6.96 | 29.7 | 7.55 | 33.5 | 8.73 | 37.2 | 10.03 |
| | 41 | 17.9 | 5.11 | 21.4 | 6.11 | 24.9 | 7.23 | 26.6 | 7.20 | 28.2 | 7.78 | 31.9 | 9.00 | 35.5 | 10.30 |
| | 44 | 16.6 | 5.55 | 20.2 | 6.65 | 23.7 | 8.03 | 25.5 | 8.13 | 27.1 | 8.38 | 30.7 | 9.47 | 34.2 | 10.84 |
| | 47 | 15.7 | 7.39 | 19.6 | 8.84 | 22.9 | 8.43 | 24.6 | 8.26 | 26.1 | 8.92 | 29.6 | 10.17 | 33.1 | 11.64 |
| | 50 | 14.4 | 7.26 | 17.5 | 8.68 | 20.5 | 8.89 | 21.9 | 9.56 | 23.3 | 9.79 | 26.5 | 11.02 | 29.8 | 12.26 |
| | 52 | 10.9 | 6.12 | 13.0 | 7.33 | 15.3 | 7.57 | 16.5 | 8.13 | 17.8 | 8.58 | 21.1 | 9.70 | 24.2 | 10.66 |

CHV-5S615NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 135% | -5 | 54.0 | 8.18 | 64.4 | 9.96 | 74.7 | 10.08 | 77.5 | 10.13 | 79.1 | 10.19 | 81.1 | 10.31 | 83.5 | 10.42 |
| | 0 | 54.0 | 8.19 | 64.4 | 9.98 | 74.7 | 10.10 | 77.5 | 10.15 | 79.1 | 10.21 | 81.1 | 10.33 | 83.5 | 10.43 |
| | 4 | 54.0 | 8.23 | 64.4 | 10.02 | 74.7 | 10.14 | 77.5 | 10.19 | 79.1 | 10.24 | 81.1 | 10.37 | 83.5 | 10.47 |
| | 7 | 54.0 | 8.38 | 64.4 | 10.20 | 74.7 | 10.32 | 77.5 | 10.38 | 79.1 | 10.43 | 80.4 | 10.56 | 82.4 | 10.67 |
| | 10 | 54.0 | 8.53 | 64.4 | 10.42 | 74.7 | 12.39 | 77.5 | 12.66 | 78.4 | 12.42 | 80.4 | 11.89 | 82.4 | 11.34 |
| | 12 | 54.0 | 8.68 | 64.4 | 10.62 | 74.7 | 12.64 | 76.4 | 12.59 | 77.5 | 12.34 | 79.3 | 11.79 | 81.3 | 11.62 |
| | 14 | 54.0 | 8.85 | 64.4 | 10.82 | 74.5 | 12.79 | 75.6 | 12.54 | 76.4 | 12.27 | 78.4 | 12.17 | 80.4 | 12.29 |
| | 16 | 54.0 | 9.00 | 64.4 | 11.04 | 73.6 | 12.74 | 74.5 | 12.64 | 75.3 | 12.69 | 77.3 | 12.81 | 79.3 | 12.94 |
| | 18 | 54.0 | 9.17 | 64.4 | 11.27 | 72.5 | 13.21 | 73.4 | 13.29 | 74.5 | 13.36 | 76.4 | 13.49 | 78.4 | 13.61 |
| | 20 | 54.0 | 9.37 | 64.4 | 11.99 | 71.4 | 13.86 | 72.5 | 13.94 | 73.4 | 14.01 | 75.3 | 14.14 | 77.3 | 14.28 |
| | 21 | 54.0 | 9.62 | 64.4 | 12.42 | 70.9 | 14.19 | 72.0 | 14.26 | 72.9 | 14.33 | 74.9 | 14.48 | 76.9 | 14.61 |
| | 23 | 54.0 | 10.32 | 64.4 | 13.31 | 70.1 | 14.83 | 70.9 | 14.91 | 71.8 | 14.98 | 73.8 | 15.13 | 75.8 | 15.28 |
| | 25 | 54.0 | 11.02 | 64.4 | 14.26 | 69.0 | 15.48 | 70.1 | 15.56 | 70.9 | 15.66 | 72.9 | 15.81 | 74.9 | 15.96 |
| | 27 | 54.0 | 11.77 | 64.4 | 15.26 | 68.1 | 13.64 | 69.0 | 16.23 | 69.8 | 16.30 | 71.8 | 16.48 | 73.8 | 16.65 |
| | 29 | 54.0 | 12.56 | 64.4 | 16.30 | 67.0 | 16.78 | 67.9 | 16.88 | 69.0 | 16.98 | 70.9 | 17.15 | 72.9 | 17.33 |
| | 31 | 54.0 | 13.41 | 64.1 | 17.25 | 65.9 | 17.45 | 67.0 | 17.55 | 67.9 | 17.63 | 69.8 | 17.82 | 71.8 | 18.02 |
| | 33 | 54.0 | 14.28 | 63.0 | 17.90 | 65.0 | 18.07 | 65.9 | 18.20 | 67.0 | 18.30 | 69.0 | 18.50 | 70.7 | 18.72 |
| | 35 | 54.0 | 15.23 | 61.9 | 18.55 | 63.9 | 18.77 | 65.0 | 18.87 | 65.9 | 18.97 | 67.9 | 19.20 | 69.8 | 19.40 |
| | 37 | 54.0 | 16.20 | 61.1 | 19.22 | 63.0 | 19.45 | 63.9 | 19.55 | 65.0 | 19.67 | 66.8 | 19.89 | 68.8 | 20.12 |
| | 39 | 54.0 | 17.25 | 60.0 | 19.87 | 61.9 | 20.09 | 63.0 | 20.22 | 63.9 | 20.34 | 65.9 | 20.57 | 67.9 | 20.82 |
| | 41 | 51.1 | 19.19 | 58.8 | 23.37 | 60.7 | 23.65 | 61.8 | 21.89 | 62.7 | 22.01 | 64.6 | 22.27 | 66.6 | 22.50 |
| | 44 | 47.5 | 20.87 | 55.7 | 25.41 | 57.8 | 26.28 | 59.2 | 24.72 | 60.2 | 23.71 | 62.2 | 23.42 | 64.3 | 23.66 |
| | 47 | 44.8 | 27.77 | 53.9 | 33.81 | 55.9 | 27.60 | 57.1 | 25.10 | 58.0 | 25.23 | 60.1 | 25.15 | 62.2 | 25.41 |
| | 50 | 41.1 | 27.27 | 48.3 | 33.20 | 49.9 | 29.10 | 50.9 | 29.06 | 51.7 | 27.70 | 53.6 | 27.26 | 55.9 | 26.77 |
| | 52 | 31.1 | 23.00 | 35.9 | 28.01 | 37.4 | 24.78 | 38.4 | 24.72 | 39.5 | 24.28 | 42.8 | 24.00 | 45.4 | 23.27 |
| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120% | -5 | 49.9 | 7.28 | 61.6 | 9.42 | 73.4 | 10.01 | 76.0 | 10.07 | 77.8 | 10.12 | 79.5 | 10.23 | 81.6 | 10.34 |
| | 0 | 49.9 | 7.30 | 61.6 | 9.44 | 73.4 | 10.03 | 76.0 | 10.09 | 77.8 | 10.14 | 79.5 | 10.25 | 81.6 | 10.35 |
| | 4 | 49.9 | 7.32 | 61.6 | 9.48 | 73.4 | 10.07 | 76.0 | 10.12 | 77.8 | 10.18 | 79.5 | 10.29 | 81.6 | 10.39 |
| | 7 | 49.9 | 7.46 | 61.6 | 9.65 | 73.4 | 10.26 | 76.0 | 10.31 | 77.8 | 10.37 | 78.8 | 10.48 | 80.6 | 10.59 |
| | 10 | 49.9 | 7.78 | 59.3 | 9.50 | 69.0 | 11.29 | 73.8 | 12.22 | 77.3 | 12.74 | 79.1 | 12.24 | 80.8 | 11.77 |
| | 12 | 49.9 | 7.93 | 59.3 | 9.67 | 69.0 | 11.52 | 73.8 | 12.44 | 76.2 | 12.66 | 78.0 | 12.19 | 79.7 | 11.69 |
| | 14 | 49.9 | 8.08 | 59.3 | 9.87 | 69.0 | 11.74 | 73.8 | 12.69 | 75.1 | 12.59 | 77.1 | 12.12 | 78.9 | 12.19 |
| | 16 | 49.9 | 8.23 | 59.3 | 10.07 | 69.0 | 11.97 | 73.4 | 12.79 | 74.2 | 12.61 | 76.0 | 12.74 | 77.8 | 12.84 |
| | 18 | 49.9 | 8.38 | 59.3 | 10.27 | 69.0 | 12.39 | 72.3 | 13.21 | 73.1 | 13.26 | 74.9 | 13.39 | 76.9 | 13.51 |
| | 20 | 49.9 | 8.55 | 59.3 | 10.67 | 69.0 | 13.31 | 71.4 | 13.86 | 72.3 | 13.91 | 74.0 | 14.04 | 75.8 | 14.16 |
| | 21 | 49.9 | 8.63 | 59.3 | 11.04 | 69.0 | 13.79 | 70.7 | 14.19 | 71.6 | 14.24 | 73.6 | 14.36 | 75.3 | 14.51 |
| | 23 | 49.9 | 9.22 | 59.3 | 11.84 | 69.0 | 14.76 | 69.8 | 14.81 | 70.7 | 14.88 | 72.5 | 15.03 | 74.2 | 15.16 |
| | 25 | 49.9 | 9.85 | 59.3 | 12.66 | 67.9 | 15.41 | 68.8 | 15.46 | 69.6 | 15.53 | 71.6 | 15.68 | 73.4 | 15.83 |
| | 27 | 49.9 | 10.52 | 59.3 | 13.54 | 67.0 | 16.03 | 67.9 | 16.13 | 68.8 | 16.20 | 70.5 | 16.35 | 72.3 | 16.50 |
| | 29 | 49.9 | 11.22 | 59.3 | 14.46 | 65.9 | 16.68 | 66.8 | 16.78 | 67.7 | 16.85 | 69.4 | 17.03 | 71.4 | 17.18 |
| | 31 | 49.9 | 11.97 | 59.3 | 15.43 | 65.0 | 17.35 | 65.9 | 17.43 | 66.8 | 17.53 | 68.5 | 17.70 | 70.3 | 17.87 |
| | 33 | 49.9 | 12.74 | 59.3 | 16.48 | 63.9 | 18.00 | 64.8 | 18.10 | 65.7 | 18.17 | 67.4 | 18.37 | 69.2 | 18.55 |
| | 35 | 49.9 | 13.56 | 59.3 | 17.55 | 62.8 | 18.65 | 63.7 | 18.75 | 64.8 | 18.85 | 66.6 | 19.05 | 68.3 | 19.25 |
| | 37 | 49.9 | 14.43 | 59.3 | 18.70 | 61.9 | 19.32 | 62.8 | 19.42 | 63.7 | 19.52 | 65.5 | 19.72 | 67.2 | 19.94 |
| | 39 | 49.9 | 15.36 | 59.1 | 19.74 | 60.8 | 19.97 | 61.7 | 20.09 | 62.6 | 20.19 | 64.6 | 20.42 | 66.3 | 20.62 |
| | 41 | 47.1 | 17.09 | 56.3 | 22.11 | 59.7 | 23.50 | 60.5 | 21.75 | 61.6 | 21.86 | 63.4 | 22.09 | 65.1 | 22.33 |
| | 44 | 43.9 | 18.58 | 53.4 | 24.04 | 56.9 | 26.11 | 58.0 | 24.56 | 59.2 | 23.56 | 61.0 | 23.24 | 62.8 | 23.48 |
| | 47 | 41.4 | 24.72 | 51.6 | 31.99 | 55.0 | 27.41 | 55.9 | 24.93 | 57.0 | 25.07 | 58.9 | 24.95 | 60.8 | 25.21 |
| | 50 | 37.9 | 24.28 | 46.3 | 31.42 | 49.1 | 28.90 | 49.9 | 28.87 | 50.9 | 27.52 | 52.6 | 27.05 | 54.6 | 26.56 |
| | 52 | 28.7 | 20.48 | 34.4 | 26.50 | 36.7 | 24.61 | 37.6 | 24.56 | 38.9 | 24.12 | 41.9 | 23.81 | 44.4 | 23.10 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110% | -5 | 45.7 | 6.44 | 56.6 | 8.29 | 72.4 | 9.95 | 74.7 | 10.00 | 76.2 | 10.05 | 77.6 | 10.15 | 79.8 | 10.24 |
| | 0 | 45.7 | 6.45 | 56.6 | 8.30 | 72.4 | 9.97 | 74.7 | 10.02 | 76.2 | 10.07 | 77.6 | 10.17 | 79.8 | 10.26 |
| | 4 | 45.7 | 6.48 | 56.6 | 8.33 | 72.4 | 10.00 | 74.7 | 10.06 | 76.2 | 10.11 | 77.6 | 10.20 | 79.8 | 10.30 |
| | 7 | 45.7 | 6.60 | 56.6 | 8.49 | 72.4 | 10.19 | 74.7 | 10.24 | 76.2 | 10.30 | 77.0 | 10.39 | 78.7 | 10.49 |
| | 10 | 45.7 | 7.06 | 54.5 | 8.60 | 63.3 | 10.22 | 67.7 | 11.04 | 72.0 | 11.89 | 77.5 | 12.61 | 79.3 | 12.19 |
| | 12 | 45.7 | 7.20 | 54.5 | 8.78 | 63.3 | 10.42 | 67.7 | 11.27 | 72.0 | 12.12 | 76.7 | 12.56 | 78.2 | 12.12 |
| | 14 | 45.7 | 7.33 | 54.5 | 8.92 | 63.3 | 10.62 | 67.7 | 11.47 | 72.0 | 12.34 | 75.6 | 12.56 | 77.3 | 12.09 |
| | 16 | 45.7 | 7.45 | 54.5 | 9.10 | 63.3 | 10.82 | 67.7 | 11.69 | 72.0 | 12.59 | 74.7 | 12.64 | 76.2 | 12.76 |
| | 18 | 45.7 | 7.60 | 54.5 | 9.27 | 63.3 | 11.04 | 67.7 | 12.02 | 72.0 | 13.19 | 73.6 | 13.29 | 75.3 | 13.41 |
| | 20 | 45.7 | 7.75 | 54.5 | 9.47 | 63.3 | 11.69 | 67.7 | 12.91 | 70.9 | 13.84 | 72.7 | 13.94 | 74.2 | 14.06 |
| | 21 | 45.7 | 7.83 | 54.5 | 9.75 | 63.3 | 12.12 | 67.7 | 13.39 | 70.5 | 14.16 | 72.0 | 14.26 | 73.8 | 14.38 |
| | 23 | 45.7 | 8.20 | 54.5 | 10.45 | 63.3 | 12.99 | 67.7 | 14.36 | 69.4 | 14.78 | 71.2 | 14.93 | 72.7 | 15.06 |
| | 25 | 45.7 | 8.73 | 54.5 | 11.17 | 63.3 | 13.89 | 67.7 | 15.38 | 68.5 | 15.43 | 70.1 | 15.58 | 71.8 | 15.71 |
| | 27 | 45.7 | 9.32 | 54.5 | 11.94 | 63.3 | 14.86 | 66.6 | 16.03 | 67.4 | 16.08 | 69.2 | 16.23 | 70.7 | 16.38 |
| | 29 | 45.7 | 9.95 | 54.5 | 12.74 | 63.3 | 15.88 | 65.7 | 16.68 | 66.6 | 16.75 | 68.1 | 16.90 | 69.8 | 17.05 |
| | 31 | 45.7 | 10.60 | 54.5 | 13.59 | 63.3 | 16.95 | 64.6 | 17.33 | 65.5 | 17.40 | 67.2 | 17.55 | 68.8 | 17.73 |
| | 33 | 45.7 | 11.27 | 54.5 | 14.48 | 62.8 | 17.87 | 63.7 | 17.97 | 64.6 | 18.05 | 66.1 | 18.22 | 67.9 | 18.40 |
| | 35 | 45.7 | 11.99 | 54.5 | 15.43 | 61.9 | 18.52 | 62.6 | 18.62 | 63.5 | 18.72 | 65.0 | 18.90 | 66.8 | 19.07 |
| | 37 | 45.7 | 12.76 | 54.5 | 16.43 | 60.8 | 19.20 | 61.7 | 19.27 | 62.4 | 19.37 | 64.1 | 19.57 | 65.7 | 19.74 |
| | 39 | 45.7 | 13.56 | 54.5 | 17.50 | 59.7 | 19.84 | 60.6 | 19.94 | 61.5 | 20.04 | 63.0 | 20.24 | 64.8 | 20.44 |
| | 41 | 43.2 | 15.11 | 51.7 | 19.44 | 58.9 | 23.34 | 59.5 | 21.60 | 60.4 | 21.72 | 61.9 | 21.92 | 63.6 | 22.12 |
| | 44 | 40.2 | 16.43 | 49.0 | 21.14 | 56.1 | 25.93 | 57.0 | 24.40 | 58.0 | 23.40 | 59.6 | 23.05 | 61.4 | 23.27 |
| | 47 | 37.9 | 21.86 | 47.4 | 28.13 | 54.2 | 27.23 | 55.0 | 24.77 | 55.9 | 24.90 | 57.5 | 24.75 | 59.4 | 24.98 |
| | 50 | 34.7 | 21.46 | 42.5 | 27.62 | 48.4 | 28.71 | 49.0 | 28.68 | 49.8 | 27.33 | 51.4 | 26.83 | 53.4 | 26.32 |
| | 52 | 26.3 | 18.11 | 31.6 | 23.30 | 36.2 | 24.45 | 36.9 | 24.40 | 38.1 | 23.96 | 41.0 | 23.62 | 43.4 | 22.89 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100% | -5 | 41.5 | 5.63 | 51.3 | 7.21 | 67.2 | 8.99 | 73.3 | 9.93 | 74.6 | 9.98 | 76.0 | 10.07 | 77.9 | 10.16 |
| | 0 | 41.5 | 5.64 | 51.3 | 7.22 | 67.2 | 9.01 | 73.3 | 9.95 | 74.6 | 10.00 | 76.0 | 10.09 | 77.9 | 10.18 |
| | 4 | 41.5 | 5.66 | 51.3 | 7.25 | 67.2 | 9.04 | 73.3 | 9.99 | 74.6 | 10.04 | 76.0 | 10.13 | 77.9 | 10.22 |
| | 7 | 41.5 | 5.77 | 51.3 | 7.38 | 67.2 | 9.21 | 73.3 | 10.17 | 74.6 | 10.22 | 75.4 | 10.32 | 76.9 | 10.41 |
| | 10 | 41.5 | 6.38 | 49.4 | 7.75 | 57.5 | 9.17 | 61.5 | 9.90 | 65.5 | 10.69 | 73.6 | 12.10 | 77.7 | 12.58 |
| | 12 | 41.5 | 6.47 | 49.4 | 7.86 | 57.5 | 9.29 | 61.5 | 10.03 | 65.5 | 10.90 | 73.6 | 12.31 | 76.6 | 12.48 |
| | 14 | 41.5 | 6.58 | 49.4 | 7.99 | 57.5 | 9.45 | 61.5 | 10.22 | 65.5 | 11.10 | 73.6 | 12.52 | 75.8 | 12.38 |
| | 16 | 41.5 | 6.73 | 49.4 | 8.17 | 57.5 | 9.66 | 61.5 | 10.45 | 65.5 | 11.35 | 73.3 | 12.81 | 74.7 | 12.66 |
| | 18 | 41.5 | 6.88 | 49.4 | 8.36 | 57.5 | 9.85 | 61.5 | 10.65 | 65.5 | 11.57 | 72.3 | 13.05 | 73.8 | 13.25 |
| | 20 | 41.5 | 6.98 | 49.4 | 8.48 | 57.5 | 10.18 | 61.5 | 11.21 | 65.5 | 12.31 | 71.2 | 13.74 | 72.7 | 13.95 |
| | 21 | 41.5 | 7.05 | 49.4 | 8.57 | 57.5 | 10.52 | 61.5 | 11.59 | 65.5 | 12.73 | 70.7 | 14.21 | 72.3 | 14.34 |
| | 23 | 41.5 | 7.23 | 49.4 | 9.15 | 57.5 | 11.32 | 61.5 | 12.46 | 65.5 | 13.69 | 69.9 | 15.04 | 71.2 | 15.17 |
| | 25 | 41.5 | 7.70 | 49.4 | 9.74 | 57.5 | 12.04 | 61.5 | 13.26 | 65.5 | 14.64 | 68.7 | 15.58 | 70.3 | 15.72 |
| | 27 | 41.5 | 8.22 | 49.4 | 10.40 | 57.5 | 12.92 | 61.5 | 14.23 | 65.5 | 15.71 | 67.7 | 16.13 | 69.2 | 16.28 |
| | 29 | 41.5 | 8.71 | 49.4 | 11.12 | 57.5 | 13.82 | 61.5 | 15.22 | 65.2 | 16.64 | 66.7 | 16.91 | 68.3 | 17.06 |
| | 31 | 41.5 | 9.27 | 49.4 | 11.84 | 57.5 | 14.73 | 61.5 | 16.40 | 64.4 | 17.31 | 65.2 | 17.59 | 67.2 | 17.75 |
| | 33 | 41.5 | 9.86 | 49.4 | 12.61 | 57.5 | 15.70 | 61.5 | 17.35 | 63.3 | 17.94 | 64.9 | 18.10 | 66.3 | 18.26 |
| | 35 | 41.5 | 10.49 | 49.4 | 13.43 | 57.5 | 16.74 | 61.5 | 18.50 | 62.2 | 18.59 | 63.7 | 18.76 | 65.2 | 18.93 |
| | 37 | 41.5 | 11.17 | 49.4 | 14.30 | 57.5 | 17.83 | 60.4 | 19.16 | 61.4 | 19.26 | 62.7 | 19.40 | 64.3 | 19.57 |
| | 39 | 41.5 | 11.89 | 49.4 | 15.23 | 57.5 | 18.99 | 59.6 | 19.80 | 59.9 | 19.90 | 61.9 | 20.04 | 62.7 | 20.22 |
| | 41 | 39.2 | 13.21 | 47.0 | 16.92 | 54.7 | 21.09 | 58.5 | 21.46 | 59.1 | 21.57 | 60.6 | 21.76 | 62.1 | 21.95 |
| | 44 | 36.5 | 14.37 | 44.5 | 18.39 | 52.1 | 23.44 | 56.0 | 24.23 | 56.8 | 23.24 | 58.3 | 22.88 | 60.0 | 23.09 |
| | 47 | 34.5 | 19.12 | 43.0 | 24.48 | 50.4 | 24.61 | 54.0 | 24.60 | 54.7 | 24.73 | 56.3 | 24.57 | 58.0 | 24.79 |
| | 50 | 31.6 | 18.77 | 38.5 | 24.03 | 44.9 | 25.95 | 48.2 | 28.49 | 48.8 | 27.14 | 50.3 | 26.64 | 52.2 | 26.12 |
| | 52 | 23.9 | 15.83 | 28.7 | 20.27 | 33.7 | 22.10 | 36.3 | 24.23 | 37.3 | 23.80 | 40.1 | 23.45 | 42.4 | 22.71 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90% | -5 | 37.4 | 4.91 | 46.2 | 6.22 | 60.5 | 7.68 | 66.0 | 8.48 | 70.7 | 9.33 | 74.5 | 9.98 | 76.1 | 10.07 |
| | 0 | 37.4 | 4.92 | 46.2 | 6.23 | 60.5 | 7.69 | 66.0 | 8.50 | 70.7 | 9.35 | 74.5 | 10.00 | 76.1 | 10.09 |
| | 4 | 37.4 | 4.94 | 46.2 | 6.25 | 60.5 | 7.72 | 66.0 | 8.53 | 70.7 | 9.38 | 74.5 | 10.04 | 76.1 | 10.13 |
| | 7 | 37.4 | 5.03 | 46.2 | 6.37 | 60.5 | 7.86 | 66.0 | 8.69 | 70.7 | 9.56 | 73.9 | 10.23 | 75.1 | 10.32 |
| | 10 | 37.4 | 5.57 | 44.5 | 6.69 | 51.8 | 7.83 | 55.4 | 8.82 | 58.9 | 9.39 | 66.2 | 10.76 | 73.3 | 12.19 |
| | 12 | 37.4 | 5.64 | 44.5 | 6.78 | 51.8 | 7.93 | 55.4 | 8.94 | 58.9 | 9.58 | 66.2 | 10.95 | 73.3 | 12.35 |
| | 14 | 37.4 | 5.74 | 44.5 | 6.89 | 51.8 | 8.07 | 55.4 | 9.08 | 58.9 | 9.74 | 66.2 | 11.14 | 73.3 | 12.56 |
| | 16 | 37.4 | 5.87 | 44.5 | 7.05 | 51.8 | 8.25 | 55.4 | 9.28 | 58.9 | 9.96 | 66.2 | 11.39 | 73.1 | 12.80 |
| | 18 | 37.4 | 6.00 | 44.5 | 7.21 | 51.8 | 8.41 | 55.4 | 9.46 | 58.9 | 10.15 | 66.2 | 11.66 | 72.5 | 13.26 |
| | 20 | 37.4 | 6.09 | 44.5 | 7.32 | 51.8 | 8.69 | 55.4 | 9.65 | 58.9 | 10.58 | 66.2 | 12.52 | 71.2 | 13.82 |
| | 21 | 37.4 | 6.15 | 44.5 | 7.39 | 51.8 | 8.99 | 55.4 | 9.97 | 58.9 | 10.94 | 66.2 | 12.95 | 70.7 | 14.13 |
| | 23 | 37.4 | 6.31 | 44.5 | 7.90 | 51.8 | 9.66 | 55.4 | 10.73 | 58.9 | 11.71 | 66.2 | 13.91 | 69.6 | 14.85 |
| | 25 | 37.4 | 6.71 | 44.5 | 8.40 | 51.8 | 10.28 | 55.4 | 11.45 | 58.9 | 12.52 | 66.2 | 14.87 | 68.8 | 15.46 |
| | 27 | 37.4 | 7.17 | 44.5 | 8.97 | 51.8 | 11.03 | 55.4 | 12.22 | 58.9 | 13.41 | 66.2 | 15.87 | 67.7 | 16.13 |
| | 29 | 37.4 | 7.60 | 44.5 | 9.59 | 51.8 | 11.80 | 55.4 | 13.05 | 58.9 | 14.31 | 65.5 | 16.64 | 66.8 | 16.79 |
| | 31 | 37.4 | 8.08 | 44.5 | 10.21 | 51.8 | 12.58 | 55.4 | 13.93 | 58.9 | 15.27 | 64.4 | 17.24 | 65.7 | 17.47 |
| | 33 | 37.4 | 8.60 | 44.5 | 10.87 | 51.8 | 13.41 | 55.4 | 14.82 | 58.9 | 16.25 | 63.5 | 17.94 | 64.8 | 18.10 |
| | 35 | 37.4 | 9.15 | 44.5 | 11.58 | 51.8 | 14.30 | 55.4 | 15.80 | 58.9 | 17.38 | 62.4 | 18.59 | 63.7 | 18.76 |
| | 37 | 37.4 | 9.74 | 44.5 | 12.33 | 51.8 | 15.23 | 54.4 | 16.37 | 58.9 | 18.59 | 61.3 | 19.26 | 62.8 | 19.21 |
| | 39 | 37.4 | 10.38 | 44.5 | 13.13 | 51.8 | 16.22 | 53.6 | 16.91 | 58.9 | 19.71 | 60.4 | 19.98 | 61.7 | 19.92 |
| | 41 | 35.3 | 11.53 | 42.3 | 14.59 | 49.2 | 18.01 | 52.6 | 18.32 | 56.0 | 20.16 | 59.4 | 21.57 | 60.7 | 21.76 |
| | 44 | 32.9 | 12.53 | 40.0 | 15.86 | 46.9 | 20.02 | 50.4 | 20.69 | 53.8 | 21.72 | 57.1 | 22.68 | 58.6 | 22.89 |
| | 47 | 31.0 | 16.68 | 38.7 | 21.11 | 45.3 | 21.02 | 48.6 | 21.01 | 51.8 | 23.11 | 55.2 | 24.36 | 56.7 | 24.58 |
| | 50 | 28.4 | 16.38 | 34.7 | 20.73 | 40.5 | 22.16 | 43.3 | 24.33 | 46.2 | 25.37 | 49.3 | 26.40 | 51.0 | 25.89 |
| | 52 | 21.5 | 13.81 | 25.8 | 17.49 | 30.3 | 18.87 | 32.7 | 20.69 | 35.3 | 22.24 | 39.3 | 23.24 | 41.4 | 22.51 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80% | -5 | 33.2 | 4.24 | 41.1 | 5.23 | 53.8 | 6.51 | 58.7 | 7.16 | 62.6 | 7.83 | 70.3 | 9.29 | 74.3 | 9.96 |
| | 0 | 33.2 | 4.25 | 41.1 | 5.24 | 53.8 | 6.52 | 58.7 | 7.18 | 62.6 | 7.84 | 70.3 | 9.31 | 74.3 | 9.97 |
| | 4 | 33.2 | 4.27 | 41.1 | 5.26 | 53.8 | 6.54 | 58.7 | 7.20 | 62.6 | 7.87 | 70.3 | 9.34 | 74.3 | 10.01 |
| | 7 | 33.2 | 4.35 | 41.1 | 5.36 | 53.8 | 6.66 | 58.7 | 7.34 | 62.6 | 8.02 | 69.7 | 9.52 | 73.3 | 10.20 |
| | 10 | 33.2 | 5.06 | 39.5 | 6.06 | 46.0 | 7.13 | 49.2 | 7.68 | 52.4 | 8.22 | 58.8 | 9.39 | 65.2 | 10.91 |
| | 12 | 33.2 | 5.14 | 39.5 | 6.16 | 46.0 | 7.25 | 49.2 | 7.83 | 52.4 | 8.38 | 58.8 | 9.56 | 65.2 | 10.82 |
| | 14 | 33.2 | 5.24 | 39.5 | 6.28 | 46.0 | 7.38 | 49.2 | 7.95 | 52.4 | 8.53 | 58.8 | 9.72 | 65.2 | 11.06 |
| | 16 | 33.2 | 5.31 | 39.5 | 6.38 | 46.0 | 7.53 | 49.2 | 8.10 | 52.4 | 8.66 | 58.8 | 9.94 | 65.2 | 11.47 |
| | 18 | 33.2 | 5.41 | 39.5 | 6.51 | 46.0 | 7.70 | 49.2 | 8.28 | 52.4 | 8.83 | 58.8 | 10.16 | 65.2 | 12.26 |
| | 20 | 33.2 | 5.51 | 39.5 | 6.63 | 46.0 | 7.83 | 49.2 | 8.43 | 52.4 | 9.03 | 58.8 | 10.53 | 65.2 | 12.71 |
| | 21 | 33.2 | 5.56 | 39.5 | 6.68 | 46.0 | 7.90 | 49.2 | 8.53 | 52.4 | 9.23 | 58.8 | 10.91 | 65.2 | 13.61 |
| | 23 | 33.2 | 5.66 | 39.5 | 6.83 | 46.0 | 8.28 | 49.2 | 9.07 | 52.4 | 9.88 | 58.8 | 11.67 | 65.2 | 14.55 |
| | 25 | 33.2 | 5.83 | 39.5 | 7.25 | 46.0 | 8.85 | 49.2 | 9.70 | 52.4 | 10.54 | 58.8 | 12.50 | 65.2 | 15.53 |
| | 27 | 33.2 | 6.21 | 39.5 | 7.73 | 46.0 | 9.42 | 49.2 | 10.35 | 52.4 | 11.31 | 58.8 | 13.34 | 65.2 | 16.08 |
| | 29 | 33.2 | 6.61 | 39.5 | 8.23 | 46.0 | 10.05 | 49.2 | 11.02 | 52.2 | 12.06 | 58.8 | 14.23 | 65.2 | 16.66 |
| | 31 | 33.2 | 7.01 | 39.5 | 8.75 | 46.0 | 10.69 | 49.2 | 11.74 | 52.2 | 12.85 | 58.8 | 15.19 | 64.1 | 17.26 |
| | 33 | 33.2 | 7.45 | 39.5 | 9.75 | 46.0 | 11.39 | 49.2 | 12.51 | 52.2 | 13.69 | 58.8 | 16.21 | 63.3 | 17.89 |
| | 35 | 33.2 | 7.90 | 39.5 | 9.75 | 46.0 | 12.12 | 49.2 | 13.34 | 52.2 | 14.58 | 58.8 | 17.30 | 62.2 | 18.54 |
| | 37 | 33.2 | 8.38 | 39.5 | 10.50 | 46.0 | 12.89 | 48.3 | 14.20 | 52.2 | 15.52 | 58.8 | 18.43 | 61.3 | 19.22 |
| | 39 | 33.2 | 8.88 | 39.5 | 11.14 | 46.0 | 13.71 | 47.7 | 15.13 | 52.2 | 16.53 | 58.8 | 19.63 | 60.2 | 19.94 |
| | 41 | 31.4 | 9.96 | 37.6 | 12.28 | 43.7 | 15.27 | 46.8 | 15.47 | 49.6 | 16.91 | 56.0 | 20.07 | 59.2 | 21.50 |
| | 44 | 29.2 | 10.83 | 35.6 | 13.35 | 41.7 | 16.96 | 44.8 | 17.47 | 47.6 | 18.22 | 53.9 | 21.11 | 57.2 | 22.62 |
| | 47 | 27.6 | 14.41 | 34.4 | 17.77 | 40.3 | 17.81 | 43.2 | 17.74 | 45.9 | 19.39 | 52.1 | 22.67 | 55.3 | 24.29 |
| | 50 | 25.2 | 14.15 | 30.8 | 17.45 | 36.0 | 18.78 | 38.5 | 20.54 | 41.0 | 21.28 | 46.5 | 24.57 | 49.7 | 25.58 |
| | 52 | 19.1 | 11.93 | 22.9 | 14.72 | 26.9 | 15.99 | 29.0 | 17.47 | 31.3 | 18.66 | 37.1 | 21.63 | 40.4 | 22.25 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70% | -5 | 29.1 | 3.61 | 35.9 | 4.47 | 47.1 | 5.42 | 51.3 | 5.94 | 55.0 | 6.48 | 61.5 | 7.63 | 68.2 | 8.88 |
| | 0 | 29.1 | 3.62 | 35.9 | 4.48 | 47.1 | 5.43 | 51.3 | 5.96 | 55.0 | 6.49 | 61.5 | 7.65 | 68.2 | 8.89 |
| | 4 | 29.1 | 3.63 | 35.9 | 4.50 | 47.1 | 5.45 | 51.3 | 5.98 | 55.0 | 6.52 | 61.5 | 7.67 | 68.2 | 8.93 |
| | 7 | 29.1 | 3.70 | 35.9 | 4.58 | 47.1 | 5.55 | 51.3 | 6.09 | 55.0 | 6.64 | 61.0 | 7.82 | 67.3 | 9.09 |
| | 10 | 29.1 | 4.46 | 34.6 | 5.29 | 40.3 | 6.16 | 43.1 | 6.63 | 45.8 | 7.11 | 51.5 | 8.08 | 57.1 | 9.07 |
| | 12 | 29.1 | 4.51 | 34.6 | 5.36 | 40.3 | 6.28 | 43.1 | 6.76 | 45.8 | 7.23 | 51.5 | 8.23 | 57.1 | 9.25 |
| | 14 | 29.1 | 4.59 | 34.6 | 5.46 | 40.3 | 6.38 | 43.1 | 6.86 | 45.8 | 7.35 | 51.5 | 8.38 | 57.1 | 9.42 |
| | 16 | 29.1 | 4.66 | 34.6 | 5.56 | 40.3 | 6.51 | 43.1 | 7.01 | 45.8 | 7.50 | 51.5 | 8.53 | 57.1 | 9.60 |
| | 18 | 29.1 | 4.74 | 34.6 | 5.66 | 40.3 | 6.63 | 43.1 | 7.13 | 45.8 | 7.63 | 51.5 | 8.70 | 57.1 | 9.80 |
| | 20 | 29.1 | 4.81 | 34.6 | 5.76 | 40.3 | 6.76 | 43.1 | 7.25 | 45.8 | 7.78 | 51.5 | 8.88 | 57.1 | 10.07 |
| | 21 | 29.1 | 4.86 | 34.6 | 5.81 | 40.3 | 6.81 | 43.1 | 7.33 | 45.8 | 7.85 | 51.5 | 8.97 | 57.1 | 10.42 |
| | 23 | 29.1 | 4.94 | 34.6 | 5.91 | 40.3 | 6.96 | 43.1 | 7.58 | 45.8 | 8.25 | 51.5 | 9.65 | 57.1 | 11.17 |
| | 25 | 29.1 | 5.04 | 34.6 | 6.16 | 40.3 | 7.40 | 43.1 | 8.10 | 45.8 | 8.80 | 51.5 | 10.32 | 57.1 | 11.94 |
| | 27 | 29.1 | 5.34 | 34.6 | 6.56 | 40.3 | 7.90 | 43.1 | 8.63 | 45.8 | 9.40 | 51.5 | 11.02 | 57.1 | 12.76 |
| | 29 | 29.1 | 5.66 | 34.6 | 6.96 | 40.3 | 8.40 | 43.1 | 9.20 | 45.8 | 10.00 | 51.5 | 11.74 | 57.1 | 13.64 |
| | 31 | 29.1 | 5.98 | 34.6 | 7.38 | 40.3 | 8.95 | 43.1 | 9.77 | 45.8 | 10.65 | 51.5 | 12.51 | 57.1 | 14.53 |
| | 33 | 29.1 | 6.36 | 34.6 | 7.85 | 40.3 | 9.52 | 43.1 | 10.40 | 45.8 | 11.34 | 51.5 | 13.34 | 57.1 | 15.51 |
| | 35 | 29.1 | 6.73 | 34.6 | 8.33 | 40.3 | 10.10 | 43.1 | 11.07 | 45.8 | 12.07 | 51.5 | 14.21 | 57.1 | 16.53 |
| | 37 | 29.1 | 7.11 | 34.6 | 8.83 | 40.3 | 10.74 | 42.3 | 11.77 | 45.8 | 12.84 | 51.5 | 15.13 | 57.1 | 17.60 |
| | 39 | 29.1 | 7.53 | 34.6 | 9.35 | 40.3 | 11.39 | 41.7 | 12.49 | 45.8 | 13.64 | 51.5 | 16.08 | 57.1 | 18.75 |
| | 41 | 27.5 | 8.48 | 32.9 | 10.49 | 38.3 | 12.72 | 40.9 | 12.84 | 43.6 | 14.00 | 49.0 | 16.48 | 54.4 | 19.17 |
| | 44 | 25.6 | 9.22 | 31.1 | 11.41 | 36.5 | 14.14 | 39.2 | 14.50 | 41.8 | 15.08 | 47.2 | 17.34 | 52.5 | 20.16 |
| | 47 | 24.1 | 12.27 | 30.1 | 15.18 | 35.2 | 14.84 | 37.8 | 14.72 | 40.3 | 16.05 | 45.6 | 18.62 | 50.8 | 21.65 |
| | 50 | 22.1 | 12.05 | 27.0 | 14.90 | 31.5 | 15.65 | 33.7 | 17.05 | 36.0 | 17.62 | 40.7 | 20.18 | 45.7 | 22.81 |
| | 52 | 16.7 | 10.16 | 20.1 | 12.57 | 23.6 | 13.33 | 25.4 | 14.50 | 27.5 | 15.44 | 32.4 | 17.76 | 37.1 | 19.83 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|--------------------------|------------------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | 24.0°CWB | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | 32.0°CDB | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60% | -5 | 24.9 | 3.04 | 30.8 | 3.71 | 40.3 | 4.44 | 44.0 | 4.85 | 47.1 | 5.26 | 52.7 | 6.14 | 58.5 | 7.10 |
| | 0 | 24.9 | 3.04 | 30.8 | 3.72 | 40.3 | 4.45 | 44.0 | 4.86 | 47.1 | 5.27 | 52.7 | 6.16 | 58.5 | 7.11 |
| | 4 | 24.9 | 3.06 | 30.8 | 3.73 | 40.3 | 4.47 | 44.0 | 4.87 | 47.1 | 5.29 | 52.7 | 6.18 | 58.5 | 7.13 |
| | 7 | 24.9 | 3.11 | 30.8 | 3.80 | 40.3 | 4.55 | 44.0 | 4.96 | 47.1 | 5.39 | 52.3 | 6.29 | 57.8 | 7.27 |
| | 10 | 24.9 | 3.86 | 29.7 | 4.54 | 34.5 | 5.26 | 36.9 | 5.63 | 39.3 | 6.01 | 44.1 | 6.81 | 49.0 | 7.63 |
| | 12 | 24.9 | 3.94 | 29.7 | 4.61 | 34.5 | 5.36 | 36.9 | 5.73 | 39.3 | 6.11 | 44.1 | 6.93 | 49.0 | 7.75 |
| | 14 | 24.9 | 3.99 | 29.7 | 4.69 | 34.5 | 5.43 | 36.9 | 5.83 | 39.3 | 6.23 | 44.1 | 7.06 | 49.0 | 7.90 |
| | 16 | 24.9 | 4.04 | 29.7 | 4.76 | 34.5 | 5.53 | 36.9 | 5.93 | 39.3 | 6.33 | 44.1 | 7.18 | 49.0 | 8.05 |
| | 18 | 24.9 | 4.11 | 29.7 | 4.84 | 34.5 | 5.63 | 36.9 | 6.03 | 39.3 | 6.46 | 44.1 | 7.30 | 49.0 | 8.20 |
| | 20 | 24.9 | 4.16 | 29.7 | 4.94 | 34.5 | 5.73 | 36.9 | 6.16 | 39.3 | 6.58 | 44.1 | 7.45 | 49.0 | 8.38 |
| | 21 | 24.9 | 4.21 | 29.7 | 4.96 | 34.5 | 5.78 | 36.9 | 6.21 | 39.3 | 6.63 | 44.1 | 7.53 | 49.0 | 8.45 |
| | 23 | 24.9 | 4.26 | 29.7 | 5.06 | 34.5 | 5.88 | 36.9 | 6.33 | 39.3 | 6.76 | 44.1 | 7.83 | 49.0 | 9.00 |
| | 25 | 24.9 | 4.34 | 29.7 | 5.16 | 34.5 | 6.11 | 36.9 | 6.63 | 39.3 | 7.18 | 44.1 | 8.35 | 49.0 | 9.60 |
| | 27 | 24.9 | 4.51 | 29.7 | 5.46 | 34.5 | 6.51 | 36.9 | 7.08 | 39.3 | 7.65 | 44.1 | 8.90 | 49.0 | 10.25 |
| | 29 | 24.9 | 4.76 | 29.7 | 5.78 | 34.5 | 6.93 | 36.9 | 7.53 | 39.3 | 8.15 | 44.1 | 9.50 | 49.0 | 10.94 |
| | 31 | 24.9 | 5.06 | 29.7 | 6.16 | 34.5 | 7.35 | 36.9 | 8.00 | 39.3 | 8.68 | 44.1 | 10.10 | 49.0 | 11.64 |
| | 33 | 24.9 | 5.34 | 29.7 | 6.51 | 34.5 | 7.80 | 36.9 | 8.50 | 39.3 | 9.22 | 44.1 | 10.74 | 49.0 | 12.42 |
| | 35 | 24.9 | 5.66 | 29.7 | 6.91 | 34.5 | 8.28 | 36.9 | 9.02 | 39.3 | 9.80 | 44.1 | 11.44 | 49.0 | 13.21 |
| | 37 | 24.9 | 5.98 | 29.7 | 7.30 | 34.5 | 8.78 | 36.2 | 9.57 | 39.3 | 10.40 | 44.1 | 12.17 | 49.0 | 14.06 |
| | 39 | 24.9 | 6.31 | 29.7 | 7.73 | 34.5 | 9.30 | 35.7 | 10.15 | 39.3 | 11.04 | 44.1 | 12.91 | 49.0 | 14.96 |
| | 41 | 23.5 | 7.13 | 28.2 | 8.70 | 32.8 | 10.43 | 35.1 | 10.47 | 37.3 | 11.37 | 42.0 | 13.27 | 46.7 | 15.33 |
| | 44 | 21.9 | 7.75 | 26.7 | 9.46 | 31.2 | 11.59 | 33.6 | 11.82 | 35.9 | 12.25 | 40.4 | 13.96 | 45.1 | 16.12 |
| | 47 | 20.7 | 10.32 | 25.8 | 12.59 | 30.2 | 12.17 | 32.4 | 12.00 | 34.6 | 13.03 | 39.1 | 14.99 | 43.6 | 17.31 |
| | 50 | 18.9 | 10.13 | 23.1 | 12.36 | 27.0 | 12.83 | 28.9 | 13.90 | 30.8 | 14.30 | 34.9 | 16.25 | 39.2 | 18.23 |
| | 52 | 14.3 | 8.55 | 17.2 | 10.43 | 20.2 | 10.93 | 21.8 | 11.82 | 23.6 | 12.54 | 27.8 | 14.30 | 31.8 | 15.86 |

| Combination | Outdoor air temp. (°CDB) | Indoor air temp. | | | | | | | | | | | | | |
|-------------|-----------------------------|------------------|------|----------|-------|----------|-------|----------|-------|----------|-------|----------|-------|------|-------|
| | | 14.0°CWB | | 16.0°CWB | | 18.0°CWB | | 19.0°CWB | | 20.0°CWB | | 22.0°CWB | | | |
| | | 20.0°CDB | | 23.0°CDB | | 26.0°CDB | | 27.0°CDB | | 28.0°CDB | | 30.0°CDB | | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | | |
| 50% | -5 | 20.8 | 2.52 | 25.7 | 3.01 | 33.6 | 3.56 | 36.7 | 3.86 | 39.1 | 4.16 | 43.9 | 4.82 | 48.8 | 5.52 |
| | 0 | 20.8 | 2.52 | 25.7 | 3.02 | 33.6 | 3.57 | 36.7 | 3.86 | 39.1 | 4.17 | 43.9 | 4.83 | 48.8 | 5.53 |
| | 4 | 20.8 | 2.53 | 25.7 | 3.03 | 33.6 | 3.58 | 36.7 | 3.88 | 39.1 | 4.19 | 43.9 | 4.85 | 48.8 | 5.55 |
| | 7 | 20.8 | 2.58 | 25.7 | 3.09 | 33.6 | 3.65 | 36.7 | 3.95 | 39.1 | 4.26 | 43.6 | 4.94 | 48.2 | 5.65 |
| | 10 | 20.8 | 3.34 | 24.7 | 3.86 | 28.8 | 4.41 | 30.8 | 4.71 | 32.7 | 4.99 | 36.8 | 5.61 | 40.9 | 6.26 |
| | 12 | 20.8 | 3.37 | 24.7 | 3.91 | 28.8 | 4.49 | 30.8 | 4.76 | 32.7 | 5.09 | 36.8 | 5.71 | 40.9 | 6.36 |
| | 14 | 20.8 | 3.42 | 24.7 | 3.96 | 28.8 | 4.54 | 30.8 | 4.86 | 32.7 | 5.16 | 36.8 | 5.81 | 40.9 | 6.48 |
| | 16 | 20.8 | 3.47 | 24.7 | 4.01 | 28.8 | 4.61 | 30.8 | 4.94 | 32.7 | 5.24 | 36.8 | 5.91 | 40.9 | 6.58 |
| | 18 | 20.8 | 3.52 | 24.7 | 4.09 | 28.8 | 4.69 | 30.8 | 5.01 | 32.7 | 5.34 | 36.8 | 6.01 | 40.9 | 6.71 |
| | 20 | 20.8 | 3.56 | 24.7 | 4.14 | 28.8 | 4.76 | 30.8 | 5.11 | 32.7 | 5.43 | 36.8 | 6.13 | 40.9 | 6.83 |
| | 21 | 20.8 | 3.59 | 24.7 | 4.19 | 28.8 | 4.81 | 30.8 | 5.14 | 32.7 | 5.48 | 36.8 | 6.18 | 40.9 | 6.91 |
| | 23 | 20.8 | 3.64 | 24.7 | 4.24 | 28.8 | 4.89 | 30.8 | 5.24 | 32.7 | 5.58 | 36.8 | 6.28 | 40.9 | 7.06 |
| | 25 | 20.8 | 3.69 | 24.7 | 4.31 | 28.8 | 4.99 | 30.8 | 5.34 | 32.7 | 5.76 | 36.8 | 6.61 | 40.9 | 7.53 |
| | 27 | 20.8 | 3.76 | 24.7 | 4.49 | 28.8 | 5.26 | 30.8 | 5.68 | 32.7 | 6.11 | 36.8 | 7.03 | 40.9 | 8.03 |
| | 29 | 20.8 | 3.96 | 24.7 | 4.74 | 28.8 | 5.58 | 30.8 | 6.03 | 32.6 | 6.51 | 36.8 | 7.48 | 40.9 | 8.55 |
| | 31 | 20.8 | 4.19 | 24.7 | 5.01 | 28.8 | 5.96 | 30.8 | 6.41 | 32.6 | 6.91 | 36.8 | 7.95 | 40.9 | 9.10 |
| | 33 | 20.8 | 4.44 | 24.7 | 5.31 | 28.8 | 6.28 | 30.8 | 6.78 | 32.6 | 7.33 | 36.8 | 8.45 | 40.9 | 9.67 |
| | 35 | 20.8 | 4.69 | 24.7 | 5.61 | 28.8 | 6.63 | 30.8 | 7.18 | 32.6 | 7.75 | 36.8 | 8.97 | 40.9 | 10.27 |
| | 37 | 20.8 | 4.94 | 24.7 | 5.93 | 28.8 | 7.03 | 30.2 | 7.60 | 32.6 | 8.23 | 36.8 | 9.52 | 40.9 | 10.92 |
| | 39 | 20.8 | 5.21 | 24.7 | 6.26 | 28.8 | 7.43 | 29.8 | 8.05 | 32.6 | 8.73 | 36.8 | 10.10 | 40.9 | 11.59 |
| | 41 | 19.6 | 5.91 | 23.5 | 7.07 | 27.3 | 8.36 | 29.2 | 8.33 | 31.0 | 8.99 | 35.0 | 10.41 | 38.9 | 11.91 |
| | 44 | 18.3 | 6.42 | 22.2 | 7.68 | 26.0 | 9.28 | 28.0 | 9.41 | 29.8 | 9.69 | 33.7 | 10.95 | 37.6 | 12.53 |
| | 47 | 17.2 | 8.54 | 21.5 | 10.23 | 25.2 | 9.75 | 27.0 | 9.55 | 28.7 | 10.31 | 32.5 | 11.76 | 36.4 | 13.46 |
| | 50 | 15.8 | 8.39 | 19.3 | 10.04 | 22.5 | 10.28 | 24.1 | 11.06 | 25.6 | 11.32 | 29.1 | 12.74 | 32.7 | 14.17 |
| | 52 | 12.0 | 7.08 | 14.3 | 8.47 | 16.8 | 8.75 | 18.1 | 9.41 | 19.6 | 9.92 | 23.2 | 11.22 | 26.6 | 12.33 |

➤ Heating Capacity Calculation Method

CHV-5S224NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. °CDB | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|---------------------------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 130 | -19.8 | 16.2 | 3.88 | 16.1 | 4.16 | 16.0 | 4.43 | 16.0 | 4.57 | 16.0 | 4.71 | 16.0 | 4.98 |
| | -18.8 | 16.4 | 3.97 | 16.4 | 4.24 | 16.4 | 4.51 | 16.3 | 4.65 | 16.3 | 4.78 | 16.2 | 5.05 |
| | -16.7 | 17.1 | 4.16 | 17.0 | 4.41 | 16.9 | 4.68 | 16.9 | 4.78 | 16.9 | 4.93 | 16.8 | 5.20 |
| | -13.7 | 17.8 | 4.35 | 17.7 | 4.60 | 17.6 | 4.85 | 17.6 | 4.97 | 17.5 | 5.10 | 17.5 | 5.35 |
| | -11.8 | 18.5 | 4.54 | 18.5 | 4.78 | 18.4 | 5.02 | 18.3 | 5.14 | 18.3 | 5.26 | 18.3 | 5.50 |
| | -9.8 | 19.4 | 4.74 | 19.3 | 4.97 | 19.2 | 5.20 | 19.2 | 5.31 | 19.2 | 5.43 | 19.1 | 5.65 |
| | -9.5 | 19.8 | 4.84 | 19.8 | 5.06 | 19.7 | 5.28 | 19.7 | 5.40 | 19.6 | 5.50 | 19.6 | 5.73 |
| | -8.5 | 20.2 | 4.93 | 20.2 | 5.14 | 20.2 | 5.36 | 20.1 | 5.47 | 20.1 | 5.58 | 20.0 | 5.80 |
| | -7.0 | 21.0 | 5.07 | 21.0 | 5.28 | 20.9 | 5.49 | 20.9 | 5.60 | 20.8 | 5.70 | 20.7 | 5.91 |
| | -5.0 | 22.1 | 5.26 | 22.0 | 5.36 | 21.9 | 5.66 | 21.9 | 5.76 | 21.8 | 5.85 | 21.8 | 6.05 |
| | -3.0 | 23.1 | 5.43 | 23.0 | 5.63 | 23.0 | 5.81 | 22.9 | 5.91 | 22.9 | 6.00 | 22.9 | 6.19 |
| | 0.0 | 24.9 | 5.70 | 24.9 | 5.88 | 24.8 | 6.05 | 24.8 | 6.13 | 24.8 | 6.23 | 24.8 | 6.40 |
| | 3.0 | 26.9 | 5.93 | 26.8 | 6.10 | 26.7 | 6.26 | 26.7 | 6.34 | 26.7 | 6.43 | 26.7 | 6.58 |
| | 5.0 | 28.3 | 6.08 | 28.2 | 6.24 | 28.2 | 6.39 | 28.1 | 6.47 | 28.1 | 6.55 | 28.0 | 6.70 |
| | 7.0 | 29.7 | 6.23 | 29.6 | 6.37 | 29.6 | 6.52 | 29.5 | 5.88 | 29.5 | 6.66 | 28.3 | 6.40 |
| | 9.0 | 31.2 | 6.35 | 31.1 | 6.50 | 31.1 | 6.63 | 31.0 | 6.70 | 30.4 | 6.57 | 28.3 | 6.01 |
| | 11.0 | 32.8 | 6.48 | 32.7 | 6.61 | 32.5 | 6.70 | 31.4 | 6.43 | 30.4 | 6.17 | 28.3 | 5.66 |
| | 13.0 | 34.5 | 6.60 | 34.4 | 6.73 | 32.5 | 6.28 | 31.4 | 6.03 | 30.4 | 5.79 | 28.3 | 5.31 |
| | 15.0 | 36.2 | 6.72 | 34.6 | 6.38 | 32.5 | 5.91 | 31.4 | 5.68 | 30.4 | 5.45 | 28.3 | 5.01 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120 | -19.8 | -20.0 | 16.1 | 4.26 | 16.0 | 4.51 | 16.0 | 4.76 | 16.0 | 4.88 | 16.0 | 5.01 | 15.9 | 5.27 |
| | -18.8 | -19.0 | 16.4 | 4.33 | 16.3 | 4.58 | 16.3 | 4.78 | 16.2 | 4.96 | 16.2 | 5.08 | 16.1 | 5.33 |
| | -16.7 | -17.0 | 17.0 | 4.51 | 16.9 | 4.75 | 16.9 | 4.98 | 16.8 | 5.11 | 16.8 | 5.23 | 16.7 | 5.46 |
| | -13.7 | -15.0 | 17.7 | 4.68 | 17.6 | 4.91 | 17.5 | 5.14 | 17.5 | 5.26 | 17.5 | 5.38 | 17.5 | 5.60 |
| | -11.8 | -13.0 | 18.4 | 4.86 | 18.4 | 5.08 | 18.3 | 5.31 | 18.3 | 5.42 | 18.3 | 5.53 | 18.3 | 5.75 |
| | -9.8 | -11.0 | 19.3 | 5.05 | 19.2 | 5.26 | 19.2 | 5.47 | 19.1 | 5.58 | 19.1 | 5.68 | 19.0 | 5.90 |
| | -9.5 | -10.0 | 19.8 | 5.14 | 19.7 | 5.35 | 19.6 | 5.55 | 19.6 | 5.65 | 19.6 | 5.71 | 19.5 | 5.96 |
| | -8.5 | -9.1 | 20.2 | 5.22 | 20.1 | 5.42 | 20.1 | 5.62 | 20.0 | 5.72 | 20.0 | 5.83 | 19.9 | 6.03 |
| | -7.0 | -7.6 | 20.9 | 5.36 | 20.9 | 5.55 | 20.8 | 5.74 | 20.8 | 5.84 | 20.7 | 5.93 | 20.7 | 6.13 |
| | -5.0 | -5.6 | 22.0 | 5.53 | 21.9 | 5.71 | 21.8 | 5.90 | 21.8 | 5.99 | 21.8 | 6.08 | 21.7 | 6.26 |
| | -3.0 | -3.7 | 23.0 | 5.69 | 23.0 | 5.87 | 22.9 | 6.04 | 22.9 | 6.13 | 22.9 | 6.22 | 22.9 | 6.39 |
| | 0.0 | -0.7 | 24.8 | 5.93 | 24.8 | 6.10 | 24.8 | 6.33 | 24.8 | 6.34 | 24.7 | 6.42 | 24.7 | 6.58 |
| | 3.0 | 2.2 | 26.8 | 6.15 | 26.7 | 6.30 | 26.7 | 6.45 | 26.7 | 6.53 | 26.7 | 6.60 | 26.1 | 6.57 |
| | 5.0 | 4.1 | 28.2 | 6.29 | 28.1 | 6.43 | 28.1 | 6.58 | 28.0 | 6.65 | 28.0 | 6.72 | 26.1 | 6.17 |
| | 7.0 | 6.0 | 29.6 | 6.42 | 29.6 | 6.55 | 29.5 | 6.69 | 29.0 | 6.60 | 28.1 | 6.33 | 26.1 | 5.80 |
| | 9.0 | 7.9 | 31.1 | 6.55 | 31.0 | 6.68 | 30.0 | 6.45 | 29.0 | 6.20 | 28.1 | 5.95 | 26.1 | 5.46 |
| | 11.0 | 9.8 | 32.7 | 6.66 | 31.9 | 6.55 | 30.0 | 6.07 | 29.0 | 5.83 | 28.1 | 5.60 | 26.1 | 5.15 |
| | 13.0 | 11.8 | 33.9 | 6.60 | 31.9 | 6.14 | 30.0 | 5.69 | 29.0 | 5.48 | 28.1 | 5.26 | 26.1 | 4.84 |
| | 15.0 | 13.7 | 33.9 | 6.21 | 31.9 | 5.78 | 30.0 | 5.37 | 29.0 | 5.16 | 28.1 | 4.96 | 26.1 | 4.57 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|-------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110 | -19.8 | -20.0 | 16.0 | 4.63 | 16.0 | 4.86 | 15.9 | 5.09 | 15.9 | 5.21 | 15.9 | 5.32 | 15.8 | 5.55 |
| | -18.8 | -19.0 | 16.3 | 4.70 | 16.3 | 4.93 | 174.9 | 5.16 | 16.2 | 5.27 | 16.1 | 5.38 | 16.1 | 5.61 |
| | -16.7 | -17.0 | 16.9 | 4.86 | 16.8 | 5.08 | 16.8 | 5.30 | 16.7 | 5.40 | 16.7 | 5.52 | 16.7 | 5.73 |
| | -13.7 | -15.0 | 17.6 | 5.02 | 17.5 | 5.23 | 17.5 | 5.44 | 17.5 | 5.55 | 17.5 | 5.65 | 17.4 | 5.86 |
| | -11.8 | -13.0 | 18.3 | 5.19 | 18.3 | 5.39 | 18.3 | 5.59 | 18.3 | 5.69 | 18.2 | 5.79 | 18.2 | 6.00 |
| | -9.8 | -11.0 | 19.2 | 5.36 | 19.1 | 5.55 | 19.1 | 5.74 | 19.0 | 5.84 | 19.0 | 5.93 | 19.0 | 6.13 |
| | -9.5 | -10.0 | 19.7 | 5.44 | 19.6 | 5.63 | 19.5 | 5.82 | 19.5 | 5.91 | 19.5 | 6.00 | 19.4 | 6.19 |
| | -8.5 | -9.1 | 20.1 | 5.51 | 20.0 | 5.70 | 20.0 | 5.88 | 20.0 | 5.98 | 19.9 | 6.07 | 19.9 | 6.25 |
| | -7.0 | -7.6 | 20.8 | 5.64 | 20.8 | 5.81 | 20.7 | 5.99 | 20.7 | 6.08 | 21.0 | 6.17 | 20.6 | 6.35 |
| | -5.0 | -5.6 | 21.9 | 5.80 | 21.8 | 5.97 | 21.7 | 6.13 | 21.7 | 6.22 | 22.8 | 6.30 | 21.7 | 6.48 |
| | -3.0 | -3.7 | 22.9 | 5.95 | 22.9 | 6.10 | 22.9 | 6.27 | 22.9 | 6.35 | 24.7 | 6.43 | 22.8 | 6.59 |
| | 0.0 | -0.7 | 24.8 | 6.17 | 24.8 | 6.32 | 24.7 | 6.47 | 24.7 | 6.54 | 25.7 | 6.62 | 24.0 | 6.49 |
| | 3.0 | 2.2 | 26.7 | 6.38 | 26.7 | 6.51 | 26.7 | 6.65 | 26.6 | 6.71 | 25.7 | 6.44 | 24.0 | 5.90 |
| | 5.0 | 4.1 | 28.1 | 6.50 | 28.1 | 6.63 | 27.5 | 6.57 | 26.6 | 6.30 | 25.7 | 6.05 | 24.0 | 5.55 |
| | 7.0 | 6.0 | 29.5 | 6.62 | 29.3 | 6.66 | 27.5 | 6.17 | 26.6 | 5.93 | 25.7 | 5.69 | 24.0 | 5.23 |
| | 9.0 | 7.9 | 31.0 | 6.73 | 29.3 | 6.26 | 27.5 | 5.80 | 26.6 | 5.58 | 25.7 | 5.36 | 24.0 | 4.93 |
| | 11.0 | 9.8 | 31.0 | 6.33 | 29.3 | 5.89 | 27.5 | 5.46 | 26.6 | 5.26 | 25.7 | 5.05 | 24.0 | 4.65 |
| | 13.0 | 11.8 | 31.0 | 5.93 | 29.3 | 5.53 | 27.5 | 5.13 | 26.6 | 4.94 | 25.7 | 4.75 | 24.0 | 4.38 |
| | 15.0 | 13.7 | 31.0 | 5.59 | 29.3 | 5.21 | 27.5 | 4.85 | 26.6 | 4.66 | 25.7 | 4.49 | 24.0 | 4.14 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 100 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 16.0 | 5.00 | 15.9 | 5.21 | 15.9 | 5.42 | 15.8 | 5.53 | 15.8 | 5.63 | 15.7 | 5.84 |
| | -18.8 | -19.0 | 16.2 | 5.06 | 16.2 | 5.27 | 16.1 | 5.48 | 16.1 | 5.58 | 16.0 | 5.69 | 16.0 | 5.90 |
| | -16.7 | -17.0 | 16.8 | 5.21 | 16.7 | 5.40 | 16.7 | 5.60 | 16.7 | 5.70 | 16.7 | 5.80 | 16.7 | 6.00 |
| | -13.7 | -15.0 | 17.5 | 5.36 | 17.5 | 5.55 | 17.5 | 5.74 | 17.4 | 5.84 | 17.4 | 5.93 | 17.3 | 6.13 |
| | -11.8 | -13.0 | 18.3 | 5.51 | 18.3 | 5.69 | 18.2 | 5.88 | 18.2 | 5.97 | 18.2 | 5.85 | 18.1 | 6.25 |
| | -9.8 | -11.0 | 19.1 | 5.66 | 19.0 | 5.84 | 19.0 | 6.01 | 19.0 | 6.10 | 19.0 | 6.19 | 19.0 | 6.36 |
| | -9.5 | -10.0 | 19.6 | 5.74 | 19.5 | 5.91 | 19.5 | 6.08 | 19.4 | 6.17 | 19.4 | 6.25 | 19.4 | 6.43 |
| | -8.5 | -9.1 | 20.0 | 5.80 | 20.0 | 5.98 | 19.9 | 6.14 | 19.9 | 6.23 | 19.8 | 6.31 | 19.8 | 6.48 |
| | -7.0 | -7.6 | 20.7 | 5.92 | 20.7 | 6.08 | 20.6 | 6.24 | 20.6 | 6.33 | 20.6 | 6.40 | 20.6 | 6.57 |
| | -5.0 | -5.6 | 21.8 | 6.07 | 21.7 | 6.22 | 21.7 | 6.38 | 21.7 | 6.45 | 21.7 | 6.53 | 21.7 | 6.68 |
| | -3.0 | -3.7 | 22.9 | 6.20 | 22.9 | 6.35 | 22.8 | 6.50 | 22.8 | 6.57 | 22.8 | 6.64 | 21.8 | 6.36 |
| | 0.0 | -0.7 | 24.7 | 6.41 | 24.7 | 6.54 | 24.6 | 6.68 | 24.2 | 6.57 | 23.4 | 6.30 | 21.8 | 5.78 |
| | 3.0 | 2.2 | 26.7 | 6.59 | 26.6 | 6.71 | 25.0 | 6.21 | 24.2 | 5.97 | 23.4 | 5.73 | 21.8 | 5.26 |
| | 5.0 | 4.1 | 28.0 | 6.71 | 26.6 | 6.30 | 25.0 | 5.84 | 24.2 | 5.62 | 23.4 | 5.40 | 21.8 | 4.96 |
| | 7.0 | 6.0 | 28.2 | 6.37 | 26.6 | 5.93 | 25.0 | 5.50 | 24.2 | 5.29 | 23.4 | 5.08 | 21.8 | 4.68 |
| | 9.0 | 7.9 | 28.2 | 5.98 | 26.6 | 5.58 | 25.0 | 5.18 | 24.2 | 4.98 | 23.4 | 4.79 | 21.8 | 4.41 |
| | 11.0 | 9.8 | 28.2 | 5.63 | 26.6 | 5.26 | 25.0 | 4.88 | 24.2 | 4.70 | 23.4 | 4.52 | 21.8 | 4.17 |
| | 13.0 | 11.8 | 28.2 | 5.29 | 26.6 | 4.94 | 25.0 | 4.60 | 24.2 | 4.43 | 23.4 | 4.26 | 21.8 | 3.93 |
| | 15.0 | 13.7 | 28.2 | 4.99 | 26.6 | 4.66 | 25.0 | 4.34 | 24.2 | 4.18 | 23.4 | 4.03 | 21.8 | 3.73 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 90 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 15.9 | 5.37 | 15.8 | 5.55 | 15.8 | 5.75 | 15.7 | 5.84 | 15.7 | 5.94 | 15.7 | 6.13 |
| | -18.8 | -19.0 | 16.1 | 5.43 | 16.1 | 5.62 | 16.0 | 5.80 | 16.0 | 5.90 | 16.0 | 5.99 | 16.0 | 6.18 |
| | -16.7 | -17.0 | 16.7 | 5.56 | 16.7 | 5.74 | 16.7 | 5.92 | 16.7 | 6.01 | 16.6 | 6.10 | 16.6 | 6.28 |
| | -13.7 | -15.0 | 17.5 | 5.70 | 17.4 | 5.87 | 17.4 | 6.04 | 17.3 | 6.07 | 17.3 | 6.21 | 17.3 | 6.38 |
| | -11.8 | -13.0 | 18.2 | 5.83 | 18.2 | 6.00 | 18.1 | 6.16 | 18.1 | 6.25 | 18.1 | 6.33 | 18.0 | 6.49 |
| | -9.8 | -11.0 | 19.0 | 5.97 | 19.0 | 6.13 | 19.0 | 6.28 | 19.0 | 6.37 | 19.0 | 6.45 | 18.9 | 6.60 |
| | -9.5 | -10.0 | 19.5 | 6.04 | 19.4 | 6.20 | 19.4 | 6.35 | 19.4 | 6.43 | 19.4 | 6.50 | 19.4 | 6.65 |
| | -8.5 | -9.1 | 19.9 | 6.10 | 19.9 | 6.25 | 19.8 | 6.40 | 19.8 | 6.48 | 19.8 | 6.55 | 19.6 | 6.62 |
| | -7.0 | -7.6 | 20.6 | 6.20 | 20.6 | 6.35 | 20.6 | 6.50 | 20.6 | 6.57 | 20.6 | 6.64 | 19.6 | 6.32 |
| | -5.0 | -5.6 | 21.7 | 6.34 | 21.7 | 6.48 | 21.7 | 6.61 | 21.7 | 6.68 | 21.0 | 6.48 | 19.6 | 5.94 |
| | -3.0 | -3.7 | 22.8 | 6.46 | 22.8 | 5.88 | 22.5 | 6.62 | 21.7 | 6.35 | 21.0 | 6.10 | 19.6 | 5.60 |
| | 0.0 | -0.7 | 24.7 | 6.65 | 24.0 | 5.77 | 22.5 | 6.00 | 21.7 | 5.77 | 21.0 | 5.54 | 19.6 | 5.09 |
| | 3.0 | 2.2 | 25.4 | 6.33 | 24.0 | 5.90 | 22.5 | 5.47 | 21.7 | 5.26 | 21.0 | 5.06 | 19.6 | 4.66 |
| | 5.0 | 4.1 | 25.4 | 5.95 | 24.0 | 5.55 | 22.5 | 5.16 | 21.7 | 4.96 | 21.0 | 4.77 | 19.6 | 4.39 |
| | 7.0 | 6.0 | 25.4 | 5.60 | 24.0 | 5.23 | 22.5 | 4.86 | 21.7 | 4.68 | 21.0 | 4.50 | 19.6 | 4.15 |
| | 9.0 | 7.9 | 25.4 | 5.28 | 24.0 | 4.92 | 22.5 | 4.58 | 21.7 | 4.41 | 21.0 | 4.25 | 19.6 | 3.92 |
| | 11.0 | 9.8 | 25.4 | 4.97 | 24.0 | 4.64 | 22.5 | 4.33 | 21.7 | 4.17 | 21.0 | 4.01 | 19.6 | 3.71 |
| | 13.0 | 11.8 | 25.4 | 4.68 | 24.0 | 4.38 | 22.5 | 4.08 | 21.7 | 3.93 | 21.0 | 3.79 | 19.6 | 3.51 |
| | 15.0 | 13.7 | 25.4 | 4.42 | 24.0 | 4.13 | 22.5 | 3.86 | 21.7 | 3.71 | 21.0 | 3.59 | 19.6 | 3.33 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80 | -19.8 | -20.0 | 15.8 | 5.74 | 15.7 | 5.90 | 15.7 | 6.08 | 15.7 | 6.16 | 15.6 | 6.25 | 15.6 | 6.41 |
| | -18.8 | -19.0 | 16.0 | 5.79 | 16.0 | 5.96 | 16.0 | 6.13 | 16.0 | 6.21 | 16.0 | 6.29 | 15.9 | 6.46 |
| | -16.7 | -17.0 | 16.7 | 5.91 | 16.6 | 6.07 | 16.6 | 6.23 | 16.6 | 6.31 | 16.6 | 6.39 | 16.5 | 6.55 |
| | -13.7 | -15.0 | 17.4 | 6.03 | 17.3 | 6.18 | 17.3 | 6.34 | 17.3 | 6.41 | 17.2 | 6.49 | 17.2 | 6.65 |
| | -11.8 | -13.0 | 18.1 | 6.15 | 18.1 | 6.30 | 18.0 | 6.45 | 18.0 | 6.52 | 18.0 | 6.60 | 17.5 | 6.42 |
| | -9.8 | -11.0 | 19.0 | 6.28 | 19.0 | 6.42 | 18.9 | 6.56 | 18.9 | 6.63 | 18.7 | 6.61 | 17.5 | 6.06 |
| | -9.5 | -10.0 | 19.4 | 6.34 | 19.4 | 6.48 | 19.4 | 6.61 | 19.4 | 6.68 | 18.7 | 6.42 | 17.5 | 5.88 |
| | -8.5 | -9.1 | 19.8 | 6.40 | 19.8 | 6.53 | 19.8 | 6.66 | 19.4 | 6.52 | 18.7 | 6.25 | 17.5 | 5.73 |
| | -7.0 | -7.6 | 20.6 | 6.49 | 20.6 | 6.62 | 20.0 | 6.48 | 19.4 | 6.22 | 18.7 | 5.97 | 17.5 | 5.50 |
| | -5.0 | -5.6 | 21.7 | 5.89 | 21.3 | 6.57 | 20.0 | 6.08 | 19.4 | 5.85 | 18.7 | 5.61 | 17.5 | 5.16 |
| | -3.0 | -3.7 | 22.5 | 5.93 | 21.3 | 6.18 | 20.0 | 5.73 | 19.4 | 5.53 | 18.7 | 5.29 | 17.5 | 4.87 |
| | 0.0 | -0.7 | 22.5 | 6.03 | 21.3 | 5.61 | 20.0 | 5.21 | 19.4 | 5.02 | 18.7 | 4.82 | 17.5 | 4.44 |
| | 3.0 | 2.2 | 22.5 | 5.49 | 21.3 | 5.12 | 20.0 | 4.76 | 19.4 | 4.58 | 18.7 | 4.41 | 17.5 | 4.07 |
| | 5.0 | 4.1 | 22.5 | 5.17 | 21.3 | 4.83 | 20.0 | 4.49 | 19.4 | 4.33 | 18.7 | 4.17 | 17.5 | 3.85 |
| | 7.0 | 6.0 | 22.5 | 4.87 | 21.3 | 4.56 | 20.0 | 4.24 | 19.4 | 4.09 | 18.7 | 3.94 | 17.5 | 3.64 |
| | 9.0 | 7.9 | 22.5 | 4.60 | 21.3 | 4.30 | 20.0 | 4.03 | 19.4 | 3.86 | 18.7 | 3.73 | 17.5 | 3.45 |
| | 11.0 | 9.8 | 22.5 | 4.34 | 21.3 | 4.06 | 20.0 | 3.79 | 19.4 | 3.66 | 18.7 | 3.53 | 17.5 | 3.27 |
| | 13.0 | 11.8 | 22.5 | 4.09 | 21.3 | 3.83 | 20.0 | 3.58 | 19.4 | 3.46 | 18.7 | 3.33 | 17.5 | 3.09 |
| | 15.0 | 13.7 | 22.5 | 3.87 | 21.3 | 3.63 | 20.0 | 3.40 | 19.4 | 3.28 | 18.7 | 3.16 | 17.5 | 2.94 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70 | -19.8 | -20.0 | 15.7 | 6.11 | 15.6 | 6.25 | 15.6 | 6.40 | 15.6 | 6.48 | 15.6 | 6.55 | 15.2 | 6.48 |
| | -18.8 | -19.0 | 16.0 | 6.16 | 16.0 | 6.30 | 15.9 | 6.45 | 15.9 | 6.52 | 15.9 | 6.60 | 15.2 | 6.35 |
| | -16.7 | -17.0 | 16.6 | 6.26 | 16.6 | 6.40 | 16.5 | 6.54 | 16.5 | 6.61 | 16.4 | 6.60 | 15.2 | 6.05 |
| | -13.7 | -15.0 | 17.3 | 6.37 | 17.2 | 6.50 | 17.2 | 6.64 | 16.9 | 6.66 | 16.4 | 6.28 | 15.2 | 5.75 |
| | -11.8 | -13.0 | 18.0 | 6.48 | 18.0 | 6.60 | 17.5 | 6.45 | 16.9 | 6.20 | 16.4 | 5.95 | 15.2 | 5.45 |
| | -9.8 | -11.0 | 18.9 | 6.58 | 18.7 | 6.58 | 17.5 | 6.09 | 16.9 | 5.85 | 16.4 | 5.62 | 15.2 | 5.16 |
| | -9.5 | -10.0 | 19.4 | 6.64 | 18.7 | 6.38 | 17.5 | 5.91 | 16.9 | 5.68 | 16.4 | 5.46 | 15.2 | 5.02 |
| | -8.5 | -9.1 | 19.8 | 6.68 | 18.7 | 6.21 | 17.5 | 5.75 | 16.9 | 5.53 | 16.4 | 5.32 | 15.2 | 4.89 |
| | -7.0 | -7.6 | 19.8 | 6.38 | 18.7 | 5.93 | 17.5 | 5.50 | 16.9 | 5.30 | 16.4 | 5.09 | 15.2 | 4.68 |
| | -5.0 | -5.6 | 19.8 | 5.99 | 18.7 | 5.58 | 17.5 | 5.18 | 16.9 | 4.98 | 16.4 | 4.79 | 15.2 | 4.42 |
| | -3.0 | -3.7 | 19.8 | 5.64 | 18.7 | 5.26 | 17.5 | 4.89 | 16.9 | 4.71 | 16.4 | 4.53 | 15.2 | 4.18 |
| | 0.0 | -0.7 | 19.8 | 5.13 | 18.7 | 4.82 | 17.5 | 4.46 | 16.9 | 4.30 | 16.4 | 4.14 | 15.2 | 3.83 |
| | 3.0 | 2.2 | 19.8 | 4.69 | 18.7 | 0.11 | 17.5 | 4.09 | 16.9 | 3.94 | 16.4 | 3.80 | 15.2 | 3.51 |
| | 5.0 | 4.1 | 19.8 | 4.43 | 18.7 | 4.14 | 17.5 | 3.87 | 16.9 | 3.73 | 16.4 | 3.60 | 15.2 | 3.33 |
| | 7.0 | 6.0 | 19.8 | 4.18 | 18.7 | 3.92 | 17.5 | 3.66 | 16.9 | 3.53 | 16.4 | 3.41 | 15.2 | 3.16 |
| | 9.0 | 7.9 | 19.8 | 3.96 | 18.7 | 3.71 | 17.5 | 3.46 | 16.9 | 3.34 | 16.4 | 3.23 | 15.2 | 2.99 |
| | 11.0 | 9.8 | 19.8 | 3.74 | 18.7 | 3.51 | 17.5 | 3.28 | 16.9 | 3.17 | 16.4 | 3.06 | 15.2 | 2.84 |
| | 13.0 | 11.8 | 19.8 | 3.53 | 18.7 | 3.32 | 17.5 | 3.11 | 16.9 | 3.01 | 16.4 | 2.90 | 15.2 | 2.70 |
| | 15.0 | 13.7 | 19.8 | 3.35 | 18.7 | 3.15 | 17.5 | 2.95 | 16.9 | 2.86 | 16.4 | 2.76 | 15.2 | 2.57 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 60 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 15.6 | 6.48 | 15.6 | 6.60 | 15.0 | 6.35 | 14.5 | 6.10 | 14.0 | 5.86 | 13.1 | 5.38 |
| | -18.8 | -19.0 | 15.9 | 6.53 | 15.9 | 6.65 | 15.0 | 6.22 | 14.5 | 5.98 | 14.0 | 5.73 | 13.1 | 5.26 |
| | -16.7 | -17.0 | 16.5 | 6.61 | 16.0 | 6.40 | 15.0 | 5.93 | 14.5 | 5.70 | 14.0 | 5.48 | 13.1 | 5.03 |
| | -13.7 | -15.0 | 16.9 | 6.54 | 16.0 | 6.08 | 15.0 | 5.64 | 14.5 | 5.43 | 14.0 | 5.21 | 13.1 | 4.79 |
| | -11.8 | -13.0 | 16.9 | 6.19 | 16.0 | 5.76 | 15.0 | 5.35 | 14.5 | 5.15 | 14.0 | 4.95 | 13.1 | 4.56 |
| | -9.8 | -11.0 | 16.9 | 5.85 | 16.0 | 5.45 | 15.0 | 5.06 | 14.5 | 4.87 | 14.0 | 4.68 | 13.1 | 4.32 |
| | -9.5 | -10.0 | 16.9 | 5.68 | 16.0 | 5.30 | 15.0 | 4.92 | 14.5 | 4.74 | 14.0 | 4.56 | 13.1 | 4.20 |
| | -8.5 | -9.1 | 16.9 | 5.53 | 16.0 | 5.16 | 15.0 | 4.80 | 14.5 | 4.62 | 14.0 | 4.44 | 13.1 | 4.10 |
| | -7.0 | -7.6 | 16.9 | 5.29 | 16.0 | 4.94 | 15.0 | 4.59 | 14.5 | 4.43 | 14.0 | 4.26 | 13.1 | 3.93 |
| | -5.0 | -5.6 | 16.9 | 4.98 | 16.0 | 4.66 | 15.0 | 4.33 | 14.5 | 4.18 | 14.0 | 4.02 | 13.1 | 3.72 |
| | -3.0 | -3.7 | 16.9 | 4.71 | 16.0 | 4.40 | 15.0 | 4.11 | 14.5 | 3.96 | 14.0 | 3.81 | 13.1 | 3.52 |
| | 0.0 | -0.7 | 16.9 | 4.30 | 16.0 | 4.03 | 15.0 | 3.76 | 14.5 | 3.63 | 14.0 | 3.49 | 13.1 | 3.23 |
| | 3.0 | 2.2 | 16.9 | 3.94 | 16.0 | 3.70 | 15.0 | 3.46 | 14.5 | 3.33 | 14.0 | 3.22 | 13.1 | 0.13 |
| | 5.0 | 4.1 | 16.9 | 3.73 | 16.0 | 3.50 | 15.0 | 3.27 | 14.5 | 3.16 | 14.0 | 3.05 | 13.1 | 2.83 |
| | 7.0 | 6.0 | 16.9 | 3.53 | 16.0 | 3.31 | 15.0 | 3.10 | 14.5 | 3.00 | 14.0 | 2.90 | 13.1 | 2.69 |
| | 9.0 | 7.9 | 16.9 | 3.34 | 16.0 | 3.14 | 15.0 | 2.94 | 14.5 | 2.85 | 14.0 | 2.75 | 13.1 | 2.56 |
| | 11.0 | 9.8 | 16.9 | 3.17 | 16.0 | 2.98 | 15.0 | 2.80 | 14.5 | 2.71 | 14.0 | 2.61 | 13.1 | 2.44 |
| | 13.0 | 11.8 | 16.9 | 3.00 | 16.0 | 2.83 | 15.0 | 2.66 | 14.5 | 2.57 | 14.0 | 2.48 | 13.1 | 2.32 |
| | 15.0 | 13.7 | 16.9 | 2.86 | 16.0 | 2.68 | 15.0 | 2.53 | 14.5 | 2.45 | 14.0 | 2.37 | 13.1 | 2.21 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 50 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 14.1 | 5.90 | 13.3 | 5.49 | 12.5 | 5.10 | 12.1 | 4.91 | 11.7 | 4.72 | 10.9 | 4.35 |
| | -18.8 | -19.0 | 14.1 | 5.77 | 13.3 | 5.38 | 12.5 | 5.00 | 12.1 | 4.81 | 11.7 | 4.62 | 10.9 | 4.26 |
| | -16.7 | -17.0 | 14.1 | 5.50 | 13.3 | 5.13 | 12.5 | 4.78 | 12.1 | 4.60 | 11.7 | 4.43 | 10.9 | 4.08 |
| | -13.7 | -15.0 | 14.1 | 5.24 | 13.3 | 4.89 | 12.5 | 4.55 | 12.1 | 4.38 | 11.7 | 4.22 | 10.9 | 3.90 |
| | -11.8 | -13.0 | 14.1 | 4.98 | 13.3 | 4.66 | 12.5 | 4.33 | 12.1 | 4.17 | 11.7 | 4.01 | 10.9 | 3.71 |
| | -9.8 | -11.0 | 14.1 | 4.71 | 13.3 | 4.41 | 12.5 | 4.11 | 12.1 | 3.96 | 11.7 | 3.81 | 10.9 | 3.53 |
| | -9.5 | -10.0 | 14.1 | 4.58 | 13.3 | 4.28 | 12.5 | 4.00 | 12.1 | 3.86 | 11.7 | 3.71 | 10.9 | 3.43 |
| | -8.5 | -9.1 | 14.1 | 4.47 | 13.3 | 4.18 | 12.5 | 3.90 | 12.1 | 3.76 | 11.7 | 3.63 | 10.9 | 3.36 |
| | -7.0 | -7.6 | 14.1 | 4.28 | 13.3 | 4.03 | 12.5 | 3.74 | 12.1 | 3.61 | 11.7 | 3.48 | 10.9 | 3.23 |
| | -5.0 | -5.6 | 14.1 | 4.04 | 13.3 | 3.79 | 12.5 | 3.54 | 12.1 | 3.42 | 11.7 | 3.30 | 10.9 | 3.06 |
| | -3.0 | -3.7 | 14.1 | 3.83 | 13.3 | 3.59 | 12.5 | 3.36 | 12.1 | 3.24 | 11.7 | 3.13 | 10.9 | 2.91 |
| | 0.0 | -0.7 | 14.1 | 3.51 | 13.3 | 3.30 | 12.5 | 3.09 | 12.1 | 2.98 | 11.7 | 2.88 | 10.9 | 2.68 |
| | 3.0 | 2.2 | 14.1 | 3.23 | 13.3 | 3.04 | 12.5 | 2.85 | 12.1 | 2.76 | 11.7 | 2.67 | 10.9 | 2.48 |
| | 5.0 | 4.1 | 14.1 | 3.07 | 13.3 | 2.88 | 12.5 | 2.71 | 12.1 | 2.62 | 11.7 | 2.53 | 10.9 | 2.36 |
| | 7.0 | 6.0 | 14.1 | 2.91 | 13.3 | 2.74 | 12.5 | 2.58 | 12.1 | 2.49 | 11.7 | 2.41 | 10.9 | 2.26 |
| | 9.0 | 7.9 | 14.1 | 2.76 | 13.3 | 2.61 | 12.5 | 2.45 | 12.1 | 2.38 | 11.7 | 2.30 | 10.9 | 2.15 |
| | 11.0 | 9.8 | 14.1 | 2.63 | 13.3 | 2.48 | 12.5 | 2.33 | 12.1 | 2.26 | 11.7 | 2.19 | 10.9 | 2.05 |
| | 13.0 | 11.8 | 14.1 | 2.50 | 13.3 | 2.36 | 12.5 | 2.22 | 12.1 | 2.16 | 11.7 | 2.08 | 10.9 | 1.96 |
| | 15.0 | 13.7 | 14.1 | 2.38 | 13.3 | 2.25 | 12.5 | 2.12 | 12.1 | 2.06 | 11.7 | 1.99 | 10.9 | 1.86 |

CHV5 DC Inverter VRF Units Technical Sales Guide

CHV-5S280NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|----------|------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC °CDB | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW |
| 130 | -19.8 | -20.0 | 20.4 | 5.16 | 20.3 | 5.52 | 20.2 | 5.89 | 20.2 | 6.07 | 21.1 | 6.25 | 20.1 | 6.62 |
| | -18.8 | -19.0 | 20.7 | 5.27 | 20.6 | 5.63 | 20.6 | 5.99 | 20.5 | 6.17 | 20.5 | 6.34 | 20.4 | 6.70 |
| | -16.7 | -17.0 | 21.5 | 5.52 | 21.4 | 5.86 | 21.3 | 6.21 | 21.3 | 6.35 | 21.3 | 6.55 | 21.2 | 6.90 |
| | -13.7 | -15.0 | 22.4 | 5.77 | 22.3 | 6.11 | 22.2 | 6.44 | 22.2 | 6.60 | 22.1 | 6.77 | 22.1 | 7.10 |
| | -11.8 | -13.0 | 23.3 | 6.03 | 23.3 | 6.35 | 23.2 | 6.66 | 23.1 | 6.83 | 23.1 | 6.99 | 23.0 | 7.30 |
| | -9.8 | -11.0 | 24.4 | 6.29 | 24.3 | 6.60 | 24.2 | 6.90 | 24.2 | 7.05 | 24.2 | 7.20 | 24.1 | 7.51 |
| | -9.5 | -10.0 | 25.0 | 6.43 | 24.9 | 6.72 | 24.8 | 7.02 | 24.8 | 7.17 | 24.7 | 7.31 | 24.7 | 7.60 |
| | -8.5 | -9.1 | 25.5 | 6.54 | 25.4 | 6.83 | 25.4 | 7.12 | 25.3 | 7.26 | 25.3 | 7.40 | 25.2 | 7.70 |
| | -7.0 | -7.6 | 26.4 | 6.73 | 26.4 | 7.02 | 26.3 | 7.29 | 26.3 | 7.43 | 26.2 | 7.57 | 26.1 | 7.85 |
| | -5.0 | -5.6 | 27.8 | 6.99 | 27.7 | 7.11 | 27.6 | 7.52 | 27.6 | 7.65 | 27.5 | 7.77 | 27.5 | 8.04 |
| | -3.0 | -3.7 | 29.1 | 7.21 | 29.0 | 7.47 | 29.0 | 7.72 | 28.9 | 7.85 | 28.9 | 7.97 | 28.8 | 8.22 |
| | 0.0 | -0.7 | 31.4 | 7.57 | 31.4 | 7.80 | 31.3 | 8.03 | 31.3 | 8.14 | 31.2 | 8.27 | 31.2 | 8.49 |
| | 3.0 | 2.2 | 33.9 | 7.88 | 33.8 | 8.10 | 33.7 | 8.31 | 33.7 | 8.42 | 33.7 | 8.53 | 33.6 | 8.74 |
| | 5.0 | 4.1 | 35.6 | 8.08 | 35.5 | 8.29 | 35.5 | 8.48 | 35.4 | 8.59 | 35.4 | 8.69 | 35.3 | 8.89 |
| | 7.0 | 6.0 | 37.4 | 8.27 | 37.3 | 8.46 | 37.3 | 8.66 | 37.2 | 7.80 | 37.2 | 8.84 | 35.7 | 8.49 |
| | 9.0 | 7.9 | 39.3 | 8.44 | 39.2 | 8.63 | 39.2 | 8.81 | 39.1 | 8.90 | 38.3 | 8.72 | 35.7 | 7.98 |
| | 11.0 | 9.8 | 41.3 | 8.61 | 41.2 | 8.78 | 41.0 | 8.89 | 39.6 | 8.54 | 38.3 | 8.19 | 35.7 | 7.52 |
| | 13.0 | 11.8 | 43.5 | 8.77 | 43.4 | 8.94 | 41.0 | 8.33 | 39.6 | 8.00 | 38.3 | 7.69 | 35.7 | 7.05 |
| | 15.0 | 13.7 | 45.6 | 8.92 | 43.6 | 8.47 | 41.0 | 7.85 | 39.6 | 7.55 | 38.3 | 7.24 | 35.7 | 6.65 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|----------|------------------------------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|----------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC °CDB | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW | TC kW | PI kW |
| 120 | -19.8 | -20.0 | 20.3 | 5.65 | 20.2 | 5.98 | 20.1 | 6.32 | 20.1 | 6.48 | 20.1 | 6.65 | 20.0 | 7.00 |
| | -18.8 | -19.0 | 20.6 | 5.75 | 20.5 | 6.09 | 20.5 | 6.35 | 20.4 | 6.58 | 20.4 | 6.75 | 20.3 | 7.08 |
| | -16.7 | -17.0 | 21.4 | 5.98 | 21.3 | 6.30 | 21.3 | 6.62 | 21.2 | 6.78 | 21.2 | 6.94 | 21.1 | 7.25 |
| | -13.7 | -15.0 | 22.3 | 6.22 | 22.2 | 6.52 | 22.1 | 6.83 | 22.1 | 6.99 | 22.1 | 7.14 | 22.0 | 7.44 |
| | -11.8 | -13.0 | 23.2 | 6.46 | 23.2 | 6.75 | 23.1 | 7.04 | 23.1 | 7.20 | 23.0 | 7.34 | 23.0 | 7.63 |
| | -9.8 | -11.0 | 24.3 | 6.70 | 24.2 | 6.98 | 24.2 | 7.26 | 24.1 | 7.40 | 24.1 | 7.54 | 24.0 | 7.83 |
| | -9.5 | -10.0 | 24.9 | 6.83 | 24.8 | 7.10 | 24.7 | 7.37 | 24.7 | 7.51 | 24.7 | 7.58 | 24.6 | 7.92 |
| | -8.5 | -9.1 | 25.4 | 6.93 | 25.3 | 7.20 | 25.3 | 7.46 | 25.2 | 7.59 | 25.2 | 7.74 | 25.1 | 8.00 |
| | -7.0 | -7.6 | 26.3 | 7.11 | 26.3 | 7.37 | 26.2 | 7.62 | 26.2 | 7.75 | 26.1 | 7.88 | 26.1 | 8.13 |
| | -5.0 | -5.6 | 27.7 | 7.34 | 27.6 | 7.58 | 27.5 | 7.83 | 27.5 | 7.95 | 27.5 | 8.08 | 27.4 | 8.31 |
| | -3.0 | -3.7 | 29.0 | 7.56 | 29.0 | 7.79 | 28.9 | 8.02 | 28.9 | 8.13 | 28.8 | 8.26 | 28.8 | 8.48 |
| | 0.0 | -0.7 | 31.3 | 7.88 | 31.3 | 8.10 | 31.2 | 8.41 | 31.2 | 8.42 | 31.1 | 8.52 | 31.1 | 8.74 |
| | 3.0 | 2.2 | 33.8 | 8.17 | 33.7 | 8.37 | 33.7 | 8.57 | 33.6 | 8.67 | 33.6 | 8.77 | 32.9 | 8.72 |
| | 5.0 | 4.1 | 35.5 | 8.35 | 35.4 | 8.54 | 35.4 | 8.73 | 35.3 | 8.83 | 35.3 | 8.92 | 32.9 | 8.19 |
| | 7.0 | 6.0 | 37.3 | 8.52 | 37.3 | 8.70 | 37.2 | 8.88 | 36.6 | 8.76 | 35.4 | 8.40 | 32.9 | 7.71 |
| | 9.0 | 7.9 | 39.2 | 8.69 | 39.1 | 8.86 | 37.8 | 8.57 | 36.6 | 8.23 | 35.4 | 7.90 | 32.9 | 7.25 |
| | 11.0 | 9.8 | 41.2 | 8.84 | 40.2 | 8.69 | 37.8 | 8.06 | 36.6 | 7.75 | 35.4 | 7.43 | 32.9 | 6.84 |
| | 13.0 | 11.8 | 42.7 | 8.76 | 40.2 | 8.15 | 37.8 | 7.56 | 36.6 | 7.27 | 35.4 | 6.99 | 32.9 | 6.43 |
| | 15.0 | 13.7 | 42.7 | 8.25 | 40.2 | 7.68 | 37.8 | 7.13 | 36.6 | 6.85 | 35.4 | 6.59 | 32.9 | 6.07 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|-------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 110 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 20.2 | 6.14 | 20.1 | 6.45 | 20.0 | 6.76 | 20.0 | 6.91 | 20.0 | 7.06 | 19.9 | 7.38 |
| | -18.8 | -19.0 | 20.5 | 6.24 | 20.5 | 6.54 | 220.4 | 6.84 | 20.4 | 7.00 | 20.3 | 7.15 | 20.3 | 7.45 |
| | -16.7 | -17.0 | 21.3 | 6.45 | 21.2 | 6.74 | 21.2 | 7.03 | 21.1 | 7.18 | 21.1 | 7.33 | 21.0 | 7.61 |
| | -13.7 | -15.0 | 22.2 | 6.66 | 22.1 | 6.95 | 22.0 | 7.22 | 22.0 | 7.37 | 22.0 | 7.51 | 21.9 | 7.78 |
| | -11.8 | -13.0 | 23.1 | 6.89 | 23.1 | 7.16 | 23.0 | 7.42 | 23.0 | 7.56 | 22.9 | 7.69 | 22.9 | 7.96 |
| | -9.8 | -11.0 | 24.2 | 7.11 | 24.1 | 7.37 | 24.1 | 7.62 | 24.0 | 7.75 | 24.0 | 7.88 | 24.0 | 8.13 |
| | -9.5 | -10.0 | 24.8 | 7.22 | 24.7 | 7.47 | 24.6 | 7.73 | 24.6 | 7.85 | 24.6 | 7.97 | 24.5 | 8.22 |
| | -8.5 | -9.1 | 25.3 | 7.32 | 25.2 | 7.57 | 25.2 | 7.81 | 25.2 | 7.93 | 25.1 | 8.06 | 25.1 | 8.30 |
| | -7.0 | -7.6 | 26.2 | 7.49 | 26.2 | 7.72 | 26.1 | 7.95 | 26.1 | 8.08 | 26.4 | 8.19 | 26.0 | 8.43 |
| | -5.0 | -5.6 | 27.6 | 7.70 | 27.5 | 7.93 | 27.4 | 8.14 | 27.4 | 8.26 | 28.7 | 8.37 | 27.3 | 8.60 |
| | -3.0 | -3.7 | 28.9 | 7.90 | 28.9 | 8.11 | 28.8 | 8.32 | 28.8 | 8.43 | 31.1 | 8.53 | 28.7 | 8.75 |
| | 0.0 | -0.7 | 31.2 | 8.19 | 31.2 | 8.39 | 31.1 | 8.59 | 31.1 | 8.68 | 32.4 | 8.79 | 30.2 | 8.62 |
| | 3.0 | 2.2 | 33.7 | 8.47 | 33.6 | 8.65 | 33.6 | 8.83 | 33.5 | 8.91 | 32.4 | 8.55 | 30.2 | 7.84 |
| | 5.0 | 4.1 | 35.4 | 8.63 | 35.4 | 8.81 | 34.7 | 8.72 | 33.5 | 8.37 | 32.4 | 8.04 | 30.2 | 7.38 |
| | 7.0 | 6.0 | 37.2 | 8.79 | 36.9 | 8.84 | 34.7 | 8.19 | 33.5 | 7.87 | 32.4 | 7.56 | 30.2 | 6.94 |
| | 9.0 | 7.9 | 39.1 | 8.93 | 36.9 | 8.31 | 34.7 | 7.71 | 33.5 | 7.40 | 32.4 | 7.11 | 30.2 | 6.54 |
| | 11.0 | 9.8 | 39.1 | 8.40 | 36.9 | 7.82 | 34.7 | 7.25 | 33.5 | 6.98 | 32.4 | 6.70 | 30.2 | 6.17 |
| | 13.0 | 11.8 | 39.1 | 7.88 | 36.9 | 7.34 | 34.7 | 6.82 | 33.5 | 6.56 | 32.4 | 6.30 | 30.2 | 5.81 |
| | 15.0 | 13.7 | 39.1 | 7.42 | 36.9 | 6.92 | 34.7 | 6.44 | 33.5 | 6.19 | 32.4 | 5.96 | 30.2 | 5.50 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 100 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 20.1 | 6.64 | 20.0 | 6.91 | 20.0 | 7.20 | 19.9 | 7.34 | 19.9 | 7.47 | 19.8 | 7.75 |
| | -18.8 | -19.0 | 20.4 | 6.72 | 20.4 | 7.00 | 20.3 | 7.27 | 20.3 | 7.41 | 20.2 | 7.56 | 20.2 | 7.83 |
| | -16.7 | -17.0 | 21.2 | 6.91 | 21.1 | 7.18 | 21.1 | 7.44 | 21.1 | 7.57 | 21.0 | 7.71 | 21.0 | 7.97 |
| | -13.7 | -15.0 | 22.1 | 7.11 | 22.0 | 7.37 | 22.0 | 7.62 | 21.9 | 7.75 | 21.9 | 7.88 | 21.8 | 8.13 |
| | -11.8 | -13.0 | 23.0 | 7.32 | 23.0 | 7.56 | 22.9 | 7.80 | 22.9 | 7.93 | 22.9 | 7.76 | 22.8 | 8.30 |
| | -9.8 | -11.0 | 24.1 | 7.52 | 24.0 | 7.75 | 24.0 | 7.98 | 24.0 | 8.11 | 23.9 | 8.22 | 23.9 | 8.45 |
| | -9.5 | -10.0 | 24.7 | 7.62 | 24.6 | 7.85 | 24.6 | 8.08 | 24.5 | 8.19 | 24.5 | 8.30 | 24.4 | 8.53 |
| | -8.5 | -9.1 | 25.2 | 7.71 | 25.2 | 7.93 | 25.1 | 8.15 | 25.1 | 8.27 | 25.0 | 8.38 | 25.0 | 8.60 |
| | -7.0 | -7.6 | 26.1 | 7.86 | 26.1 | 8.08 | 26.0 | 8.29 | 26.0 | 8.40 | 26.0 | 8.50 | 25.9 | 8.72 |
| | -5.0 | -5.6 | 27.5 | 8.06 | 27.4 | 8.26 | 27.4 | 8.47 | 27.3 | 8.57 | 27.3 | 8.66 | 27.3 | 8.87 |
| | -3.0 | -3.7 | 28.8 | 8.24 | 28.8 | 8.43 | 28.7 | 8.63 | 28.7 | 8.72 | 28.7 | 8.82 | 27.5 | 8.45 |
| | 0.0 | -0.7 | 31.1 | 8.51 | 31.1 | 8.68 | 31.0 | 8.86 | 30.5 | 8.72 | 29.5 | 8.36 | 27.5 | 7.68 |
| | 3.0 | 2.2 | 33.6 | 8.75 | 33.5 | 8.91 | 31.5 | 8.25 | 30.5 | 7.93 | 29.5 | 7.61 | 27.5 | 6.99 |
| | 5.0 | 4.1 | 35.3 | 8.91 | 33.5 | 8.37 | 31.5 | 7.75 | 30.5 | 7.46 | 29.5 | 7.17 | 27.5 | 6.59 |
| | 7.0 | 6.0 | 35.5 | 8.46 | 33.5 | 7.87 | 31.5 | 7.30 | 30.5 | 7.02 | 29.5 | 6.75 | 27.5 | 6.21 |
| | 9.0 | 7.9 | 35.5 | 7.94 | 33.5 | 7.40 | 31.5 | 6.87 | 30.5 | 6.62 | 29.5 | 6.36 | 27.5 | 5.86 |
| | 11.0 | 9.8 | 35.5 | 7.48 | 33.5 | 6.98 | 31.5 | 6.48 | 30.5 | 6.24 | 29.5 | 6.00 | 27.5 | 5.54 |
| | 13.0 | 11.8 | 35.5 | 7.02 | 33.5 | 6.56 | 31.5 | 6.11 | 30.5 | 5.88 | 29.5 | 5.66 | 27.5 | 5.22 |
| | 15.0 | 13.7 | 35.5 | 6.63 | 33.5 | 6.19 | 31.5 | 5.76 | 30.5 | 5.56 | 29.5 | 5.35 | 27.5 | 4.95 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90 | -19.8 | -20.0 | 20.0 | 7.13 | 19.9 | 7.38 | 19.9 | 7.63 | 19.8 | 7.75 | 19.8 | 7.89 | 19.8 | 8.13 |
| | -18.8 | -19.0 | 20.3 | 7.20 | 20.3 | 7.46 | 20.2 | 7.71 | 20.2 | 7.83 | 20.2 | 7.95 | 20.1 | 8.20 |
| | -16.7 | -17.0 | 21.1 | 7.38 | 21.0 | 7.62 | 21.0 | 7.86 | 21.0 | 7.98 | 20.9 | 8.10 | 20.9 | 8.33 |
| | -13.7 | -15.0 | 22.0 | 7.57 | 21.9 | 7.79 | 21.9 | 8.02 | 21.8 | 8.06 | 21.8 | 8.25 | 21.8 | 8.48 |
| | -11.8 | -13.0 | 22.9 | 7.75 | 22.9 | 7.96 | 22.8 | 8.18 | 22.8 | 8.30 | 22.8 | 8.40 | 22.7 | 8.62 |
| | -9.8 | -11.0 | 24.0 | 7.93 | 24.0 | 8.13 | 23.9 | 8.34 | 23.9 | 8.46 | 23.9 | 8.56 | 23.8 | 8.77 |
| | -9.5 | -10.0 | 24.6 | 8.02 | 24.5 | 8.23 | 24.5 | 8.43 | 24.4 | 8.53 | 24.4 | 8.64 | 24.4 | 8.84 |
| | -8.5 | -9.1 | 25.1 | 8.11 | 25.1 | 8.30 | 25.0 | 8.50 | 25.0 | 8.60 | 25.0 | 8.70 | 24.7 | 8.79 |
| | -7.0 | -7.6 | 26.0 | 8.24 | 26.0 | 8.43 | 25.9 | 8.63 | 25.9 | 8.72 | 25.9 | 8.82 | 24.7 | 8.39 |
| | -5.0 | -5.6 | 27.4 | 8.42 | 27.3 | 8.60 | 27.3 | 8.78 | 27.3 | 8.87 | 26.5 | 8.60 | 24.7 | 7.89 |
| | -3.0 | -3.7 | 28.7 | 8.58 | 28.7 | 7.80 | 28.4 | 8.79 | 27.4 | 8.44 | 26.5 | 8.10 | 24.7 | 7.43 |
| | 0.0 | -0.7 | 31.1 | 8.83 | 30.2 | 7.66 | 28.4 | 7.97 | 27.4 | 7.66 | 26.5 | 7.36 | 24.7 | 6.76 |
| | 3.0 | 2.2 | 32.0 | 8.41 | 30.2 | 7.83 | 28.4 | 7.26 | 27.4 | 6.99 | 26.5 | 6.71 | 24.7 | 6.18 |
| | 5.0 | 4.1 | 32.0 | 7.91 | 30.2 | 7.37 | 28.4 | 6.84 | 27.4 | 6.58 | 26.5 | 6.33 | 24.7 | 5.83 |
| | 7.0 | 6.0 | 32.0 | 7.43 | 30.2 | 6.94 | 28.4 | 6.45 | 27.4 | 6.21 | 26.5 | 5.97 | 24.7 | 5.51 |
| | 9.0 | 7.9 | 32.0 | 7.01 | 30.2 | 6.53 | 28.4 | 6.08 | 27.4 | 5.86 | 26.5 | 5.64 | 24.7 | 5.20 |
| | 11.0 | 9.8 | 32.0 | 6.60 | 30.2 | 6.16 | 28.4 | 5.74 | 27.4 | 5.54 | 26.5 | 5.33 | 24.7 | 4.93 |
| | 13.0 | 11.8 | 32.0 | 6.21 | 30.2 | 5.81 | 28.4 | 5.41 | 27.4 | 5.22 | 26.5 | 5.03 | 24.7 | 4.65 |
| | 15.0 | 13.7 | 32.0 | 5.87 | 30.2 | 5.49 | 28.4 | 5.13 | 27.4 | 4.93 | 26.5 | 4.77 | 24.7 | 4.42 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80 | -19.8 | -20.0 | 19.9 | 7.62 | 19.8 | 7.84 | 19.8 | 8.07 | 19.8 | 8.18 | 19.7 | 8.30 | 19.7 | 8.51 |
| | -18.8 | -19.0 | 20.2 | 7.69 | 20.2 | 7.92 | 20.1 | 8.13 | 20.1 | 8.25 | 20.1 | 8.35 | 20.0 | 8.58 |
| | -16.7 | -17.0 | 21.0 | 7.85 | 20.9 | 8.06 | 20.9 | 8.28 | 20.9 | 8.38 | 20.9 | 8.48 | 20.8 | 8.69 |
| | -13.7 | -15.0 | 21.9 | 8.01 | 21.8 | 8.21 | 21.8 | 8.42 | 21.8 | 8.51 | 21.7 | 8.62 | 21.7 | 8.83 |
| | -11.8 | -13.0 | 22.8 | 8.17 | 22.8 | 8.37 | 22.7 | 8.56 | 22.7 | 8.66 | 22.7 | 8.76 | 22.0 | 8.52 |
| | -9.8 | -11.0 | 23.9 | 8.33 | 23.9 | 8.52 | 23.8 | 8.71 | 23.8 | 8.80 | 23.6 | 8.78 | 22.0 | 8.05 |
| | -9.5 | -10.0 | 24.5 | 8.42 | 24.4 | 8.60 | 24.4 | 8.78 | 24.4 | 8.87 | 23.6 | 8.52 | 22.0 | 7.81 |
| | -8.5 | -9.1 | 25.0 | 8.49 | 25.0 | 8.67 | 24.9 | 8.84 | 24.4 | 8.66 | 23.6 | 8.30 | 22.0 | 7.60 |
| | -7.0 | -7.6 | 25.9 | 8.62 | 25.9 | 8.79 | 25.2 | 8.60 | 24.4 | 8.26 | 23.6 | 7.93 | 22.0 | 7.30 |
| | -5.0 | -5.6 | 27.3 | 7.82 | 26.8 | 8.72 | 25.2 | 8.08 | 24.4 | 7.76 | 23.6 | 7.45 | 22.0 | 6.84 |
| | -3.0 | -3.7 | 28.4 | 7.87 | 26.8 | 8.21 | 25.2 | 7.60 | 24.4 | 7.35 | 23.6 | 7.02 | 22.0 | 6.47 |
| | 0.0 | -0.7 | 28.4 | 8.00 | 26.8 | 7.45 | 25.2 | 6.92 | 24.4 | 6.66 | 23.6 | 6.40 | 22.0 | 5.90 |
| | 3.0 | 2.2 | 28.4 | 7.29 | 26.8 | 6.80 | 25.2 | 6.32 | 24.4 | 6.09 | 23.6 | 5.86 | 22.0 | 5.40 |
| | 5.0 | 4.1 | 28.4 | 6.86 | 26.8 | 6.41 | 25.2 | 5.96 | 24.4 | 5.74 | 23.6 | 5.54 | 22.0 | 5.11 |
| | 7.0 | 6.0 | 28.4 | 6.47 | 26.8 | 6.06 | 25.2 | 5.63 | 24.4 | 5.43 | 23.6 | 5.23 | 22.0 | 4.83 |
| | 9.0 | 7.9 | 28.4 | 6.11 | 26.8 | 5.71 | 25.2 | 5.35 | 24.4 | 5.13 | 23.6 | 4.95 | 22.0 | 4.58 |
| | 11.0 | 9.8 | 28.4 | 5.76 | 26.8 | 5.39 | 25.2 | 5.03 | 24.4 | 4.85 | 23.6 | 4.68 | 22.0 | 4.34 |
| | 13.0 | 11.8 | 28.4 | 5.43 | 26.8 | 5.09 | 25.2 | 4.76 | 24.4 | 4.59 | 23.6 | 4.43 | 22.0 | 4.10 |
| | 15.0 | 13.7 | 28.4 | 5.14 | 26.8 | 4.83 | 25.2 | 4.51 | 24.4 | 4.35 | 23.6 | 4.20 | 22.0 | 3.91 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|-------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 70 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 19.8 | 8.11 | 19.7 | 8.30 | 19.7 | 8.50 | 19.7 | 8.60 | 19.7 | 8.70 | 19.2 | 8.61 |
| | -18.8 | -19.0 | 20.1 | 8.18 | 20.1 | 8.37 | 20.0 | 8.56 | 20.0 | 8.66 | 20.0 | 8.76 | 19.2 | 8.43 |
| | -16.7 | -17.0 | 20.9 | 8.31 | 20.9 | 8.50 | 20.8 | 8.68 | 20.8 | 8.78 | 20.6 | 8.77 | 19.2 | 8.04 |
| | -13.7 | -15.0 | 21.8 | 8.46 | 21.7 | 8.64 | 21.7 | 8.82 | 21.3 | 84.52 | 20.6 | 8.33 | 19.2 | 7.64 |
| | -11.8 | -13.0 | 22.7 | 8.60 | 22.7 | 8.77 | 22.1 | 8.56 | 21.3 | 8.23 | 20.6 | 7.90 | 19.2 | 7.24 |
| | -9.8 | -11.0 | 23.8 | 8.74 | 23.5 | 8.73 | 22.1 | 8.09 | 21.3 | 7.77 | 20.6 | 7.46 | 19.2 | 6.85 |
| | -9.5 | -10.0 | 24.4 | 8.82 | 23.5 | 8.48 | 22.1 | 7.85 | 21.3 | 7.55 | 20.6 | 7.25 | 19.2 | 6.66 |
| | -8.5 | -9.1 | 24.9 | 8.86 | 23.5 | 8.25 | 22.1 | 7.64 | 21.3 | 7.35 | 20.6 | 7.06 | 19.2 | 6.49 |
| | -7.0 | -7.6 | 24.9 | 8.47 | 23.5 | 7.88 | 22.1 | 7.31 | 21.3 | 7.03 | 20.6 | 6.76 | 19.2 | 6.22 |
| | -5.0 | -5.6 | 24.9 | 7.95 | 23.5 | 7.41 | 22.1 | 6.88 | 21.3 | 6.62 | 20.6 | 6.36 | 19.2 | 5.87 |
| | -3.0 | -3.7 | 24.9 | 7.49 | 23.5 | 6.99 | 22.1 | 6.49 | 21.3 | 6.25 | 20.6 | 6.01 | 19.2 | 5.55 |
| | 0.0 | -0.7 | 24.9 | 6.82 | 23.5 | 6.40 | 22.1 | 5.93 | 21.3 | 5.71 | 20.6 | 5.50 | 19.2 | 5.08 |
| | 3.0 | 2.2 | 24.9 | 6.23 | 23.5 | 0.14 | 22.1 | 5.43 | 21.3 | 5.23 | 20.6 | 5.04 | 19.2 | 4.66 |
| | 5.0 | 4.1 | 24.9 | 5.88 | 23.5 | 5.50 | 22.1 | 5.14 | 21.3 | 4.95 | 20.6 | 4.78 | 19.2 | 4.42 |
| | 7.0 | 6.0 | 24.9 | 5.56 | 23.5 | 5.20 | 22.1 | 4.85 | 21.3 | 4.68 | 20.6 | 4.52 | 19.2 | 4.19 |
| | 9.0 | 7.9 | 24.9 | 5.25 | 23.5 | 4.92 | 22.1 | 4.60 | 21.3 | 4.44 | 20.6 | 4.28 | 19.2 | 3.97 |
| | 11.0 | 9.8 | 24.9 | 4.97 | 23.5 | 4.65 | 22.1 | 4.36 | 21.3 | 4.21 | 20.6 | 4.07 | 19.2 | 3.77 |
| | 13.0 | 11.8 | 24.9 | 4.69 | 23.5 | 4.41 | 22.1 | 4.12 | 21.3 | 3.99 | 20.6 | 3.85 | 19.2 | 3.58 |
| | 15.0 | 13.7 | 24.9 | 4.45 | 23.5 | 4.18 | 22.1 | 3.92 | 21.3 | 3.79 | 20.6 | 3.66 | 19.2 | 3.41 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 60 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 19.7 | 8.61 | 19.6 | 8.77 | 18.9 | 8.44 | 18.3 | 8.11 | 17.7 | 7.78 | 16.5 | 7.14 |
| | -18.8 | -19.0 | 20.0 | 8.66 | 20.0 | 8.83 | 18.9 | 8.26 | 18.3 | 7.93 | 17.7 | 7.61 | 16.5 | 6.99 |
| | -16.7 | -17.0 | 20.8 | 8.78 | 20.1 | 8.50 | 18.9 | 7.88 | 18.3 | 7.57 | 17.7 | 7.27 | 16.5 | 6.68 |
| | -13.7 | -15.0 | 21.3 | 8.68 | 20.1 | 8.08 | 18.9 | 7.49 | 18.3 | 7.20 | 17.7 | 6.92 | 16.5 | 6.36 |
| | -11.8 | -13.0 | 21.3 | 8.22 | 20.1 | 7.65 | 18.9 | 7.10 | 18.3 | 6.84 | 17.7 | 6.57 | 16.5 | 6.05 |
| | -9.8 | -11.0 | 21.3 | 7.76 | 20.1 | 7.23 | 18.9 | 6.72 | 18.3 | 6.47 | 17.7 | 6.22 | 16.5 | 5.74 |
| | -9.5 | -10.0 | 21.3 | 7.55 | 20.1 | 7.03 | 18.9 | 6.53 | 18.3 | 6.29 | 17.7 | 6.05 | 16.5 | 5.57 |
| | -8.5 | -9.1 | 21.3 | 7.35 | 20.1 | 6.85 | 18.9 | 6.37 | 18.3 | 6.13 | 17.7 | 5.90 | 16.5 | 5.44 |
| | -7.0 | -7.6 | 21.3 | 7.02 | 20.1 | 6.56 | 18.9 | 6.10 | 18.3 | 5.88 | 17.7 | 5.65 | 16.5 | 5.22 |
| | -5.0 | -5.6 | 21.3 | 6.62 | 20.1 | 6.18 | 18.9 | 5.75 | 18.3 | 5.55 | 17.7 | 5.34 | 16.5 | 4.94 |
| | -3.0 | -3.7 | 21.3 | 6.25 | 20.1 | 5.84 | 18.9 | 5.46 | 18.3 | 5.25 | 17.7 | 5.05 | 16.5 | 4.67 |
| | 0.0 | -0.7 | 21.3 | 5.71 | 20.1 | 5.35 | 18.9 | 4.99 | 18.3 | 4.82 | 17.7 | 4.64 | 16.5 | 4.29 |
| | 3.0 | 2.2 | 21.3 | 5.23 | 20.1 | 4.91 | 18.9 | 4.59 | 18.3 | 4.43 | 17.7 | 4.28 | 16.5 | 0.17 |
| | 5.0 | 4.1 | 21.3 | 4.95 | 20.1 | 4.65 | 18.9 | 4.34 | 18.3 | 4.20 | 17.7 | 4.05 | 16.5 | 3.76 |
| | 7.0 | 6.0 | 21.3 | 4.68 | 20.1 | 4.40 | 18.9 | 4.11 | 18.3 | 3.98 | 17.7 | 3.85 | 16.5 | 3.57 |
| | 9.0 | 7.9 | 21.3 | 4.44 | 20.1 | 4.17 | 18.9 | 3.91 | 18.3 | 3.78 | 17.7 | 3.65 | 16.5 | 3.40 |
| | 11.0 | 9.8 | 21.3 | 4.21 | 20.1 | 3.96 | 18.9 | 3.72 | 18.3 | 3.59 | 17.7 | 3.47 | 16.5 | 3.24 |
| | 13.0 | 11.8 | 21.3 | 3.98 | 20.1 | 3.75 | 18.9 | 3.53 | 18.3 | 3.41 | 17.7 | 3.30 | 16.5 | 3.08 |
| | 15.0 | 13.7 | 21.3 | 3.79 | 20.1 | 3.56 | 18.9 | 3.36 | 18.3 | 3.25 | 17.7 | 3.15 | 16.5 | 2.94 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | Indoor air temperature. °CDB | | | | | | | | | | | | |
|-------------|-------------------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|------|
| | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | |
| 50 | -19.8 | -20.0 | 17.8 | 7.83 | 16.8 | 7.29 | 15.8 | 6.77 | 15.2 | 6.52 | 14.7 | 6.27 | 13.7 | 5.77 |
| | -18.8 | -19.0 | 17.8 | 7.66 | 16.8 | 7.14 | 15.8 | 6.64 | 15.2 | 6.38 | 14.7 | 6.13 | 13.7 | 5.66 |
| | -16.7 | -17.0 | 17.8 | 7.31 | 16.8 | 6.82 | 15.8 | 6.34 | 15.2 | 6.11 | 14.7 | 5.88 | 13.7 | 5.42 |
| | -13.7 | -15.0 | 17.8 | 6.96 | 16.8 | 6.49 | 15.8 | 6.04 | 15.2 | 5.82 | 14.7 | 5.60 | 13.7 | 5.18 |
| | -11.8 | -13.0 | 17.8 | 6.61 | 16.8 | 6.18 | 15.8 | 5.74 | 15.2 | 5.54 | 14.7 | 5.33 | 13.7 | 4.93 |
| | -9.8 | -11.0 | 17.8 | 6.26 | 16.8 | 5.85 | 15.8 | 5.45 | 15.2 | 5.25 | 14.7 | 5.06 | 13.7 | 4.68 |
| | -9.5 | -10.0 | 17.8 | 6.09 | 16.8 | 5.69 | 15.8 | 5.31 | 15.2 | 5.12 | 14.7 | 4.93 | 13.7 | 4.56 |
| | -8.5 | -9.1 | 17.8 | 5.93 | 16.8 | 5.56 | 15.8 | 5.18 | 15.2 | 5.00 | 14.7 | 4.82 | 13.7 | 4.46 |
| | -7.0 | -7.6 | 17.8 | 5.69 | 16.8 | 5.35 | 15.8 | 4.97 | 15.2 | 4.80 | 14.7 | 4.63 | 13.7 | 4.28 |
| | -5.0 | -5.6 | 17.8 | 5.37 | 16.8 | 5.03 | 15.8 | 4.70 | 15.2 | 4.54 | 14.7 | 4.38 | 13.7 | 4.06 |
| | -3.0 | -3.7 | 17.8 | 5.08 | 16.8 | 4.77 | 15.8 | 4.46 | 15.2 | 4.30 | 14.7 | 4.15 | 13.7 | 3.86 |
| | 0.0 | -0.7 | 17.8 | 4.66 | 16.8 | 4.38 | 15.8 | 4.10 | 15.2 | 3.96 | 14.7 | 3.83 | 13.7 | 3.56 |
| | 3.0 | 2.2 | 17.8 | 4.29 | 16.8 | 4.04 | 15.8 | 3.78 | 15.2 | 3.66 | 14.7 | 3.55 | 13.7 | 3.30 |
| | 5.0 | 4.1 | 17.8 | 4.08 | 16.8 | 3.83 | 15.8 | 3.59 | 15.2 | 3.48 | 14.7 | 3.37 | 13.7 | 3.14 |
| | 7.0 | 6.0 | 17.8 | 3.87 | 16.8 | 3.64 | 15.8 | 3.42 | 15.2 | 3.31 | 14.7 | 3.20 | 13.7 | 3.00 |
| | 9.0 | 7.9 | 17.8 | 3.67 | 16.8 | 3.46 | 15.8 | 3.25 | 15.2 | 3.16 | 14.7 | 3.05 | 13.7 | 2.85 |
| | 11.0 | 9.8 | 17.8 | 3.49 | 16.8 | 3.29 | 15.8 | 3.10 | 15.2 | 3.01 | 14.7 | 2.91 | 13.7 | 2.72 |
| | 13.0 | 11.8 | 17.8 | 3.32 | 16.8 | 3.13 | 15.8 | 2.95 | 15.2 | 2.86 | 14.7 | 2.77 | 13.7 | 2.60 |
| | 15.0 | 13.7 | 17.8 | 3.16 | 16.8 | 2.99 | 15.8 | 2.82 | 15.2 | 2.73 | 14.7 | 2.64 | 13.7 | 2.47 |

CHV-5S335NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. | Indoor air temperature. °CDB | | | | | | | | | | | | |
|-------------|-------------------|------------------------------|------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | | |
| | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | |
| 130 | -19.8 | -20.0 | 24.3 | 6.36 | 24.2 | 6.80 | 24.0 | 7.26 | 24.0 | 7.48 | 23.9 | 7.70 | 23.9 | 8.16 |
| | -18.8 | -19.0 | 24.6 | 6.50 | 24.5 | 6.94 | 24.5 | 7.39 | 24.4 | 7.61 | 24.4 | 7.82 | 24.3 | 8.26 |
| | -16.7 | -17.0 | 25.6 | 6.80 | 25.5 | 7.22 | 25.3 | 7.66 | 25.3 | 7.83 | 25.3 | 8.08 | 25.2 | 8.51 |
| | -13.7 | -15.0 | 26.7 | 7.12 | 26.5 | 7.53 | 26.4 | 7.94 | 26.4 | 8.14 | 26.3 | 8.35 | 26.3 | 8.76 |
| | -11.8 | -13.0 | 27.7 | 7.43 | 27.7 | 7.83 | 27.6 | 8.22 | 27.5 | 8.42 | 27.5 | 8.62 | 27.4 | 9.00 |
| | -9.8 | -11.0 | 29.0 | 7.76 | 28.9 | 8.14 | 28.8 | 8.51 | 28.8 | 8.70 | 28.8 | 8.88 | 28.7 | 9.26 |
| | -9.5 | -10.0 | 29.8 | 7.93 | 29.6 | 8.29 | 29.5 | 8.65 | 29.5 | 8.84 | 29.4 | 9.01 | 29.4 | 9.38 |
| | -8.5 | -9.1 | 30.3 | 8.07 | 30.2 | 8.42 | 30.2 | 8.78 | 30.1 | 8.95 | 30.1 | 9.13 | 30.0 | 9.49 |
| | -7.0 | -7.6 | 31.4 | 8.30 | 31.4 | 8.65 | 31.3 | 8.99 | 31.3 | 9.16 | 31.2 | 9.33 | 31.1 | 9.68 |
| | -5.0 | -5.6 | 33.1 | 8.62 | 33.0 | 8.77 | 32.8 | 9.27 | 32.8 | 9.43 | 32.7 | 9.59 | 32.7 | 9.91 |
| | -3.0 | -3.7 | 34.6 | 8.90 | 34.5 | 9.21 | 34.5 | 9.52 | 34.4 | 9.68 | 34.4 | 9.83 | 34.3 | 10.14 |
| | 0.0 | -0.7 | 37.4 | 9.33 | 37.4 | 9.62 | 37.2 | 9.90 | 37.2 | 10.04 | 37.1 | 10.19 | 37.1 | 10.47 |
| | 3.0 | 2.2 | 40.3 | 9.71 | 40.2 | 9.98 | 40.1 | 10.25 | 40.1 | 10.38 | 40.1 | 10.52 | 40.0 | 10.78 |
| | 5.0 | 4.1 | 42.4 | 9.96 | 42.2 | 10.22 | 42.2 | 10.46 | 42.1 | 10.59 | 42.1 | 10.72 | 42.0 | 10.97 |
| | 7.0 | 6.0 | 44.5 | 10.19 | 44.4 | 10.43 | 44.4 | 10.67 | 44.3 | 9.62 | 44.3 | 10.91 | 42.5 | 10.47 |
| | 9.0 | 7.9 | 46.8 | 10.40 | 46.6 | 10.64 | 46.6 | 10.86 | 46.5 | 10.98 | 45.6 | 10.75 | 42.5 | 9.84 |
| | 11.0 | 9.8 | 49.1 | 10.61 | 49.0 | 10.82 | 48.8 | 10.97 | 47.1 | 10.53 | 45.6 | 10.10 | 42.5 | 9.27 |
| | 13.0 | 11.8 | 51.8 | 10.81 | 51.6 | 11.02 | 48.8 | 10.28 | 47.1 | 9.87 | 45.6 | 9.48 | 42.5 | 8.70 |
| | 15.0 | 13.7 | 54.3 | 11.00 | 51.9 | 10.44 | 48.8 | 9.68 | 47.1 | 9.31 | 45.6 | 8.93 | 42.5 | 8.21 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 120 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 24.2 | 6.97 | 24.0 | 7.38 | 23.9 | 7.80 | 23.9 | 8.00 | 23.9 | 8.21 | 23.8 | 8.63 |
| | -18.8 | -19.0 | 24.5 | 7.10 | 24.4 | 7.50 | 24.4 | 7.83 | 24.3 | 8.11 | 24.3 | 8.32 | 24.2 | 8.73 |
| | -16.7 | -17.0 | 25.5 | 7.38 | 25.3 | 7.77 | 25.3 | 8.16 | 25.2 | 8.36 | 25.2 | 8.56 | 25.1 | 8.94 |
| | -13.7 | -15.0 | 26.5 | 7.67 | 26.4 | 8.04 | 26.3 | 8.42 | 26.3 | 8.62 | 26.3 | 8.80 | 26.2 | 9.18 |
| | -11.8 | -13.0 | 27.6 | 7.96 | 27.6 | 8.32 | 27.5 | 8.69 | 27.5 | 8.87 | 27.4 | 9.05 | 27.4 | 9.41 |
| | -9.8 | -11.0 | 28.9 | 8.26 | 28.8 | 8.60 | 28.8 | 8.95 | 28.7 | 9.13 | 28.7 | 9.29 | 28.6 | 9.66 |
| | -9.5 | -10.0 | 29.6 | 8.42 | 29.5 | 8.76 | 29.4 | 9.08 | 29.4 | 9.26 | 29.4 | 9.35 | 29.3 | 9.76 |
| | -8.5 | -9.1 | 30.2 | 8.55 | 30.1 | 8.87 | 30.1 | 9.20 | 30.0 | 9.36 | 30.0 | 9.54 | 29.9 | 9.87 |
| | -7.0 | -7.6 | 31.3 | 8.77 | 31.3 | 9.08 | 31.2 | 9.40 | 31.2 | 9.56 | 31.1 | 9.71 | 31.1 | 10.03 |
| | -5.0 | -5.6 | 33.0 | 9.05 | 32.8 | 9.35 | 32.7 | 9.66 | 32.7 | 9.81 | 32.7 | 9.96 | 32.6 | 10.25 |
| | -3.0 | -3.7 | 34.5 | 9.32 | 34.5 | 9.61 | 34.4 | 9.89 | 34.4 | 10.03 | 34.3 | 10.18 | 34.3 | 10.46 |
| | 0.0 | -0.7 | 37.2 | 9.71 | 37.2 | 9.98 | 37.1 | 10.37 | 37.1 | 10.38 | 37.0 | 10.51 | 37.0 | 10.78 |
| | 3.0 | 2.2 | 40.2 | 10.08 | 40.1 | 10.32 | 40.1 | 10.57 | 40.0 | 10.70 | 40.0 | 10.81 | 39.2 | 10.75 |
| | 5.0 | 4.1 | 42.2 | 10.30 | 42.1 | 10.53 | 42.1 | 10.77 | 42.0 | 10.88 | 42.0 | 11.00 | 39.2 | 10.10 |
| | 7.0 | 6.0 | 44.4 | 10.51 | 44.4 | 10.73 | 44.3 | 10.95 | 43.6 | 10.80 | 42.1 | 10.36 | 39.2 | 9.50 |
| | 9.0 | 7.9 | 46.6 | 10.72 | 46.5 | 10.93 | 45.0 | 10.57 | 43.6 | 10.15 | 42.1 | 9.74 | 39.2 | 8.94 |
| | 11.0 | 9.8 | 49.0 | 10.91 | 47.8 | 10.72 | 45.0 | 9.94 | 43.6 | 9.55 | 42.1 | 9.16 | 39.2 | 8.43 |
| | 13.0 | 11.8 | 50.8 | 10.80 | 47.8 | 10.05 | 45.0 | 9.32 | 43.6 | 8.97 | 42.1 | 8.62 | 39.2 | 7.93 |
| | 15.0 | 13.7 | 50.8 | 10.17 | 47.8 | 9.47 | 45.0 | 8.79 | 43.6 | 8.45 | 42.1 | 8.12 | 39.2 | 7.48 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|-------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 110 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 24.0 | 7.58 | 23.9 | 7.95 | 23.8 | 8.33 | 23.8 | 8.52 | 23.8 | 8.71 | 23.7 | 9.09 |
| | -18.8 | -19.0 | 24.4 | 7.69 | 24.4 | 8.07 | 262.3 | 8.44 | 24.3 | 8.63 | 24.2 | 8.81 | 24.2 | 9.19 |
| | -16.7 | -17.0 | 25.3 | 7.95 | 25.2 | 8.31 | 25.2 | 8.67 | 25.1 | 8.85 | 25.1 | 9.04 | 25.0 | 9.39 |
| | -13.7 | -15.0 | 26.4 | 8.22 | 26.3 | 8.57 | 26.2 | 8.91 | 26.2 | 9.08 | 26.2 | 9.26 | 26.1 | 9.60 |
| | -11.8 | -13.0 | 27.5 | 8.50 | 27.5 | 8.83 | 27.4 | 9.15 | 27.4 | 9.32 | 27.3 | 9.48 | 27.3 | 9.82 |
| | -9.8 | -11.0 | 28.8 | 8.77 | 28.7 | 9.08 | 28.7 | 9.40 | 28.6 | 9.56 | 28.6 | 9.71 | 28.6 | 10.03 |
| | -9.5 | -10.0 | 29.5 | 8.91 | 29.4 | 9.21 | 29.3 | 9.53 | 29.3 | 9.68 | 29.3 | 9.83 | 29.2 | 10.14 |
| | -8.5 | -9.1 | 30.1 | 9.02 | 30.0 | 9.33 | 30.0 | 9.63 | 30.0 | 9.78 | 29.9 | 9.94 | 29.9 | 10.23 |
| | -7.0 | -7.6 | 31.2 | 9.24 | 31.2 | 9.52 | 31.1 | 9.81 | 31.1 | 9.96 | 31.4 | 10.10 | 30.9 | 10.39 |
| | -5.0 | -5.6 | 32.8 | 9.49 | 32.7 | 9.77 | 32.6 | 10.04 | 32.6 | 10.18 | 34.2 | 10.32 | 32.5 | 10.60 |
| | -3.0 | -3.7 | 34.4 | 9.74 | 34.4 | 9.99 | 34.3 | 10.26 | 34.3 | 10.39 | 37.0 | 10.52 | 34.2 | 10.79 |
| | 0.0 | -0.7 | 37.1 | 10.10 | 37.1 | 10.35 | 37.0 | 10.59 | 37.0 | 10.71 | 38.6 | 10.84 | 35.9 | 10.63 |
| | 3.0 | 2.2 | 40.1 | 10.44 | 40.0 | 10.66 | 40.0 | 10.88 | 39.9 | 10.99 | 38.6 | 10.54 | 35.9 | 9.67 |
| | 5.0 | 4.1 | 42.1 | 10.64 | 42.1 | 10.86 | 41.3 | 10.75 | 39.9 | 10.32 | 38.6 | 9.91 | 35.9 | 9.09 |
| | 7.0 | 6.0 | 44.3 | 10.84 | 43.9 | 10.91 | 41.3 | 10.10 | 39.9 | 9.70 | 38.6 | 9.32 | 35.9 | 8.56 |
| | 9.0 | 7.9 | 46.5 | 11.01 | 43.9 | 10.25 | 41.3 | 9.50 | 39.9 | 9.13 | 38.6 | 8.77 | 35.9 | 8.07 |
| | 11.0 | 9.8 | 46.5 | 10.36 | 43.9 | 9.64 | 41.3 | 8.94 | 39.9 | 8.60 | 38.6 | 8.26 | 35.9 | 7.61 |
| | 13.0 | 11.8 | 46.5 | 9.71 | 43.9 | 9.05 | 41.3 | 8.41 | 39.9 | 8.09 | 38.6 | 7.77 | 35.9 | 7.17 |
| | 15.0 | 13.7 | 46.5 | 9.15 | 43.9 | 8.53 | 41.3 | 7.94 | 39.9 | 7.63 | 38.6 | 7.35 | 35.9 | 6.78 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100 | -19.8 | -20.0 | 23.9 | 8.18 | 23.8 | 8.52 | 23.8 | 8.87 | 23.7 | 9.05 | 23.7 | 9.21 | 23.6 | 9.56 |
| | -18.8 | -19.0 | 24.3 | 8.29 | 24.3 | 8.63 | 24.2 | 8.97 | 24.2 | 9.14 | 24.0 | 9.32 | 24.0 | 9.66 |
| | -16.7 | -17.0 | 25.2 | 8.52 | 25.1 | 8.85 | 25.1 | 9.18 | 25.1 | 9.34 | 25.0 | 9.50 | 25.0 | 9.83 |
| | -13.7 | -15.0 | 26.3 | 8.77 | 26.2 | 9.08 | 26.2 | 9.40 | 26.1 | 9.56 | 26.1 | 9.71 | 25.9 | 10.03 |
| | -11.8 | -13.0 | 27.4 | 9.02 | 27.4 | 9.32 | 27.3 | 9.62 | 27.3 | 9.77 | 27.3 | 9.57 | 27.1 | 10.23 |
| | -9.8 | -11.0 | 28.7 | 9.27 | 28.6 | 9.56 | 28.6 | 9.84 | 28.6 | 9.99 | 28.4 | 10.14 | 28.4 | 10.42 |
| | -9.5 | -10.0 | 29.4 | 9.40 | 29.3 | 9.68 | 29.3 | 9.96 | 29.2 | 10.10 | 29.2 | 10.24 | 29.0 | 10.52 |
| | -8.5 | -9.1 | 30.0 | 9.50 | 30.0 | 9.78 | 29.9 | 10.05 | 29.9 | 10.19 | 29.8 | 10.33 | 29.8 | 10.60 |
| | -7.0 | -7.6 | 31.1 | 9.69 | 31.1 | 9.96 | 30.9 | 10.22 | 30.9 | 10.36 | 30.9 | 10.49 | 30.8 | 10.75 |
| | -5.0 | -5.6 | 32.7 | 9.94 | 32.6 | 10.18 | 32.6 | 10.44 | 32.5 | 10.57 | 32.5 | 10.68 | 32.5 | 10.94 |
| | -3.0 | -3.7 | 34.3 | 10.16 | 34.3 | 10.39 | 34.2 | 10.64 | 34.2 | 10.75 | 34.2 | 10.87 | 32.7 | 10.42 |
| | 0.0 | -0.7 | 37.0 | 10.50 | 37.0 | 10.71 | 36.9 | 10.93 | 36.3 | 10.75 | 35.1 | 10.31 | 32.7 | 9.47 |
| | 3.0 | 2.2 | 40.0 | 10.79 | 39.9 | 10.99 | 37.5 | 10.17 | 36.3 | 9.77 | 35.1 | 9.39 | 32.7 | 8.62 |
| | 5.0 | 4.1 | 42.0 | 10.99 | 39.9 | 10.32 | 37.5 | 9.56 | 36.3 | 9.20 | 35.1 | 8.84 | 32.7 | 8.12 |
| | 7.0 | 6.0 | 42.2 | 10.43 | 39.9 | 9.70 | 37.5 | 9.00 | 36.3 | 8.66 | 35.1 | 8.32 | 32.7 | 7.66 |
| | 9.0 | 7.9 | 42.2 | 9.80 | 39.9 | 9.13 | 37.5 | 8.48 | 36.3 | 8.16 | 35.1 | 7.84 | 32.7 | 7.22 |
| | 11.0 | 9.8 | 42.2 | 9.22 | 39.9 | 8.60 | 37.5 | 8.00 | 36.3 | 7.69 | 35.1 | 7.40 | 32.7 | 6.83 |
| | 13.0 | 11.8 | 42.2 | 8.66 | 39.9 | 8.09 | 37.5 | 7.53 | 36.3 | 7.25 | 35.1 | 6.98 | 32.7 | 6.44 |
| | 15.0 | 13.7 | 42.2 | 8.17 | 39.9 | 7.63 | 37.5 | 7.11 | 36.3 | 6.85 | 35.1 | 6.59 | 32.7 | 6.10 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90 | -19.8 | -20.0 | 23.8 | 8.79 | 23.7 | 9.09 | 23.7 | 9.41 | 23.6 | 9.56 | 23.6 | 9.73 | 23.6 | 10.03 |
| | -18.8 | -19.0 | 24.2 | 8.88 | 24.2 | 9.20 | 24.0 | 9.50 | 24.0 | 9.66 | 24.0 | 9.81 | 23.9 | 10.11 |
| | -16.7 | -17.0 | 25.1 | 9.11 | 25.0 | 9.40 | 25.0 | 9.69 | 25.0 | 9.84 | 24.9 | 9.98 | 24.9 | 10.28 |
| | -13.7 | -15.0 | 26.2 | 9.33 | 26.1 | 9.61 | 26.1 | 9.89 | 25.9 | 9.94 | 25.9 | 10.17 | 25.9 | 10.45 |
| | -11.8 | -13.0 | 27.3 | 9.55 | 27.3 | 9.82 | 27.1 | 10.09 | 27.1 | 10.23 | 27.1 | 10.36 | 27.0 | 10.63 |
| | -9.8 | -11.0 | 28.6 | 9.77 | 28.6 | 10.03 | 28.4 | 10.29 | 28.4 | 10.43 | 28.4 | 10.56 | 28.3 | 10.81 |
| | -9.5 | -10.0 | 29.3 | 9.89 | 29.2 | 10.15 | 29.2 | 10.39 | 29.0 | 10.52 | 29.0 | 10.65 | 29.0 | 10.90 |
| | -8.5 | -9.1 | 29.9 | 9.99 | 29.9 | 10.24 | 29.8 | 10.49 | 29.8 | 10.60 | 29.8 | 10.73 | 29.4 | 10.84 |
| | -7.0 | -7.6 | 30.9 | 10.16 | 30.9 | 10.39 | 30.8 | 10.64 | 30.8 | 10.75 | 30.8 | 10.87 | 29.4 | 10.35 |
| | -5.0 | -5.6 | 32.6 | 10.38 | 32.5 | 10.60 | 32.5 | 10.82 | 32.5 | 10.94 | 31.5 | 10.60 | 29.4 | 9.73 |
| | -3.0 | -3.7 | 34.2 | 10.58 | 34.2 | 9.62 | 33.8 | 10.84 | 32.6 | 10.40 | 31.5 | 9.98 | 29.4 | 9.16 |
| | 0.0 | -0.7 | 37.0 | 10.88 | 35.9 | 9.45 | 33.8 | 9.83 | 32.6 | 9.45 | 31.5 | 9.07 | 29.4 | 8.33 |
| | 3.0 | 2.2 | 38.1 | 10.37 | 35.9 | 9.66 | 33.8 | 8.95 | 32.6 | 8.62 | 31.5 | 8.28 | 29.4 | 7.62 |
| | 5.0 | 4.1 | 38.1 | 9.75 | 35.9 | 9.08 | 33.8 | 8.44 | 32.6 | 8.11 | 31.5 | 7.81 | 29.4 | 7.19 |
| | 7.0 | 6.0 | 38.1 | 9.16 | 35.9 | 8.56 | 33.8 | 7.95 | 32.6 | 7.66 | 31.5 | 7.36 | 29.4 | 6.79 |
| | 9.0 | 7.9 | 38.1 | 8.64 | 35.9 | 8.05 | 33.8 | 7.49 | 32.6 | 7.22 | 31.5 | 6.96 | 29.4 | 6.42 |
| | 11.0 | 9.8 | 38.1 | 8.14 | 35.9 | 7.60 | 33.8 | 7.08 | 32.6 | 6.83 | 31.5 | 6.57 | 29.4 | 6.08 |
| | 13.0 | 11.8 | 38.1 | 7.66 | 35.9 | 7.17 | 33.8 | 6.67 | 32.6 | 6.44 | 31.5 | 6.21 | 29.4 | 5.74 |
| | 15.0 | 13.7 | 38.1 | 7.24 | 35.9 | 6.77 | 33.8 | 6.32 | 32.6 | 6.08 | 31.5 | 5.88 | 29.4 | 5.45 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 80 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 23.7 | 9.40 | 23.6 | 9.67 | 23.6 | 9.95 | 23.6 | 10.09 | 23.4 | 10.23 | 23.4 | 10.50 |
| | -18.8 | -19.0 | 24.0 | 9.48 | 24.0 | 9.76 | 23.9 | 10.03 | 23.9 | 10.17 | 23.9 | 10.30 | 23.8 | 10.58 |
| | -16.7 | -17.0 | 25.0 | 9.68 | 24.9 | 9.94 | 24.9 | 10.21 | 24.9 | 10.33 | 24.9 | 10.46 | 24.8 | 10.72 |
| | -13.7 | -15.0 | 26.1 | 9.88 | 25.9 | 10.12 | 25.9 | 10.38 | 25.9 | 10.50 | 25.8 | 10.63 | 25.8 | 10.88 |
| | -11.8 | -13.0 | 27.1 | 10.08 | 27.1 | 10.32 | 27.0 | 10.56 | 27.0 | 10.67 | 27.0 | 10.80 | 26.2 | 10.51 |
| | -9.8 | -11.0 | 28.4 | 10.28 | 28.4 | 10.51 | 28.3 | 10.74 | 28.3 | 10.85 | 28.1 | 10.82 | 26.2 | 9.92 |
| | -9.5 | -10.0 | 29.2 | 10.38 | 29.0 | 10.60 | 29.0 | 10.82 | 29.0 | 10.94 | 28.1 | 10.51 | 26.2 | 9.63 |
| | -8.5 | -9.1 | 29.8 | 10.47 | 29.8 | 10.70 | 29.6 | 10.91 | 29.0 | 10.67 | 28.1 | 10.23 | 26.2 | 9.38 |
| | -7.0 | -7.6 | 30.8 | 10.63 | 30.8 | 10.84 | 30.0 | 10.60 | 29.0 | 10.18 | 28.1 | 9.77 | 26.2 | 9.00 |
| | -5.0 | -5.6 | 32.5 | 9.64 | 31.9 | 10.75 | 30.0 | 9.96 | 29.0 | 9.57 | 28.1 | 9.19 | 26.2 | 8.44 |
| | -3.0 | -3.7 | 33.8 | 9.70 | 31.9 | 10.12 | 30.0 | 9.38 | 29.0 | 9.06 | 28.1 | 8.66 | 26.2 | 7.97 |
| | 0.0 | -0.7 | 33.8 | 9.87 | 31.9 | 9.19 | 30.0 | 8.53 | 29.0 | 8.22 | 28.1 | 7.89 | 26.2 | 7.27 |
| | 3.0 | 2.2 | 33.8 | 8.99 | 31.9 | 8.38 | 30.0 | 7.80 | 29.0 | 7.50 | 28.1 | 7.22 | 26.2 | 6.66 |
| | 5.0 | 4.1 | 33.8 | 8.46 | 31.9 | 7.90 | 30.0 | 7.35 | 29.0 | 7.08 | 28.1 | 6.83 | 26.2 | 6.30 |
| | 7.0 | 6.0 | 33.8 | 7.97 | 31.9 | 7.47 | 30.0 | 6.94 | 29.0 | 6.70 | 28.1 | 6.45 | 26.2 | 5.96 |
| | 9.0 | 7.9 | 33.8 | 7.53 | 31.9 | 7.04 | 30.0 | 6.59 | 29.0 | 6.32 | 28.1 | 6.10 | 26.2 | 5.65 |
| | 11.0 | 9.8 | 33.8 | 7.11 | 31.9 | 6.65 | 30.0 | 6.21 | 29.0 | 5.99 | 28.1 | 5.77 | 26.2 | 5.35 |
| | 13.0 | 11.8 | 33.8 | 6.70 | 31.9 | 6.28 | 30.0 | 5.87 | 29.0 | 5.66 | 28.1 | 5.46 | 26.2 | 5.06 |
| | 15.0 | 13.7 | 33.8 | 6.34 | 31.9 | 5.95 | 30.0 | 5.56 | 29.0 | 5.37 | 28.1 | 5.18 | 26.2 | 4.82 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|--------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 70 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 23.6 | 10.01 | 23.4 | 10.24 | 23.4 | 10.49 | 23.4 | 10.60 | 23.4 | 10.73 | 22.8 | 10.61 |
| | -18.8 | -19.0 | 23.9 | 10.09 | 23.9 | 10.32 | 23.8 | 10.56 | 23.8 | 10.67 | 23.8 | 10.80 | 22.8 | 10.39 |
| | -16.7 | -17.0 | 24.9 | 10.25 | 24.9 | 10.49 | 24.8 | 10.71 | 24.8 | 10.82 | 24.5 | 10.81 | 22.8 | 9.91 |
| | -13.7 | -15.0 | 25.9 | 10.43 | 25.8 | 10.65 | 25.8 | 10.87 | 25.3 | 104.23 | 24.5 | 10.28 | 22.8 | 9.42 |
| | -11.8 | -13.0 | 27.0 | 10.60 | 27.0 | 10.81 | 26.3 | 10.56 | 25.3 | 10.15 | 24.5 | 9.74 | 22.8 | 8.93 |
| | -9.8 | -11.0 | 28.3 | 10.78 | 28.0 | 10.77 | 26.3 | 9.97 | 25.3 | 9.59 | 24.5 | 9.20 | 22.8 | 8.45 |
| | -9.5 | -10.0 | 29.0 | 10.87 | 28.0 | 10.45 | 26.3 | 9.68 | 25.3 | 9.31 | 24.5 | 8.94 | 22.8 | 8.22 |
| | -8.5 | -9.1 | 29.6 | 10.93 | 28.0 | 10.17 | 26.3 | 9.42 | 25.3 | 9.06 | 24.5 | 8.71 | 22.8 | 8.01 |
| | -7.0 | -7.6 | 29.6 | 10.44 | 28.0 | 9.71 | 26.3 | 9.01 | 25.3 | 8.67 | 24.5 | 8.33 | 22.8 | 7.67 |
| | -5.0 | -5.6 | 29.6 | 9.81 | 28.0 | 9.14 | 26.3 | 8.49 | 25.3 | 8.16 | 24.5 | 7.84 | 22.8 | 7.24 |
| | -3.0 | -3.7 | 29.6 | 9.24 | 28.0 | 8.62 | 26.3 | 8.01 | 25.3 | 7.70 | 24.5 | 7.41 | 22.8 | 6.84 |
| | 0.0 | -0.7 | 29.6 | 8.41 | 28.0 | 7.89 | 26.3 | 7.31 | 25.3 | 7.04 | 24.5 | 6.78 | 22.8 | 6.27 |
| | 3.0 | 2.2 | 29.6 | 7.68 | 28.0 | 0.18 | 26.3 | 6.70 | 25.3 | 6.45 | 24.5 | 6.22 | 22.8 | 5.75 |
| | 5.0 | 4.1 | 29.6 | 7.25 | 28.0 | 6.78 | 26.3 | 6.34 | 25.3 | 6.10 | 24.5 | 5.89 | 22.8 | 5.45 |
| | 7.0 | 6.0 | 29.6 | 6.85 | 28.0 | 6.42 | 26.3 | 5.99 | 25.3 | 5.77 | 24.5 | 5.58 | 22.8 | 5.17 |
| | 9.0 | 7.9 | 29.6 | 6.48 | 28.0 | 6.07 | 26.3 | 5.67 | 25.3 | 5.47 | 24.5 | 5.28 | 22.8 | 4.90 |
| | 11.0 | 9.8 | 29.6 | 6.13 | 28.0 | 5.74 | 26.3 | 5.38 | 25.3 | 5.19 | 24.5 | 5.02 | 22.8 | 4.65 |
| | 13.0 | 11.8 | 29.6 | 5.79 | 28.0 | 5.44 | 26.3 | 5.09 | 25.3 | 4.92 | 24.5 | 4.75 | 22.8 | 4.42 |
| | 15.0 | 13.7 | 29.6 | 5.48 | 28.0 | 5.16 | 26.3 | 4.83 | 25.3 | 4.68 | 24.5 | 4.51 | 22.8 | 4.21 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60 | -19.8 | -20.0 | 23.4 | 10.61 | 23.3 | 10.81 | 22.5 | 10.40 | 21.8 | 9.99 | 21.1 | 9.60 | 19.6 | 8.80 |
| | -18.8 | -19.0 | 23.8 | 10.68 | 23.8 | 10.88 | 22.5 | 10.18 | 21.8 | 9.78 | 21.1 | 9.39 | 19.6 | 8.62 |
| | -16.7 | -17.0 | 24.8 | 10.82 | 23.9 | 10.49 | 22.5 | 9.71 | 21.8 | 9.34 | 21.1 | 8.97 | 19.6 | 8.24 |
| | -13.7 | -15.0 | 25.3 | 10.71 | 23.9 | 9.96 | 22.5 | 9.24 | 21.8 | 8.88 | 21.1 | 8.53 | 19.6 | 7.84 |
| | -11.8 | -13.0 | 25.3 | 10.14 | 23.9 | 9.43 | 22.5 | 8.76 | 21.8 | 8.43 | 21.1 | 8.10 | 19.6 | 7.46 |
| | -9.8 | -11.0 | 25.3 | 9.57 | 23.9 | 8.92 | 22.5 | 8.29 | 21.8 | 7.97 | 21.1 | 7.67 | 19.6 | 7.07 |
| | -9.5 | -10.0 | 25.3 | 9.31 | 23.9 | 8.67 | 22.5 | 8.05 | 21.8 | 7.76 | 21.1 | 7.46 | 19.6 | 6.87 |
| | -8.5 | -9.1 | 25.3 | 9.06 | 23.9 | 8.45 | 22.5 | 7.86 | 21.8 | 7.56 | 21.1 | 7.27 | 19.6 | 6.71 |
| | -7.0 | -7.6 | 25.3 | 8.66 | 23.9 | 8.09 | 22.5 | 7.52 | 21.8 | 7.25 | 21.1 | 6.97 | 19.6 | 6.44 |
| | -5.0 | -5.6 | 25.3 | 8.16 | 23.9 | 7.62 | 22.5 | 7.10 | 21.8 | 6.84 | 21.1 | 6.58 | 19.6 | 6.09 |
| | -3.0 | -3.7 | 25.3 | 7.70 | 23.9 | 7.20 | 22.5 | 6.73 | 21.8 | 6.48 | 21.1 | 6.23 | 19.6 | 5.76 |
| | 0.0 | -0.7 | 25.3 | 7.04 | 23.9 | 6.59 | 22.5 | 6.15 | 21.8 | 5.94 | 21.1 | 5.72 | 19.6 | 5.30 |
| | 3.0 | 2.2 | 25.3 | 6.45 | 23.9 | 6.06 | 22.5 | 5.66 | 21.8 | 5.46 | 21.1 | 5.27 | 19.6 | 0.21 |
| | 5.0 | 4.1 | 25.3 | 6.10 | 23.9 | 5.73 | 22.5 | 5.35 | 21.8 | 5.18 | 21.1 | 4.99 | 19.6 | 4.64 |
| | 7.0 | 6.0 | 25.3 | 5.77 | 23.9 | 5.42 | 22.5 | 5.07 | 21.8 | 4.91 | 21.1 | 4.75 | 19.6 | 4.41 |
| | 9.0 | 7.9 | 25.3 | 5.47 | 23.9 | 5.14 | 22.5 | 4.82 | 21.8 | 4.66 | 21.1 | 4.50 | 19.6 | 4.20 |
| | 11.0 | 9.8 | 25.3 | 5.19 | 23.9 | 4.89 | 22.5 | 4.58 | 21.8 | 4.43 | 21.1 | 4.28 | 19.6 | 4.00 |
| | 13.0 | 11.8 | 25.3 | 4.91 | 23.9 | 4.63 | 22.5 | 4.35 | 21.8 | 4.21 | 21.1 | 4.07 | 19.6 | 3.80 |
| | 15.0 | 13.7 | 25.3 | 4.68 | 23.9 | 4.40 | 22.5 | 4.14 | 21.8 | 4.01 | 21.1 | 3.88 | 19.6 | 3.62 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|------|------|------|------|------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 50 | -19.8 | -20.0 | 21.2 | 9.66 | 20.0 | 8.99 | 18.8 | 8.35 | 18.1 | 8.04 | 17.5 | 7.73 | 16.3 | 7.12 |
| | -18.8 | -19.0 | 21.2 | 9.45 | 20.0 | 8.80 | 18.8 | 8.18 | 18.1 | 7.87 | 17.5 | 7.56 | 16.3 | 6.98 |
| | -16.7 | -17.0 | 21.2 | 9.01 | 20.0 | 8.41 | 18.8 | 7.82 | 18.1 | 7.53 | 17.5 | 7.25 | 16.3 | 6.69 |
| | -13.7 | -15.0 | 21.2 | 8.58 | 20.0 | 8.01 | 18.8 | 7.45 | 18.1 | 7.18 | 17.5 | 6.91 | 16.3 | 6.38 |
| | -11.8 | -13.0 | 21.2 | 8.15 | 20.0 | 7.62 | 18.8 | 7.08 | 18.1 | 6.83 | 17.5 | 6.57 | 16.3 | 6.08 |
| | -9.8 | -11.0 | 21.2 | 7.72 | 20.0 | 7.21 | 18.8 | 6.72 | 18.1 | 6.48 | 17.5 | 6.24 | 16.3 | 5.77 |
| | -9.5 | -10.0 | 21.2 | 7.50 | 20.0 | 7.01 | 18.8 | 6.55 | 18.1 | 6.31 | 17.5 | 6.08 | 16.3 | 5.62 |
| | -8.5 | -9.1 | 21.2 | 7.32 | 20.0 | 6.85 | 18.8 | 6.38 | 18.1 | 6.16 | 17.5 | 5.94 | 16.3 | 5.49 |
| | -7.0 | -7.6 | 21.2 | 7.01 | 20.0 | 6.59 | 18.8 | 6.13 | 18.1 | 5.92 | 17.5 | 5.70 | 16.3 | 5.28 |
| | -5.0 | -5.6 | 21.2 | 6.62 | 20.0 | 6.21 | 18.8 | 5.80 | 18.1 | 5.60 | 17.5 | 5.40 | 16.3 | 5.00 |
| | -3.0 | -3.7 | 21.2 | 6.27 | 20.0 | 5.88 | 18.8 | 5.49 | 18.1 | 5.31 | 17.5 | 5.12 | 16.3 | 4.76 |
| | 0.0 | -0.7 | 21.2 | 5.75 | 20.0 | 5.40 | 18.8 | 5.06 | 18.1 | 4.89 | 17.5 | 4.72 | 16.3 | 4.40 |
| | 3.0 | 2.2 | 21.2 | 5.30 | 20.0 | 4.98 | 18.8 | 4.66 | 18.1 | 4.51 | 17.5 | 4.37 | 16.3 | 4.07 |
| | 5.0 | 4.1 | 21.2 | 5.03 | 20.0 | 4.72 | 18.8 | 4.43 | 18.1 | 4.29 | 17.5 | 4.15 | 16.3 | 3.87 |
| | 7.0 | 6.0 | 21.2 | 4.77 | 20.0 | 4.49 | 18.8 | 4.22 | 18.1 | 4.08 | 17.5 | 3.95 | 16.3 | 3.69 |
| | 9.0 | 7.9 | 21.2 | 4.52 | 20.0 | 4.27 | 18.8 | 4.01 | 18.1 | 3.89 | 17.5 | 3.76 | 16.3 | 3.52 |
| | 11.0 | 9.8 | 21.2 | 4.30 | 20.0 | 4.06 | 18.8 | 3.82 | 18.1 | 3.71 | 17.5 | 3.59 | 16.3 | 3.36 |
| | 13.0 | 11.8 | 21.2 | 4.09 | 20.0 | 3.86 | 18.8 | 3.64 | 18.1 | 3.53 | 17.5 | 3.41 | 16.3 | 3.20 |
| | 15.0 | 13.7 | 21.2 | 3.89 | 20.0 | 3.68 | 18.8 | 3.47 | 18.1 | 3.37 | 17.5 | 3.26 | 16.3 | 3.05 |

CHV-5S400NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 130 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 29.1 | 7.84 | 29.0 | 8.39 | 28.9 | 8.95 | 28.9 | 9.23 | 28.7 | 9.50 | 28.7 | 10.07 |
| | -18.8 | -19.0 | 29.6 | 8.02 | 29.4 | 8.57 | 29.4 | 9.11 | 29.3 | 9.39 | 29.3 | 9.65 | 29.1 | 10.19 |
| | -16.7 | -17.0 | 30.7 | 8.39 | 30.6 | 8.91 | 30.4 | 9.45 | 30.4 | 9.66 | 30.4 | 9.96 | 30.3 | 10.50 |
| | -13.7 | -15.0 | 32.0 | 8.78 | 31.9 | 9.29 | 31.7 | 9.79 | 31.7 | 10.04 | 31.6 | 10.30 | 31.6 | 10.80 |
| | -11.8 | -13.0 | 33.3 | 9.17 | 33.3 | 9.66 | 33.1 | 10.14 | 33.0 | 10.38 | 33.0 | 10.63 | 32.9 | 11.10 |
| | -9.8 | -11.0 | 34.9 | 9.57 | 34.7 | 10.04 | 34.6 | 10.50 | 34.6 | 10.73 | 34.6 | 10.96 | 34.4 | 11.42 |
| | -9.5 | -10.0 | 35.7 | 9.78 | 35.6 | 10.22 | 35.4 | 10.67 | 35.4 | 10.90 | 35.3 | 11.12 | 35.3 | 11.56 |
| | -8.5 | -9.1 | 36.4 | 9.95 | 36.3 | 10.38 | 36.3 | 10.83 | 36.1 | 11.05 | 36.1 | 11.26 | 36.0 | 11.71 |
| | -7.0 | -7.6 | 37.7 | 10.24 | 37.7 | 10.67 | 37.6 | 11.09 | 37.6 | 11.31 | 37.4 | 11.51 | 37.3 | 11.94 |
| | -5.0 | -5.6 | 39.7 | 10.63 | 39.6 | 10.82 | 39.4 | 11.44 | 39.4 | 11.64 | 39.3 | 11.82 | 39.3 | 12.23 |
| | -3.0 | -3.7 | 41.6 | 10.97 | 41.4 | 11.36 | 41.4 | 11.74 | 41.3 | 11.94 | 41.3 | 12.13 | 41.1 | 12.50 |
| | 0.0 | -0.7 | 44.9 | 11.51 | 44.9 | 11.87 | 44.7 | 12.21 | 44.7 | 12.39 | 44.6 | 12.57 | 44.6 | 12.92 |
| | 3.0 | 2.2 | 48.4 | 11.98 | 48.3 | 12.31 | 48.1 | 12.65 | 48.1 | 12.80 | 48.1 | 12.98 | 48.0 | 13.30 |
| | 5.0 | 4.1 | 50.9 | 12.29 | 50.7 | 12.60 | 50.7 | 12.91 | 50.6 | 13.06 | 50.6 | 13.22 | 50.4 | 13.53 |
| | 7.0 | 6.0 | 53.4 | 12.57 | 53.3 | 12.86 | 53.3 | 13.17 | 53.1 | 11.87 | 53.1 | 13.45 | 51.0 | 12.92 |
| | 9.0 | 7.9 | 56.1 | 12.83 | 56.0 | 13.12 | 56.0 | 13.40 | 55.9 | 13.54 | 54.7 | 13.26 | 51.0 | 12.14 |
| | 11.0 | 9.8 | 59.0 | 13.09 | 58.9 | 13.35 | 58.6 | 13.53 | 56.6 | 12.99 | 54.7 | 12.46 | 51.0 | 11.44 |
| | 13.0 | 11.8 | 62.1 | 13.34 | 62.0 | 13.60 | 58.6 | 12.68 | 56.6 | 12.17 | 54.7 | 11.69 | 51.0 | 10.73 |
| | 15.0 | 13.7 | 65.1 | 13.57 | 62.3 | 12.88 | 58.6 | 11.94 | 56.6 | 11.48 | 54.7 | 11.02 | 51.0 | 10.12 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 120 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 29.0 | 8.59 | 28.9 | 9.10 | 28.7 | 9.62 | 28.7 | 9.86 | 28.7 | 10.12 | 28.6 | 10.64 |
| | -18.8 | -19.0 | 29.4 | 8.75 | 29.3 | 9.26 | 29.3 | 9.66 | 29.1 | 10.01 | 29.1 | 10.27 | 29.0 | 10.77 |
| | -16.7 | -17.0 | 30.6 | 9.10 | 30.4 | 9.59 | 30.4 | 10.07 | 30.3 | 10.31 | 30.3 | 10.56 | 30.1 | 11.03 |
| | -13.7 | -15.0 | 31.9 | 9.46 | 31.7 | 9.92 | 31.6 | 10.38 | 31.6 | 10.63 | 31.6 | 10.86 | 31.4 | 11.32 |
| | -11.8 | -13.0 | 33.1 | 9.82 | 33.1 | 10.27 | 33.0 | 10.71 | 33.0 | 10.94 | 32.9 | 11.16 | 32.9 | 11.61 |
| | -9.8 | -11.0 | 34.7 | 10.19 | 34.6 | 10.61 | 34.6 | 11.05 | 34.4 | 11.26 | 34.4 | 11.46 | 34.3 | 11.91 |
| | -9.5 | -10.0 | 35.6 | 10.38 | 35.4 | 10.80 | 35.3 | 11.20 | 35.3 | 11.42 | 35.3 | 11.54 | 35.1 | 12.04 |
| | -8.5 | -9.1 | 36.3 | 10.54 | 36.1 | 10.94 | 36.1 | 11.35 | 36.0 | 11.55 | 36.0 | 11.77 | 35.9 | 12.17 |
| | -7.0 | -7.6 | 37.6 | 10.82 | 37.6 | 11.20 | 37.4 | 11.59 | 37.4 | 11.80 | 37.3 | 11.98 | 37.3 | 12.37 |
| | -5.0 | -5.6 | 39.6 | 11.16 | 39.4 | 11.54 | 39.3 | 11.91 | 39.3 | 12.10 | 39.3 | 12.29 | 39.1 | 12.65 |
| | -3.0 | -3.7 | 41.4 | 11.49 | 41.4 | 11.85 | 41.3 | 12.20 | 41.3 | 12.37 | 41.1 | 12.56 | 41.1 | 12.91 |
| | 0.0 | -0.7 | 44.7 | 11.98 | 44.7 | 12.31 | 44.6 | 12.79 | 44.6 | 12.80 | 44.4 | 12.96 | 44.4 | 13.30 |
| | 3.0 | 2.2 | 48.3 | 12.43 | 48.1 | 12.73 | 48.1 | 13.04 | 48.0 | 13.19 | 48.0 | 13.34 | 47.0 | 13.27 |
| | 5.0 | 4.1 | 50.7 | 12.70 | 50.6 | 12.99 | 50.6 | 13.28 | 50.4 | 13.43 | 50.4 | 13.57 | 47.0 | 12.46 |
| | 7.0 | 6.0 | 53.3 | 12.96 | 53.3 | 13.24 | 53.1 | 13.51 | 52.3 | 13.32 | 50.6 | 12.78 | 47.0 | 11.72 |
| | 9.0 | 7.9 | 56.0 | 13.22 | 55.9 | 13.48 | 54.0 | 13.04 | 52.3 | 12.52 | 50.6 | 12.01 | 47.0 | 11.03 |
| | 11.0 | 9.8 | 58.9 | 13.45 | 57.4 | 13.22 | 54.0 | 12.26 | 52.3 | 11.78 | 50.6 | 11.31 | 47.0 | 10.40 |
| | 13.0 | 11.8 | 61.0 | 13.32 | 57.4 | 12.40 | 54.0 | 11.49 | 52.3 | 11.06 | 50.6 | 10.63 | 47.0 | 9.78 |
| | 15.0 | 13.7 | 61.0 | 12.55 | 57.4 | 11.68 | 54.0 | 10.84 | 52.3 | 10.43 | 50.6 | 10.02 | 47.0 | 9.23 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|-------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110 | -19.8 | -20.0 | 28.9 | 9.34 | 28.7 | 9.81 | 28.6 | 10.28 | 28.6 | 10.51 | 28.6 | 10.74 | 28.4 | 11.22 |
| | -18.8 | -19.0 | 29.3 | 9.49 | 29.3 | 9.95 | 314.9 | 10.41 | 29.1 | 10.64 | 29.0 | 10.87 | 29.0 | 11.33 |
| | -16.7 | -17.0 | 30.4 | 9.81 | 30.3 | 10.25 | 30.3 | 10.70 | 30.1 | 10.92 | 30.1 | 11.15 | 30.0 | 11.58 |
| | -13.7 | -15.0 | 31.7 | 10.14 | 31.6 | 10.57 | 31.4 | 10.99 | 31.4 | 11.20 | 31.4 | 11.42 | 31.3 | 11.84 |
| | -11.8 | -13.0 | 33.0 | 10.48 | 33.0 | 10.89 | 32.9 | 11.29 | 32.9 | 11.49 | 32.7 | 11.69 | 32.7 | 12.11 |
| | -9.8 | -11.0 | 34.6 | 10.82 | 34.4 | 11.20 | 34.4 | 11.59 | 34.3 | 11.80 | 34.3 | 11.98 | 34.3 | 12.37 |
| | -9.5 | -10.0 | 35.4 | 10.99 | 35.3 | 11.36 | 35.1 | 11.75 | 35.1 | 11.94 | 35.1 | 12.13 | 35.0 | 12.50 |
| | -8.5 | -9.1 | 36.1 | 11.13 | 36.0 | 11.51 | 36.0 | 11.88 | 36.0 | 12.07 | 35.9 | 12.26 | 35.9 | 12.62 |
| | -7.0 | -7.6 | 37.4 | 11.39 | 37.4 | 11.74 | 37.3 | 12.10 | 37.3 | 12.29 | 37.7 | 12.46 | 37.1 | 12.82 |
| | -5.0 | -5.6 | 39.4 | 11.71 | 39.3 | 12.06 | 39.1 | 12.39 | 39.1 | 12.56 | 41.0 | 12.73 | 39.0 | 13.08 |
| | -3.0 | -3.7 | 41.3 | 12.01 | 41.3 | 12.33 | 41.1 | 12.66 | 41.1 | 12.82 | 44.4 | 12.98 | 41.0 | 13.31 |
| | 0.0 | -0.7 | 44.6 | 12.46 | 44.6 | 12.76 | 44.4 | 13.06 | 44.4 | 13.21 | 46.3 | 13.37 | 43.1 | 13.11 |
| | 3.0 | 2.2 | 48.1 | 12.88 | 48.0 | 13.15 | 48.0 | 13.43 | 47.9 | 13.55 | 46.3 | 13.01 | 43.1 | 11.93 |
| | 5.0 | 4.1 | 50.6 | 13.12 | 50.6 | 13.40 | 49.6 | 13.27 | 47.9 | 12.73 | 46.3 | 12.23 | 43.1 | 11.22 |
| | 7.0 | 6.0 | 53.1 | 13.37 | 52.7 | 13.45 | 49.6 | 12.46 | 47.9 | 11.97 | 46.3 | 11.49 | 43.1 | 10.56 |
| | 9.0 | 7.9 | 55.9 | 13.58 | 52.7 | 12.65 | 49.6 | 11.72 | 47.9 | 11.26 | 46.3 | 10.82 | 43.1 | 9.95 |
| | 11.0 | 9.8 | 55.9 | 12.78 | 52.7 | 11.90 | 49.6 | 11.03 | 47.9 | 10.61 | 46.3 | 10.19 | 43.1 | 9.39 |
| | 13.0 | 11.8 | 55.9 | 11.98 | 52.7 | 11.16 | 49.6 | 10.37 | 47.9 | 9.98 | 46.3 | 9.59 | 43.1 | 8.84 |
| | 15.0 | 13.7 | 55.9 | 11.29 | 52.7 | 10.53 | 49.6 | 9.79 | 47.9 | 9.42 | 46.3 | 9.07 | 43.1 | 8.36 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100 | -19.8 | -20.0 | 28.7 | 10.09 | 28.6 | 10.51 | 28.6 | 10.94 | 28.4 | 11.16 | 28.4 | 11.36 | 28.3 | 11.80 |
| | -18.8 | -19.0 | 29.1 | 10.22 | 29.1 | 10.64 | 29.0 | 11.06 | 29.0 | 11.28 | 28.9 | 11.49 | 28.9 | 11.91 |
| | -16.7 | -17.0 | 30.3 | 10.51 | 30.1 | 10.92 | 30.1 | 11.32 | 30.1 | 11.52 | 30.0 | 11.72 | 30.0 | 12.13 |
| | -13.7 | -15.0 | 31.6 | 10.82 | 31.4 | 11.20 | 31.4 | 11.59 | 31.3 | 11.80 | 31.3 | 11.98 | 31.1 | 12.37 |
| | -11.8 | -13.0 | 32.9 | 11.13 | 32.9 | 11.49 | 32.7 | 11.87 | 32.7 | 12.06 | 32.7 | 11.81 | 32.6 | 12.62 |
| | -9.8 | -11.0 | 34.4 | 11.44 | 34.3 | 11.80 | 34.3 | 12.14 | 34.3 | 12.33 | 34.1 | 12.50 | 34.1 | 12.85 |
| | -9.5 | -10.0 | 35.3 | 11.59 | 35.1 | 11.94 | 35.1 | 12.29 | 35.0 | 12.46 | 35.0 | 12.63 | 34.9 | 12.98 |
| | -8.5 | -9.1 | 36.0 | 11.72 | 36.0 | 12.07 | 35.9 | 12.40 | 35.9 | 12.57 | 35.7 | 12.75 | 35.7 | 13.08 |
| | -7.0 | -7.6 | 37.3 | 11.95 | 37.3 | 12.29 | 37.1 | 12.60 | 37.1 | 12.78 | 37.1 | 12.93 | 37.0 | 13.27 |
| | -5.0 | -5.6 | 39.3 | 12.26 | 39.1 | 12.56 | 39.1 | 12.88 | 39.0 | 13.04 | 39.0 | 13.18 | 39.0 | 13.50 |
| | -3.0 | -3.7 | 41.1 | 12.53 | 41.1 | 12.82 | 41.0 | 13.12 | 41.0 | 13.27 | 41.0 | 13.41 | 39.3 | 12.85 |
| | 0.0 | -0.7 | 44.4 | 12.95 | 44.4 | 13.21 | 44.3 | 13.48 | 43.6 | 13.27 | 42.1 | 12.72 | 39.3 | 11.68 |
| | 3.0 | 2.2 | 48.0 | 13.31 | 47.9 | 13.55 | 45.0 | 12.55 | 43.6 | 12.06 | 42.1 | 11.58 | 39.3 | 10.63 |
| | 5.0 | 4.1 | 50.4 | 13.55 | 47.9 | 12.73 | 45.0 | 11.80 | 43.6 | 11.35 | 42.1 | 10.90 | 39.3 | 10.02 |
| | 7.0 | 6.0 | 50.7 | 12.86 | 47.9 | 11.97 | 45.0 | 11.10 | 43.6 | 10.69 | 42.1 | 10.27 | 39.3 | 9.45 |
| | 9.0 | 7.9 | 50.7 | 12.08 | 47.9 | 11.26 | 45.0 | 10.45 | 43.6 | 10.07 | 42.1 | 9.68 | 39.3 | 8.91 |
| | 11.0 | 9.8 | 50.7 | 11.38 | 47.9 | 10.61 | 45.0 | 9.86 | 43.6 | 9.49 | 42.1 | 9.13 | 39.3 | 8.42 |
| | 13.0 | 11.8 | 50.7 | 10.69 | 47.9 | 9.98 | 45.0 | 9.29 | 43.6 | 8.94 | 42.1 | 8.61 | 39.3 | 7.95 |
| | 15.0 | 13.7 | 50.7 | 10.08 | 47.9 | 9.42 | 45.0 | 8.77 | 43.6 | 8.45 | 42.1 | 8.13 | 39.3 | 7.53 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 90 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 28.6 | 10.84 | 28.4 | 11.22 | 28.4 | 11.61 | 28.3 | 11.80 | 28.3 | 12.00 | 28.3 | 12.37 |
| | -18.8 | -19.0 | 29.0 | 10.96 | 29.0 | 11.35 | 28.9 | 11.72 | 28.9 | 11.91 | 28.9 | 12.10 | 28.7 | 12.47 |
| | -16.7 | -17.0 | 30.1 | 11.23 | 30.0 | 11.59 | 30.0 | 11.95 | 30.0 | 12.14 | 29.9 | 12.31 | 29.9 | 12.68 |
| | -13.7 | -15.0 | 31.4 | 11.51 | 31.3 | 11.85 | 31.3 | 12.20 | 31.1 | 12.26 | 31.1 | 12.55 | 31.1 | 12.89 |
| | -11.8 | -13.0 | 32.7 | 11.78 | 32.7 | 12.11 | 32.6 | 12.44 | 32.6 | 12.62 | 32.6 | 12.78 | 32.4 | 13.11 |
| | -9.8 | -11.0 | 34.3 | 12.06 | 34.3 | 12.37 | 34.1 | 12.69 | 34.1 | 12.86 | 34.1 | 13.02 | 34.0 | 13.34 |
| | -9.5 | -10.0 | 35.1 | 12.20 | 35.0 | 12.52 | 35.0 | 12.82 | 34.9 | 12.98 | 34.9 | 13.14 | 34.9 | 13.44 |
| | -8.5 | -9.1 | 35.9 | 12.33 | 35.9 | 12.63 | 35.7 | 12.93 | 35.7 | 13.08 | 35.7 | 13.24 | 35.3 | 13.37 |
| | -7.0 | -7.6 | 37.1 | 12.53 | 37.1 | 12.82 | 37.0 | 13.12 | 37.0 | 13.27 | 37.0 | 13.41 | 35.3 | 12.76 |
| | -5.0 | -5.6 | 39.1 | 12.80 | 39.0 | 13.08 | 39.0 | 13.35 | 39.0 | 13.50 | 37.9 | 13.08 | 35.3 | 12.00 |
| | -3.0 | -3.7 | 41.0 | 13.05 | 41.0 | 11.87 | 40.6 | 13.37 | 39.1 | 12.83 | 37.9 | 12.31 | 35.3 | 11.31 |
| | 0.0 | -0.7 | 44.4 | 13.43 | 43.1 | 11.65 | 40.6 | 12.13 | 39.1 | 11.65 | 37.9 | 11.19 | 35.3 | 10.28 |
| | 3.0 | 2.2 | 45.7 | 12.79 | 43.1 | 11.91 | 40.6 | 11.05 | 39.1 | 10.63 | 37.9 | 10.21 | 35.3 | 9.40 |
| | 5.0 | 4.1 | 45.7 | 12.03 | 43.1 | 11.20 | 40.6 | 10.41 | 39.1 | 10.01 | 37.9 | 9.63 | 35.3 | 8.87 |
| | 7.0 | 6.0 | 45.7 | 11.31 | 43.1 | 10.56 | 40.6 | 9.81 | 39.1 | 9.45 | 37.9 | 9.08 | 35.3 | 8.38 |
| | 9.0 | 7.9 | 45.7 | 10.66 | 43.1 | 9.94 | 40.6 | 9.24 | 39.1 | 8.91 | 37.9 | 8.58 | 35.3 | 7.92 |
| | 11.0 | 9.8 | 45.7 | 10.04 | 43.1 | 9.37 | 40.6 | 8.74 | 39.1 | 8.42 | 37.9 | 8.10 | 35.3 | 7.50 |
| | 13.0 | 11.8 | 45.7 | 9.45 | 43.1 | 8.84 | 40.6 | 8.23 | 39.1 | 7.95 | 37.9 | 7.66 | 35.3 | 7.08 |
| | 15.0 | 13.7 | 45.7 | 8.93 | 43.1 | 8.35 | 40.6 | 7.80 | 39.1 | 7.50 | 37.9 | 7.25 | 35.3 | 6.72 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 80 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 28.4 | 11.59 | 28.3 | 11.93 | 28.3 | 12.27 | 28.3 | 12.44 | 28.1 | 12.62 | 28.1 | 12.95 |
| | -18.8 | -19.0 | 28.9 | 11.69 | 28.9 | 12.04 | 28.7 | 12.37 | 28.7 | 12.55 | 28.7 | 12.70 | 28.6 | 13.05 |
| | -16.7 | -17.0 | 30.0 | 11.94 | 29.9 | 12.26 | 29.9 | 12.59 | 29.9 | 12.75 | 29.9 | 12.91 | 29.7 | 13.22 |
| | -13.7 | -15.0 | 31.3 | 12.18 | 31.1 | 12.49 | 31.1 | 12.80 | 31.1 | 12.95 | 31.0 | 13.11 | 31.0 | 13.43 |
| | -11.8 | -13.0 | 32.6 | 12.43 | 32.6 | 12.73 | 32.4 | 13.02 | 32.4 | 13.17 | 32.4 | 13.32 | 31.4 | 12.96 |
| | -9.8 | -11.0 | 34.1 | 12.68 | 34.1 | 12.96 | 34.0 | 13.25 | 34.0 | 13.38 | 33.7 | 13.35 | 31.4 | 12.24 |
| | -9.5 | -10.0 | 35.0 | 12.80 | 34.9 | 13.08 | 34.9 | 13.35 | 34.9 | 13.50 | 33.7 | 12.96 | 31.4 | 11.88 |
| | -8.5 | -9.1 | 35.7 | 12.92 | 35.7 | 13.19 | 35.6 | 13.45 | 34.9 | 13.17 | 33.7 | 12.62 | 31.4 | 11.56 |
| | -7.0 | -7.6 | 37.0 | 13.11 | 37.0 | 13.37 | 36.0 | 13.08 | 34.9 | 12.56 | 33.7 | 12.06 | 31.4 | 11.10 |
| | -5.0 | -5.6 | 39.0 | 11.90 | 38.3 | 13.27 | 36.0 | 12.29 | 34.9 | 11.81 | 33.7 | 11.33 | 31.4 | 10.41 |
| | -3.0 | -3.7 | 40.6 | 11.97 | 38.3 | 12.49 | 36.0 | 11.56 | 34.9 | 11.18 | 33.7 | 10.69 | 31.4 | 9.83 |
| | 0.0 | -0.7 | 40.6 | 12.17 | 38.3 | 11.33 | 36.0 | 10.53 | 34.9 | 10.14 | 33.7 | 9.73 | 31.4 | 8.97 |
| | 3.0 | 2.2 | 40.6 | 11.09 | 38.3 | 10.34 | 36.0 | 9.62 | 34.9 | 9.26 | 33.7 | 8.91 | 31.4 | 8.22 |
| | 5.0 | 4.1 | 40.6 | 10.44 | 38.3 | 9.75 | 36.0 | 9.07 | 34.9 | 8.74 | 33.7 | 8.42 | 31.4 | 7.77 |
| | 7.0 | 6.0 | 40.6 | 9.83 | 38.3 | 9.21 | 36.0 | 8.57 | 34.9 | 8.26 | 33.7 | 7.96 | 31.4 | 7.35 |
| | 9.0 | 7.9 | 40.6 | 9.29 | 38.3 | 8.68 | 36.0 | 8.13 | 34.9 | 7.80 | 33.7 | 7.53 | 31.4 | 6.96 |
| | 11.0 | 9.8 | 40.6 | 8.77 | 38.3 | 8.20 | 36.0 | 7.66 | 34.9 | 7.38 | 33.7 | 7.12 | 31.4 | 6.60 |
| | 13.0 | 11.8 | 40.6 | 8.26 | 38.3 | 7.74 | 36.0 | 7.24 | 34.9 | 6.98 | 33.7 | 6.73 | 31.4 | 6.24 |
| | 15.0 | 13.7 | 40.6 | 7.82 | 38.3 | 7.34 | 36.0 | 6.86 | 34.9 | 6.62 | 33.7 | 6.39 | 31.4 | 5.94 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|--------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 70 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 28.3 | 12.34 | 28.1 | 12.63 | 28.1 | 12.93 | 28.1 | 13.08 | 28.1 | 13.24 | 27.4 | 13.09 |
| | -18.8 | -19.0 | 28.7 | 12.44 | 28.7 | 12.73 | 28.6 | 13.02 | 28.6 | 13.17 | 28.6 | 13.32 | 27.4 | 12.82 |
| | -16.7 | -17.0 | 29.9 | 12.65 | 29.9 | 12.93 | 29.7 | 13.21 | 29.7 | 13.35 | 29.4 | 13.34 | 27.4 | 12.23 |
| | -13.7 | -15.0 | 31.1 | 12.86 | 31.0 | 13.14 | 31.0 | 13.41 | 30.4 | 128.57 | 29.4 | 12.68 | 27.4 | 11.62 |
| | -11.8 | -13.0 | 32.4 | 13.08 | 32.4 | 13.34 | 31.6 | 13.02 | 30.4 | 12.52 | 29.4 | 12.01 | 27.4 | 11.02 |
| | -9.8 | -11.0 | 34.0 | 13.30 | 33.6 | 13.28 | 31.6 | 12.30 | 30.4 | 11.82 | 29.4 | 11.35 | 27.4 | 10.43 |
| | -9.5 | -10.0 | 34.9 | 13.41 | 33.6 | 12.89 | 31.6 | 11.94 | 30.4 | 11.48 | 29.4 | 11.03 | 27.4 | 10.14 |
| | -8.5 | -9.1 | 35.6 | 13.48 | 33.6 | 12.55 | 31.6 | 11.62 | 30.4 | 11.18 | 29.4 | 10.74 | 27.4 | 9.88 |
| | -7.0 | -7.6 | 35.6 | 12.88 | 33.6 | 11.98 | 31.6 | 11.12 | 30.4 | 10.70 | 29.4 | 10.28 | 27.4 | 9.46 |
| | -5.0 | -5.6 | 35.6 | 12.10 | 33.6 | 11.28 | 31.6 | 10.47 | 30.4 | 10.07 | 29.4 | 9.68 | 27.4 | 8.93 |
| | -3.0 | -3.7 | 35.6 | 11.39 | 33.6 | 10.63 | 31.6 | 9.88 | 30.4 | 9.50 | 29.4 | 9.14 | 27.4 | 8.44 |
| | 0.0 | -0.7 | 35.6 | 10.37 | 33.6 | 9.73 | 31.6 | 9.01 | 30.4 | 8.68 | 29.4 | 8.36 | 27.4 | 7.73 |
| | 3.0 | 2.2 | 35.6 | 9.47 | 33.6 | 0.22 | 31.6 | 8.26 | 30.4 | 7.96 | 29.4 | 7.67 | 27.4 | 7.09 |
| | 5.0 | 4.1 | 35.6 | 8.94 | 33.6 | 8.36 | 31.6 | 7.82 | 30.4 | 7.53 | 29.4 | 7.27 | 27.4 | 6.72 |
| | 7.0 | 6.0 | 35.6 | 8.45 | 33.6 | 7.92 | 31.6 | 7.38 | 30.4 | 7.12 | 29.4 | 6.88 | 27.4 | 6.37 |
| | 9.0 | 7.9 | 35.6 | 7.99 | 33.6 | 7.48 | 31.6 | 6.99 | 30.4 | 6.75 | 29.4 | 6.52 | 27.4 | 6.04 |
| | 11.0 | 9.8 | 35.6 | 7.56 | 33.6 | 7.08 | 31.6 | 6.63 | 30.4 | 6.40 | 29.4 | 6.19 | 27.4 | 5.74 |
| | 13.0 | 11.8 | 35.6 | 7.14 | 33.6 | 6.71 | 31.6 | 6.27 | 30.4 | 6.07 | 29.4 | 5.85 | 27.4 | 5.45 |
| | 15.0 | 13.7 | 35.6 | 6.76 | 33.6 | 6.36 | 31.6 | 5.96 | 30.4 | 5.77 | 29.4 | 5.57 | 27.4 | 5.19 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 60 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 28.1 | 13.09 | 28.0 | 13.34 | 27.0 | 12.83 | 26.1 | 12.33 | 25.3 | 11.84 | 23.6 | 10.86 |
| | -18.8 | -19.0 | 28.6 | 13.18 | 28.6 | 13.43 | 27.0 | 12.56 | 26.1 | 12.07 | 25.3 | 11.58 | 23.6 | 10.63 |
| | -16.7 | -17.0 | 29.7 | 13.35 | 28.7 | 12.93 | 27.0 | 11.98 | 26.1 | 11.52 | 25.3 | 11.06 | 23.6 | 10.17 |
| | -13.7 | -15.0 | 30.4 | 13.21 | 28.7 | 12.29 | 27.0 | 11.39 | 26.1 | 10.96 | 25.3 | 10.53 | 23.6 | 9.68 |
| | -11.8 | -13.0 | 30.4 | 12.50 | 28.7 | 11.64 | 27.0 | 10.80 | 26.1 | 10.40 | 25.3 | 9.99 | 23.6 | 9.20 |
| | -9.8 | -11.0 | 30.4 | 11.81 | 28.7 | 11.00 | 27.0 | 10.22 | 26.1 | 9.83 | 25.3 | 9.46 | 23.6 | 8.72 |
| | -9.5 | -10.0 | 30.4 | 11.48 | 28.7 | 10.70 | 27.0 | 9.94 | 26.1 | 9.57 | 25.3 | 9.20 | 23.6 | 8.48 |
| | -8.5 | -9.1 | 30.4 | 11.18 | 28.7 | 10.43 | 27.0 | 9.69 | 26.1 | 9.33 | 25.3 | 8.97 | 23.6 | 8.28 |
| | -7.0 | -7.6 | 30.4 | 10.69 | 28.7 | 9.98 | 27.0 | 9.27 | 26.1 | 8.94 | 25.3 | 8.59 | 23.6 | 7.95 |
| | -5.0 | -5.6 | 30.4 | 10.07 | 28.7 | 9.40 | 27.0 | 8.75 | 26.1 | 8.44 | 25.3 | 8.12 | 23.6 | 7.51 |
| | -3.0 | -3.7 | 30.4 | 9.50 | 28.7 | 8.88 | 27.0 | 8.31 | 26.1 | 7.99 | 25.3 | 7.69 | 23.6 | 7.11 |
| | 0.0 | -0.7 | 30.4 | 8.68 | 28.7 | 8.13 | 27.0 | 7.58 | 26.1 | 7.33 | 25.3 | 7.05 | 23.6 | 6.53 |
| | 3.0 | 2.2 | 30.4 | 7.96 | 28.7 | 7.47 | 27.0 | 6.98 | 26.1 | 6.73 | 25.3 | 6.50 | 23.6 | 0.26 |
| | 5.0 | 4.1 | 30.4 | 7.53 | 28.7 | 7.07 | 27.0 | 6.60 | 26.1 | 6.39 | 25.3 | 6.16 | 23.6 | 5.72 |
| | 7.0 | 6.0 | 30.4 | 7.12 | 28.7 | 6.69 | 27.0 | 6.26 | 26.1 | 6.06 | 25.3 | 5.85 | 23.6 | 5.44 |
| | 9.0 | 7.9 | 30.4 | 6.75 | 28.7 | 6.34 | 27.0 | 5.94 | 26.1 | 5.75 | 25.3 | 5.55 | 23.6 | 5.18 |
| | 11.0 | 9.8 | 30.4 | 6.40 | 28.7 | 6.03 | 27.0 | 5.65 | 26.1 | 5.47 | 25.3 | 5.28 | 23.6 | 4.93 |
| | 13.0 | 11.8 | 30.4 | 6.06 | 28.7 | 5.71 | 27.0 | 5.36 | 26.1 | 5.19 | 25.3 | 5.02 | 23.6 | 4.69 |
| | 15.0 | 13.7 | 30.4 | 5.77 | 28.7 | 5.42 | 27.0 | 5.10 | 26.1 | 4.95 | 25.3 | 4.79 | 23.6 | 4.47 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|------|------|------|------|------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 50 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 25.4 | 11.91 | 24.0 | 11.09 | 22.6 | 10.30 | 21.7 | 9.92 | 21.0 | 9.53 | 19.6 | 8.78 |
| | -18.8 | -19.0 | 25.4 | 11.65 | 24.0 | 10.86 | 22.6 | 10.09 | 21.7 | 9.70 | 21.0 | 9.33 | 19.6 | 8.61 |
| | -16.7 | -17.0 | 25.4 | 11.12 | 24.0 | 10.37 | 22.6 | 9.65 | 21.7 | 9.29 | 21.0 | 8.94 | 19.6 | 8.25 |
| | -13.7 | -15.0 | 25.4 | 10.58 | 24.0 | 9.88 | 22.6 | 9.19 | 21.7 | 8.85 | 21.0 | 8.52 | 19.6 | 7.87 |
| | -11.8 | -13.0 | 25.4 | 10.05 | 24.0 | 9.40 | 22.6 | 8.74 | 21.7 | 8.42 | 21.0 | 8.10 | 19.6 | 7.50 |
| | -9.8 | -11.0 | 25.4 | 9.52 | 24.0 | 8.90 | 22.6 | 8.29 | 21.7 | 7.99 | 21.0 | 7.70 | 19.6 | 7.12 |
| | -9.5 | -10.0 | 25.4 | 9.26 | 24.0 | 8.65 | 22.6 | 8.08 | 21.7 | 7.79 | 21.0 | 7.50 | 19.6 | 6.94 |
| | -8.5 | -9.1 | 25.4 | 9.03 | 24.0 | 8.45 | 22.6 | 7.87 | 21.7 | 7.60 | 21.0 | 7.33 | 19.6 | 6.78 |
| | -7.0 | -7.6 | 25.4 | 8.65 | 24.0 | 8.13 | 22.6 | 7.56 | 21.7 | 7.30 | 21.0 | 7.04 | 19.6 | 6.52 |
| | -5.0 | -5.6 | 25.4 | 8.16 | 24.0 | 7.66 | 22.6 | 7.15 | 21.7 | 6.91 | 21.0 | 6.66 | 19.6 | 6.17 |
| | -3.0 | -3.7 | 25.4 | 7.73 | 24.0 | 7.25 | 22.6 | 6.78 | 21.7 | 6.55 | 21.0 | 6.32 | 19.6 | 5.87 |
| | 0.0 | -0.7 | 25.4 | 7.09 | 24.0 | 6.66 | 22.6 | 6.24 | 21.7 | 6.03 | 21.0 | 5.83 | 19.6 | 5.42 |
| | 3.0 | 2.2 | 25.4 | 6.53 | 24.0 | 6.14 | 22.6 | 5.75 | 21.7 | 5.57 | 21.0 | 5.39 | 19.6 | 5.02 |
| | 5.0 | 4.1 | 25.4 | 6.20 | 24.0 | 5.83 | 22.6 | 5.47 | 21.7 | 5.29 | 21.0 | 5.12 | 19.6 | 4.77 |
| | 7.0 | 6.0 | 25.4 | 5.88 | 24.0 | 5.54 | 22.6 | 5.21 | 21.7 | 5.03 | 21.0 | 4.87 | 19.6 | 4.56 |
| | 9.0 | 7.9 | 25.4 | 5.58 | 24.0 | 5.26 | 22.6 | 4.95 | 21.7 | 4.80 | 21.0 | 4.64 | 19.6 | 4.34 |
| | 11.0 | 9.8 | 25.4 | 5.31 | 24.0 | 5.00 | 22.6 | 4.72 | 21.7 | 4.57 | 21.0 | 4.43 | 19.6 | 4.14 |
| | 13.0 | 11.8 | 25.4 | 5.05 | 24.0 | 4.76 | 22.6 | 4.48 | 21.7 | 4.35 | 21.0 | 4.21 | 19.6 | 3.95 |
| | 15.0 | 13.7 | 25.4 | 4.80 | 24.0 | 4.54 | 22.6 | 4.28 | 21.7 | 4.15 | 21.0 | 4.02 | 19.6 | 3.76 |

CHV-5S450NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 130 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 32.4 | 9.18 | 32.2 | 9.82 | 32.1 | 10.48 | 32.1 | 10.80 | 31.9 | 11.12 | 31.9 | 11.78 |
| | -18.8 | -19.0 | 32.9 | 9.39 | 32.7 | 10.03 | 32.7 | 10.67 | 32.5 | 10.99 | 32.5 | 11.29 | 32.4 | 11.93 |
| | -16.7 | -17.0 | 34.1 | 9.82 | 34.0 | 10.43 | 33.8 | 11.06 | 33.8 | 11.31 | 33.8 | 11.66 | 33.7 | 12.29 |
| | -13.7 | -15.0 | 35.6 | 10.28 | 35.4 | 10.87 | 35.2 | 11.46 | 35.2 | 11.75 | 35.1 | 12.05 | 35.1 | 12.64 |
| | -11.8 | -13.0 | 37.0 | 10.74 | 37.0 | 11.31 | 36.8 | 11.87 | 36.7 | 12.15 | 36.7 | 12.44 | 36.5 | 13.00 |
| | -9.8 | -11.0 | 38.7 | 11.21 | 38.6 | 11.75 | 38.4 | 12.29 | 38.4 | 12.56 | 38.4 | 12.83 | 38.3 | 13.37 |
| | -9.5 | -10.0 | 39.7 | 11.44 | 39.5 | 11.97 | 39.4 | 12.49 | 39.4 | 12.76 | 39.2 | 13.01 | 39.2 | 13.54 |
| | -8.5 | -9.1 | 40.5 | 11.65 | 40.3 | 12.15 | 40.3 | 12.68 | 40.2 | 12.93 | 40.2 | 13.18 | 40.0 | 13.71 |
| | -7.0 | -7.6 | 41.9 | 11.98 | 41.9 | 12.49 | 41.7 | 12.98 | 41.7 | 13.23 | 41.6 | 13.47 | 41.4 | 13.98 |
| | -5.0 | -5.6 | 44.1 | 12.44 | 44.0 | 12.66 | 43.8 | 13.39 | 43.8 | 13.62 | 43.7 | 13.84 | 43.7 | 14.31 |
| | -3.0 | -3.7 | 46.2 | 12.85 | 46.0 | 13.30 | 46.0 | 13.74 | 45.9 | 13.98 | 45.9 | 14.20 | 45.7 | 14.63 |
| | 0.0 | -0.7 | 49.8 | 13.47 | 49.8 | 13.89 | 49.7 | 14.30 | 49.7 | 14.50 | 49.5 | 14.72 | 49.5 | 15.12 |
| | 3.0 | 2.2 | 53.8 | 14.03 | 53.7 | 14.42 | 53.5 | 14.80 | 53.5 | 14.99 | 53.5 | 15.19 | 53.3 | 15.56 |
| | 5.0 | 4.1 | 56.5 | 14.38 | 56.3 | 14.75 | 56.3 | 15.11 | 56.2 | 15.29 | 56.2 | 15.48 | 56.0 | 15.83 |
| | 7.0 | 6.0 | 59.4 | 14.72 | 59.2 | 15.06 | 59.2 | 15.41 | 59.0 | 15.89 | 59.0 | 15.75 | 56.7 | 15.12 |
| | 9.0 | 7.9 | 62.4 | 15.02 | 62.2 | 15.36 | 62.2 | 15.68 | 62.1 | 15.85 | 60.8 | 15.53 | 56.7 | 14.21 |
| | 11.0 | 9.8 | 65.6 | 15.33 | 65.4 | 15.63 | 65.1 | 15.83 | 62.9 | 15.21 | 60.8 | 14.58 | 56.7 | 13.39 |
| | 13.0 | 11.8 | 69.0 | 15.61 | 68.9 | 15.92 | 65.1 | 14.84 | 62.9 | 14.25 | 60.8 | 13.69 | 56.7 | 12.56 |
| | 15.0 | 13.7 | 72.4 | 15.88 | 69.2 | 15.07 | 65.1 | 13.98 | 62.9 | 13.44 | 60.8 | 12.90 | 56.7 | 11.85 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 120 | -19.8 | -20.0 | 32.2 | 10.06 | 32.1 | 10.65 | 31.9 | 11.26 | 31.9 | 11.55 | 31.9 | 11.85 | 31.7 | 12.46 |
| | -18.8 | -19.0 | 32.7 | 10.25 | 32.5 | 10.84 | 32.5 | 11.31 | 32.4 | 11.71 | 32.4 | 12.02 | 32.2 | 12.61 |
| | -16.7 | -17.0 | 34.0 | 10.65 | 33.8 | 11.23 | 33.8 | 11.78 | 33.7 | 12.07 | 33.7 | 12.36 | 33.5 | 12.91 |
| | -13.7 | -15.0 | 35.4 | 11.07 | 35.2 | 11.61 | 35.1 | 12.15 | 35.1 | 12.44 | 35.1 | 12.71 | 34.9 | 13.25 |
| | -11.8 | -13.0 | 36.8 | 11.50 | 36.8 | 12.02 | 36.7 | 12.54 | 36.7 | 12.81 | 36.5 | 13.07 | 36.5 | 13.59 |
| | -9.8 | -11.0 | 38.6 | 11.93 | 38.4 | 12.42 | 38.4 | 12.93 | 38.3 | 13.18 | 38.3 | 13.42 | 38.1 | 13.94 |
| | -9.5 | -10.0 | 39.5 | 12.15 | 39.4 | 12.64 | 39.2 | 13.12 | 39.2 | 13.37 | 39.2 | 13.50 | 39.0 | 14.09 |
| | -8.5 | -9.1 | 40.3 | 12.34 | 40.2 | 12.81 | 40.2 | 13.28 | 40.0 | 13.52 | 40.0 | 13.77 | 39.8 | 14.25 |
| | -7.0 | -7.6 | 41.7 | 12.66 | 41.7 | 13.12 | 41.6 | 13.57 | 41.6 | 13.81 | 41.4 | 14.03 | 41.4 | 14.48 |
| | -5.0 | -5.6 | 44.0 | 13.07 | 43.8 | 13.50 | 43.7 | 13.94 | 43.7 | 14.16 | 43.7 | 14.38 | 43.5 | 14.80 |
| | -3.0 | -3.7 | 46.0 | 13.45 | 46.0 | 13.88 | 45.9 | 14.28 | 45.9 | 14.48 | 45.7 | 14.70 | 45.7 | 15.11 |
| | 0.0 | -0.7 | 49.7 | 14.03 | 49.7 | 14.42 | 49.5 | 14.97 | 49.5 | 14.99 | 49.4 | 15.18 | 49.4 | 15.56 |
| | 3.0 | 2.2 | 53.7 | 14.55 | 53.5 | 14.91 | 53.5 | 15.26 | 53.3 | 15.45 | 53.3 | 15.61 | 52.2 | 15.53 |
| | 5.0 | 4.1 | 56.3 | 14.87 | 56.2 | 15.21 | 56.2 | 15.55 | 56.0 | 15.72 | 56.0 | 15.88 | 52.2 | 14.58 |
| | 7.0 | 6.0 | 59.2 | 15.18 | 59.2 | 15.50 | 59.0 | 15.82 | 58.1 | 15.60 | 56.2 | 14.96 | 52.2 | 13.72 |
| | 9.0 | 7.9 | 62.2 | 15.48 | 62.1 | 15.78 | 60.0 | 15.26 | 58.1 | 14.65 | 56.2 | 14.06 | 52.2 | 12.91 |
| | 11.0 | 9.8 | 65.4 | 15.75 | 63.8 | 15.48 | 60.0 | 14.35 | 58.1 | 13.79 | 56.2 | 13.23 | 52.2 | 12.17 |
| | 13.0 | 11.8 | 67.8 | 15.60 | 63.8 | 14.52 | 60.0 | 13.45 | 58.1 | 12.95 | 56.2 | 12.44 | 52.2 | 11.44 |
| | 15.0 | 13.7 | 67.8 | 14.69 | 63.8 | 13.67 | 60.0 | 12.69 | 58.1 | 12.20 | 56.2 | 11.73 | 52.2 | 10.80 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|-------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110 | -19.8 | -20.0 | 32.1 | 10.94 | 31.9 | 11.48 | 31.7 | 12.04 | 31.7 | 12.31 | 31.7 | 12.58 | 31.6 | 13.13 |
| | -18.8 | -19.0 | 32.5 | 11.11 | 32.5 | 11.65 | 349.8 | 12.19 | 32.4 | 12.46 | 32.2 | 12.73 | 32.2 | 13.27 |
| | -16.7 | -17.0 | 33.8 | 11.48 | 33.7 | 12.00 | 33.7 | 12.52 | 33.5 | 12.78 | 33.5 | 13.05 | 33.3 | 13.55 |
| | -13.7 | -15.0 | 35.2 | 11.87 | 35.1 | 12.37 | 34.9 | 12.86 | 34.9 | 13.12 | 34.9 | 13.37 | 34.8 | 13.86 |
| | -11.8 | -13.0 | 36.7 | 12.27 | 36.7 | 12.74 | 36.5 | 13.22 | 36.5 | 13.45 | 36.3 | 13.69 | 36.3 | 14.18 |
| | -9.8 | -11.0 | 38.4 | 12.66 | 38.3 | 13.12 | 38.3 | 13.57 | 38.1 | 13.81 | 38.1 | 14.03 | 38.1 | 14.48 |
| | -9.5 | -10.0 | 39.4 | 12.86 | 39.2 | 13.30 | 39.0 | 13.76 | 39.0 | 13.98 | 39.0 | 14.20 | 38.9 | 14.63 |
| | -8.5 | -9.1 | 40.2 | 13.03 | 40.0 | 13.47 | 40.0 | 13.91 | 40.0 | 14.13 | 39.8 | 14.35 | 39.8 | 14.77 |
| | -7.0 | -7.6 | 41.6 | 13.34 | 41.6 | 13.74 | 41.4 | 14.16 | 41.4 | 14.38 | 41.9 | 14.58 | 41.3 | 15.01 |
| | -5.0 | -5.6 | 43.8 | 13.71 | 43.7 | 14.11 | 43.5 | 14.50 | 43.5 | 14.70 | 45.6 | 14.91 | 43.3 | 15.31 |
| | -3.0 | -3.7 | 45.9 | 14.06 | 45.9 | 14.43 | 45.7 | 14.82 | 45.7 | 15.01 | 49.4 | 15.19 | 45.6 | 15.58 |
| | 0.0 | -0.7 | 49.5 | 14.58 | 49.5 | 14.94 | 49.4 | 15.29 | 49.4 | 15.46 | 51.4 | 15.65 | 47.9 | 15.34 |
| | 3.0 | 2.2 | 53.5 | 15.07 | 53.3 | 15.39 | 53.3 | 15.72 | 53.2 | 15.87 | 51.4 | 15.23 | 47.9 | 13.96 |
| | 5.0 | 4.1 | 56.2 | 15.36 | 56.2 | 15.68 | 55.1 | 15.53 | 53.2 | 14.91 | 51.4 | 14.31 | 47.9 | 13.13 |
| | 7.0 | 6.0 | 59.0 | 15.65 | 58.6 | 15.75 | 55.1 | 14.58 | 53.2 | 14.01 | 51.4 | 13.45 | 47.9 | 12.36 |
| | 9.0 | 7.9 | 62.1 | 15.90 | 58.6 | 14.80 | 55.1 | 13.72 | 53.2 | 13.18 | 51.4 | 12.66 | 47.9 | 11.65 |
| | 11.0 | 9.8 | 62.1 | 14.96 | 58.6 | 13.93 | 55.1 | 12.91 | 53.2 | 12.42 | 51.4 | 11.93 | 47.9 | 10.99 |
| | 13.0 | 11.8 | 62.1 | 14.03 | 58.6 | 13.07 | 55.1 | 12.14 | 53.2 | 11.68 | 51.4 | 11.23 | 47.9 | 10.35 |
| | 15.0 | 13.7 | 62.1 | 13.22 | 58.6 | 12.32 | 55.1 | 11.46 | 53.2 | 11.02 | 51.4 | 10.62 | 47.9 | 9.79 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 100 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 31.9 | 11.82 | 31.7 | 12.31 | 31.7 | 12.81 | 31.6 | 13.07 | 31.6 | 13.30 | 31.4 | 13.81 |
| | -18.8 | -19.0 | 32.4 | 11.97 | 32.4 | 12.46 | 32.2 | 12.95 | 32.2 | 13.20 | 32.1 | 13.45 | 32.1 | 13.94 |
| | -16.7 | -17.0 | 33.7 | 12.31 | 33.5 | 12.78 | 33.5 | 13.25 | 33.5 | 13.49 | 33.3 | 13.72 | 33.3 | 14.20 |
| | -13.7 | -15.0 | 35.1 | 12.66 | 34.9 | 13.12 | 34.9 | 13.57 | 34.8 | 13.81 | 34.8 | 14.03 | 34.6 | 14.48 |
| | -11.8 | -13.0 | 36.5 | 13.03 | 36.5 | 13.45 | 36.3 | 13.89 | 36.3 | 14.11 | 36.3 | 13.82 | 36.2 | 14.77 |
| | -9.8 | -11.0 | 38.3 | 13.39 | 38.1 | 13.81 | 38.1 | 14.21 | 38.1 | 14.43 | 37.9 | 14.63 | 37.9 | 15.04 |
| | -9.5 | -10.0 | 39.2 | 13.57 | 39.0 | 13.98 | 39.0 | 14.38 | 38.9 | 14.58 | 38.9 | 14.79 | 38.7 | 15.19 |
| | -8.5 | -9.1 | 40.0 | 13.72 | 40.0 | 14.13 | 39.8 | 14.52 | 39.8 | 14.72 | 39.7 | 14.92 | 39.7 | 15.31 |
| | -7.0 | -7.6 | 41.4 | 13.99 | 41.4 | 14.38 | 41.3 | 14.75 | 41.3 | 14.96 | 41.3 | 15.14 | 41.1 | 15.53 |
| | -5.0 | -5.6 | 43.7 | 14.35 | 43.5 | 14.70 | 43.5 | 15.07 | 43.3 | 15.26 | 43.3 | 15.43 | 43.3 | 15.80 |
| | -3.0 | -3.7 | 45.7 | 14.67 | 45.7 | 15.01 | 45.6 | 15.36 | 45.6 | 15.53 | 45.6 | 15.70 | 43.7 | 15.04 |
| | 0.0 | -0.7 | 49.4 | 15.16 | 49.4 | 15.46 | 49.2 | 15.78 | 48.4 | 15.53 | 46.8 | 14.89 | 43.7 | 13.67 |
| | 3.0 | 2.2 | 53.3 | 15.58 | 53.2 | 15.87 | 50.0 | 14.69 | 48.4 | 14.11 | 46.8 | 13.55 | 43.7 | 12.44 |
| | 5.0 | 4.1 | 56.0 | 15.87 | 53.2 | 14.91 | 50.0 | 13.81 | 48.4 | 13.28 | 46.8 | 12.76 | 43.7 | 11.73 |
| | 7.0 | 6.0 | 56.3 | 15.06 | 53.2 | 14.01 | 50.0 | 13.00 | 48.4 | 12.51 | 46.8 | 12.02 | 43.7 | 11.06 |
| | 9.0 | 7.9 | 56.3 | 14.15 | 53.2 | 13.18 | 50.0 | 12.24 | 48.4 | 11.78 | 46.8 | 11.33 | 43.7 | 10.43 |
| | 11.0 | 9.8 | 56.3 | 13.32 | 53.2 | 12.42 | 50.0 | 11.55 | 48.4 | 11.11 | 46.8 | 10.69 | 43.7 | 9.86 |
| | 13.0 | 11.8 | 56.3 | 12.51 | 53.2 | 11.68 | 50.0 | 10.87 | 48.4 | 10.47 | 46.8 | 10.08 | 43.7 | 9.30 |
| | 15.0 | 13.7 | 56.3 | 11.80 | 53.2 | 11.02 | 50.0 | 10.26 | 48.4 | 9.89 | 46.8 | 9.52 | 43.7 | 8.81 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 90 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 31.7 | 12.69 | 31.6 | 13.13 | 31.6 | 13.59 | 31.4 | 13.81 | 31.4 | 14.04 | 31.4 | 14.48 |
| | -18.8 | -19.0 | 32.2 | 12.83 | 32.2 | 13.28 | 32.1 | 13.72 | 32.1 | 13.94 | 32.1 | 14.16 | 31.9 | 14.60 |
| | -16.7 | -17.0 | 33.5 | 13.15 | 33.3 | 13.57 | 33.3 | 13.99 | 33.3 | 14.21 | 33.2 | 14.42 | 33.2 | 14.84 |
| | -13.7 | -15.0 | 34.9 | 13.47 | 34.8 | 13.88 | 34.8 | 14.28 | 34.6 | 14.35 | 34.6 | 14.69 | 34.6 | 15.09 |
| | -11.8 | -13.0 | 36.3 | 13.79 | 36.3 | 14.18 | 36.2 | 14.57 | 36.2 | 14.77 | 36.2 | 14.96 | 36.0 | 15.34 |
| | -9.8 | -11.0 | 38.1 | 14.11 | 38.1 | 14.48 | 37.9 | 14.85 | 37.9 | 15.06 | 37.9 | 15.24 | 37.8 | 15.61 |
| | -9.5 | -10.0 | 39.0 | 14.28 | 38.9 | 14.65 | 38.9 | 15.01 | 38.7 | 15.19 | 38.7 | 15.38 | 38.7 | 15.73 |
| | -8.5 | -9.1 | 39.8 | 14.43 | 39.8 | 14.79 | 39.7 | 15.14 | 39.7 | 15.31 | 39.7 | 15.50 | 39.2 | 15.65 |
| | -7.0 | -7.6 | 41.3 | 14.67 | 41.3 | 15.01 | 41.1 | 15.36 | 41.1 | 15.53 | 41.1 | 15.70 | 39.2 | 14.94 |
| | -5.0 | -5.6 | 43.5 | 14.99 | 43.3 | 15.31 | 43.3 | 15.63 | 43.3 | 15.80 | 42.1 | 15.31 | 39.2 | 14.04 |
| | -3.0 | -3.7 | 45.6 | 15.28 | 45.6 | 13.89 | 45.1 | 15.65 | 43.5 | 15.02 | 42.1 | 14.42 | 39.2 | 13.23 |
| | 0.0 | -0.7 | 49.4 | 15.72 | 47.9 | 13.64 | 45.1 | 14.20 | 43.5 | 13.64 | 42.1 | 13.10 | 39.2 | 12.04 |
| | 3.0 | 2.2 | 50.8 | 14.97 | 47.9 | 13.94 | 45.1 | 12.93 | 43.5 | 12.44 | 42.1 | 11.95 | 39.2 | 11.01 |
| | 5.0 | 4.1 | 50.8 | 14.08 | 47.9 | 13.12 | 45.1 | 12.19 | 43.5 | 11.71 | 42.1 | 11.28 | 39.2 | 10.38 |
| | 7.0 | 6.0 | 50.8 | 13.23 | 47.9 | 12.36 | 45.1 | 11.48 | 43.5 | 11.06 | 42.1 | 10.63 | 39.2 | 9.81 |
| | 9.0 | 7.9 | 50.8 | 12.47 | 47.9 | 11.63 | 45.1 | 10.82 | 43.5 | 10.43 | 42.1 | 10.04 | 39.2 | 9.27 |
| | 11.0 | 9.8 | 50.8 | 11.75 | 47.9 | 10.97 | 45.1 | 10.23 | 43.5 | 9.86 | 42.1 | 9.49 | 39.2 | 8.78 |
| | 13.0 | 11.8 | 50.8 | 11.06 | 47.9 | 10.35 | 45.1 | 9.64 | 43.5 | 9.30 | 42.1 | 8.96 | 39.2 | 8.29 |
| | 15.0 | 13.7 | 50.8 | 10.45 | 47.9 | 9.77 | 45.1 | 9.13 | 43.5 | 8.78 | 42.1 | 8.49 | 39.2 | 7.87 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80 | -19.8 | -20.0 | 31.6 | 13.57 | 31.4 | 13.96 | 31.4 | 14.36 | 31.4 | 14.57 | 31.3 | 14.77 | 31.3 | 15.16 |
| | -18.8 | -19.0 | 32.1 | 13.69 | 32.1 | 14.09 | 31.9 | 14.48 | 31.9 | 14.69 | 31.9 | 14.87 | 31.7 | 15.28 |
| | -16.7 | -17.0 | 33.3 | 13.98 | 33.2 | 14.35 | 33.2 | 14.74 | 33.2 | 14.92 | 33.2 | 15.11 | 33.0 | 15.48 |
| | -13.7 | -15.0 | 34.8 | 14.26 | 34.6 | 14.62 | 34.6 | 14.99 | 34.6 | 15.16 | 34.4 | 15.34 | 34.4 | 15.72 |
| | -11.8 | -13.0 | 36.2 | 14.55 | 36.2 | 14.91 | 36.0 | 15.24 | 36.0 | 15.41 | 36.0 | 15.60 | 34.9 | 15.18 |
| | -9.8 | -11.0 | 37.9 | 14.84 | 37.9 | 15.18 | 37.8 | 15.51 | 37.8 | 15.66 | 37.5 | 15.63 | 34.9 | 14.33 |
| | -9.5 | -10.0 | 38.9 | 14.99 | 38.7 | 15.31 | 38.7 | 15.63 | 38.7 | 15.80 | 37.5 | 15.18 | 34.9 | 13.91 |
| | -8.5 | -9.1 | 39.7 | 15.12 | 39.7 | 15.45 | 39.5 | 15.75 | 38.7 | 15.41 | 37.5 | 14.77 | 34.9 | 13.54 |
| | -7.0 | -7.6 | 41.1 | 15.34 | 41.1 | 15.65 | 40.0 | 15.31 | 38.7 | 14.70 | 37.5 | 14.11 | 34.9 | 13.00 |
| | -5.0 | -5.6 | 43.3 | 13.93 | 42.5 | 15.53 | 40.0 | 14.38 | 38.7 | 13.82 | 37.5 | 13.27 | 34.9 | 12.19 |
| | -3.0 | -3.7 | 45.1 | 14.01 | 42.5 | 14.62 | 40.0 | 13.54 | 38.7 | 13.08 | 37.5 | 12.51 | 34.9 | 11.51 |
| | 0.0 | -0.7 | 45.1 | 14.25 | 42.5 | 13.27 | 40.0 | 12.32 | 38.7 | 11.87 | 37.5 | 11.39 | 34.9 | 10.50 |
| | 3.0 | 2.2 | 45.1 | 12.98 | 42.5 | 12.10 | 40.0 | 11.26 | 38.7 | 10.84 | 37.5 | 10.43 | 34.9 | 9.62 |
| | 5.0 | 4.1 | 45.1 | 12.22 | 42.5 | 11.41 | 40.0 | 10.62 | 38.7 | 10.23 | 37.5 | 9.86 | 34.9 | 9.10 |
| | 7.0 | 6.0 | 45.1 | 11.51 | 42.5 | 10.79 | 40.0 | 10.03 | 38.7 | 9.67 | 37.5 | 9.32 | 34.9 | 8.61 |
| | 9.0 | 7.9 | 45.1 | 10.87 | 42.5 | 10.16 | 40.0 | 9.52 | 38.7 | 9.13 | 37.5 | 8.81 | 34.9 | 8.15 |
| | 11.0 | 9.8 | 45.1 | 10.26 | 42.5 | 9.60 | 40.0 | 8.96 | 38.7 | 8.64 | 37.5 | 8.34 | 34.9 | 7.73 |
| | 13.0 | 11.8 | 45.1 | 9.67 | 42.5 | 9.06 | 40.0 | 8.47 | 38.7 | 8.17 | 37.5 | 7.88 | 34.9 | 7.31 |
| | 15.0 | 13.7 | 45.1 | 9.15 | 42.5 | 8.59 | 40.0 | 8.03 | 38.7 | 7.75 | 37.5 | 7.48 | 34.9 | 6.95 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|--------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70 | -19.8 | -20.0 | 31.4 | 14.45 | 31.3 | 14.79 | 31.3 | 15.14 | 31.3 | 15.31 | 31.3 | 15.50 | 30.5 | 15.33 |
| | -18.8 | -19.0 | 31.9 | 14.57 | 31.9 | 14.91 | 31.7 | 15.24 | 31.7 | 15.41 | 31.7 | 15.60 | 30.5 | 15.01 |
| | -16.7 | -17.0 | 33.2 | 14.80 | 33.2 | 15.14 | 33.0 | 15.46 | 33.0 | 15.63 | 32.7 | 15.61 | 30.5 | 14.31 |
| | -13.7 | -15.0 | 34.6 | 15.06 | 34.4 | 15.38 | 34.4 | 15.70 | 33.8 | 150.50 | 32.7 | 14.84 | 30.5 | 13.61 |
| | -11.8 | -13.0 | 36.0 | 15.31 | 36.0 | 15.61 | 35.1 | 15.24 | 33.8 | 14.65 | 32.7 | 14.06 | 30.5 | 12.90 |
| | -9.8 | -11.0 | 37.8 | 15.56 | 37.3 | 15.55 | 35.1 | 14.40 | 33.8 | 13.84 | 32.7 | 13.28 | 30.5 | 12.20 |
| | -9.5 | -10.0 | 38.7 | 15.70 | 37.3 | 15.09 | 35.1 | 13.98 | 33.8 | 13.44 | 32.7 | 12.91 | 30.5 | 11.87 |
| | -8.5 | -9.1 | 39.5 | 15.78 | 37.3 | 14.69 | 35.1 | 13.61 | 33.8 | 13.08 | 32.7 | 12.58 | 30.5 | 11.56 |
| | -7.0 | -7.6 | 39.5 | 15.07 | 37.3 | 14.03 | 35.1 | 13.01 | 33.8 | 12.52 | 32.7 | 12.04 | 30.5 | 11.07 |
| | -5.0 | -5.6 | 39.5 | 14.16 | 37.3 | 13.20 | 35.1 | 12.25 | 33.8 | 11.78 | 32.7 | 11.33 | 30.5 | 10.45 |
| | -3.0 | -3.7 | 39.5 | 13.34 | 37.3 | 12.44 | 35.1 | 11.56 | 33.8 | 11.12 | 32.7 | 10.70 | 30.5 | 9.87 |
| | 0.0 | -0.7 | 39.5 | 12.14 | 37.3 | 11.39 | 35.1 | 10.55 | 33.8 | 10.16 | 32.7 | 9.79 | 30.5 | 9.05 |
| | 3.0 | 2.2 | 39.5 | 11.09 | 37.3 | 0.25 | 35.1 | 9.67 | 33.8 | 9.32 | 32.7 | 8.98 | 30.5 | 8.30 |
| | 5.0 | 4.1 | 39.5 | 10.47 | 37.3 | 9.79 | 35.1 | 9.15 | 33.8 | 8.81 | 32.7 | 8.51 | 30.5 | 7.87 |
| | 7.0 | 6.0 | 39.5 | 9.89 | 37.3 | 9.27 | 35.1 | 8.64 | 33.8 | 8.34 | 32.7 | 8.05 | 30.5 | 7.46 |
| | 9.0 | 7.9 | 39.5 | 9.35 | 37.3 | 8.76 | 35.1 | 8.19 | 33.8 | 7.90 | 32.7 | 7.63 | 30.5 | 7.07 |
| | 11.0 | 9.8 | 39.5 | 8.85 | 37.3 | 8.29 | 35.1 | 7.76 | 33.8 | 7.49 | 32.7 | 7.24 | 30.5 | 6.72 |
| | 13.0 | 11.8 | 39.5 | 8.36 | 37.3 | 7.85 | 35.1 | 7.34 | 33.8 | 7.11 | 32.7 | 6.85 | 30.5 | 6.38 |
| | 15.0 | 13.7 | 39.5 | 7.92 | 37.3 | 7.44 | 35.1 | 6.97 | 33.8 | 6.75 | 32.7 | 6.52 | 30.5 | 6.08 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 60 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 31.3 | 15.33 | 31.1 | 15.61 | 30.0 | 15.02 | 29.0 | 14.43 | 28.1 | 13.86 | 26.2 | 12.71 |
| | -18.8 | -19.0 | 31.7 | 15.43 | 31.7 | 15.72 | 30.0 | 14.70 | 29.0 | 14.13 | 28.1 | 13.55 | 26.2 | 12.44 |
| | -16.7 | -17.0 | 33.0 | 15.63 | 31.9 | 15.14 | 30.0 | 14.03 | 29.0 | 13.49 | 28.1 | 12.95 | 26.2 | 11.90 |
| | -13.7 | -15.0 | 33.8 | 15.46 | 31.9 | 14.38 | 30.0 | 13.34 | 29.0 | 12.83 | 28.1 | 12.32 | 26.2 | 11.33 |
| | -11.8 | -13.0 | 33.8 | 14.63 | 31.9 | 13.62 | 30.0 | 12.64 | 29.0 | 12.17 | 28.1 | 11.70 | 26.2 | 10.77 |
| | -9.8 | -11.0 | 33.8 | 13.82 | 31.9 | 12.88 | 30.0 | 11.97 | 29.0 | 11.51 | 28.1 | 11.07 | 26.2 | 10.21 |
| | -9.5 | -10.0 | 33.8 | 13.44 | 31.9 | 12.52 | 30.0 | 11.63 | 29.0 | 11.21 | 28.1 | 10.77 | 26.2 | 9.93 |
| | -8.5 | -9.1 | 33.8 | 13.08 | 31.9 | 12.20 | 30.0 | 11.34 | 29.0 | 10.92 | 28.1 | 10.50 | 26.2 | 9.69 |
| | -7.0 | -7.6 | 33.8 | 12.51 | 31.9 | 11.68 | 30.0 | 10.85 | 29.0 | 10.47 | 28.1 | 10.06 | 26.2 | 9.30 |
| | -5.0 | -5.6 | 33.8 | 11.78 | 31.9 | 11.01 | 30.0 | 10.25 | 29.0 | 9.87 | 28.1 | 9.50 | 26.2 | 8.79 |
| | -3.0 | -3.7 | 33.8 | 11.12 | 31.9 | 10.40 | 30.0 | 9.72 | 29.0 | 9.35 | 28.1 | 9.00 | 26.2 | 8.32 |
| | 0.0 | -0.7 | 33.8 | 10.16 | 31.9 | 9.52 | 30.0 | 8.88 | 29.0 | 8.58 | 28.1 | 8.25 | 26.2 | 7.65 |
| | 3.0 | 2.2 | 33.8 | 9.32 | 31.9 | 8.74 | 30.0 | 8.17 | 29.0 | 7.88 | 28.1 | 7.61 | 26.2 | 0.30 |
| | 5.0 | 4.1 | 33.8 | 8.81 | 31.9 | 8.27 | 30.0 | 7.73 | 29.0 | 7.48 | 28.1 | 7.21 | 26.2 | 6.70 |
| | 7.0 | 6.0 | 33.8 | 8.34 | 31.9 | 7.83 | 30.0 | 7.33 | 29.0 | 7.09 | 28.1 | 6.85 | 26.2 | 6.36 |
| | 9.0 | 7.9 | 33.8 | 7.90 | 31.9 | 7.43 | 30.0 | 6.95 | 29.0 | 6.74 | 28.1 | 6.50 | 26.2 | 6.06 |
| | 11.0 | 9.8 | 33.8 | 7.49 | 31.9 | 7.06 | 30.0 | 6.62 | 29.0 | 6.40 | 28.1 | 6.18 | 26.2 | 5.77 |
| | 13.0 | 11.8 | 33.8 | 7.09 | 31.9 | 6.68 | 30.0 | 6.28 | 29.0 | 6.08 | 28.1 | 5.87 | 26.2 | 5.49 |
| | 15.0 | 13.7 | 33.8 | 6.75 | 31.9 | 6.35 | 30.0 | 5.98 | 29.0 | 5.79 | 28.1 | 5.60 | 26.2 | 5.23 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 50 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 28.3 | 13.94 | 26.7 | 12.98 | 25.1 | 12.05 | 24.1 | 11.61 | 23.3 | 11.16 | 21.7 | 10.28 |
| | -18.8 | -19.0 | 28.3 | 13.64 | 26.7 | 12.71 | 25.1 | 11.82 | 24.1 | 11.36 | 23.3 | 10.92 | 21.7 | 10.08 |
| | -16.7 | -17.0 | 28.3 | 13.01 | 26.7 | 12.14 | 25.1 | 11.29 | 24.1 | 10.87 | 23.3 | 10.47 | 21.7 | 9.66 |
| | -13.7 | -15.0 | 28.3 | 12.39 | 26.7 | 11.56 | 25.1 | 10.75 | 24.1 | 10.36 | 23.3 | 9.98 | 21.7 | 9.22 |
| | -11.8 | -13.0 | 28.3 | 11.77 | 26.7 | 11.01 | 25.1 | 10.23 | 24.1 | 9.86 | 23.3 | 9.49 | 21.7 | 8.78 |
| | -9.8 | -11.0 | 28.3 | 11.14 | 26.7 | 10.41 | 25.1 | 9.71 | 24.1 | 9.35 | 23.3 | 9.01 | 21.7 | 8.34 |
| | -9.5 | -10.0 | 28.3 | 10.84 | 26.7 | 10.13 | 25.1 | 9.45 | 24.1 | 9.12 | 23.3 | 8.78 | 21.7 | 8.12 |
| | -8.5 | -9.1 | 28.3 | 10.57 | 26.7 | 9.89 | 25.1 | 9.22 | 24.1 | 8.90 | 23.3 | 8.58 | 21.7 | 7.93 |
| | -7.0 | -7.6 | 28.3 | 10.13 | 26.7 | 9.52 | 25.1 | 8.85 | 24.1 | 8.54 | 23.3 | 8.24 | 21.7 | 7.63 |
| | -5.0 | -5.6 | 28.3 | 9.55 | 26.7 | 8.96 | 25.1 | 8.37 | 24.1 | 8.09 | 23.3 | 7.80 | 21.7 | 7.22 |
| | -3.0 | -3.7 | 28.3 | 9.05 | 26.7 | 8.49 | 25.1 | 7.93 | 24.1 | 7.66 | 23.3 | 7.39 | 21.7 | 6.87 |
| | 0.0 | -0.7 | 28.3 | 8.30 | 26.7 | 7.80 | 25.1 | 7.31 | 24.1 | 7.06 | 23.3 | 6.82 | 21.7 | 6.35 |
| | 3.0 | 2.2 | 28.3 | 7.65 | 26.7 | 7.19 | 25.1 | 6.74 | 24.1 | 6.52 | 23.3 | 6.31 | 21.7 | 5.87 |
| | 5.0 | 4.1 | 28.3 | 7.26 | 26.7 | 6.82 | 25.1 | 6.40 | 24.1 | 6.19 | 23.3 | 5.99 | 21.7 | 5.59 |
| | 7.0 | 6.0 | 28.3 | 6.89 | 26.7 | 6.48 | 25.1 | 6.09 | 24.1 | 5.89 | 23.3 | 5.71 | 21.7 | 5.33 |
| | 9.0 | 7.9 | 28.3 | 6.53 | 26.7 | 6.16 | 25.1 | 5.79 | 24.1 | 5.62 | 23.3 | 5.44 | 21.7 | 5.08 |
| | 11.0 | 9.8 | 28.3 | 6.21 | 26.7 | 5.86 | 25.1 | 5.52 | 24.1 | 5.35 | 23.3 | 5.18 | 21.7 | 4.84 |
| | 13.0 | 11.8 | 28.3 | 5.91 | 26.7 | 5.57 | 25.1 | 5.25 | 24.1 | 5.10 | 23.3 | 4.93 | 21.7 | 4.63 |
| | 15.0 | 13.7 | 28.3 | 5.62 | 26.7 | 5.32 | 25.1 | 5.01 | 24.1 | 4.86 | 23.3 | 4.71 | 21.7 | 4.41 |

CHV5 DC Inverter VRF Units Technical Sales Guide

CHV-5S504NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 130 | -19.8 | -20.0 | 36.6 | 9.96 | 36.4 | 10.66 | 36.2 | 11.37 | 36.2 | 11.72 | 36.1 | 12.07 | 36.1 | 12.78 |
| | -18.8 | -19.0 | 37.1 | 10.18 | 37.0 | 10.88 | 37.0 | 11.58 | 36.8 | 11.92 | 36.8 | 12.25 | 36.6 | 12.95 |
| | -16.7 | -17.0 | 38.6 | 10.66 | 38.4 | 11.32 | 38.2 | 12.00 | 38.2 | 12.27 | 38.2 | 12.66 | 38.0 | 13.33 |
| | -13.7 | -15.0 | 40.2 | 11.15 | 40.0 | 11.80 | 39.8 | 12.44 | 39.8 | 12.75 | 39.6 | 13.08 | 39.6 | 13.72 |
| | -11.8 | -13.0 | 41.8 | 11.65 | 41.8 | 12.27 | 41.6 | 12.88 | 41.4 | 13.19 | 41.4 | 13.50 | 41.3 | 14.10 |
| | -9.8 | -11.0 | 43.8 | 12.16 | 43.6 | 12.75 | 43.4 | 13.33 | 43.4 | 13.63 | 43.4 | 13.92 | 43.2 | 14.51 |
| | -9.5 | -10.0 | 44.8 | 12.42 | 44.7 | 12.99 | 44.5 | 13.55 | 44.5 | 13.85 | 44.3 | 14.12 | 44.3 | 14.69 |
| | -8.5 | -9.1 | 45.7 | 12.64 | 45.6 | 13.19 | 45.6 | 13.76 | 45.4 | 14.03 | 45.4 | 14.30 | 45.2 | 14.87 |
| | -7.0 | -7.6 | 47.4 | 13.00 | 47.4 | 13.55 | 47.2 | 14.09 | 47.2 | 14.36 | 47.0 | 14.62 | 46.8 | 15.17 |
| | -5.0 | -5.6 | 49.9 | 13.50 | 49.7 | 13.74 | 49.5 | 14.52 | 49.5 | 14.78 | 49.3 | 15.02 | 49.3 | 15.53 |
| | -3.0 | -3.7 | 52.2 | 13.94 | 52.0 | 14.43 | 52.0 | 14.91 | 51.8 | 15.17 | 51.8 | 15.40 | 51.7 | 15.88 |
| | 0.0 | -0.7 | 56.3 | 14.62 | 56.3 | 15.07 | 56.1 | 15.51 | 56.1 | 15.73 | 56.0 | 15.97 | 56.0 | 16.41 |
| | 3.0 | 2.2 | 60.8 | 15.22 | 60.6 | 15.64 | 60.4 | 16.06 | 60.4 | 16.26 | 60.4 | 16.48 | 60.3 | 16.89 |
| | 5.0 | 4.1 | 63.9 | 15.61 | 63.7 | 16.01 | 63.7 | 16.39 | 63.5 | 16.59 | 63.5 | 16.80 | 63.3 | 17.18 |
| | 7.0 | 6.0 | 67.1 | 15.97 | 66.9 | 16.34 | 66.9 | 16.72 | 66.7 | 15.07 | 66.7 | 17.09 | 64.0 | 16.41 |
| | 9.0 | 7.9 | 70.5 | 16.30 | 70.3 | 16.67 | 70.3 | 17.02 | 70.1 | 17.20 | 68.7 | 16.85 | 64.0 | 15.42 |
| | 11.0 | 9.8 | 74.1 | 16.63 | 73.9 | 16.96 | 73.5 | 17.18 | 71.0 | 16.50 | 68.7 | 15.83 | 64.0 | 14.52 |
| | 13.0 | 11.8 | 78.0 | 16.94 | 77.8 | 17.27 | 73.5 | 16.10 | 71.0 | 15.46 | 68.7 | 14.85 | 64.0 | 13.63 |
| | 15.0 | 13.7 | 81.8 | 17.24 | 78.2 | 16.36 | 73.5 | 15.17 | 71.0 | 14.58 | 68.7 | 13.99 | 64.0 | 12.86 |
| 120 | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 36.4 | 10.92 | 36.2 | 11.56 | 36.1 | 12.22 | 36.1 | 12.53 | 36.1 | 12.86 | 35.9 | 13.52 |
| | -18.8 | -19.0 | 37.0 | 11.12 | 36.8 | 11.76 | 36.8 | 12.27 | 36.6 | 12.71 | 36.6 | 13.04 | 36.4 | 13.68 |
| | -16.7 | -17.0 | 38.4 | 11.56 | 38.2 | 12.18 | 38.2 | 12.78 | 38.0 | 13.10 | 38.0 | 13.41 | 37.8 | 14.01 |
| | -13.7 | -15.0 | 40.0 | 12.02 | 39.8 | 12.60 | 39.6 | 13.19 | 39.6 | 13.50 | 39.6 | 13.79 | 39.5 | 14.38 |
| | -11.8 | -13.0 | 41.6 | 12.47 | 41.6 | 13.04 | 41.4 | 13.61 | 41.4 | 13.90 | 41.3 | 14.18 | 41.3 | 14.74 |
| | -9.8 | -11.0 | 43.6 | 12.95 | 43.4 | 13.48 | 43.4 | 14.03 | 43.2 | 14.30 | 43.2 | 14.56 | 43.0 | 15.13 |
| | -9.5 | -10.0 | 44.7 | 13.19 | 44.5 | 13.72 | 44.3 | 14.23 | 44.3 | 14.51 | 44.3 | 14.65 | 44.1 | 15.29 |
| | -8.5 | -9.1 | 45.6 | 13.39 | 45.4 | 13.90 | 45.4 | 14.41 | 45.2 | 14.67 | 45.2 | 14.95 | 45.0 | 15.46 |
| | -7.0 | -7.6 | 47.2 | 13.74 | 47.2 | 14.23 | 47.0 | 14.73 | 47.0 | 14.98 | 46.8 | 15.22 | 46.8 | 15.72 |
| | -5.0 | -5.6 | 49.7 | 14.18 | 49.5 | 14.65 | 49.3 | 15.13 | 49.3 | 15.37 | 49.3 | 15.61 | 49.1 | 16.06 |
| | -3.0 | -3.7 | 52.0 | 14.60 | 52.0 | 15.06 | 51.8 | 15.50 | 51.8 | 15.72 | 51.7 | 15.95 | 51.7 | 16.39 |
| | 0.0 | -0.7 | 56.1 | 15.22 | 56.1 | 15.64 | 56.0 | 16.25 | 56.0 | 16.26 | 55.8 | 16.47 | 55.8 | 16.89 |
| | 3.0 | 2.2 | 60.6 | 15.79 | 60.4 | 16.17 | 60.4 | 16.56 | 60.3 | 16.76 | 60.3 | 16.94 | 59.0 | 16.85 |
| | 5.0 | 4.1 | 63.7 | 16.14 | 63.5 | 16.50 | 63.5 | 16.87 | 63.3 | 17.05 | 63.3 | 17.24 | 59.0 | 15.83 |
| | 7.0 | 6.0 | 66.9 | 16.47 | 66.9 | 16.81 | 66.7 | 17.16 | 65.6 | 16.92 | 63.5 | 16.23 | 59.0 | 14.89 |
| | 9.0 | 7.9 | 70.3 | 16.80 | 70.1 | 17.13 | 67.8 | 16.56 | 65.6 | 15.90 | 63.5 | 15.26 | 59.0 | 14.01 |
| | 11.0 | 9.8 | 73.9 | 17.09 | 72.1 | 16.80 | 67.8 | 15.57 | 65.6 | 14.96 | 63.5 | 14.36 | 59.0 | 13.21 |
| | 13.0 | 11.8 | 76.6 | 16.92 | 72.1 | 15.75 | 67.8 | 14.60 | 65.6 | 14.05 | 63.5 | 13.50 | 59.0 | 12.42 |
| | 15.0 | 13.7 | 76.6 | 15.93 | 72.1 | 14.84 | 67.8 | 13.77 | 65.6 | 13.24 | 63.5 | 12.73 | 59.0 | 11.72 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|-------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 110 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 36.2 | 11.87 | 36.1 | 12.45 | 35.9 | 13.06 | 35.9 | 13.35 | 35.9 | 13.65 | 35.7 | 14.25 |
| | -18.8 | -19.0 | 36.8 | 12.05 | 36.8 | 12.64 | 395.3 | 13.22 | 36.6 | 13.52 | 36.4 | 13.81 | 36.4 | 14.40 |
| | -16.7 | -17.0 | 38.2 | 12.45 | 38.0 | 13.02 | 38.0 | 13.59 | 37.8 | 13.87 | 37.8 | 14.16 | 37.7 | 14.71 |
| | -13.7 | -15.0 | 39.8 | 12.88 | 39.6 | 13.43 | 39.5 | 13.96 | 39.5 | 14.23 | 39.5 | 14.51 | 39.3 | 15.04 |
| | -11.8 | -13.0 | 41.4 | 13.32 | 41.4 | 13.83 | 41.3 | 14.34 | 41.3 | 14.60 | 41.1 | 14.85 | 41.1 | 15.39 |
| | -9.8 | -11.0 | 43.4 | 13.74 | 43.2 | 14.23 | 43.2 | 14.73 | 43.0 | 14.98 | 43.0 | 15.22 | 43.0 | 15.72 |
| | -9.5 | -10.0 | 44.5 | 13.96 | 44.3 | 14.43 | 44.1 | 14.93 | 44.1 | 15.17 | 44.1 | 15.40 | 43.9 | 15.88 |
| | -8.5 | -9.1 | 45.4 | 14.14 | 45.2 | 14.62 | 45.2 | 15.09 | 45.2 | 15.33 | 45.0 | 15.57 | 45.0 | 16.03 |
| | -7.0 | -7.6 | 47.0 | 14.47 | 47.0 | 14.91 | 46.8 | 15.37 | 46.8 | 15.61 | 47.4 | 15.83 | 46.6 | 16.28 |
| | -5.0 | -5.6 | 49.5 | 14.87 | 49.3 | 15.31 | 49.1 | 15.73 | 49.1 | 15.95 | 51.5 | 16.17 | 49.0 | 16.61 |
| | -3.0 | -3.7 | 51.8 | 15.26 | 51.8 | 15.66 | 51.7 | 16.08 | 51.7 | 16.28 | 55.8 | 16.48 | 51.5 | 16.91 |
| | 0.0 | -0.7 | 56.0 | 15.83 | 56.0 | 16.21 | 55.8 | 16.59 | 55.8 | 16.78 | 58.1 | 16.98 | 54.2 | 16.65 |
| | 3.0 | 2.2 | 60.4 | 16.36 | 60.3 | 16.70 | 60.3 | 17.05 | 60.1 | 17.22 | 58.1 | 16.52 | 54.2 | 15.15 |
| | 5.0 | 4.1 | 63.5 | 16.67 | 63.5 | 17.02 | 62.2 | 16.85 | 60.1 | 16.17 | 58.1 | 15.53 | 54.2 | 14.25 |
| | 7.0 | 6.0 | 66.7 | 16.98 | 66.2 | 17.09 | 62.2 | 15.83 | 60.1 | 15.20 | 58.1 | 14.60 | 54.2 | 13.41 |
| | 9.0 | 7.9 | 70.1 | 17.25 | 66.2 | 16.06 | 62.2 | 14.89 | 60.1 | 14.30 | 58.1 | 13.74 | 54.2 | 12.64 |
| | 11.0 | 9.8 | 70.1 | 16.23 | 66.2 | 15.11 | 62.2 | 14.01 | 60.1 | 13.48 | 58.1 | 12.95 | 54.2 | 11.92 |
| | 13.0 | 11.8 | 70.1 | 15.22 | 66.2 | 14.18 | 62.2 | 13.17 | 60.1 | 12.67 | 58.1 | 12.18 | 54.2 | 11.23 |
| | 15.0 | 13.7 | 70.1 | 14.34 | 66.2 | 13.37 | 62.2 | 12.44 | 60.1 | 11.96 | 58.1 | 11.52 | 54.2 | 10.62 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 100 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 36.1 | 12.82 | 35.9 | 13.35 | 35.9 | 13.90 | 35.7 | 14.18 | 35.7 | 14.43 | 35.5 | 14.98 |
| | -18.8 | -19.0 | 36.6 | 12.99 | 36.6 | 13.52 | 36.4 | 14.05 | 36.4 | 14.32 | 36.2 | 14.60 | 36.2 | 15.13 |
| | -16.7 | -17.0 | 38.0 | 13.35 | 37.8 | 13.87 | 37.8 | 14.38 | 37.8 | 14.63 | 37.7 | 14.89 | 37.7 | 15.40 |
| | -13.7 | -15.0 | 39.6 | 13.74 | 39.5 | 14.23 | 39.5 | 14.73 | 39.3 | 14.98 | 39.3 | 15.22 | 39.1 | 15.72 |
| | -11.8 | -13.0 | 41.3 | 14.14 | 41.3 | 14.60 | 41.1 | 15.07 | 41.1 | 15.31 | 41.1 | 15.00 | 40.9 | 16.03 |
| | -9.8 | -11.0 | 43.2 | 14.52 | 43.0 | 14.98 | 43.0 | 15.42 | 43.0 | 15.66 | 42.9 | 15.88 | 42.9 | 16.32 |
| | -9.5 | -10.0 | 44.3 | 14.73 | 44.1 | 15.17 | 44.1 | 15.61 | 43.9 | 15.83 | 43.9 | 16.04 | 43.8 | 16.48 |
| | -8.5 | -9.1 | 45.2 | 14.89 | 45.2 | 15.33 | 45.0 | 15.75 | 45.0 | 15.97 | 44.8 | 16.19 | 44.8 | 16.61 |
| | -7.0 | -7.6 | 46.8 | 15.18 | 46.8 | 15.61 | 46.6 | 16.01 | 46.6 | 16.23 | 46.6 | 16.43 | 46.5 | 16.85 |
| | -5.0 | -5.6 | 49.3 | 15.57 | 49.1 | 15.95 | 49.1 | 16.36 | 49.0 | 16.56 | 49.0 | 16.74 | 49.0 | 17.14 |
| | -3.0 | -3.7 | 51.7 | 15.92 | 51.7 | 16.28 | 51.5 | 16.67 | 51.5 | 16.85 | 51.5 | 17.03 | 49.3 | 16.32 |
| | 0.0 | -0.7 | 55.8 | 16.45 | 55.8 | 16.78 | 55.6 | 17.13 | 54.7 | 16.85 | 52.9 | 16.15 | 49.3 | 14.84 |
| | 3.0 | 2.2 | 60.3 | 16.91 | 60.1 | 17.22 | 56.5 | 15.93 | 54.7 | 15.31 | 52.9 | 14.71 | 49.3 | 13.50 |
| | 5.0 | 4.1 | 63.3 | 17.22 | 60.1 | 16.17 | 56.5 | 14.98 | 54.7 | 14.41 | 52.9 | 13.85 | 49.3 | 12.73 |
| | 7.0 | 6.0 | 63.7 | 16.34 | 60.1 | 15.20 | 56.5 | 14.10 | 54.7 | 13.57 | 52.9 | 13.04 | 49.3 | 12.00 |
| | 9.0 | 7.9 | 63.7 | 15.35 | 60.1 | 14.30 | 56.5 | 13.28 | 54.7 | 12.78 | 52.9 | 12.29 | 49.3 | 11.32 |
| | 11.0 | 9.8 | 63.7 | 14.45 | 60.1 | 13.48 | 56.5 | 12.53 | 54.7 | 12.05 | 52.9 | 11.59 | 49.3 | 10.70 |
| | 13.0 | 11.8 | 63.7 | 13.57 | 60.1 | 12.67 | 56.5 | 11.80 | 54.7 | 11.36 | 52.9 | 10.93 | 49.3 | 10.09 |
| | 15.0 | 13.7 | 63.7 | 12.80 | 60.1 | 11.96 | 56.5 | 11.14 | 54.7 | 10.73 | 52.9 | 10.33 | 49.3 | 9.56 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90 | -19.8 | -20.0 | 35.9 | 13.77 | 35.7 | 14.25 | 35.7 | 14.74 | 35.5 | 14.98 | 35.5 | 15.24 | 35.5 | 15.72 |
| | -18.8 | -19.0 | 36.4 | 13.92 | 36.4 | 14.41 | 36.2 | 14.89 | 36.2 | 15.13 | 36.2 | 15.37 | 36.1 | 15.84 |
| | -16.7 | -17.0 | 37.8 | 14.27 | 37.7 | 14.73 | 37.7 | 15.18 | 37.7 | 15.42 | 37.5 | 15.64 | 37.5 | 16.10 |
| | -13.7 | -15.0 | 39.5 | 14.62 | 39.3 | 15.06 | 39.3 | 15.50 | 39.1 | 15.57 | 39.1 | 15.93 | 39.1 | 16.37 |
| | -11.8 | -13.0 | 41.1 | 14.96 | 41.1 | 15.39 | 40.9 | 15.81 | 40.9 | 16.03 | 40.9 | 16.23 | 40.7 | 16.65 |
| | -9.8 | -11.0 | 43.0 | 15.31 | 43.0 | 15.72 | 42.9 | 16.12 | 42.9 | 16.34 | 42.9 | 16.54 | 42.7 | 16.94 |
| | -9.5 | -10.0 | 44.1 | 15.50 | 43.9 | 15.90 | 43.9 | 16.28 | 43.8 | 16.48 | 43.8 | 16.69 | 43.8 | 17.07 |
| | -8.5 | -9.1 | 45.0 | 15.66 | 45.0 | 16.04 | 44.8 | 16.43 | 44.8 | 16.61 | 44.8 | 16.81 | 44.3 | 16.98 |
| | -7.0 | -7.6 | 46.6 | 15.92 | 46.6 | 16.28 | 46.5 | 16.67 | 46.5 | 16.85 | 46.5 | 17.03 | 44.3 | 16.21 |
| | -5.0 | -5.6 | 49.1 | 16.26 | 49.0 | 16.61 | 49.0 | 16.96 | 49.0 | 17.14 | 47.5 | 16.61 | 44.3 | 15.24 |
| | -3.0 | -3.7 | 51.5 | 16.58 | 51.5 | 15.07 | 50.9 | 16.98 | 49.1 | 16.30 | 47.5 | 15.64 | 44.3 | 14.36 |
| | 0.0 | -0.7 | 55.8 | 17.05 | 54.2 | 14.80 | 50.9 | 15.40 | 49.1 | 14.80 | 47.5 | 14.21 | 44.3 | 13.06 |
| | 3.0 | 2.2 | 57.4 | 16.25 | 54.2 | 15.13 | 50.9 | 14.03 | 49.1 | 13.50 | 47.5 | 12.97 | 44.3 | 11.94 |
| | 5.0 | 4.1 | 57.4 | 15.28 | 54.2 | 14.23 | 50.9 | 13.22 | 49.1 | 12.71 | 47.5 | 12.24 | 44.3 | 11.26 |
| | 7.0 | 6.0 | 57.4 | 14.36 | 54.2 | 13.41 | 50.9 | 12.45 | 49.1 | 12.00 | 47.5 | 11.54 | 44.3 | 10.64 |
| | 9.0 | 7.9 | 57.4 | 13.54 | 54.2 | 12.62 | 50.9 | 11.74 | 49.1 | 11.32 | 47.5 | 10.90 | 44.3 | 10.06 |
| | 11.0 | 9.8 | 57.4 | 12.75 | 54.2 | 11.91 | 50.9 | 11.10 | 49.1 | 10.70 | 47.5 | 10.29 | 44.3 | 9.52 |
| | 13.0 | 11.8 | 57.4 | 12.00 | 54.2 | 11.23 | 50.9 | 10.46 | 49.1 | 10.09 | 47.5 | 9.73 | 44.3 | 8.99 |
| | 15.0 | 13.7 | 57.4 | 11.34 | 54.2 | 10.60 | 50.9 | 9.91 | 49.1 | 9.52 | 47.5 | 9.21 | 44.3 | 8.54 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 80 | -19.8 | -20.0 | 35.7 | 14.73 | 35.5 | 15.15 | 35.5 | 15.59 | 35.5 | 15.81 | 35.3 | 16.03 | 35.3 | 16.45 |
| | -18.8 | -19.0 | 36.2 | 14.85 | 36.2 | 15.29 | 36.1 | 15.72 | 36.1 | 15.93 | 36.1 | 16.14 | 35.9 | 16.58 |
| | -16.7 | -17.0 | 37.7 | 15.17 | 37.5 | 15.57 | 37.5 | 15.99 | 37.5 | 16.19 | 37.5 | 16.39 | 37.3 | 16.80 |
| | -13.7 | -15.0 | 39.3 | 15.48 | 39.1 | 15.86 | 39.1 | 16.26 | 39.1 | 16.45 | 38.9 | 16.65 | 38.9 | 17.05 |
| | -11.8 | -13.0 | 40.9 | 15.79 | 40.9 | 16.17 | 40.7 | 16.54 | 40.7 | 16.72 | 40.7 | 16.92 | 39.5 | 16.47 |
| | -9.8 | -11.0 | 42.9 | 16.10 | 42.9 | 16.47 | 42.7 | 16.83 | 42.7 | 17.00 | 42.3 | 16.96 | 39.5 | 15.55 |
| | -9.5 | -10.0 | 43.9 | 16.26 | 43.8 | 16.61 | 43.8 | 16.96 | 43.8 | 17.14 | 42.3 | 16.47 | 39.5 | 15.09 |
| | -8.5 | -9.1 | 44.8 | 16.41 | 44.8 | 16.76 | 44.7 | 17.09 | 43.8 | 16.72 | 42.3 | 16.03 | 39.5 | 14.69 |
| | -7.0 | -7.6 | 46.5 | 16.65 | 46.5 | 16.98 | 45.2 | 16.61 | 43.8 | 15.95 | 42.3 | 15.31 | 39.5 | 14.10 |
| | -5.0 | -5.6 | 49.0 | 15.11 | 48.1 | 16.85 | 45.2 | 15.61 | 43.8 | 15.00 | 42.3 | 14.40 | 39.5 | 13.22 |
| | -3.0 | -3.7 | 50.9 | 15.20 | 48.1 | 15.86 | 45.2 | 14.69 | 43.8 | 14.19 | 42.3 | 13.57 | 39.5 | 12.49 |
| | 0.0 | -0.7 | 50.9 | 15.46 | 48.1 | 14.40 | 45.2 | 13.37 | 43.8 | 12.88 | 42.3 | 12.36 | 39.5 | 11.39 |
| | 3.0 | 2.2 | 50.9 | 14.09 | 48.1 | 13.13 | 45.2 | 12.22 | 43.8 | 11.76 | 42.3 | 11.32 | 39.5 | 10.44 |
| | 5.0 | 4.1 | 50.9 | 13.26 | 48.1 | 12.38 | 45.2 | 11.52 | 43.8 | 11.10 | 42.3 | 10.70 | 39.5 | 9.87 |
| | 7.0 | 6.0 | 50.9 | 12.49 | 48.1 | 11.70 | 45.2 | 10.88 | 43.8 | 10.50 | 42.3 | 10.11 | 39.5 | 9.34 |
| | 9.0 | 7.9 | 50.9 | 11.80 | 48.1 | 11.03 | 45.2 | 10.33 | 43.8 | 9.91 | 42.3 | 9.56 | 39.5 | 8.85 |
| | 11.0 | 9.8 | 50.9 | 11.14 | 48.1 | 10.42 | 45.2 | 9.73 | 43.8 | 9.38 | 42.3 | 9.05 | 39.5 | 8.39 |
| | 13.0 | 11.8 | 50.9 | 10.50 | 48.1 | 9.84 | 45.2 | 9.19 | 43.8 | 8.86 | 42.3 | 8.55 | 39.5 | 7.93 |
| | 15.0 | 13.7 | 50.9 | 9.93 | 48.1 | 9.32 | 45.2 | 8.72 | 43.8 | 8.41 | 42.3 | 8.11 | 39.5 | 7.55 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|--------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 70 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 35.5 | 15.68 | 35.3 | 16.04 | 35.3 | 16.43 | 35.3 | 16.61 | 35.3 | 16.81 | 34.4 | 16.63 |
| | -18.8 | -19.0 | 36.1 | 15.81 | 36.1 | 16.17 | 35.9 | 16.54 | 35.9 | 16.72 | 35.9 | 16.92 | 34.4 | 16.28 |
| | -16.7 | -17.0 | 37.5 | 16.06 | 37.5 | 16.43 | 37.3 | 16.78 | 37.3 | 16.96 | 37.0 | 16.94 | 34.4 | 15.53 |
| | -13.7 | -15.0 | 39.1 | 16.34 | 38.9 | 16.69 | 38.9 | 17.03 | 38.2 | 163.31 | 37.0 | 16.10 | 34.4 | 14.76 |
| | -11.8 | -13.0 | 40.7 | 16.61 | 40.7 | 16.94 | 39.6 | 16.54 | 38.2 | 15.90 | 37.0 | 15.26 | 34.4 | 13.99 |
| | -9.8 | -11.0 | 42.7 | 16.89 | 42.2 | 16.87 | 39.6 | 15.62 | 38.2 | 15.02 | 37.0 | 14.41 | 34.4 | 13.24 |
| | -9.5 | -10.0 | 43.8 | 17.03 | 42.2 | 16.37 | 39.6 | 15.17 | 38.2 | 14.58 | 37.0 | 14.01 | 34.4 | 12.88 |
| | -8.5 | -9.1 | 44.7 | 17.13 | 42.2 | 15.93 | 39.6 | 14.76 | 38.2 | 14.19 | 37.0 | 13.65 | 34.4 | 12.55 |
| | -7.0 | -7.6 | 44.7 | 16.36 | 42.2 | 15.22 | 39.6 | 14.12 | 38.2 | 13.59 | 37.0 | 13.06 | 34.4 | 12.02 |
| | -5.0 | -5.6 | 44.7 | 15.37 | 42.2 | 14.32 | 39.6 | 13.30 | 38.2 | 12.78 | 37.0 | 12.29 | 34.4 | 11.34 |
| | -3.0 | -3.7 | 44.7 | 14.47 | 42.2 | 13.50 | 39.6 | 12.55 | 38.2 | 12.07 | 37.0 | 11.61 | 34.4 | 10.71 |
| | 0.0 | -0.7 | 44.7 | 13.17 | 42.2 | 12.36 | 39.6 | 11.45 | 38.2 | 11.03 | 37.0 | 10.62 | 34.4 | 9.82 |
| | 3.0 | 2.2 | 44.7 | 12.03 | 42.2 | 0.27 | 39.6 | 10.50 | 38.2 | 10.11 | 37.0 | 9.74 | 34.4 | 9.01 |
| | 5.0 | 4.1 | 44.7 | 11.36 | 42.2 | 10.62 | 39.6 | 9.93 | 38.2 | 9.56 | 37.0 | 9.23 | 34.4 | 8.54 |
| | 7.0 | 6.0 | 44.7 | 10.73 | 42.2 | 10.06 | 39.6 | 9.38 | 38.2 | 9.05 | 37.0 | 8.74 | 34.4 | 8.10 |
| | 9.0 | 7.9 | 44.7 | 10.15 | 42.2 | 9.51 | 39.6 | 8.88 | 38.2 | 8.57 | 37.0 | 8.28 | 34.4 | 7.67 |
| | 11.0 | 9.8 | 44.7 | 9.60 | 42.2 | 8.99 | 39.6 | 8.43 | 38.2 | 8.13 | 37.0 | 7.86 | 34.4 | 7.29 |
| | 13.0 | 11.8 | 44.7 | 9.07 | 42.2 | 8.52 | 39.6 | 7.97 | 38.2 | 7.71 | 37.0 | 7.44 | 34.4 | 6.92 |
| | 15.0 | 13.7 | 44.7 | 8.59 | 42.2 | 8.08 | 39.6 | 7.56 | 38.2 | 7.33 | 37.0 | 7.07 | 34.4 | 6.59 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 60 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 35.3 | 16.63 | 35.2 | 16.94 | 33.9 | 16.30 | 32.8 | 15.66 | 31.7 | 15.04 | 29.6 | 13.79 |
| | -18.8 | -19.0 | 35.9 | 16.74 | 35.9 | 17.05 | 33.9 | 15.95 | 32.8 | 15.33 | 31.7 | 14.71 | 29.6 | 13.50 |
| | -16.7 | -17.0 | 37.3 | 16.96 | 36.1 | 16.43 | 33.9 | 15.22 | 32.8 | 14.63 | 31.7 | 14.05 | 29.6 | 12.91 |
| | -13.7 | -15.0 | 38.2 | 16.78 | 36.1 | 15.61 | 33.9 | 14.47 | 32.8 | 13.92 | 31.7 | 13.37 | 29.6 | 12.29 |
| | -11.8 | -13.0 | 38.2 | 15.88 | 36.1 | 14.78 | 33.9 | 13.72 | 32.8 | 13.21 | 31.7 | 12.69 | 29.6 | 11.69 |
| | -9.8 | -11.0 | 38.2 | 15.00 | 36.1 | 13.98 | 33.9 | 12.99 | 32.8 | 12.49 | 31.7 | 12.02 | 29.6 | 11.08 |
| | -9.5 | -10.0 | 38.2 | 14.58 | 36.1 | 13.59 | 33.9 | 12.62 | 32.8 | 12.16 | 31.7 | 11.69 | 29.6 | 10.77 |
| | -8.5 | -9.1 | 38.2 | 14.19 | 36.1 | 13.24 | 33.9 | 12.31 | 32.8 | 11.85 | 31.7 | 11.39 | 29.6 | 10.51 |
| | -7.0 | -7.6 | 38.2 | 13.57 | 36.1 | 12.67 | 33.9 | 11.78 | 32.8 | 11.36 | 31.7 | 10.92 | 29.6 | 10.09 |
| | -5.0 | -5.6 | 38.2 | 12.78 | 36.1 | 11.94 | 33.9 | 11.12 | 32.8 | 10.71 | 31.7 | 10.31 | 29.6 | 9.54 |
| | -3.0 | -3.7 | 38.2 | 12.07 | 36.1 | 11.28 | 33.9 | 10.55 | 32.8 | 10.15 | 31.7 | 9.76 | 29.6 | 9.03 |
| | 0.0 | -0.7 | 38.2 | 11.03 | 36.1 | 10.33 | 33.9 | 9.63 | 32.8 | 9.30 | 31.7 | 8.96 | 29.6 | 8.30 |
| | 3.0 | 2.2 | 38.2 | 10.11 | 36.1 | 9.49 | 33.9 | 8.86 | 32.8 | 8.55 | 31.7 | 8.26 | 29.6 | 0.33 |
| | 5.0 | 4.1 | 38.2 | 9.56 | 36.1 | 8.97 | 33.9 | 8.39 | 32.8 | 8.11 | 31.7 | 7.82 | 29.6 | 7.27 |
| | 7.0 | 6.0 | 38.2 | 9.05 | 36.1 | 8.50 | 33.9 | 7.95 | 32.8 | 7.69 | 31.7 | 7.44 | 29.6 | 6.91 |
| | 9.0 | 7.9 | 38.2 | 8.57 | 36.1 | 8.06 | 33.9 | 7.55 | 32.8 | 7.31 | 31.7 | 7.05 | 29.6 | 6.58 |
| | 11.0 | 9.8 | 38.2 | 8.13 | 36.1 | 7.66 | 33.9 | 7.18 | 32.8 | 6.94 | 31.7 | 6.70 | 29.6 | 6.26 |
| | 13.0 | 11.8 | 38.2 | 7.69 | 36.1 | 7.25 | 33.9 | 6.81 | 32.8 | 6.59 | 31.7 | 6.37 | 29.6 | 5.95 |
| | 15.0 | 13.7 | 38.2 | 7.33 | 36.1 | 6.89 | 33.9 | 6.48 | 32.8 | 6.28 | 31.7 | 6.08 | 29.6 | 5.68 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 50 | -19.8 | -20.0 | 31.9 | 15.13 | 30.1 | 14.09 | 28.3 | 13.08 | 27.3 | 12.60 | 26.4 | 12.11 | 24.6 | 11.15 |
| | -18.8 | -19.0 | 31.9 | 14.80 | 30.1 | 13.79 | 28.3 | 12.82 | 27.3 | 12.33 | 26.4 | 11.85 | 24.6 | 10.93 |
| | -16.7 | -17.0 | 31.9 | 14.12 | 30.1 | 13.17 | 28.3 | 12.25 | 27.3 | 11.80 | 26.4 | 11.36 | 24.6 | 10.48 |
| | -13.7 | -15.0 | 31.9 | 13.44 | 30.1 | 12.55 | 28.3 | 11.67 | 27.3 | 11.25 | 26.4 | 10.82 | 24.6 | 10.00 |
| | -11.8 | -13.0 | 31.9 | 12.77 | 30.1 | 11.94 | 28.3 | 11.10 | 27.3 | 10.70 | 26.4 | 10.29 | 24.6 | 9.52 |
| | -9.8 | -11.0 | 31.9 | 12.09 | 30.1 | 11.30 | 28.3 | 10.53 | 27.3 | 10.15 | 26.4 | 9.78 | 24.6 | 9.05 |
| | -9.5 | -10.0 | 31.9 | 11.76 | 30.1 | 10.99 | 28.3 | 10.26 | 27.3 | 9.89 | 26.4 | 9.52 | 24.6 | 8.81 |
| | -8.5 | -9.1 | 31.9 | 11.47 | 30.1 | 10.73 | 28.3 | 10.00 | 27.3 | 9.65 | 26.4 | 9.30 | 24.6 | 8.61 |
| | -7.0 | -7.6 | 31.9 | 10.99 | 30.1 | 10.33 | 28.3 | 9.60 | 27.3 | 9.27 | 26.4 | 8.94 | 24.6 | 8.28 |
| | -5.0 | -5.6 | 31.9 | 10.37 | 30.1 | 9.73 | 28.3 | 9.08 | 27.3 | 8.77 | 26.4 | 8.46 | 24.6 | 7.84 |
| | -3.0 | -3.7 | 31.9 | 9.82 | 30.1 | 9.21 | 28.3 | 8.61 | 27.3 | 8.32 | 26.4 | 8.02 | 24.6 | 7.45 |
| | 0.0 | -0.7 | 31.9 | 9.01 | 30.1 | 8.46 | 28.3 | 7.93 | 27.3 | 7.66 | 26.4 | 7.40 | 24.6 | 6.89 |
| | 3.0 | 2.2 | 31.9 | 8.30 | 30.1 | 7.80 | 28.3 | 7.31 | 27.3 | 7.07 | 26.4 | 6.85 | 24.6 | 6.37 |
| | 5.0 | 4.1 | 31.9 | 7.88 | 30.1 | 7.40 | 28.3 | 6.94 | 27.3 | 6.72 | 26.4 | 6.50 | 24.6 | 6.06 |
| | 7.0 | 6.0 | 31.9 | 7.47 | 30.1 | 7.03 | 28.3 | 6.61 | 27.3 | 6.39 | 26.4 | 6.19 | 24.6 | 5.79 |
| | 9.0 | 7.9 | 31.9 | 7.09 | 30.1 | 6.69 | 28.3 | 6.28 | 27.3 | 6.10 | 26.4 | 5.90 | 24.6 | 5.51 |
| | 11.0 | 9.8 | 31.9 | 6.74 | 30.1 | 6.36 | 28.3 | 5.99 | 27.3 | 5.81 | 26.4 | 5.62 | 24.6 | 5.26 |
| | 13.0 | 11.8 | 31.9 | 6.41 | 30.1 | 6.04 | 28.3 | 5.70 | 27.3 | 5.53 | 26.4 | 5.35 | 24.6 | 5.02 |
| | 15.0 | 13.7 | 31.9 | 6.10 | 30.1 | 5.77 | 28.3 | 5.44 | 27.3 | 5.28 | 26.4 | 5.11 | 24.6 | 4.78 |

CHV-5S560NMX

TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 130 | -19.8 | -20.0 | 40.8 | 11.73 | 40.6 | 12.55 | 40.4 | 13.39 | 40.4 | 13.80 | 40.2 | 14.21 | 40.2 | 15.05 |
| | -18.8 | -19.0 | 41.4 | 11.99 | 41.2 | 12.81 | 41.2 | 13.63 | 41.0 | 14.03 | 41.0 | 14.42 | 40.8 | 15.24 |
| | -16.7 | -17.0 | 43.0 | 12.55 | 42.8 | 13.32 | 42.6 | 14.12 | 42.6 | 14.44 | 42.6 | 14.90 | 42.4 | 15.69 |
| | -13.7 | -15.0 | 44.8 | 13.13 | 44.6 | 13.88 | 44.4 | 14.64 | 44.4 | 15.01 | 44.2 | 15.39 | 44.2 | 16.15 |
| | -11.8 | -13.0 | 46.6 | 13.71 | 46.6 | 14.44 | 46.4 | 15.16 | 46.2 | 15.52 | 46.2 | 15.89 | 46.0 | 16.60 |
| | -9.8 | -11.0 | 48.8 | 14.32 | 48.6 | 15.01 | 48.4 | 15.69 | 48.4 | 16.04 | 48.4 | 16.38 | 48.2 | 17.07 |
| | -9.5 | -10.0 | 50.0 | 14.62 | 49.8 | 15.29 | 49.6 | 15.95 | 49.6 | 16.30 | 49.4 | 16.62 | 49.4 | 17.29 |
| | -8.5 | -9.1 | 51.0 | 14.88 | 50.8 | 15.52 | 50.8 | 16.19 | 50.6 | 16.51 | 50.6 | 16.84 | 50.4 | 17.51 |
| | -7.0 | -7.6 | 52.8 | 15.31 | 52.8 | 15.95 | 52.6 | 16.58 | 52.6 | 16.90 | 52.4 | 17.20 | 52.2 | 17.85 |
| | -5.0 | -5.6 | 55.6 | 15.89 | 55.4 | 16.17 | 55.2 | 17.10 | 55.2 | 17.40 | 55.0 | 17.68 | 55.0 | 18.28 |
| | -3.0 | -3.7 | 58.2 | 16.41 | 58.0 | 16.99 | 58.0 | 17.55 | 57.8 | 17.85 | 57.8 | 18.13 | 57.6 | 18.69 |
| | 0.0 | -0.7 | 62.8 | 17.20 | 62.8 | 17.74 | 62.6 | 18.26 | 62.6 | 18.52 | 62.4 | 18.80 | 62.4 | 19.32 |
| | 3.0 | 2.2 | 67.8 | 17.92 | 67.6 | 18.41 | 67.4 | 18.91 | 67.4 | 19.14 | 67.4 | 19.40 | 67.2 | 19.88 |
| | 5.0 | 4.1 | 71.2 | 18.37 | 71.0 | 18.84 | 71.0 | 19.30 | 70.8 | 19.53 | 70.8 | 19.77 | 70.6 | 20.22 |
| | 7.0 | 6.0 | 74.8 | 18.80 | 74.6 | 19.23 | 74.6 | 19.68 | 74.4 | 17.74 | 74.4 | 20.11 | 71.4 | 19.32 |
| | 9.0 | 7.9 | 78.6 | 19.19 | 78.4 | 19.62 | 78.4 | 20.03 | 78.2 | 20.24 | 76.6 | 19.83 | 71.4 | 18.15 |
| | 11.0 | 9.8 | 82.6 | 19.58 | 82.4 | 19.96 | 82.0 | 20.22 | 79.2 | 19.42 | 76.6 | 18.63 | 71.4 | 17.10 |
| | 13.0 | 11.8 | 87.0 | 19.94 | 86.8 | 20.33 | 82.0 | 18.95 | 79.2 | 18.20 | 76.6 | 17.48 | 71.4 | 16.04 |
| | 15.0 | 13.7 | 91.2 | 20.29 | 87.2 | 19.25 | 82.0 | 17.85 | 79.2 | 17.16 | 76.6 | 16.47 | 71.4 | 15.13 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 120 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 40.6 | 12.85 | 40.4 | 13.60 | 40.2 | 14.38 | 40.2 | 14.75 | 40.2 | 15.13 | 40.0 | 15.91 |
| | -18.8 | -19.0 | 41.2 | 13.09 | 41.0 | 13.84 | 41.0 | 14.44 | 40.8 | 14.96 | 40.8 | 15.35 | 40.6 | 16.10 |
| | -16.7 | -17.0 | 42.8 | 13.60 | 42.6 | 14.34 | 42.6 | 15.05 | 42.4 | 15.41 | 42.4 | 15.78 | 42.2 | 16.49 |
| | -13.7 | -15.0 | 44.6 | 14.14 | 44.4 | 14.83 | 44.2 | 15.52 | 44.2 | 15.89 | 44.2 | 16.23 | 44.0 | 16.92 |
| | -11.8 | -13.0 | 46.4 | 14.68 | 46.4 | 15.35 | 46.2 | 16.02 | 46.2 | 16.36 | 46.0 | 16.69 | 46.0 | 17.35 |
| | -9.8 | -11.0 | 48.6 | 15.24 | 48.4 | 15.87 | 48.4 | 16.51 | 48.2 | 16.84 | 48.2 | 17.14 | 48.0 | 17.81 |
| | -9.5 | -10.0 | 49.8 | 15.52 | 49.6 | 16.15 | 49.4 | 16.75 | 49.4 | 17.07 | 49.4 | 17.25 | 49.2 | 18.00 |
| | -8.5 | -9.1 | 50.8 | 15.76 | 50.6 | 16.36 | 50.6 | 16.97 | 50.4 | 17.27 | 50.4 | 17.59 | 50.2 | 18.20 |
| | -7.0 | -7.6 | 52.6 | 16.17 | 52.6 | 16.75 | 52.4 | 17.33 | 52.4 | 17.64 | 52.2 | 17.92 | 52.2 | 18.50 |
| | -5.0 | -5.6 | 55.4 | 16.69 | 55.2 | 17.25 | 55.0 | 17.81 | 55.0 | 18.09 | 55.0 | 18.37 | 54.8 | 18.91 |
| | -3.0 | -3.7 | 58.0 | 17.18 | 58.0 | 17.72 | 57.8 | 18.24 | 57.8 | 18.50 | 57.6 | 18.78 | 57.6 | 19.30 |
| | 0.0 | -0.7 | 62.6 | 17.92 | 62.6 | 18.41 | 62.4 | 19.12 | 62.4 | 19.14 | 62.2 | 19.38 | 62.2 | 19.88 |
| | 3.0 | 2.2 | 67.6 | 18.58 | 67.4 | 19.04 | 67.4 | 19.49 | 67.2 | 19.73 | 67.2 | 19.94 | 65.8 | 19.83 |
| | 5.0 | 4.1 | 71.0 | 18.99 | 70.8 | 19.42 | 70.8 | 19.86 | 70.6 | 20.07 | 70.6 | 20.29 | 65.8 | 18.63 |
| | 7.0 | 6.0 | 74.6 | 19.38 | 74.6 | 19.79 | 74.4 | 20.20 | 73.2 | 19.92 | 70.8 | 19.10 | 65.8 | 17.53 |
| | 9.0 | 7.9 | 78.4 | 19.77 | 78.2 | 20.16 | 75.6 | 19.49 | 73.2 | 18.71 | 70.8 | 17.96 | 65.8 | 16.49 |
| | 11.0 | 9.8 | 82.4 | 20.11 | 80.4 | 19.77 | 75.6 | 18.33 | 73.2 | 17.61 | 70.8 | 16.90 | 65.8 | 15.54 |
| | 13.0 | 11.8 | 85.4 | 19.92 | 80.4 | 18.54 | 75.6 | 17.18 | 73.2 | 16.54 | 70.8 | 15.89 | 65.8 | 14.62 |
| | 15.0 | 13.7 | 85.4 | 18.76 | 80.4 | 17.46 | 75.6 | 16.21 | 73.2 | 15.59 | 70.8 | 14.98 | 65.8 | 13.80 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|-------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 110 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 40.4 | 13.97 | 40.2 | 14.66 | 40.0 | 15.37 | 40.0 | 15.72 | 40.0 | 16.06 | 39.8 | 16.77 |
| | -18.8 | -19.0 | 41.0 | 14.19 | 41.0 | 14.88 | 440.8 | 15.57 | 40.8 | 15.91 | 40.6 | 16.26 | 40.6 | 16.95 |
| | -16.7 | -17.0 | 42.6 | 14.66 | 42.4 | 15.33 | 42.4 | 16.00 | 42.2 | 16.32 | 42.2 | 16.67 | 42.0 | 17.31 |
| | -13.7 | -15.0 | 44.4 | 15.16 | 44.2 | 15.80 | 44.0 | 16.43 | 44.0 | 16.75 | 44.0 | 17.07 | 43.8 | 17.70 |
| | -11.8 | -13.0 | 46.2 | 15.67 | 46.2 | 16.28 | 46.0 | 16.88 | 46.0 | 17.18 | 45.8 | 17.48 | 45.8 | 18.11 |
| | -9.8 | -11.0 | 48.4 | 16.17 | 48.2 | 16.75 | 48.2 | 17.33 | 48.0 | 17.64 | 48.0 | 17.92 | 48.0 | 18.50 |
| | -9.5 | -10.0 | 49.6 | 16.43 | 49.4 | 16.99 | 49.2 | 17.57 | 49.2 | 17.85 | 49.2 | 18.13 | 49.0 | 18.69 |
| | -8.5 | -9.1 | 50.6 | 16.64 | 50.4 | 17.20 | 50.4 | 17.76 | 50.4 | 18.04 | 50.2 | 18.33 | 50.2 | 18.86 |
| | -7.0 | -7.6 | 52.4 | 17.03 | 52.4 | 17.55 | 52.2 | 18.09 | 52.2 | 18.37 | 52.8 | 18.63 | 52.0 | 19.17 |
| | -5.0 | -5.6 | 55.2 | 17.51 | 55.0 | 18.02 | 54.8 | 18.52 | 54.8 | 18.78 | 57.4 | 19.04 | 54.6 | 19.55 |
| | -3.0 | -3.7 | 57.8 | 17.96 | 57.8 | 18.43 | 57.6 | 18.93 | 57.6 | 19.17 | 62.2 | 19.40 | 57.4 | 19.90 |
| | 0.0 | -0.7 | 62.4 | 18.63 | 62.4 | 19.08 | 62.2 | 19.53 | 62.2 | 19.75 | 64.8 | 19.99 | 60.4 | 19.60 |
| | 3.0 | 2.2 | 67.4 | 19.25 | 67.2 | 19.66 | 67.2 | 20.07 | 67.0 | 20.27 | 64.8 | 19.45 | 60.4 | 17.83 |
| | 5.0 | 4.1 | 70.8 | 19.62 | 70.8 | 20.03 | 69.4 | 19.83 | 67.0 | 19.04 | 64.8 | 18.28 | 60.4 | 16.77 |
| | 7.0 | 6.0 | 74.4 | 19.99 | 73.8 | 20.11 | 69.4 | 18.63 | 67.0 | 17.89 | 64.8 | 17.18 | 60.4 | 15.78 |
| | 9.0 | 7.9 | 78.2 | 20.31 | 73.8 | 18.91 | 69.4 | 17.53 | 67.0 | 16.84 | 64.8 | 16.17 | 60.4 | 14.88 |
| | 11.0 | 9.8 | 78.2 | 19.10 | 73.8 | 17.79 | 69.4 | 16.49 | 67.0 | 15.87 | 64.8 | 15.24 | 60.4 | 14.03 |
| | 13.0 | 11.8 | 78.2 | 17.92 | 73.8 | 16.69 | 69.4 | 15.50 | 67.0 | 14.92 | 64.8 | 14.34 | 60.4 | 13.22 |
| | 15.0 | 13.7 | 78.2 | 16.88 | 73.8 | 15.74 | 69.4 | 14.64 | 67.0 | 14.08 | 64.8 | 13.56 | 60.4 | 12.50 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100 | -19.8 | -20.0 | 40.2 | 15.09 | 40.0 | 15.72 | 40.0 | 16.36 | 39.8 | 16.69 | 39.8 | 16.99 | 39.6 | 17.64 |
| | -18.8 | -19.0 | 40.8 | 15.29 | 40.8 | 15.91 | 40.6 | 16.54 | 40.6 | 16.86 | 40.4 | 17.18 | 40.4 | 17.81 |
| | -16.7 | -17.0 | 42.4 | 15.72 | 42.2 | 16.32 | 42.2 | 16.92 | 42.2 | 17.23 | 42.0 | 17.53 | 42.0 | 18.13 |
| | -13.7 | -15.0 | 44.2 | 16.17 | 44.0 | 16.75 | 44.0 | 17.33 | 43.8 | 17.64 | 43.8 | 17.92 | 43.6 | 18.50 |
| | -11.8 | -13.0 | 46.0 | 16.64 | 46.0 | 17.18 | 45.8 | 17.74 | 45.8 | 18.02 | 45.8 | 17.66 | 45.6 | 18.86 |
| | -9.8 | -11.0 | 48.2 | 17.10 | 48.0 | 17.64 | 48.0 | 18.15 | 48.0 | 18.43 | 47.8 | 18.69 | 47.8 | 19.21 |
| | -9.5 | -10.0 | 49.4 | 17.33 | 49.2 | 17.85 | 49.2 | 18.37 | 49.0 | 18.63 | 49.0 | 18.89 | 48.8 | 19.40 |
| | -8.5 | -9.1 | 50.4 | 17.53 | 50.4 | 18.04 | 50.2 | 18.54 | 50.2 | 18.80 | 50.0 | 19.06 | 50.0 | 19.55 |
| | -7.0 | -7.6 | 52.2 | 17.87 | 52.2 | 18.37 | 52.0 | 18.84 | 52.0 | 19.10 | 52.0 | 19.34 | 51.8 | 19.83 |
| | -5.0 | -5.6 | 55.0 | 18.33 | 54.8 | 18.78 | 54.8 | 19.25 | 54.6 | 19.49 | 54.6 | 19.70 | 54.6 | 20.18 |
| | -3.0 | -3.7 | 57.6 | 18.73 | 57.6 | 19.17 | 57.4 | 19.62 | 57.4 | 19.83 | 57.4 | 20.05 | 55.0 | 19.21 |
| | 0.0 | -0.7 | 62.2 | 19.36 | 62.2 | 19.75 | 62.0 | 20.16 | 61.0 | 19.83 | 59.0 | 19.02 | 55.0 | 17.46 |
| | 3.0 | 2.2 | 67.2 | 19.90 | 67.0 | 20.27 | 63.0 | 18.76 | 61.0 | 18.02 | 59.0 | 17.31 | 55.0 | 15.89 |
| | 5.0 | 4.1 | 70.6 | 20.27 | 67.0 | 19.04 | 63.0 | 17.64 | 61.0 | 16.97 | 59.0 | 16.30 | 55.0 | 14.98 |
| | 7.0 | 6.0 | 71.0 | 19.23 | 67.0 | 17.89 | 63.0 | 16.60 | 61.0 | 15.98 | 59.0 | 15.35 | 55.0 | 14.12 |
| | 9.0 | 7.9 | 71.0 | 18.07 | 67.0 | 16.84 | 63.0 | 15.63 | 61.0 | 15.05 | 59.0 | 14.47 | 55.0 | 13.32 |
| | 11.0 | 9.8 | 71.0 | 17.01 | 67.0 | 15.87 | 63.0 | 14.75 | 61.0 | 14.19 | 59.0 | 13.65 | 55.0 | 12.59 |
| | 13.0 | 11.8 | 71.0 | 15.98 | 67.0 | 14.92 | 63.0 | 13.88 | 61.0 | 13.37 | 59.0 | 12.87 | 55.0 | 11.88 |
| | 15.0 | 13.7 | 71.0 | 15.07 | 67.0 | 14.08 | 63.0 | 13.11 | 61.0 | 12.63 | 59.0 | 12.16 | 55.0 | 11.25 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | | | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 90 | -19.8 | -20.0 | 40.0 | 16.21 | 39.8 | 16.77 | 39.8 | 17.35 | 39.6 | 17.64 | 39.6 | 17.94 | 39.6 | 18.50 |
| | -18.8 | -19.0 | 40.6 | 16.38 | 40.6 | 16.97 | 40.4 | 17.53 | 40.4 | 17.81 | 40.4 | 18.09 | 40.2 | 18.65 |
| | -16.7 | -17.0 | 42.2 | 16.79 | 42.0 | 17.33 | 42.0 | 17.87 | 42.0 | 18.15 | 41.8 | 18.41 | 41.8 | 18.95 |
| | -13.7 | -15.0 | 44.0 | 17.20 | 43.8 | 17.72 | 43.8 | 18.24 | 43.6 | 18.33 | 43.6 | 18.76 | 43.6 | 19.27 |
| | -11.8 | -13.0 | 45.8 | 17.61 | 45.8 | 18.11 | 45.6 | 18.61 | 45.6 | 18.86 | 45.6 | 19.10 | 45.4 | 19.60 |
| | -9.8 | -11.0 | 48.0 | 18.02 | 48.0 | 18.50 | 47.8 | 18.97 | 47.8 | 19.23 | 47.8 | 19.47 | 47.6 | 19.94 |
| | -9.5 | -10.0 | 49.2 | 18.24 | 49.0 | 18.71 | 49.0 | 19.17 | 48.8 | 19.40 | 48.8 | 19.64 | 48.8 | 20.09 |
| | -8.5 | -9.1 | 50.2 | 18.43 | 50.2 | 18.89 | 50.0 | 19.34 | 50.0 | 19.55 | 50.0 | 19.79 | 49.4 | 19.99 |
| | -7.0 | -7.6 | 52.0 | 18.73 | 52.0 | 19.17 | 51.8 | 19.62 | 51.8 | 19.83 | 51.8 | 20.05 | 49.4 | 19.08 |
| | -5.0 | -5.6 | 54.8 | 19.14 | 54.6 | 19.55 | 54.6 | 19.96 | 54.6 | 20.18 | 53.0 | 19.55 | 49.4 | 17.94 |
| | -3.0 | -3.7 | 57.4 | 19.51 | 57.4 | 17.74 | 56.8 | 19.99 | 54.8 | 19.19 | 53.0 | 18.41 | 49.4 | 16.90 |
| | 0.0 | -0.7 | 62.2 | 20.07 | 60.4 | 17.42 | 56.8 | 18.13 | 54.8 | 17.42 | 53.0 | 16.73 | 49.4 | 15.37 |
| | 3.0 | 2.2 | 64.0 | 19.12 | 60.4 | 17.81 | 56.8 | 16.51 | 54.8 | 15.89 | 53.0 | 15.26 | 49.4 | 14.06 |
| | 5.0 | 4.1 | 64.0 | 17.98 | 60.4 | 16.75 | 56.8 | 15.57 | 54.8 | 14.96 | 53.0 | 14.40 | 49.4 | 13.26 |
| | 7.0 | 6.0 | 64.0 | 16.90 | 60.4 | 15.78 | 56.8 | 14.66 | 54.8 | 14.12 | 53.0 | 13.58 | 49.4 | 12.53 |
| | 9.0 | 7.9 | 64.0 | 15.93 | 60.4 | 14.85 | 56.8 | 13.82 | 54.8 | 13.32 | 53.0 | 12.83 | 49.4 | 11.84 |
| | 11.0 | 9.8 | 64.0 | 15.01 | 60.4 | 14.01 | 56.8 | 13.06 | 54.8 | 12.59 | 53.0 | 12.12 | 49.4 | 11.21 |
| | 13.0 | 11.8 | 64.0 | 14.12 | 60.4 | 13.22 | 56.8 | 12.31 | 54.8 | 11.88 | 53.0 | 11.45 | 49.4 | 10.59 |
| | 15.0 | 13.7 | 64.0 | 13.35 | 60.4 | 12.48 | 56.8 | 11.66 | 54.8 | 11.21 | 53.0 | 10.84 | 49.4 | 10.05 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 80 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 39.8 | 17.33 | 39.6 | 17.83 | 39.6 | 18.35 | 39.6 | 18.61 | 39.4 | 18.86 | 39.4 | 19.36 |
| | -18.8 | -19.0 | 40.4 | 17.48 | 40.4 | 18.00 | 40.2 | 18.50 | 40.2 | 18.76 | 40.2 | 18.99 | 40.0 | 19.51 |
| | -16.7 | -17.0 | 42.0 | 17.85 | 41.8 | 18.33 | 41.8 | 18.82 | 41.8 | 19.06 | 41.8 | 19.30 | 41.6 | 19.77 |
| | -13.7 | -15.0 | 43.8 | 18.22 | 43.6 | 18.67 | 43.6 | 19.14 | 43.6 | 19.36 | 43.4 | 19.60 | 43.4 | 20.07 |
| | -11.8 | -13.0 | 45.6 | 18.58 | 45.6 | 19.04 | 45.4 | 19.47 | 45.4 | 19.68 | 45.4 | 19.92 | 44.0 | 19.38 |
| | -9.8 | -11.0 | 47.8 | 18.95 | 47.8 | 19.38 | 47.6 | 19.81 | 47.6 | 20.01 | 47.2 | 19.96 | 44.0 | 18.30 |
| | -9.5 | -10.0 | 49.0 | 19.14 | 48.8 | 19.55 | 48.8 | 19.96 | 48.8 | 20.18 | 47.2 | 19.38 | 44.0 | 17.76 |
| | -8.5 | -9.1 | 50.0 | 19.32 | 50.0 | 19.73 | 49.8 | 20.11 | 48.8 | 19.68 | 47.2 | 18.86 | 44.0 | 17.29 |
| | -7.0 | -7.6 | 51.8 | 19.60 | 51.8 | 19.99 | 50.4 | 19.55 | 48.8 | 18.78 | 47.2 | 18.02 | 44.0 | 16.60 |
| | -5.0 | -5.6 | 54.6 | 17.79 | 53.6 | 19.83 | 50.4 | 18.37 | 48.8 | 17.66 | 47.2 | 16.95 | 44.0 | 15.57 |
| | -3.0 | -3.7 | 56.8 | 17.89 | 53.6 | 18.67 | 50.4 | 17.29 | 48.8 | 16.71 | 47.2 | 15.98 | 44.0 | 14.70 |
| | 0.0 | -0.7 | 56.8 | 18.20 | 53.6 | 16.95 | 50.4 | 15.74 | 48.8 | 15.16 | 47.2 | 14.55 | 44.0 | 13.41 |
| | 3.0 | 2.2 | 56.8 | 16.58 | 53.6 | 15.46 | 50.4 | 14.38 | 48.8 | 13.84 | 47.2 | 13.32 | 44.0 | 12.29 |
| | 5.0 | 4.1 | 56.8 | 15.61 | 53.6 | 14.57 | 50.4 | 13.56 | 48.8 | 13.06 | 47.2 | 12.59 | 44.0 | 11.62 |
| | 7.0 | 6.0 | 56.8 | 14.70 | 53.6 | 13.78 | 50.4 | 12.81 | 48.8 | 12.35 | 47.2 | 11.90 | 44.0 | 11.00 |
| | 9.0 | 7.9 | 56.8 | 13.88 | 53.6 | 12.98 | 50.4 | 12.16 | 48.8 | 11.66 | 47.2 | 11.25 | 44.0 | 10.41 |
| | 11.0 | 9.8 | 56.8 | 13.11 | 53.6 | 12.27 | 50.4 | 11.45 | 48.8 | 11.04 | 47.2 | 10.65 | 44.0 | 9.87 |
| | 13.0 | 11.8 | 56.8 | 12.35 | 53.6 | 11.58 | 50.4 | 10.82 | 48.8 | 10.43 | 47.2 | 10.07 | 44.0 | 9.34 |
| | 15.0 | 13.7 | 56.8 | 11.68 | 53.6 | 10.97 | 50.4 | 10.26 | 48.8 | 9.90 | 47.2 | 9.55 | 44.0 | 8.88 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|--------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 70 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 39.6 | 18.45 | 39.4 | 18.89 | 39.4 | 19.34 | 39.4 | 19.55 | 39.4 | 19.79 | 38.4 | 19.58 |
| | -18.8 | -19.0 | 40.2 | 18.61 | 40.2 | 19.04 | 40.0 | 19.47 | 40.0 | 19.68 | 40.0 | 19.92 | 38.4 | 19.17 |
| | -16.7 | -17.0 | 41.8 | 18.91 | 41.8 | 19.34 | 41.6 | 19.75 | 41.6 | 19.96 | 41.2 | 19.94 | 38.4 | 18.28 |
| | -13.7 | -15.0 | 43.6 | 19.23 | 43.4 | 19.64 | 43.4 | 20.05 | 42.6 | 192.22 | 41.2 | 18.95 | 38.4 | 17.38 |
| | -11.8 | -13.0 | 45.4 | 19.55 | 45.4 | 19.94 | 44.2 | 19.47 | 42.6 | 18.71 | 41.2 | 17.96 | 38.4 | 16.47 |
| | -9.8 | -11.0 | 47.6 | 19.88 | 47.0 | 19.86 | 44.2 | 18.39 | 42.6 | 17.68 | 41.2 | 16.97 | 38.4 | 15.59 |
| | -9.5 | -10.0 | 48.8 | 20.05 | 47.0 | 19.27 | 44.2 | 17.85 | 42.6 | 17.16 | 41.2 | 16.49 | 38.4 | 15.16 |
| | -8.5 | -9.1 | 49.8 | 20.16 | 47.0 | 18.76 | 44.2 | 17.38 | 42.6 | 16.71 | 41.2 | 16.06 | 38.4 | 14.77 |
| | -7.0 | -7.6 | 49.8 | 19.25 | 47.0 | 17.92 | 44.2 | 16.62 | 42.6 | 16.00 | 41.2 | 15.37 | 38.4 | 14.14 |
| | -5.0 | -5.6 | 49.8 | 18.09 | 47.0 | 16.86 | 44.2 | 15.65 | 42.6 | 15.05 | 41.2 | 14.47 | 38.4 | 13.35 |
| | -3.0 | -3.7 | 49.8 | 17.03 | 47.0 | 15.89 | 44.2 | 14.77 | 42.6 | 14.21 | 41.2 | 13.67 | 38.4 | 12.61 |
| | 0.0 | -0.7 | 49.8 | 15.50 | 47.0 | 14.55 | 44.2 | 13.47 | 42.6 | 12.98 | 41.2 | 12.50 | 38.4 | 11.56 |
| | 3.0 | 2.2 | 49.8 | 14.16 | 47.0 | 0.32 | 44.2 | 12.35 | 42.6 | 11.90 | 41.2 | 11.47 | 38.4 | 10.61 |
| | 5.0 | 4.1 | 49.8 | 13.37 | 47.0 | 12.50 | 44.2 | 11.68 | 42.6 | 11.25 | 41.2 | 10.87 | 38.4 | 10.05 |
| | 7.0 | 6.0 | 49.8 | 12.63 | 47.0 | 11.84 | 44.2 | 11.04 | 42.6 | 10.65 | 41.2 | 10.28 | 38.4 | 9.53 |
| | 9.0 | 7.9 | 49.8 | 11.94 | 47.0 | 11.19 | 44.2 | 10.46 | 42.6 | 10.09 | 41.2 | 9.74 | 38.4 | 9.03 |
| | 11.0 | 9.8 | 49.8 | 11.30 | 47.0 | 10.59 | 44.2 | 9.92 | 42.6 | 9.57 | 41.2 | 9.25 | 38.4 | 8.58 |
| | 13.0 | 11.8 | 49.8 | 10.67 | 47.0 | 10.02 | 44.2 | 9.38 | 42.6 | 9.08 | 41.2 | 8.75 | 38.4 | 8.15 |
| | 15.0 | 13.7 | 49.8 | 10.11 | 47.0 | 9.51 | 44.2 | 8.90 | 42.6 | 8.62 | 41.2 | 8.32 | 38.4 | 7.76 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60 | -19.8 | -20.0 | 39.4 | 19.58 | 39.2 | 19.94 | 37.8 | 19.19 | 36.6 | 18.43 | 35.4 | 17.70 | 33.0 | 16.23 |
| | -18.8 | -19.0 | 40.0 | 19.70 | 40.0 | 20.07 | 37.8 | 18.78 | 36.6 | 18.04 | 35.4 | 17.31 | 33.0 | 15.89 |
| | -16.7 | -17.0 | 41.6 | 19.96 | 40.2 | 19.34 | 37.8 | 17.92 | 36.6 | 17.23 | 35.4 | 16.54 | 33.0 | 15.20 |
| | -13.7 | -15.0 | 42.6 | 19.75 | 40.2 | 18.37 | 37.8 | 17.03 | 36.6 | 16.38 | 35.4 | 15.74 | 33.0 | 14.47 |
| | -11.8 | -13.0 | 42.6 | 18.69 | 40.2 | 17.40 | 37.8 | 16.15 | 36.6 | 15.54 | 35.4 | 14.94 | 33.0 | 13.75 |
| | -9.8 | -11.0 | 42.6 | 17.66 | 40.2 | 16.45 | 37.8 | 15.29 | 36.6 | 14.70 | 35.4 | 14.14 | 33.0 | 13.04 |
| | -9.5 | -10.0 | 42.6 | 17.16 | 40.2 | 16.00 | 37.8 | 14.85 | 36.6 | 14.32 | 35.4 | 13.75 | 33.0 | 12.68 |
| | -8.5 | -9.1 | 42.6 | 16.71 | 40.2 | 15.59 | 37.8 | 14.49 | 36.6 | 13.95 | 35.4 | 13.41 | 33.0 | 12.37 |
| | -7.0 | -7.6 | 42.6 | 15.98 | 40.2 | 14.92 | 37.8 | 13.86 | 36.6 | 13.37 | 35.4 | 12.85 | 33.0 | 11.88 |
| | -5.0 | -5.6 | 42.6 | 15.05 | 40.2 | 14.06 | 37.8 | 13.09 | 36.6 | 12.61 | 35.4 | 12.14 | 33.0 | 11.23 |
| | -3.0 | -3.7 | 42.6 | 14.21 | 40.2 | 13.28 | 37.8 | 12.42 | 36.6 | 11.94 | 35.4 | 11.49 | 33.0 | 10.63 |
| | 0.0 | -0.7 | 42.6 | 12.98 | 40.2 | 12.16 | 37.8 | 11.34 | 36.6 | 10.95 | 35.4 | 10.54 | 33.0 | 9.77 |
| | 3.0 | 2.2 | 42.6 | 11.90 | 40.2 | 11.17 | 37.8 | 10.43 | 36.6 | 10.07 | 35.4 | 9.72 | 33.0 | 0.39 |
| | 5.0 | 4.1 | 42.6 | 11.25 | 40.2 | 10.56 | 37.8 | 9.87 | 36.6 | 9.55 | 35.4 | 9.21 | 33.0 | 8.56 |
| | 7.0 | 6.0 | 42.6 | 10.65 | 40.2 | 10.00 | 37.8 | 9.36 | 36.6 | 9.05 | 35.4 | 8.75 | 33.0 | 8.13 |
| | 9.0 | 7.9 | 42.6 | 10.09 | 40.2 | 9.49 | 37.8 | 8.88 | 36.6 | 8.60 | 35.4 | 8.30 | 33.0 | 7.74 |
| | 11.0 | 9.8 | 42.6 | 9.57 | 40.2 | 9.01 | 37.8 | 8.45 | 36.6 | 8.17 | 35.4 | 7.89 | 33.0 | 7.37 |
| | 13.0 | 11.8 | 42.6 | 9.05 | 40.2 | 8.54 | 37.8 | 8.02 | 36.6 | 7.76 | 35.4 | 7.50 | 33.0 | 7.01 |
| | 15.0 | 13.7 | 42.6 | 8.62 | 40.2 | 8.11 | 37.8 | 7.63 | 36.6 | 7.39 | 35.4 | 7.16 | 33.0 | 6.68 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 50 | -19.8 | -20.0 | 35.6 | 17.81 | 33.6 | 16.58 | 31.6 | 15.39 | 30.4 | 14.83 | 29.4 | 14.25 | 27.4 | 13.13 |
| | -18.8 | -19.0 | 35.6 | 17.42 | 33.6 | 16.23 | 31.6 | 15.09 | 30.4 | 14.51 | 29.4 | 13.95 | 27.4 | 12.87 |
| | -16.7 | -17.0 | 35.6 | 16.62 | 33.6 | 15.50 | 31.6 | 14.42 | 30.4 | 13.88 | 29.4 | 13.37 | 27.4 | 12.33 |
| | -13.7 | -15.0 | 35.6 | 15.82 | 33.6 | 14.77 | 31.6 | 13.73 | 30.4 | 13.24 | 29.4 | 12.74 | 27.4 | 11.77 |
| | -11.8 | -13.0 | 35.6 | 15.03 | 33.6 | 14.06 | 31.6 | 13.06 | 30.4 | 12.59 | 29.4 | 12.12 | 27.4 | 11.21 |
| | -9.8 | -11.0 | 35.6 | 14.23 | 33.6 | 13.30 | 31.6 | 12.40 | 30.4 | 11.94 | 29.4 | 11.51 | 27.4 | 10.65 |
| | -9.5 | -10.0 | 35.6 | 13.84 | 33.6 | 12.94 | 31.6 | 12.07 | 30.4 | 11.64 | 29.4 | 11.21 | 27.4 | 10.37 |
| | -8.5 | -9.1 | 35.6 | 13.50 | 33.6 | 12.63 | 31.6 | 11.77 | 30.4 | 11.36 | 29.4 | 10.95 | 27.4 | 10.13 |
| | -7.0 | -7.6 | 35.6 | 12.94 | 33.6 | 12.16 | 31.6 | 11.30 | 30.4 | 10.91 | 29.4 | 10.52 | 27.4 | 9.74 |
| | -5.0 | -5.6 | 35.6 | 12.20 | 33.6 | 11.45 | 31.6 | 10.69 | 30.4 | 10.33 | 29.4 | 9.96 | 27.4 | 9.23 |
| | -3.0 | -3.7 | 35.6 | 11.56 | 33.6 | 10.84 | 31.6 | 10.13 | 30.4 | 9.79 | 29.4 | 9.44 | 27.4 | 8.77 |
| | 0.0 | -0.7 | 35.6 | 10.61 | 33.6 | 9.96 | 31.6 | 9.34 | 30.4 | 9.01 | 29.4 | 8.71 | 27.4 | 8.11 |
| | 3.0 | 2.2 | 35.6 | 9.77 | 33.6 | 9.18 | 31.6 | 8.60 | 30.4 | 8.32 | 29.4 | 8.06 | 27.4 | 7.50 |
| | 5.0 | 4.1 | 35.6 | 9.27 | 33.6 | 8.71 | 31.6 | 8.17 | 30.4 | 7.91 | 29.4 | 7.65 | 27.4 | 7.14 |
| | 7.0 | 6.0 | 35.6 | 8.80 | 33.6 | 8.28 | 31.6 | 7.78 | 30.4 | 7.52 | 29.4 | 7.29 | 27.4 | 6.81 |
| | 9.0 | 7.9 | 35.6 | 8.34 | 33.6 | 7.87 | 31.6 | 7.39 | 30.4 | 7.18 | 29.4 | 6.94 | 27.4 | 6.49 |
| | 11.0 | 9.8 | 35.6 | 7.93 | 33.6 | 7.48 | 31.6 | 7.05 | 30.4 | 6.83 | 29.4 | 6.62 | 27.4 | 6.19 |
| | 13.0 | 11.8 | 35.6 | 7.55 | 33.6 | 7.11 | 31.6 | 6.70 | 30.4 | 6.51 | 29.4 | 6.30 | 27.4 | 5.91 |
| | 15.0 | 13.7 | 35.6 | 7.18 | 33.6 | 6.79 | 31.6 | 6.40 | 30.4 | 6.21 | 29.4 | 6.01 | 27.4 | 5.63 |

CHV-5S615NMX
TC—Total capacity of outdoor unit; PI—Power input of outdoor unit

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | °CDB | °CWB | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 130 | -19.8 | -20.0 | 44.7 | 13.35 | 44.5 | 14.29 | 44.2 | 15.24 | 44.2 | 15.71 | 44.0 | 16.18 | 44.0 | 17.13 |
| | -18.8 | -19.0 | 45.3 | 13.65 | 45.1 | 14.58 | 45.1 | 15.51 | 44.9 | 15.98 | 44.9 | 16.42 | 44.7 | 17.35 |
| | -16.7 | -17.0 | 47.1 | 14.29 | 46.9 | 15.17 | 46.7 | 16.08 | 46.7 | 16.45 | 46.7 | 16.96 | 46.4 | 17.87 |
| | -13.7 | -15.0 | 49.1 | 14.95 | 48.8 | 15.81 | 48.6 | 16.67 | 48.6 | 17.08 | 48.4 | 17.53 | 48.4 | 18.38 |
| | -11.8 | -13.0 | 51.0 | 15.61 | 51.0 | 16.45 | 50.8 | 17.26 | 50.6 | 17.67 | 50.6 | 18.09 | 50.4 | 18.90 |
| | -9.8 | -11.0 | 53.4 | 16.30 | 53.2 | 17.08 | 53.0 | 17.87 | 53.0 | 18.26 | 53.0 | 18.65 | 52.8 | 19.44 |
| | -9.5 | -10.0 | 54.8 | 16.64 | 54.5 | 17.40 | 54.3 | 18.16 | 54.3 | 18.56 | 54.1 | 18.92 | 54.1 | 19.69 |
| | -8.5 | -9.1 | 55.9 | 16.94 | 55.6 | 17.67 | 55.6 | 18.43 | 55.4 | 18.80 | 55.4 | 19.17 | 55.2 | 19.93 |
| | -7.0 | -7.6 | 57.8 | 17.43 | 57.8 | 18.16 | 57.6 | 18.88 | 57.6 | 19.24 | 57.4 | 19.59 | 57.2 | 20.32 |
| | -5.0 | -5.6 | 60.9 | 18.09 | 60.7 | 18.41 | 60.5 | 19.46 | 60.5 | 19.81 | 60.2 | 20.13 | 60.2 | 20.82 |
| | -3.0 | -3.7 | 63.7 | 18.68 | 63.5 | 19.34 | 63.5 | 19.98 | 63.3 | 20.32 | 63.3 | 20.64 | 63.1 | 21.28 |
| | 0.0 | -0.7 | 68.8 | 19.59 | 68.8 | 20.20 | 68.6 | 20.79 | 68.6 | 21.09 | 68.3 | 21.40 | 68.3 | 21.99 |
| | 3.0 | 2.2 | 74.3 | 20.40 | 74.0 | 20.96 | 73.8 | 21.53 | 73.8 | 21.80 | 73.8 | 22.09 | 73.6 | 22.63 |
| | 5.0 | 4.1 | 78.0 | 20.91 | 77.8 | 21.45 | 77.8 | 21.97 | 77.5 | 22.24 | 77.5 | 22.51 | 77.3 | 23.02 |
| | 7.0 | 6.0 | 81.9 | 21.40 | 81.7 | 21.90 | 81.7 | 22.41 | 81.5 | 20.20 | 81.5 | 22.90 | 78.2 | 21.99 |
| | 9.0 | 7.9 | 86.1 | 21.85 | 85.9 | 22.34 | 85.9 | 22.80 | 85.6 | 23.05 | 83.9 | 22.58 | 78.2 | 20.67 |
| | 11.0 | 9.8 | 90.5 | 22.29 | 90.2 | 22.73 | 89.8 | 23.02 | 86.7 | 22.12 | 83.9 | 21.21 | 78.2 | 19.46 |
| | 13.0 | 11.8 | 95.3 | 22.71 | 95.1 | 23.15 | 89.8 | 21.58 | 86.7 | 20.72 | 83.9 | 19.91 | 78.2 | 18.26 |
| | 15.0 | 13.7 | 99.9 | 23.10 | 95.5 | 21.92 | 89.8 | 20.32 | 86.7 | 19.54 | 83.9 | 18.75 | 78.2 | 17.23 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | °CDB | °CWB | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 120 | -19.8 | -20.0 | 44.5 | 14.63 | 44.2 | 15.49 | 44.0 | 16.37 | 44.0 | 16.79 | 44.0 | 17.23 | 43.8 | 18.11 |
| | -18.8 | -19.0 | 45.1 | 14.90 | 44.9 | 15.76 | 44.9 | 16.45 | 44.7 | 17.03 | 44.7 | 17.48 | 44.5 | 18.34 |
| | -16.7 | -17.0 | 46.9 | 15.49 | 46.7 | 16.32 | 46.7 | 17.13 | 46.4 | 17.55 | 46.4 | 17.97 | 46.2 | 18.78 |
| | -13.7 | -15.0 | 48.8 | 16.10 | 48.6 | 16.89 | 48.4 | 17.67 | 48.4 | 18.09 | 48.4 | 18.48 | 48.2 | 19.27 |
| | -11.8 | -13.0 | 50.8 | 16.72 | 50.8 | 17.48 | 50.6 | 18.24 | 50.6 | 18.63 | 50.4 | 19.00 | 50.4 | 19.76 |
| | -9.8 | -11.0 | 53.2 | 17.35 | 53.0 | 18.07 | 53.0 | 18.80 | 52.8 | 19.17 | 52.8 | 19.51 | 52.6 | 20.27 |
| | -9.5 | -10.0 | 54.5 | 17.67 | 54.3 | 18.38 | 54.1 | 19.07 | 54.1 | 19.44 | 54.1 | 19.64 | 53.9 | 20.50 |
| | -8.5 | -9.1 | 55.6 | 17.94 | 55.4 | 18.63 | 55.4 | 19.32 | 55.2 | 19.66 | 55.2 | 20.03 | 55.0 | 20.72 |
| | -7.0 | -7.6 | 57.6 | 18.41 | 57.6 | 19.07 | 57.4 | 19.73 | 57.4 | 20.08 | 57.2 | 20.40 | 57.2 | 21.06 |
| | -5.0 | -5.6 | 60.7 | 19.00 | 60.5 | 19.64 | 60.2 | 20.27 | 60.2 | 20.59 | 60.2 | 20.91 | 60.0 | 21.53 |
| | -3.0 | -3.7 | 63.5 | 19.56 | 63.5 | 20.18 | 63.3 | 20.77 | 63.3 | 21.06 | 63.1 | 21.38 | 63.1 | 21.97 |
| | 0.0 | -0.7 | 68.6 | 20.40 | 68.6 | 20.96 | 68.3 | 21.77 | 68.3 | 21.80 | 68.1 | 22.07 | 68.1 | 22.63 |
| | 3.0 | 2.2 | 74.0 | 21.16 | 73.8 | 21.67 | 73.8 | 22.19 | 73.6 | 22.46 | 73.6 | 22.71 | 72.1 | 22.58 |
| | 5.0 | 4.1 | 77.8 | 21.63 | 77.5 | 22.12 | 77.5 | 22.61 | 77.3 | 22.85 | 77.3 | 23.10 | 72.1 | 21.21 |
| | 7.0 | 6.0 | 81.7 | 22.07 | 81.7 | 22.53 | 81.5 | 23.00 | 80.2 | 22.68 | 77.5 | 21.75 | 72.1 | 19.96 |
| | 9.0 | 7.9 | 85.9 | 22.51 | 85.6 | 22.95 | 82.8 | 22.19 | 80.2 | 21.31 | 77.5 | 20.45 | 72.1 | 18.78 |
| | 11.0 | 9.8 | 90.2 | 22.90 | 88.1 | 22.51 | 82.8 | 20.86 | 80.2 | 20.05 | 77.5 | 19.24 | 72.1 | 17.70 |
| | 13.0 | 11.8 | 93.5 | 22.68 | 88.1 | 21.11 | 82.8 | 19.56 | 80.2 | 18.83 | 77.5 | 18.09 | 72.1 | 16.64 |
| | 15.0 | 13.7 | 93.5 | 21.36 | 88.1 | 19.88 | 82.8 | 18.46 | 80.2 | 17.75 | 77.5 | 17.06 | 72.1 | 15.71 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|-------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 110 | -19.8 | -20.0 | 44.2 | 15.91 | 44.0 | 16.69 | 43.8 | 17.50 | 43.8 | 17.89 | 43.8 | 18.29 | 43.6 | 19.10 |
| | -18.8 | -19.0 | 44.9 | 16.15 | 44.9 | 16.94 | 482.8 | 17.72 | 44.7 | 18.11 | 44.5 | 18.51 | 44.5 | 19.29 |
| | -16.7 | -17.0 | 46.7 | 16.69 | 46.4 | 17.45 | 46.4 | 18.21 | 46.2 | 18.58 | 46.2 | 18.97 | 46.0 | 19.71 |
| | -13.7 | -15.0 | 48.6 | 17.26 | 48.4 | 17.99 | 48.2 | 18.70 | 48.2 | 19.07 | 48.2 | 19.44 | 48.0 | 20.15 |
| | -11.8 | -13.0 | 50.6 | 17.84 | 50.6 | 18.53 | 50.4 | 19.22 | 50.4 | 19.56 | 50.2 | 19.91 | 50.2 | 20.62 |
| | -9.8 | -11.0 | 53.0 | 18.41 | 52.8 | 19.07 | 52.8 | 19.73 | 52.6 | 20.08 | 52.6 | 20.40 | 52.6 | 21.06 |
| | -9.5 | -10.0 | 54.3 | 18.70 | 54.1 | 19.34 | 53.9 | 20.00 | 53.9 | 20.32 | 53.9 | 20.64 | 53.7 | 21.28 |
| | -8.5 | -9.1 | 55.4 | 18.95 | 55.2 | 19.59 | 55.2 | 20.23 | 55.2 | 20.55 | 55.0 | 20.86 | 55.0 | 21.48 |
| | -7.0 | -7.6 | 57.4 | 19.39 | 57.4 | 19.98 | 57.2 | 20.59 | 57.2 | 20.91 | 57.8 | 21.21 | 57.0 | 21.82 |
| | -5.0 | -5.6 | 60.5 | 19.93 | 60.2 | 20.52 | 60.0 | 21.09 | 60.0 | 21.38 | 62.9 | 21.67 | 59.8 | 22.26 |
| | -3.0 | -3.7 | 63.3 | 20.45 | 63.3 | 20.99 | 63.1 | 21.55 | 63.1 | 21.82 | 68.1 | 22.09 | 62.9 | 22.66 |
| | 0.0 | -0.7 | 68.3 | 21.21 | 68.3 | 21.72 | 68.1 | 22.24 | 68.1 | 22.48 | 71.0 | 22.75 | 66.2 | 22.31 |
| | 3.0 | 2.2 | 73.8 | 21.92 | 73.6 | 22.39 | 73.6 | 22.85 | 73.4 | 23.07 | 71.0 | 22.14 | 66.2 | 20.30 |
| | 5.0 | 4.1 | 77.5 | 22.34 | 77.5 | 22.80 | 76.0 | 22.58 | 73.4 | 21.67 | 71.0 | 20.82 | 66.2 | 19.10 |
| | 7.0 | 6.0 | 81.5 | 22.75 | 80.8 | 22.90 | 76.0 | 21.21 | 73.4 | 20.37 | 71.0 | 19.56 | 66.2 | 17.97 |
| | 9.0 | 7.9 | 85.6 | 23.12 | 80.8 | 21.53 | 76.0 | 19.96 | 73.4 | 19.17 | 71.0 | 18.41 | 66.2 | 16.94 |
| | 11.0 | 9.8 | 85.6 | 21.75 | 80.8 | 20.25 | 76.0 | 18.78 | 73.4 | 18.07 | 71.0 | 17.35 | 66.2 | 15.98 |
| | 13.0 | 11.8 | 85.6 | 20.40 | 80.8 | 19.00 | 76.0 | 17.65 | 73.4 | 16.99 | 71.0 | 16.32 | 66.2 | 15.05 |
| | 15.0 | 13.7 | 85.6 | 19.22 | 80.8 | 17.92 | 76.0 | 16.67 | 73.4 | 16.03 | 71.0 | 15.44 | 66.2 | 14.24 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 100 | -19.8 | -20.0 | 44.0 | 17.18 | 43.8 | 17.89 | 43.8 | 18.63 | 43.6 | 19.00 | 43.6 | 19.34 | 43.4 | 20.08 |
| | -18.8 | -19.0 | 44.7 | 17.40 | 44.7 | 18.11 | 44.5 | 18.83 | 44.5 | 19.19 | 44.2 | 19.56 | 44.2 | 20.27 |
| | -16.7 | -17.0 | 46.4 | 17.89 | 46.2 | 18.58 | 46.2 | 19.27 | 46.2 | 19.61 | 46.0 | 19.96 | 46.0 | 20.64 |
| | -13.7 | -15.0 | 48.4 | 18.41 | 48.2 | 19.07 | 48.2 | 19.73 | 48.0 | 20.08 | 48.0 | 20.40 | 47.8 | 21.06 |
| | -11.8 | -13.0 | 50.4 | 18.95 | 50.4 | 19.56 | 50.2 | 20.20 | 50.2 | 20.52 | 50.2 | 20.10 | 49.9 | 21.48 |
| | -9.8 | -11.0 | 52.8 | 19.46 | 52.6 | 20.08 | 52.6 | 20.67 | 52.6 | 20.99 | 52.4 | 21.28 | 52.4 | 21.87 |
| | -9.5 | -10.0 | 54.1 | 19.73 | 53.9 | 20.32 | 53.9 | 20.91 | 53.7 | 21.21 | 53.7 | 21.50 | 53.4 | 22.09 |
| | -8.5 | -9.1 | 55.2 | 19.96 | 55.2 | 20.55 | 55.0 | 21.11 | 55.0 | 21.40 | 54.8 | 21.70 | 54.8 | 22.26 |
| | -7.0 | -7.6 | 57.2 | 20.35 | 57.2 | 20.91 | 57.0 | 21.45 | 57.0 | 21.75 | 57.0 | 22.02 | 56.7 | 22.58 |
| | -5.0 | -5.6 | 60.2 | 20.86 | 60.0 | 21.38 | 60.0 | 21.92 | 59.8 | 22.19 | 59.8 | 22.44 | 59.8 | 22.98 |
| | -3.0 | -3.7 | 63.1 | 21.33 | 63.1 | 21.82 | 62.9 | 22.34 | 62.9 | 22.58 | 62.9 | 22.83 | 60.2 | 21.87 |
| | 0.0 | -0.7 | 68.1 | 22.04 | 68.1 | 22.48 | 67.9 | 22.95 | 66.8 | 22.58 | 64.6 | 21.65 | 60.2 | 19.88 |
| | 3.0 | 2.2 | 73.6 | 22.66 | 73.4 | 23.07 | 69.0 | 21.36 | 66.8 | 20.52 | 64.6 | 19.71 | 60.2 | 18.09 |
| | 5.0 | 4.1 | 77.3 | 23.07 | 73.4 | 21.67 | 69.0 | 20.08 | 66.8 | 19.32 | 64.6 | 18.56 | 60.2 | 17.06 |
| | 7.0 | 6.0 | 77.8 | 21.90 | 73.4 | 20.37 | 69.0 | 18.90 | 66.8 | 18.19 | 64.6 | 17.48 | 60.2 | 16.08 |
| | 9.0 | 7.9 | 77.8 | 20.57 | 73.4 | 19.17 | 69.0 | 17.80 | 66.8 | 17.13 | 64.6 | 16.47 | 60.2 | 15.17 |
| | 11.0 | 9.8 | 77.8 | 19.37 | 73.4 | 18.07 | 69.0 | 16.79 | 66.8 | 16.15 | 64.6 | 15.54 | 60.2 | 14.33 |
| | 13.0 | 11.8 | 77.8 | 18.19 | 73.4 | 16.99 | 69.0 | 15.81 | 66.8 | 15.22 | 64.6 | 14.65 | 60.2 | 13.52 |
| | 15.0 | 13.7 | 77.8 | 17.16 | 73.4 | 16.03 | 69.0 | 14.92 | 66.8 | 14.38 | 64.6 | 13.84 | 60.2 | 12.81 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 90 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 43.8 | 18.46 | 43.6 | 19.10 | 43.6 | 19.76 | 43.4 | 20.08 | 43.4 | 20.42 | 43.4 | 21.06 |
| | -18.8 | -19.0 | 44.5 | 18.65 | 44.5 | 19.32 | 44.2 | 19.96 | 44.2 | 20.27 | 44.2 | 20.59 | 44.0 | 21.23 |
| | -16.7 | -17.0 | 46.2 | 19.12 | 46.0 | 19.73 | 46.0 | 20.35 | 46.0 | 20.67 | 45.8 | 20.96 | 45.8 | 21.58 |
| | -13.7 | -15.0 | 48.2 | 19.59 | 48.0 | 20.18 | 48.0 | 20.77 | 47.8 | 20.86 | 47.8 | 21.36 | 47.8 | 21.94 |
| | -11.8 | -13.0 | 50.2 | 20.05 | 50.2 | 20.62 | 49.9 | 21.18 | 49.9 | 21.48 | 49.9 | 21.75 | 49.7 | 22.31 |
| | -9.8 | -11.0 | 52.6 | 20.52 | 52.6 | 21.06 | 52.4 | 21.60 | 52.4 | 21.90 | 52.4 | 22.17 | 52.1 | 22.71 |
| | -9.5 | -10.0 | 53.9 | 20.77 | 53.7 | 21.31 | 53.7 | 21.82 | 53.4 | 22.09 | 53.4 | 22.36 | 53.4 | 22.88 |
| | -8.5 | -9.1 | 55.0 | 20.99 | 55.0 | 21.50 | 54.8 | 22.02 | 54.8 | 22.26 | 54.8 | 22.53 | 54.1 | 22.75 |
| | -7.0 | -7.6 | 57.0 | 21.33 | 57.0 | 21.82 | 56.7 | 22.34 | 56.7 | 22.58 | 56.7 | 22.83 | 54.1 | 21.72 |
| | -5.0 | -5.6 | 60.0 | 21.80 | 59.8 | 22.26 | 59.8 | 22.73 | 59.8 | 22.98 | 58.0 | 22.26 | 54.1 | 20.42 |
| | -3.0 | -3.7 | 62.9 | 22.21 | 62.9 | 20.20 | 62.2 | 22.75 | 60.0 | 21.85 | 58.0 | 20.96 | 54.1 | 19.24 |
| | 0.0 | -0.7 | 68.1 | 22.85 | 66.2 | 19.83 | 62.2 | 20.64 | 60.0 | 19.83 | 58.0 | 19.05 | 54.1 | 17.50 |
| | 3.0 | 2.2 | 70.1 | 21.77 | 66.2 | 20.27 | 62.2 | 18.80 | 60.0 | 18.09 | 58.0 | 17.38 | 54.1 | 16.00 |
| | 5.0 | 4.1 | 70.1 | 20.47 | 66.2 | 19.07 | 62.2 | 17.72 | 60.0 | 17.03 | 58.0 | 16.40 | 54.1 | 15.10 |
| | 7.0 | 6.0 | 70.1 | 19.24 | 66.2 | 17.97 | 62.2 | 16.69 | 60.0 | 16.08 | 58.0 | 15.46 | 54.1 | 14.26 |
| | 9.0 | 7.9 | 70.1 | 18.14 | 66.2 | 16.91 | 62.2 | 15.73 | 60.0 | 15.17 | 58.0 | 14.60 | 54.1 | 13.48 |
| | 11.0 | 9.8 | 70.1 | 17.08 | 66.2 | 15.95 | 62.2 | 14.87 | 60.0 | 14.33 | 58.0 | 13.79 | 54.1 | 12.76 |
| | 13.0 | 11.8 | 70.1 | 16.08 | 66.2 | 15.05 | 62.2 | 14.02 | 60.0 | 13.52 | 58.0 | 13.03 | 54.1 | 12.05 |
| | 15.0 | 13.7 | 70.1 | 15.19 | 66.2 | 14.21 | 62.2 | 13.28 | 60.0 | 12.76 | 58.0 | 12.35 | 54.1 | 11.44 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 80 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 43.6 | 19.73 | 43.4 | 20.30 | 43.4 | 20.89 | 43.4 | 21.18 | 43.2 | 21.48 | 43.2 | 22.04 |
| | -18.8 | -19.0 | 44.2 | 19.91 | 44.2 | 20.50 | 44.0 | 21.06 | 44.0 | 21.36 | 44.0 | 21.63 | 43.8 | 22.21 |
| | -16.7 | -17.0 | 46.0 | 20.32 | 45.8 | 20.86 | 45.8 | 21.43 | 45.8 | 21.70 | 45.8 | 21.97 | 45.6 | 22.51 |
| | -13.7 | -15.0 | 48.0 | 20.74 | 47.8 | 21.26 | 47.8 | 21.80 | 47.8 | 22.04 | 47.5 | 22.31 | 47.5 | 22.85 |
| | -11.8 | -13.0 | 49.9 | 21.16 | 49.9 | 21.67 | 49.7 | 22.17 | 49.7 | 22.41 | 49.7 | 22.68 | 48.2 | 22.07 |
| | -9.8 | -11.0 | 52.4 | 21.58 | 52.4 | 22.07 | 52.1 | 22.56 | 52.1 | 22.78 | 51.7 | 22.73 | 48.2 | 20.84 |
| | -9.5 | -10.0 | 53.7 | 21.80 | 53.4 | 22.26 | 53.4 | 22.73 | 53.4 | 22.98 | 51.7 | 22.07 | 48.2 | 20.23 |
| | -8.5 | -9.1 | 54.8 | 21.99 | 54.8 | 22.46 | 54.5 | 22.90 | 53.4 | 22.41 | 51.7 | 21.48 | 48.2 | 19.69 |
| | -7.0 | -7.6 | 56.7 | 22.31 | 56.7 | 22.75 | 55.2 | 22.26 | 53.4 | 21.38 | 51.7 | 20.52 | 48.2 | 18.90 |
| | -5.0 | -5.6 | 59.8 | 20.25 | 58.7 | 22.58 | 55.2 | 20.91 | 53.4 | 20.10 | 51.7 | 19.29 | 48.2 | 17.72 |
| | -3.0 | -3.7 | 62.2 | 20.37 | 58.7 | 21.26 | 55.2 | 19.69 | 53.4 | 19.02 | 51.7 | 18.19 | 48.2 | 16.74 |
| | 0.0 | -0.7 | 62.2 | 20.72 | 58.7 | 19.29 | 55.2 | 17.92 | 53.4 | 17.26 | 51.7 | 16.57 | 48.2 | 15.27 |
| | 3.0 | 2.2 | 62.2 | 18.88 | 58.7 | 17.60 | 55.2 | 16.37 | 53.4 | 15.76 | 51.7 | 15.17 | 48.2 | 13.99 |
| | 5.0 | 4.1 | 62.2 | 17.77 | 58.7 | 16.59 | 55.2 | 15.44 | 53.4 | 14.87 | 51.7 | 14.33 | 48.2 | 13.23 |
| | 7.0 | 6.0 | 62.2 | 16.74 | 58.7 | 15.68 | 55.2 | 14.58 | 53.4 | 14.06 | 51.7 | 13.55 | 48.2 | 12.52 |
| | 9.0 | 7.9 | 62.2 | 15.81 | 58.7 | 14.78 | 55.2 | 13.84 | 53.4 | 13.28 | 51.7 | 12.81 | 48.2 | 11.86 |
| | 11.0 | 9.8 | 62.2 | 14.92 | 58.7 | 13.97 | 55.2 | 13.03 | 53.4 | 12.57 | 51.7 | 12.13 | 48.2 | 11.24 |
| | 13.0 | 11.8 | 62.2 | 14.06 | 58.7 | 13.18 | 55.2 | 12.32 | 53.4 | 11.88 | 51.7 | 11.46 | 48.2 | 10.63 |
| | 15.0 | 13.7 | 62.2 | 13.30 | 58.7 | 12.49 | 55.2 | 11.68 | 53.4 | 11.27 | 51.7 | 10.87 | 48.2 | 10.11 |

CHV5 DC Inverter VRF Units Technical Sales Guide

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|--------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 70 | -19.8 | -20.0 | 43.4 | 21.01 | 43.2 | 21.50 | 43.2 | 22.02 | 43.2 | 22.26 | 43.2 | 22.53 | 42.1 | 22.29 |
| | -18.8 | -19.0 | 44.0 | 21.18 | 44.0 | 21.67 | 43.8 | 22.17 | 43.8 | 22.41 | 43.8 | 22.68 | 42.1 | 21.82 |
| | -16.7 | -17.0 | 45.8 | 21.53 | 45.8 | 22.02 | 45.6 | 22.48 | 45.6 | 22.73 | 45.1 | 22.71 | 42.1 | 20.82 |
| | -13.7 | -15.0 | 47.8 | 21.90 | 47.5 | 22.36 | 47.5 | 22.83 | 46.7 | 218.85 | 45.1 | 21.58 | 42.1 | 19.78 |
| | -11.8 | -13.0 | 49.7 | 22.26 | 49.7 | 22.71 | 48.4 | 22.17 | 46.7 | 21.31 | 45.1 | 20.45 | 42.1 | 18.75 |
| | -9.8 | -11.0 | 52.1 | 22.63 | 51.5 | 22.61 | 48.4 | 20.94 | 46.7 | 20.13 | 45.1 | 19.32 | 42.1 | 17.75 |
| | -9.5 | -10.0 | 53.4 | 22.83 | 51.5 | 21.94 | 48.4 | 20.32 | 46.7 | 19.54 | 45.1 | 18.78 | 42.1 | 17.26 |
| | -8.5 | -9.1 | 54.5 | 22.95 | 51.5 | 21.36 | 48.4 | 19.78 | 46.7 | 19.02 | 45.1 | 18.29 | 42.1 | 16.81 |
| | -7.0 | -7.6 | 54.5 | 21.92 | 51.5 | 20.40 | 48.4 | 18.92 | 46.7 | 18.21 | 45.1 | 17.50 | 42.1 | 16.10 |
| | -5.0 | -5.6 | 54.5 | 20.59 | 51.5 | 19.19 | 48.4 | 17.82 | 46.7 | 17.13 | 45.1 | 16.47 | 42.1 | 15.19 |
| | -3.0 | -3.7 | 54.5 | 19.39 | 51.5 | 18.09 | 48.4 | 16.81 | 46.7 | 16.18 | 45.1 | 15.56 | 42.1 | 14.36 |
| | 0.0 | -0.7 | 54.5 | 17.65 | 51.5 | 16.57 | 48.4 | 15.34 | 46.7 | 14.78 | 45.1 | 14.24 | 42.1 | 13.16 |
| | 3.0 | 2.2 | 54.5 | 16.13 | 51.5 | 0.37 | 48.4 | 14.06 | 46.7 | 13.55 | 45.1 | 13.06 | 42.1 | 12.08 |
| | 5.0 | 4.1 | 54.5 | 15.22 | 51.5 | 14.24 | 48.4 | 13.30 | 46.7 | 12.81 | 45.1 | 12.37 | 42.1 | 11.44 |
| | 7.0 | 6.0 | 54.5 | 14.38 | 51.5 | 13.48 | 48.4 | 12.57 | 46.7 | 12.13 | 45.1 | 11.71 | 42.1 | 10.85 |
| | 9.0 | 7.9 | 54.5 | 13.60 | 51.5 | 12.74 | 48.4 | 11.90 | 46.7 | 11.49 | 45.1 | 11.09 | 42.1 | 10.28 |
| | 11.0 | 9.8 | 54.5 | 12.86 | 51.5 | 12.05 | 48.4 | 11.29 | 46.7 | 10.90 | 45.1 | 10.53 | 42.1 | 9.77 |
| | 13.0 | 11.8 | 54.5 | 12.15 | 51.5 | 11.41 | 48.4 | 10.68 | 46.7 | 10.33 | 45.1 | 9.97 | 42.1 | 9.28 |
| | 15.0 | 13.7 | 54.5 | 11.51 | 51.5 | 10.82 | 48.4 | 10.14 | 46.7 | 9.82 | 45.1 | 9.47 | 42.1 | 8.84 |


| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| 60 | -19.8 | -20.0 | 43.2 | 22.29 | 42.9 | 22.71 | 41.4 | 21.85 | 40.1 | 20.99 | 38.8 | 20.15 | 36.1 | 18.48 |
| | -18.8 | -19.0 | 43.8 | 22.44 | 43.8 | 22.85 | 41.4 | 21.38 | 40.1 | 20.55 | 38.8 | 19.71 | 36.1 | 18.09 |
| | -16.7 | -17.0 | 45.6 | 22.73 | 44.0 | 22.02 | 41.4 | 20.40 | 40.1 | 19.61 | 38.8 | 18.83 | 36.1 | 17.30 |
| | -13.7 | -15.0 | 46.7 | 22.48 | 44.0 | 20.91 | 41.4 | 19.39 | 40.1 | 18.65 | 38.8 | 17.92 | 36.1 | 16.47 |
| | -11.8 | -13.0 | 46.7 | 21.28 | 44.0 | 19.81 | 41.4 | 18.38 | 40.1 | 17.70 | 38.8 | 17.01 | 36.1 | 15.66 |
| | -9.8 | -11.0 | 46.7 | 20.10 | 44.0 | 18.73 | 41.4 | 17.40 | 40.1 | 16.74 | 38.8 | 16.10 | 36.1 | 14.85 |
| | -9.5 | -10.0 | 46.7 | 19.54 | 44.0 | 18.21 | 41.4 | 16.91 | 40.1 | 16.30 | 38.8 | 15.66 | 36.1 | 14.43 |
| | -8.5 | -9.1 | 46.7 | 19.02 | 44.0 | 17.75 | 41.4 | 16.49 | 40.1 | 15.88 | 38.8 | 15.27 | 36.1 | 14.09 |
| | -7.0 | -7.6 | 46.7 | 18.19 | 44.0 | 16.99 | 41.4 | 15.78 | 40.1 | 15.22 | 38.8 | 14.63 | 36.1 | 13.52 |
| | -5.0 | -5.6 | 46.7 | 17.13 | 44.0 | 16.00 | 41.4 | 14.90 | 40.1 | 14.36 | 38.8 | 13.82 | 36.1 | 12.79 |
| | -3.0 | -3.7 | 46.7 | 16.18 | 44.0 | 15.12 | 41.4 | 14.14 | 40.1 | 13.60 | 38.8 | 13.08 | 36.1 | 12.10 |
| | 0.0 | -0.7 | 46.7 | 14.78 | 44.0 | 13.84 | 41.4 | 12.91 | 40.1 | 12.47 | 38.8 | 12.00 | 36.1 | 11.12 |
| | 3.0 | 2.2 | 46.7 | 13.55 | 44.0 | 12.71 | 41.4 | 11.88 | 40.1 | 11.46 | 38.8 | 11.07 | 36.1 | 0.44 |
| | 5.0 | 4.1 | 46.7 | 12.81 | 44.0 | 12.03 | 41.4 | 11.24 | 40.1 | 10.87 | 38.8 | 10.48 | 36.1 | 9.74 |
| | 7.0 | 6.0 | 46.7 | 12.13 | 44.0 | 11.39 | 41.4 | 10.65 | 40.1 | 10.31 | 38.8 | 9.97 | 36.1 | 9.25 |
| | 9.0 | 7.9 | 46.7 | 11.49 | 44.0 | 10.80 | 41.4 | 10.11 | 40.1 | 9.79 | 38.8 | 9.45 | 36.1 | 8.81 |
| | 11.0 | 9.8 | 46.7 | 10.90 | 44.0 | 10.26 | 41.4 | 9.62 | 40.1 | 9.30 | 38.8 | 8.98 | 36.1 | 8.39 |
| | 13.0 | 11.8 | 46.7 | 10.31 | 44.0 | 9.72 | 41.4 | 9.13 | 40.1 | 8.84 | 38.8 | 8.54 | 36.1 | 7.98 |
| | 15.0 | 13.7 | 46.7 | 9.82 | 44.0 | 9.23 | 41.4 | 8.69 | 40.1 | 8.42 | 38.8 | 8.15 | 36.1 | 7.61 |

| Combination | Outdoor air temp. | | Indoor air temperature. °CDB | | | | | | | | | | | |
|-------------|-------------------|-------|------------------------------|-------|------|-------|------|-------|------|-------|------|-------|------|-------|
| | | | 16 | | 18 | | 20 | | 21 | | 22 | | 24 | |
| | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI | TC | PI |
| 50 | °CDB | °CWB | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW | kW |
| | -19.8 | -20.0 | 39.0 | 20.27 | 36.8 | 18.88 | 34.6 | 17.53 | 33.3 | 16.89 | 32.2 | 16.22 | 30.0 | 14.95 |
| | -18.8 | -19.0 | 39.0 | 19.83 | 36.8 | 18.48 | 34.6 | 17.18 | 33.3 | 16.52 | 32.2 | 15.88 | 30.0 | 14.65 |
| | -16.7 | -17.0 | 39.0 | 18.92 | 36.8 | 17.65 | 34.6 | 16.42 | 33.3 | 15.81 | 32.2 | 15.22 | 30.0 | 14.04 |
| | -13.7 | -15.0 | 39.0 | 18.02 | 36.8 | 16.81 | 34.6 | 15.64 | 33.3 | 15.07 | 32.2 | 14.51 | 30.0 | 13.40 |
| | -11.8 | -13.0 | 39.0 | 17.11 | 36.8 | 16.00 | 34.6 | 14.87 | 33.3 | 14.33 | 32.2 | 13.79 | 30.0 | 12.76 |
| | -9.8 | -11.0 | 39.0 | 16.20 | 36.8 | 15.14 | 34.6 | 14.11 | 33.3 | 13.60 | 32.2 | 13.11 | 30.0 | 12.13 |
| | -9.5 | -10.0 | 39.0 | 15.76 | 36.8 | 14.73 | 34.6 | 13.75 | 33.3 | 13.25 | 32.2 | 12.76 | 30.0 | 11.81 |
| | -8.5 | -9.1 | 39.0 | 15.37 | 36.8 | 14.38 | 34.6 | 13.40 | 33.3 | 12.94 | 32.2 | 12.47 | 30.0 | 11.54 |
| | -7.0 | -7.6 | 39.0 | 14.73 | 36.8 | 13.84 | 34.6 | 12.86 | 33.3 | 12.42 | 32.2 | 11.98 | 30.0 | 11.09 |
| | -5.0 | -5.6 | 39.0 | 13.89 | 36.8 | 13.03 | 34.6 | 12.17 | 33.3 | 11.76 | 32.2 | 11.34 | 30.0 | 10.51 |
| | -3.0 | -3.7 | 39.0 | 13.16 | 36.8 | 12.35 | 34.6 | 11.54 | 33.3 | 11.14 | 32.2 | 10.75 | 30.0 | 9.99 |
| | 0.0 | -0.7 | 39.0 | 12.08 | 36.8 | 11.34 | 34.6 | 10.63 | 33.3 | 10.26 | 32.2 | 9.92 | 30.0 | 9.23 |
| | 3.0 | 2.2 | 39.0 | 11.12 | 36.8 | 10.46 | 34.6 | 9.79 | 33.3 | 9.47 | 32.2 | 9.18 | 30.0 | 8.54 |
| | 5.0 | 4.1 | 39.0 | 10.55 | 36.8 | 9.92 | 34.6 | 9.30 | 33.3 | 9.01 | 32.2 | 8.71 | 30.0 | 8.12 |
| | 7.0 | 6.0 | 39.0 | 10.01 | 36.8 | 9.43 | 34.6 | 8.86 | 33.3 | 8.57 | 32.2 | 8.30 | 30.0 | 7.76 |
| | 9.0 | 7.9 | 39.0 | 9.50 | 36.8 | 8.96 | 34.6 | 8.42 | 33.3 | 8.17 | 32.2 | 7.90 | 30.0 | 7.39 |
| | 11.0 | 9.8 | 39.0 | 9.03 | 36.8 | 8.52 | 34.6 | 8.03 | 33.3 | 7.78 | 32.2 | 7.54 | 30.0 | 7.04 |
| | 13.0 | 11.8 | 39.0 | 8.59 | 36.8 | 8.10 | 34.6 | 7.63 | 33.3 | 7.41 | 32.2 | 7.17 | 30.0 | 6.73 |
| | 15.0 | 13.7 | 39.0 | 8.17 | 36.8 | 7.73 | 34.6 | 7.29 | 33.3 | 7.07 | 32.2 | 6.85 | 30.0 | 6.41 |









6.2 Correction of Capacity Along with Piping Length and Height Drop

Pipe Diameter Unit: mm

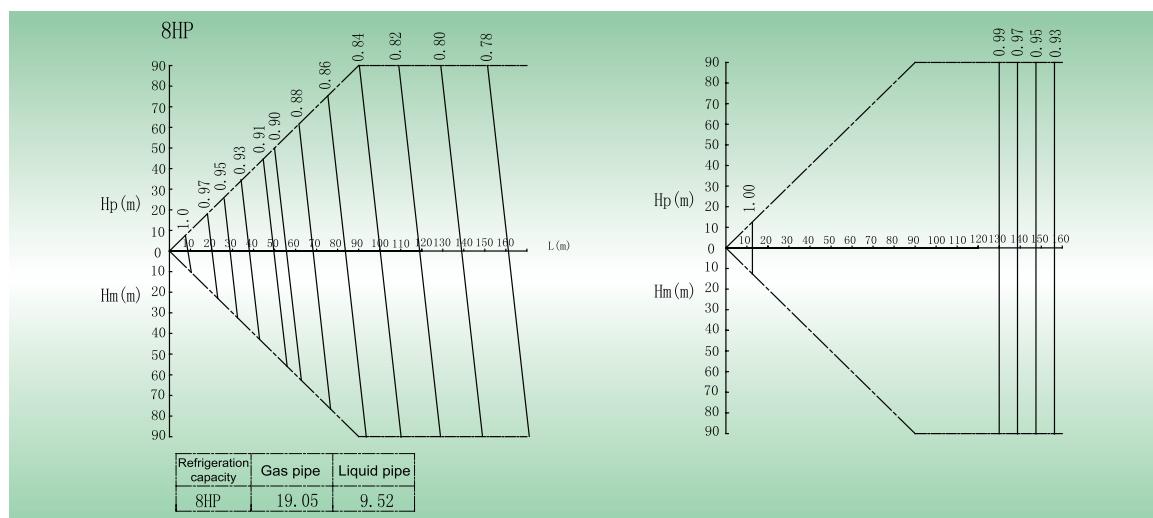


CHV5 DC Inverter VRF Units Technical Sales Guide

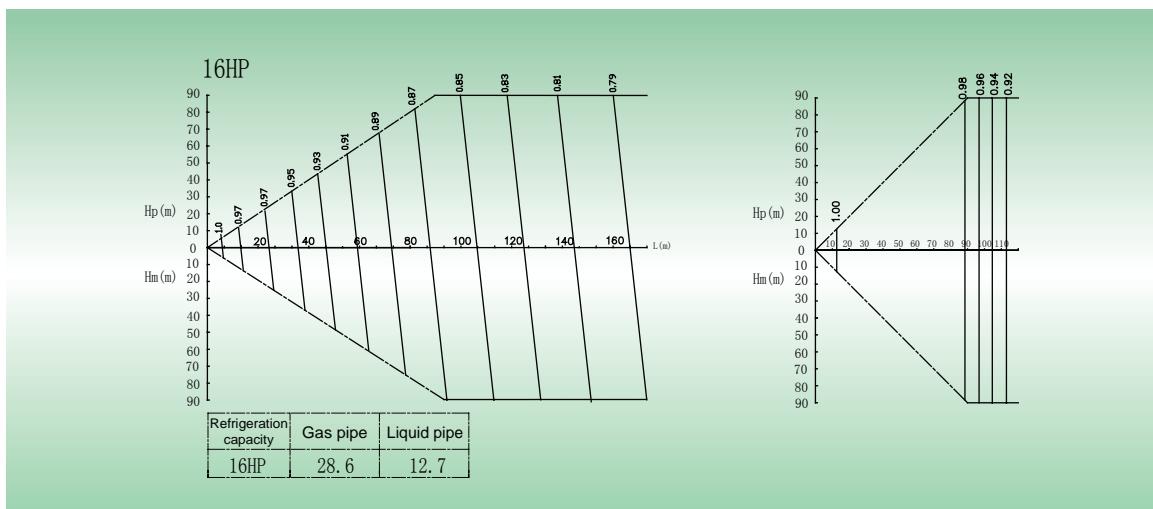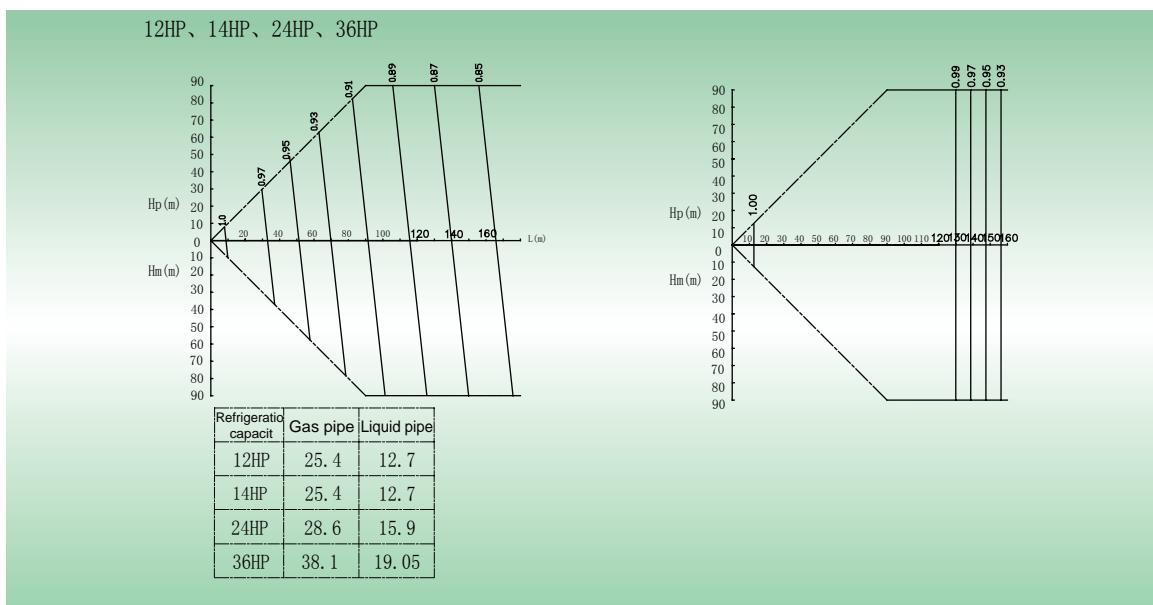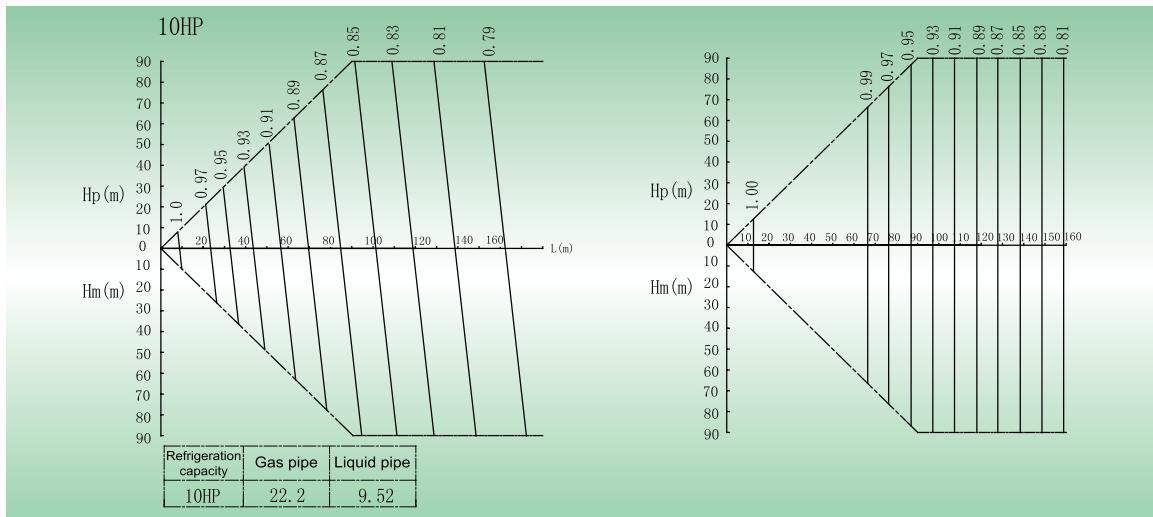

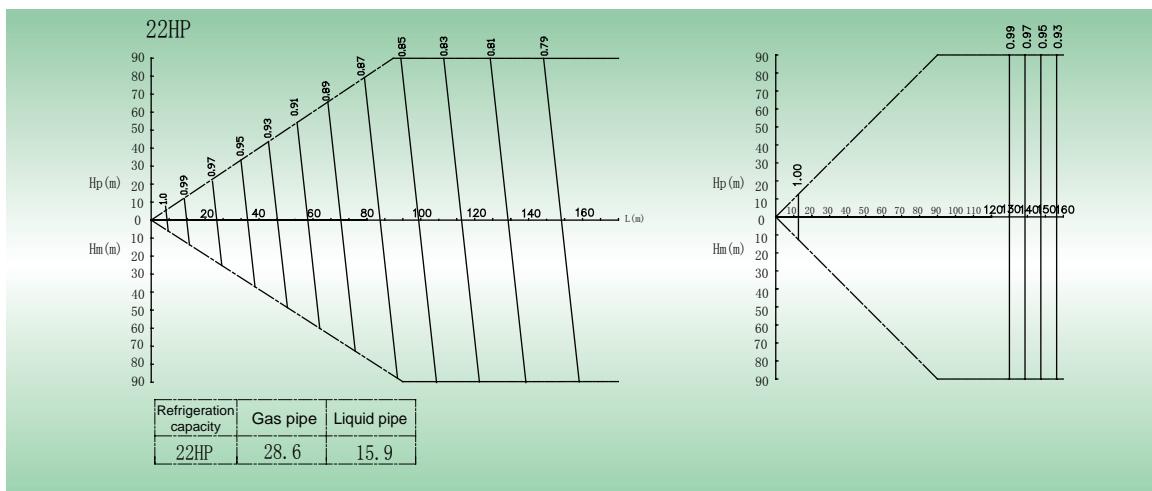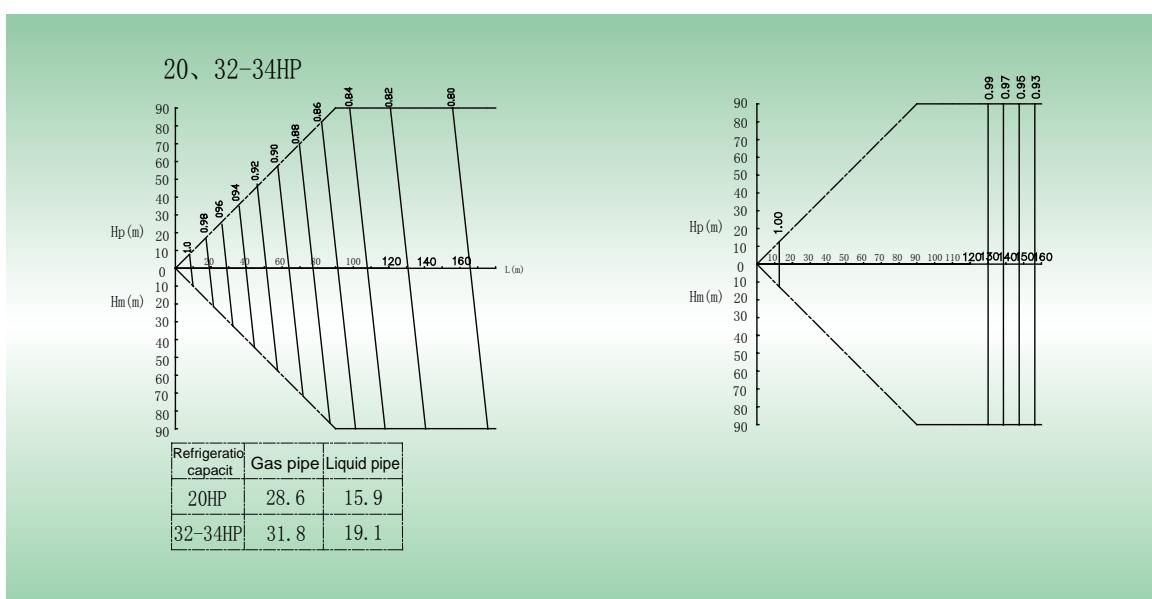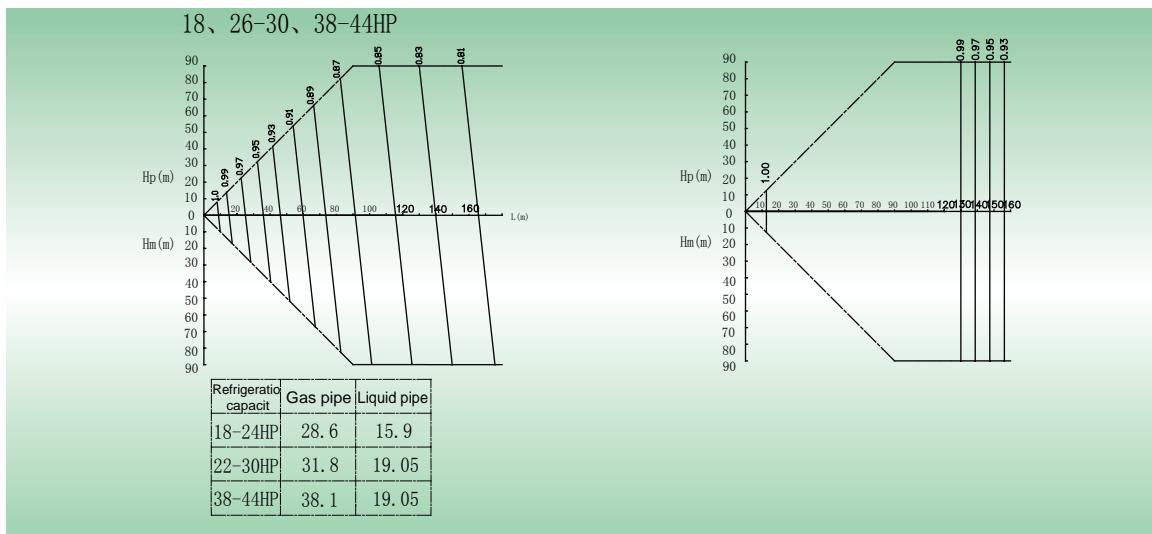


CHV5 DC Inverter VRF Units Technical Sales Guide


46HP

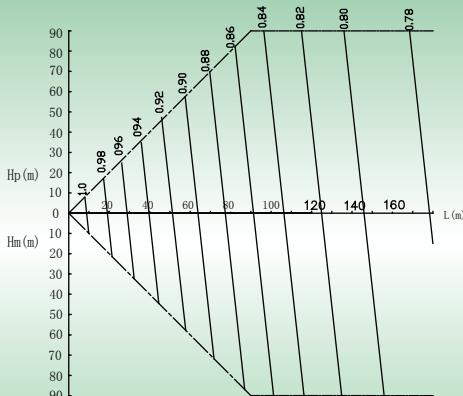


| Refrigeration capacity | Gas pipe | Liquid pipe |
|------------------------|----------|-------------|
| 46HP | 38.1 | 19.05 |

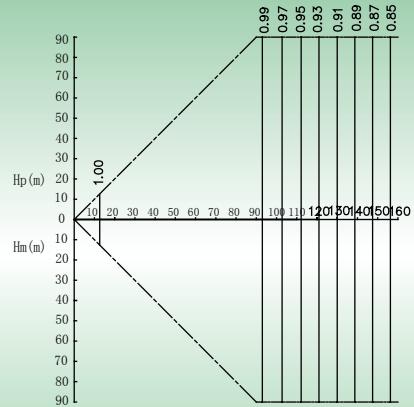


48HP

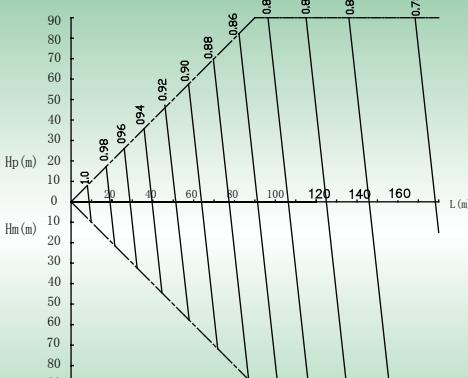


| Refrigeration capacity | Gas pipe | Liquid pipe |
|------------------------|----------|-------------|
| 48HP | 38.1 | 19.05 |



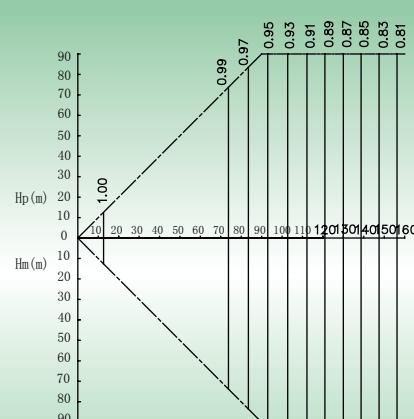


50HP



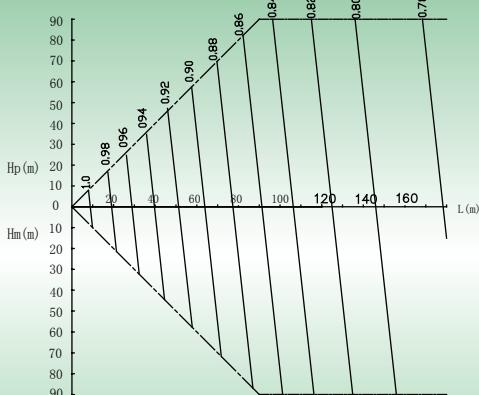


| Refrigeration capacity | Gas pipe | Liquid pipe |
|------------------------|----------|-------------|
| 50HP | 44.5 | 22.2 |

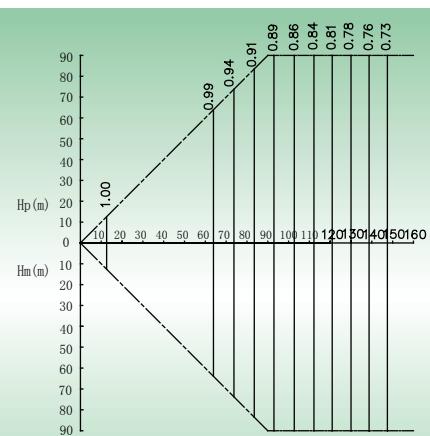

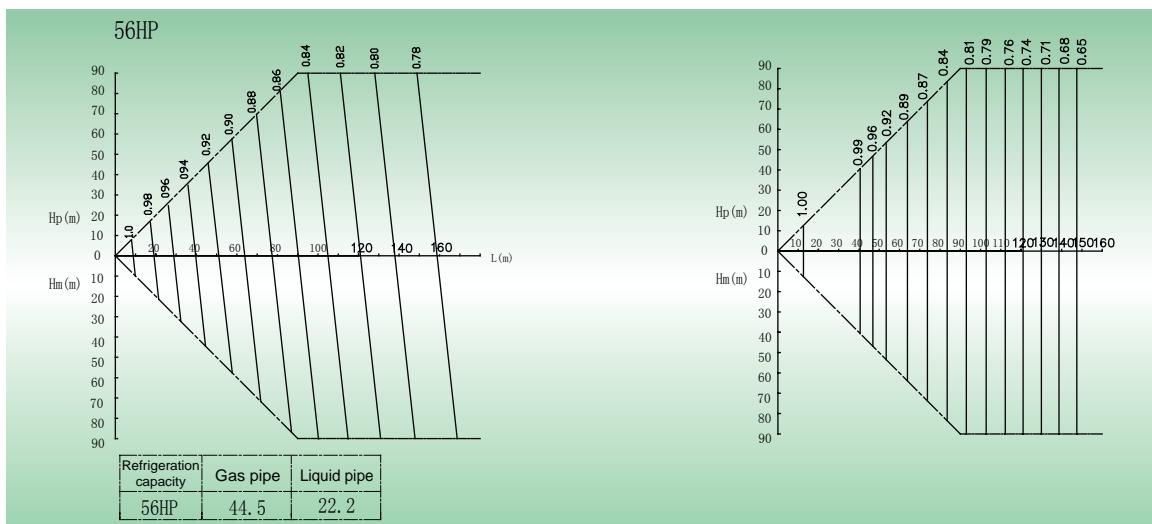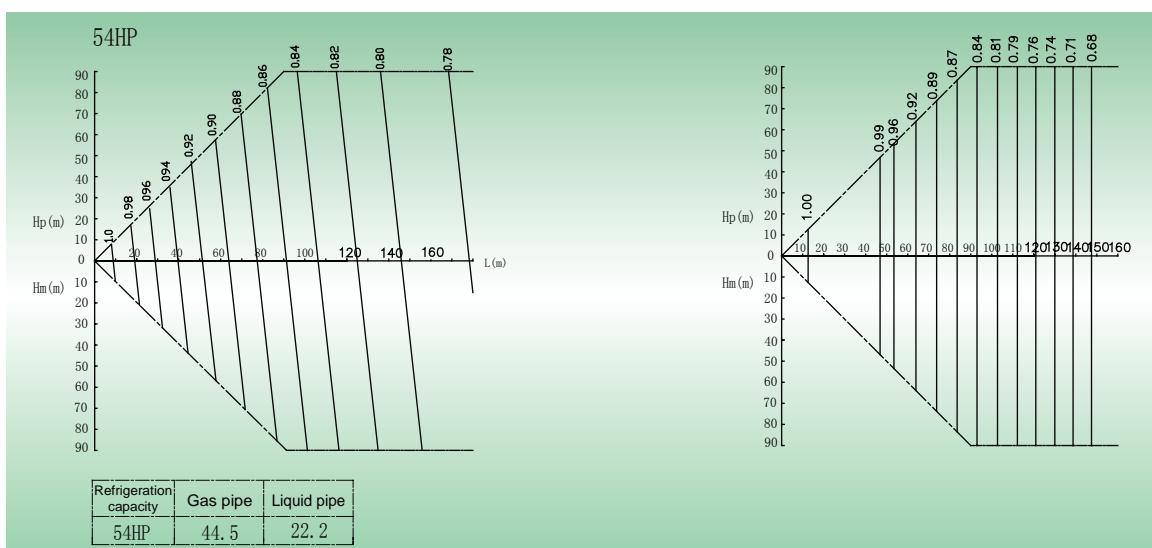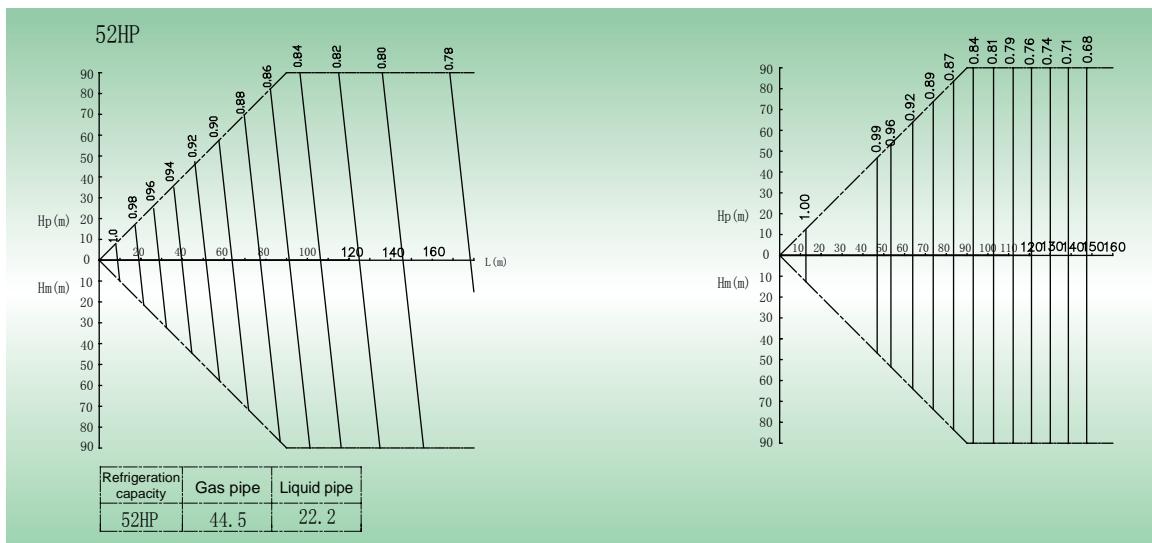

CHV5 DC Inverter VRF Units Technical Sales Guide

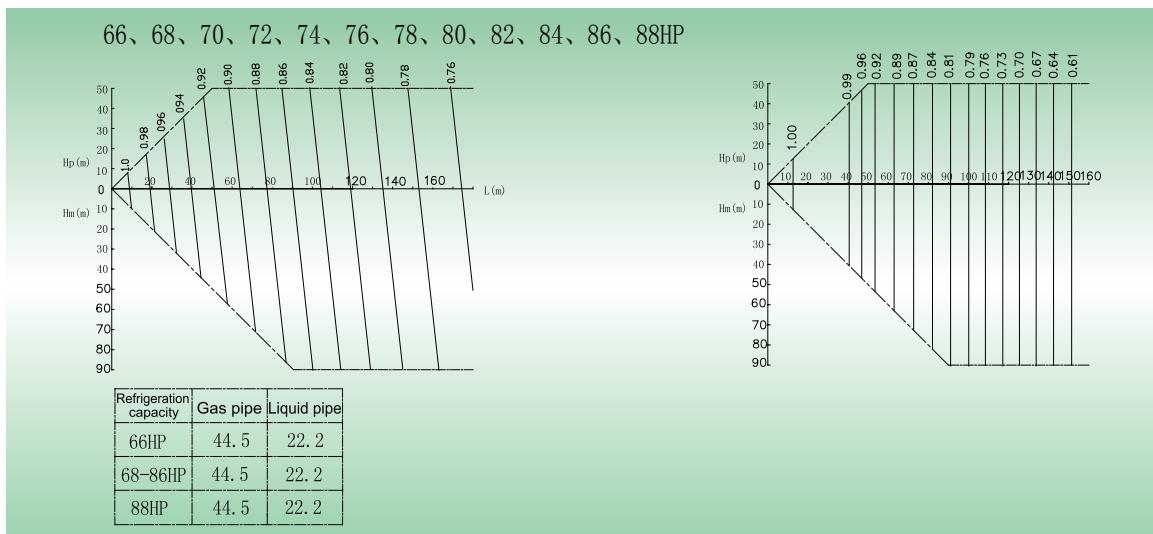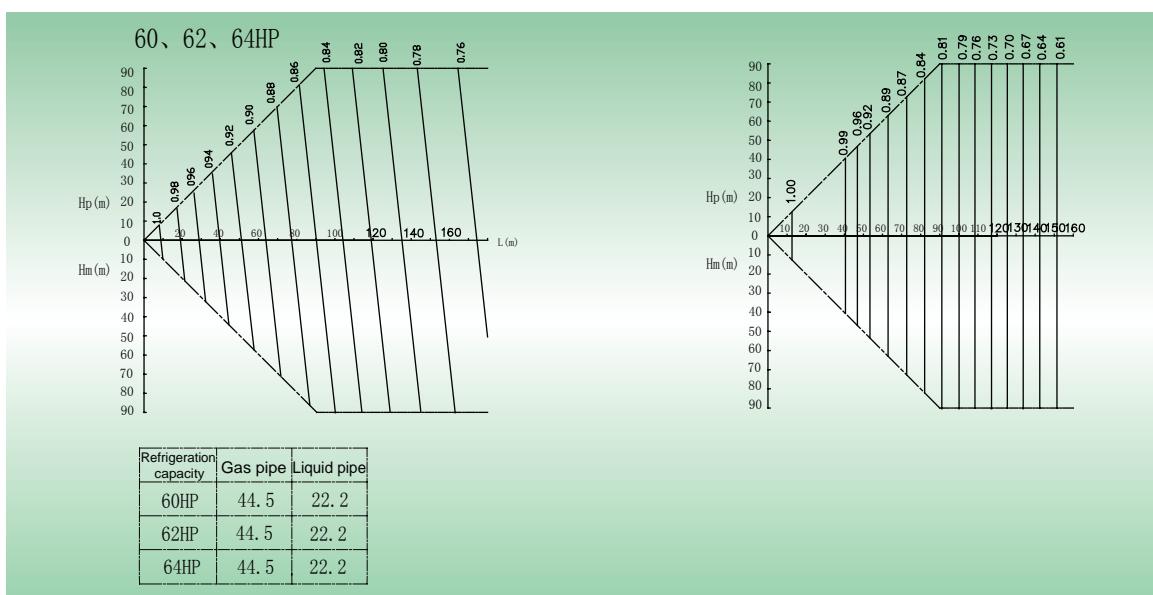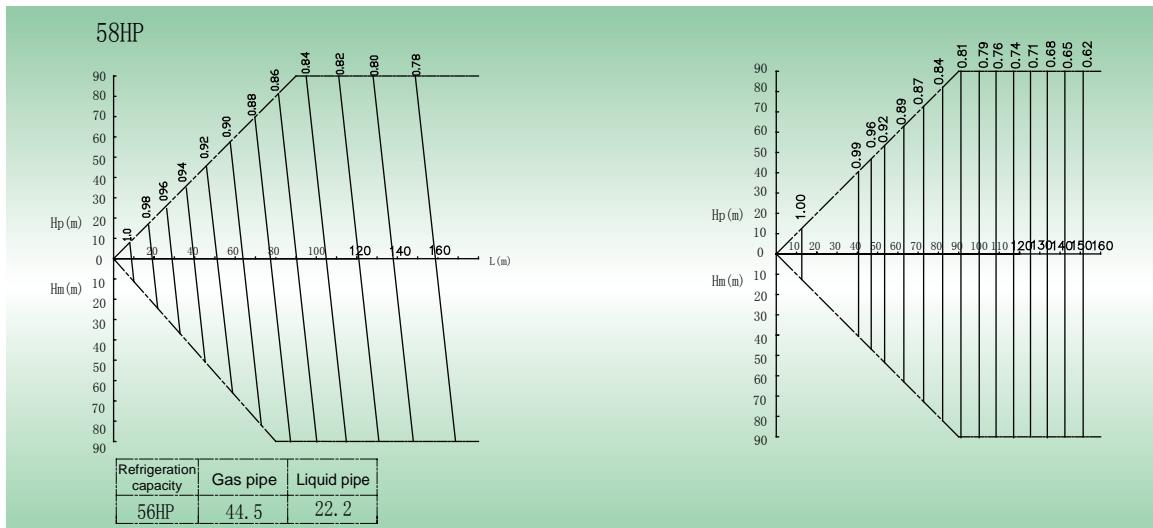

Notes for correction of the long connection pipe:

- a. The above connection of long connection pipe indicates the maximum capacity under the standard indoor unit capacity configuration.

b. Set out below are some load configurations:

Maximum system capacity: the smaller one of the indoor unit capacity and the maximum outdoor unit capacity (two algorithms are provided below)

- ◆ When the configuration ratio of indoor unit is less than 100%

Maximum outdoor unit capacity = Capacity when the configuration ratio is 100% in the outdoor unit capacity correction table × Long connection pipe correction coefficient of the longest indoor unit distance

- ◆ When the configuration ratio of indoor unit reaches 100%

Maximum outdoor unit capacity = Capacity of the corresponding configuration ratio in the outdoor unit capacity correction table × Long connection pipe correction coefficient of the longest indoor unit distance



6.3 Frosting Correction Factors of Heating

When the outdoor environment meets certain conditions (temperature and humidity conditions), the unit may be frosted or defrosted. In this case, the heating capacity of the whole system will be reduced. Therefore, the frosting correction factor should also be calculated in heating load selection for the whole system.

The table below provides the frosting correction factors:

| | | | | | | | | | |
|---|-----|------|------|------|------|-----|------|-----|---|
| Air inlet dry bulb temperature (°C/RH85%) of the outdoor heat exchanger | -11 | -9 | -7 | -5 | -3 | 0 | 3 | 5 | 7 |
| Frosting (defrosting) capacity correction factor of the whole system | 1 | 0.98 | 0.96 | 0.94 | 0.88 | 0.8 | 0.84 | 0.9 | 1 |




CHV5 DC Inverter VRF Units Technical Sales Guide




7 UNIT NOISE CURVES

Noise test method:

Test environment: semi-anechoic room; the noise level will be slightly higher due to change of the environment during actual operation.

The test points of the following noise curves are shown below:

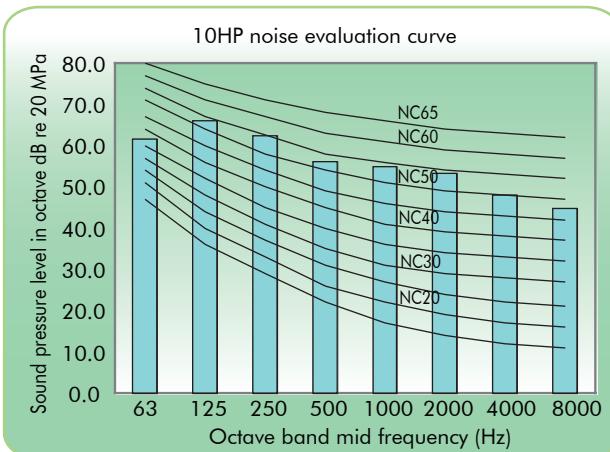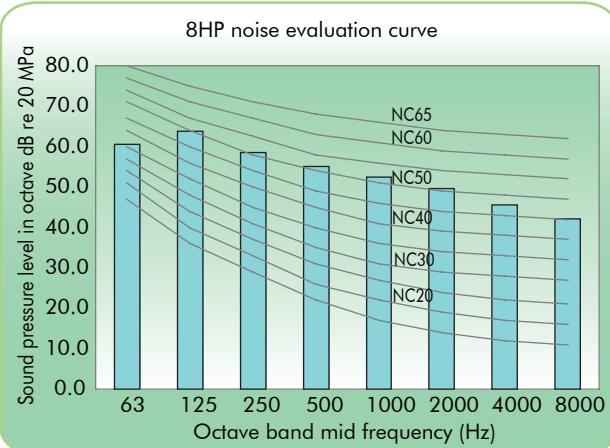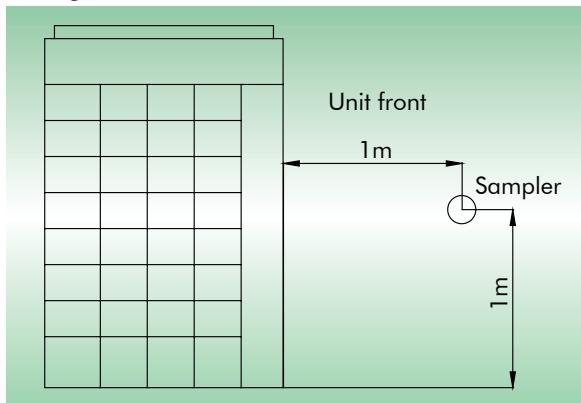

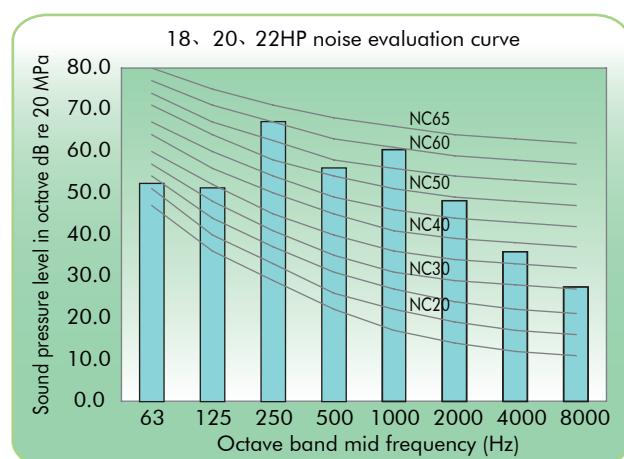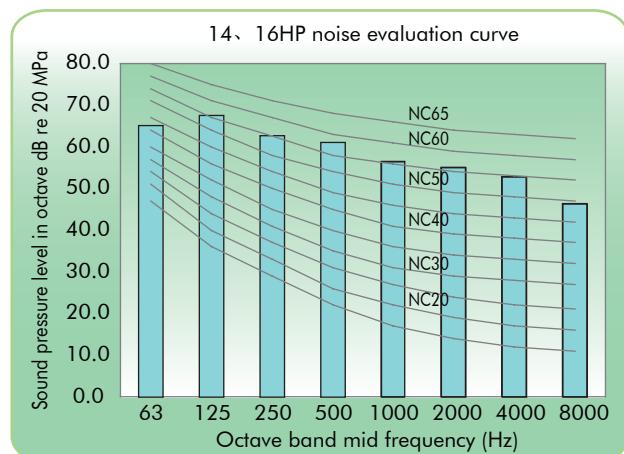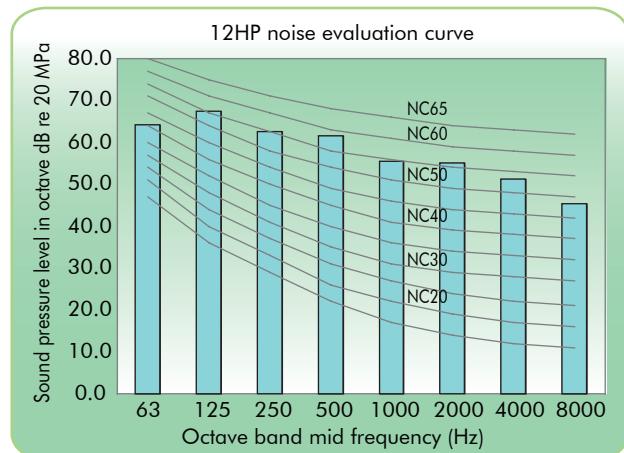


CHV5 DC Inverter VRF Units Technical Sales Guide


8 UNIT GRAVITY CENTER DIAGRAMS

Unit: mm


CHV-5S224NMX, CHV-5S280NMX

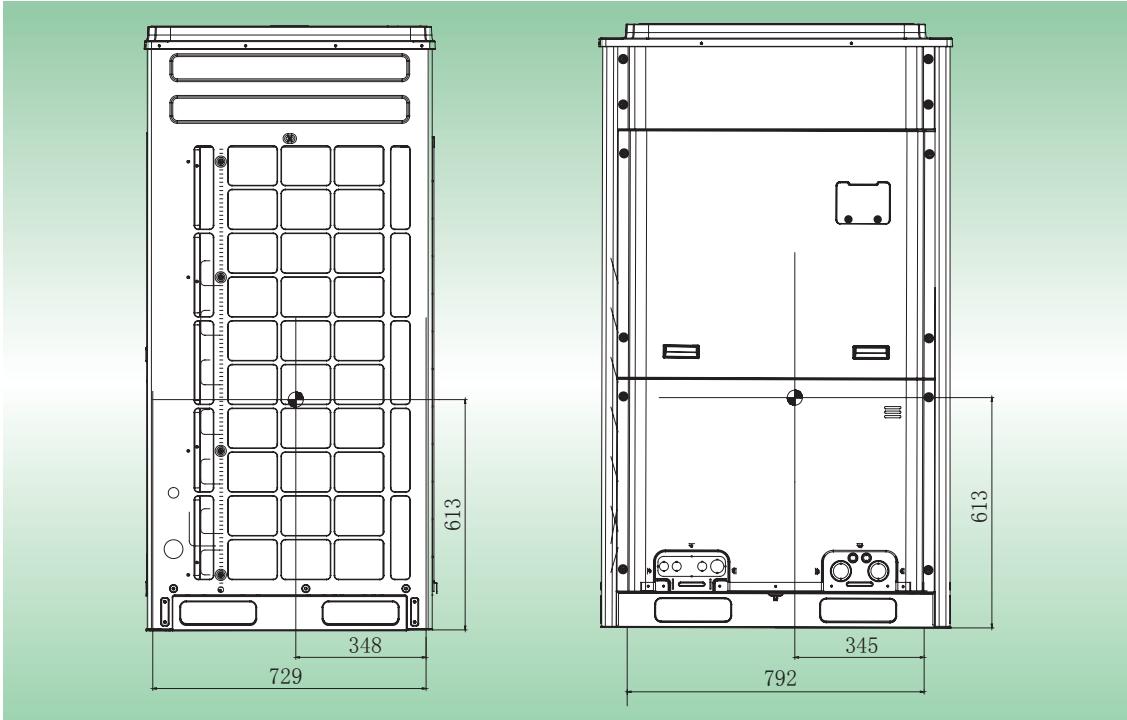


CHV-5S335NMX

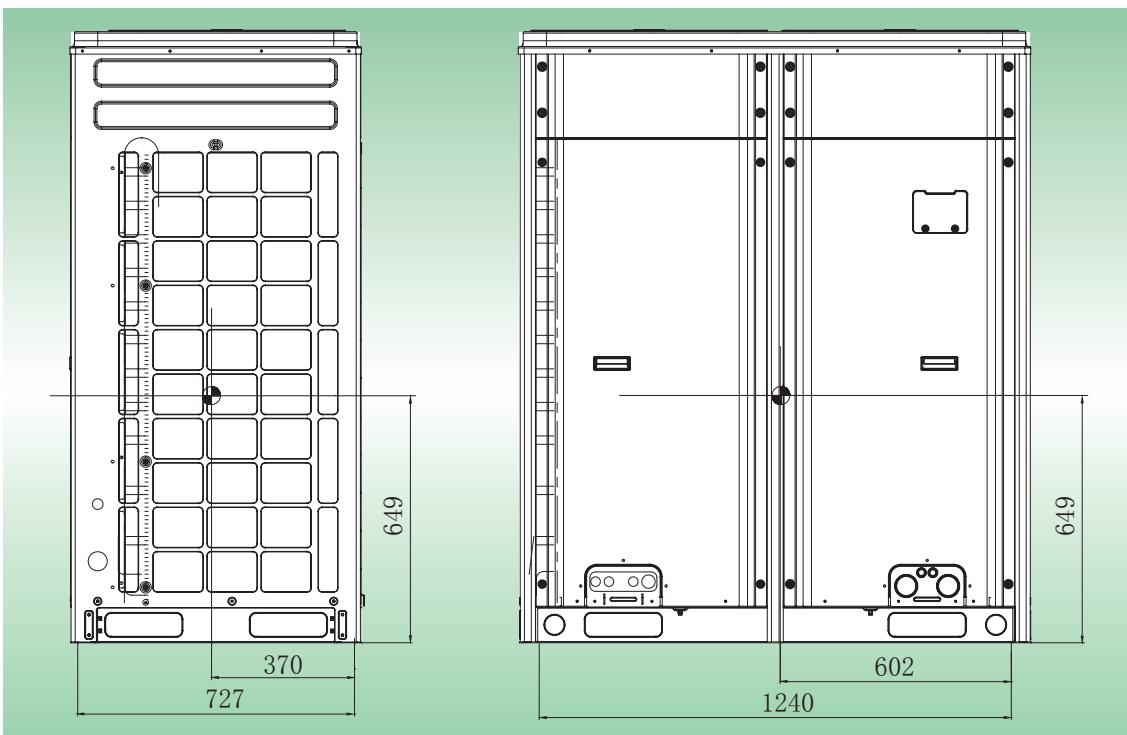

CHV-5S400NMX, CHV-5S450NMX

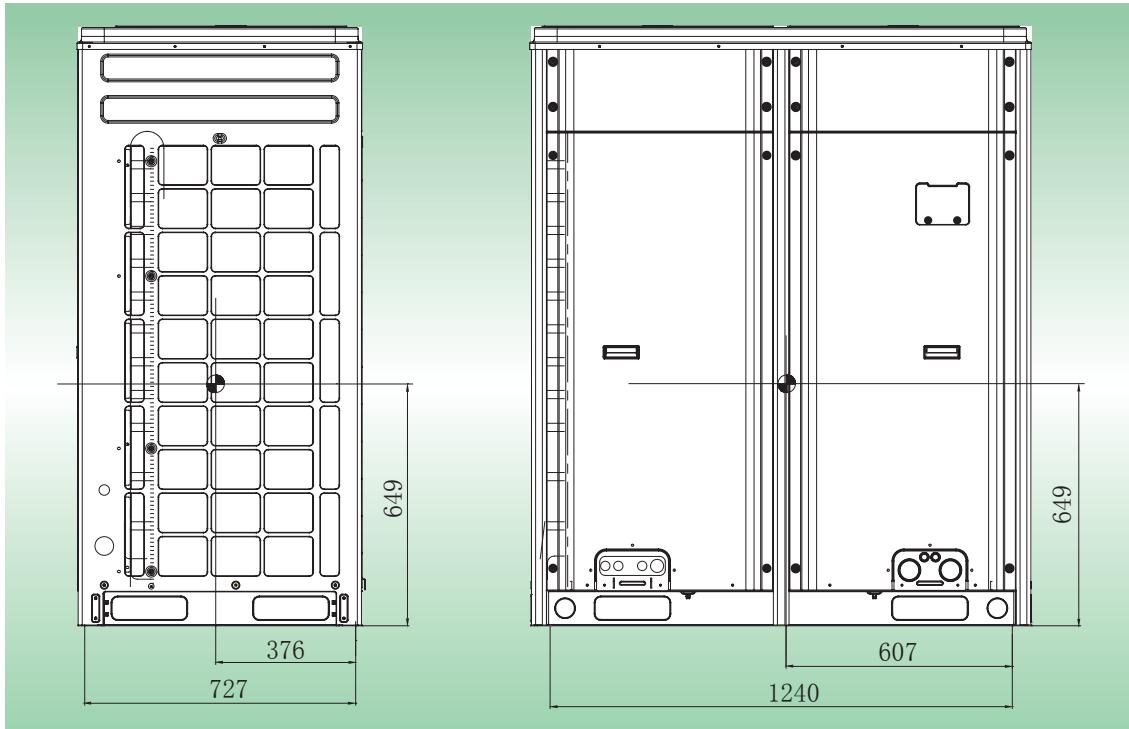

CHV-5S504NMX, CHV-5S560NMX, CHV-5S615NMX

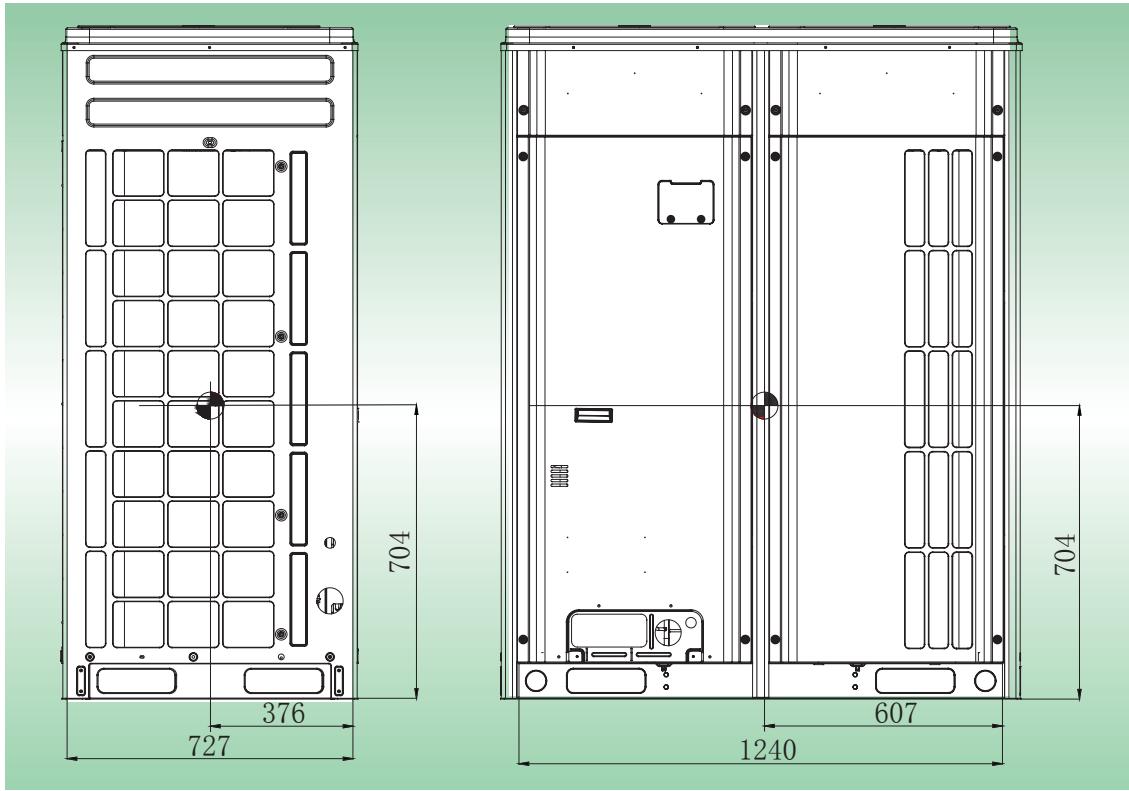

9 UNIT INSTALLATION SPACE REQUIREMENTS


9.1 Selection of outdoor unit installation site

VRF units are used in a lot of situations and serve wider users. If the unit is installed in a living environment, the cooling, heating and noise requirements will be higher, especially for the aged and infants. Therefore, the indoor/outdoor unit model with sufficient capacity and low noise should be preferred during model selection. It is not advisable to install the outdoor unit outside the bedroom, study room, or meeting room. For the commercial site, it is improper to install the outdoor unit near the office.


9.2 External dimensions and mounting hole dimensions of the outdoor unit

Unit: mm

External and installation dimensions of CHV-5S224NMX, CHV-5S280NMX, and CHV-5S335NMX:

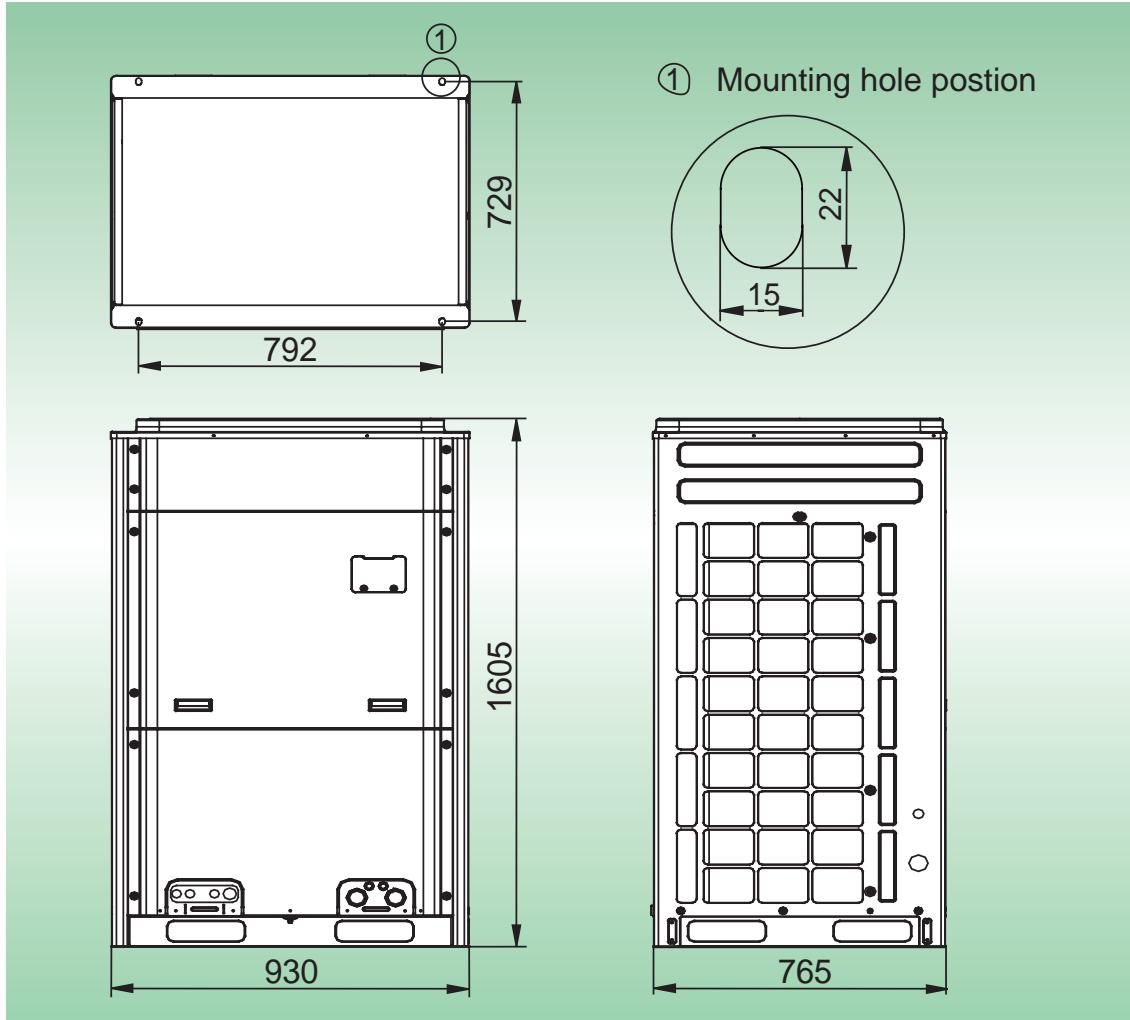


External and installation dimensions of CHV-5S400NMX and CHV-5S450NMX:

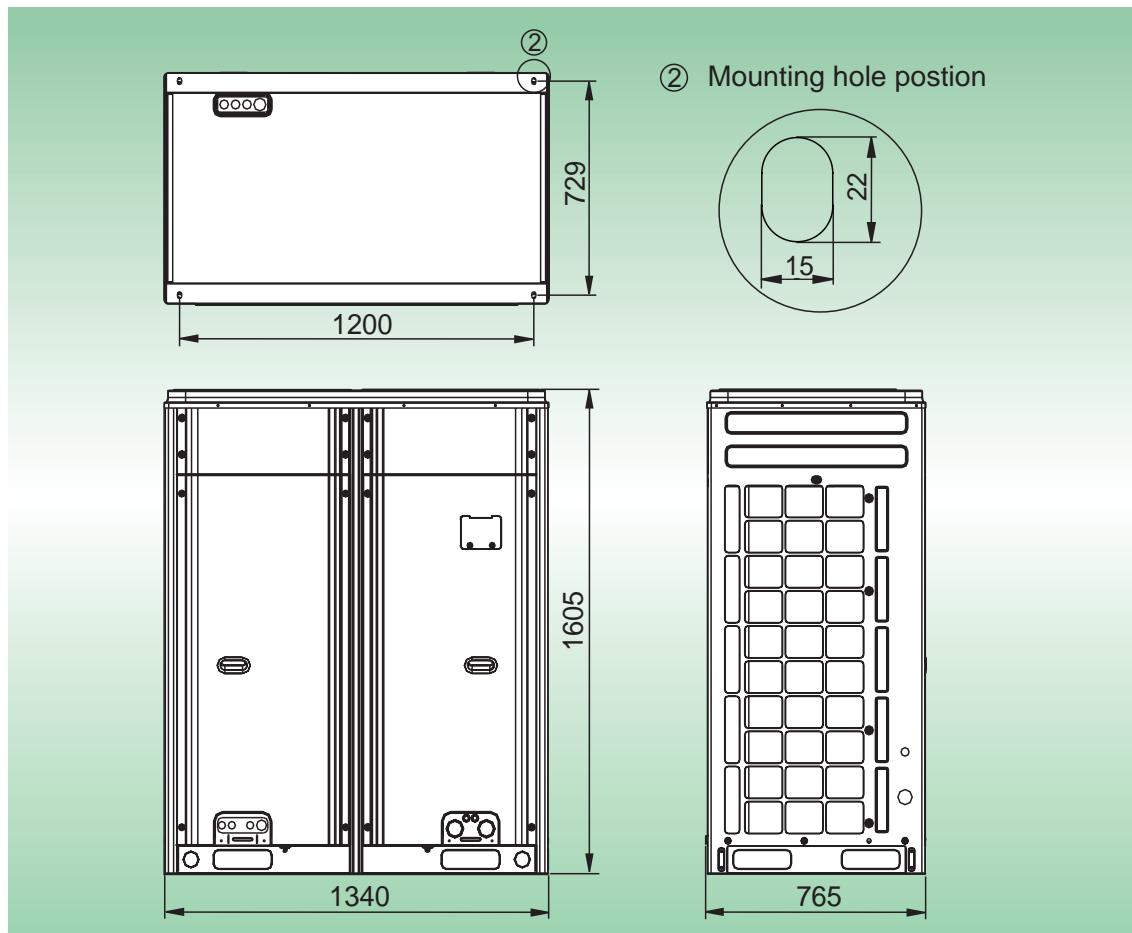

CHV5 DC Inverter VRF Units Technical Sales Guide

External and installation dimensions of CHV-5S504NMX, CHV-5S560NMX and CHV-5S615NMXX:

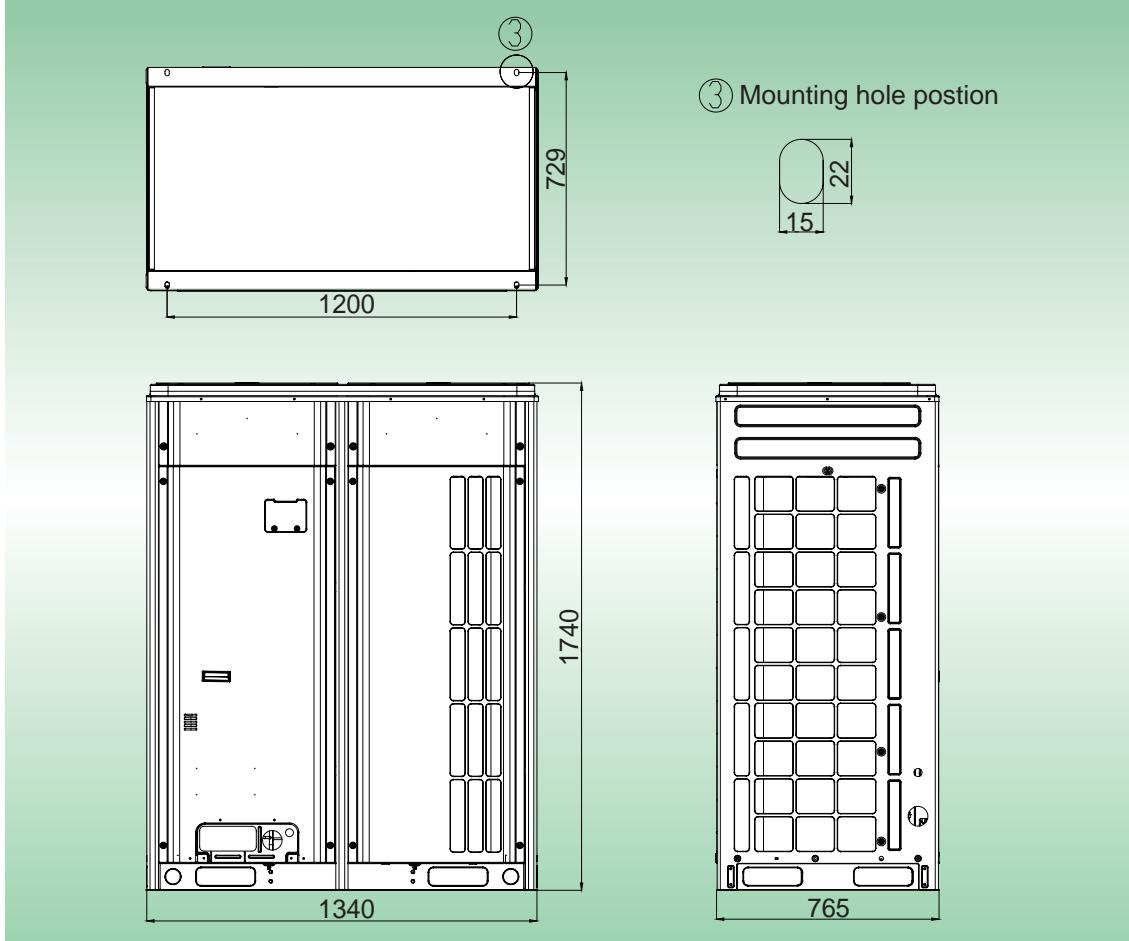


9.3 External unit installation space requirements


Unit: mm

- If all sides of the outdoor unit (including the top) are surrounded by walls, process according to the following requirements for installation space:


Installation space requirements for the single-module unit

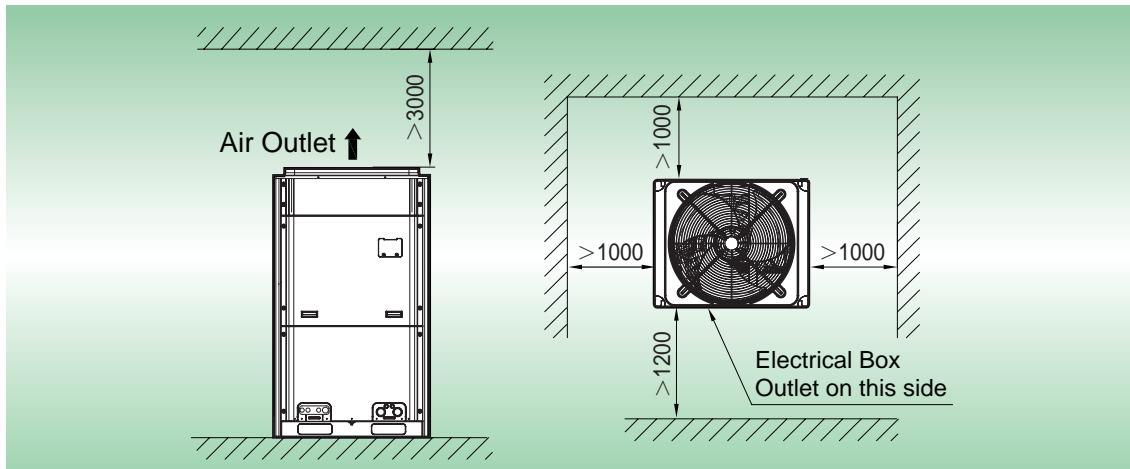

Installation space requirements for the dual-module unit

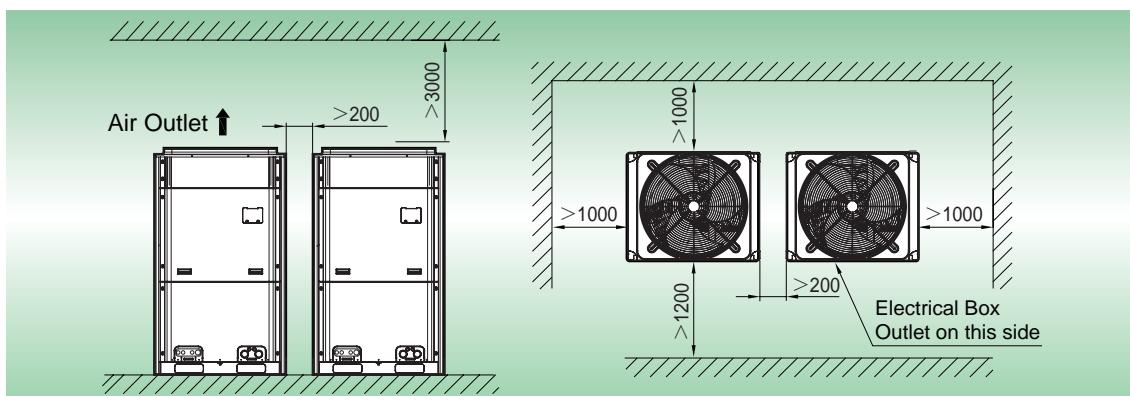


Installation space requirements for triple-module unit

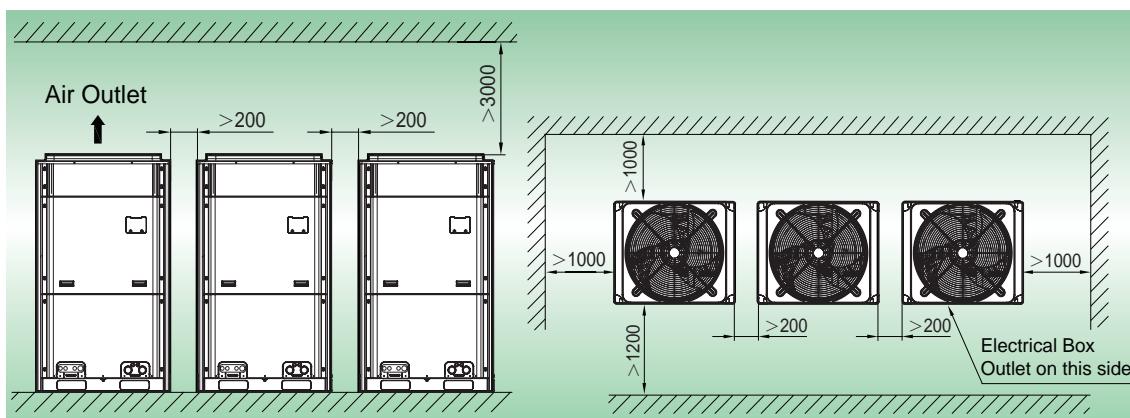

Installation space requirements for quad-module unit

CHV5 DC Inverter VRF Units Technical Sales Guide

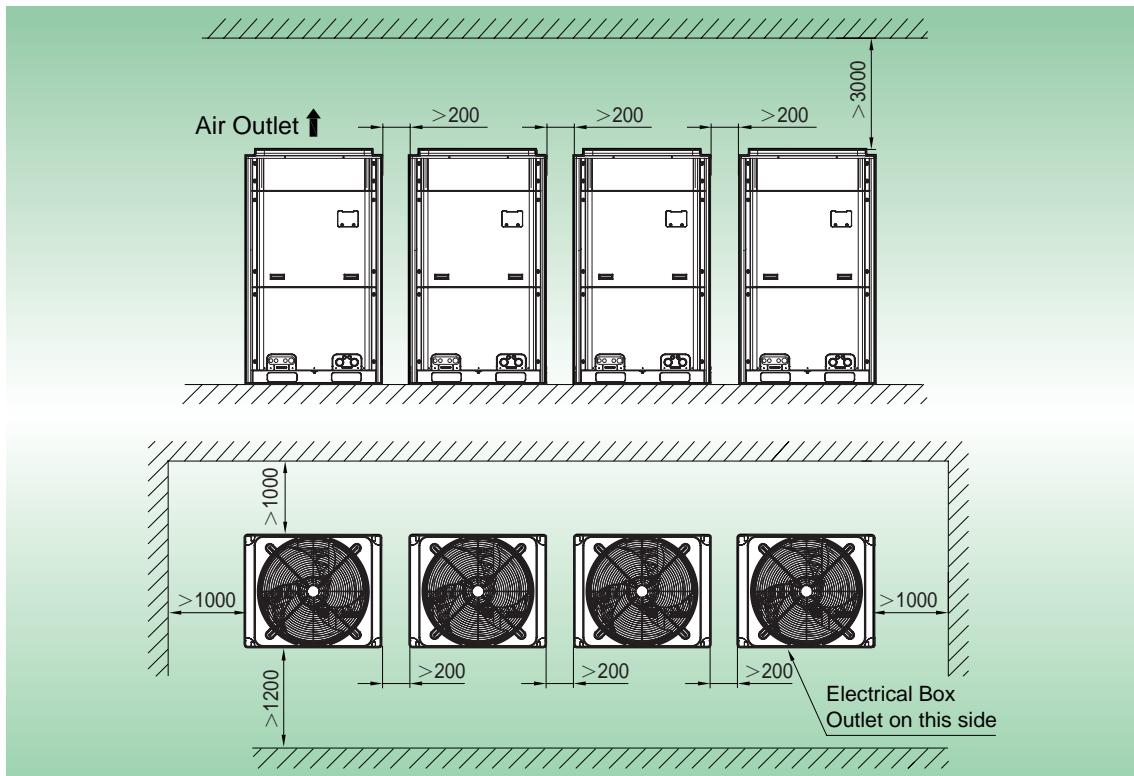

2) If there is a crown wall (such a barrier against wind) above the machine top, the machine top should be more than 3000 mm away from the crown wall in principle. If the spaces around the front, rear, left side, and right side of the machine are all open spaces, the machine top should be more than 1500 mm away from the crown wall, as shown in Figure (a). If the dimension is less than 1500 mm or the spaces around the machine are not open spaces, it is required to use a return duct to keep smooth ventilation, as shown in Figure (b).

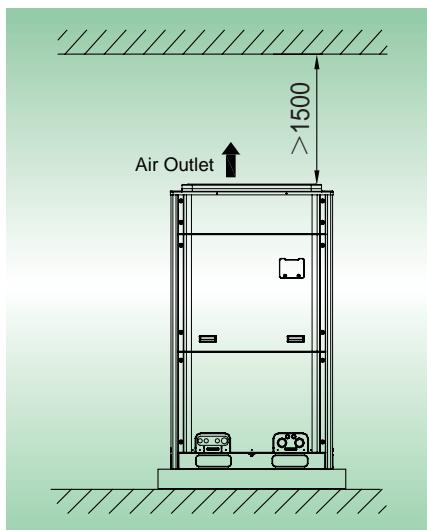


Figure (a)

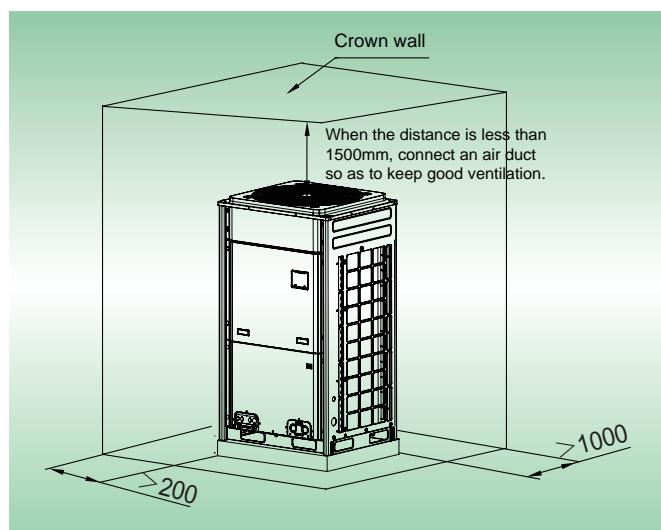




Figure (b)

Installation space requirements of multiple outdoor units


To ensure smooth ventilation, an open space must be ensured above the unit top, and there is no barrier against wind.

If there is an open space at the front side and left side (or right side) of the outdoor unit, the units should

be installed towards the same direction or reverse direction.

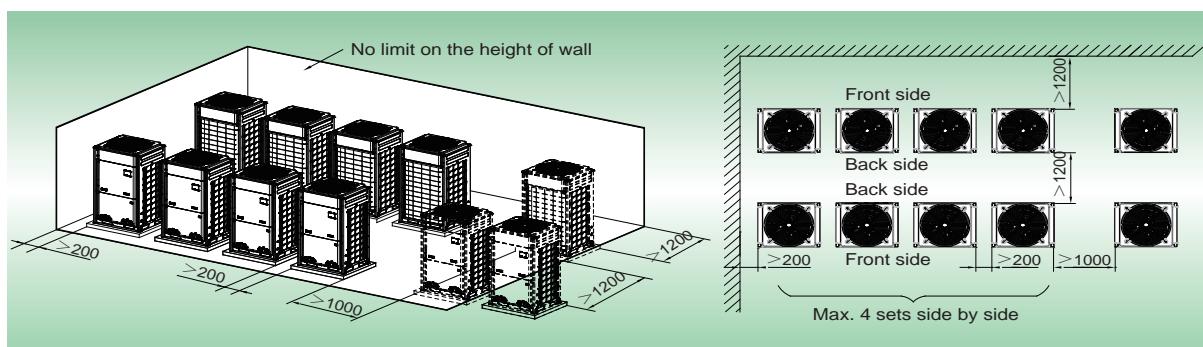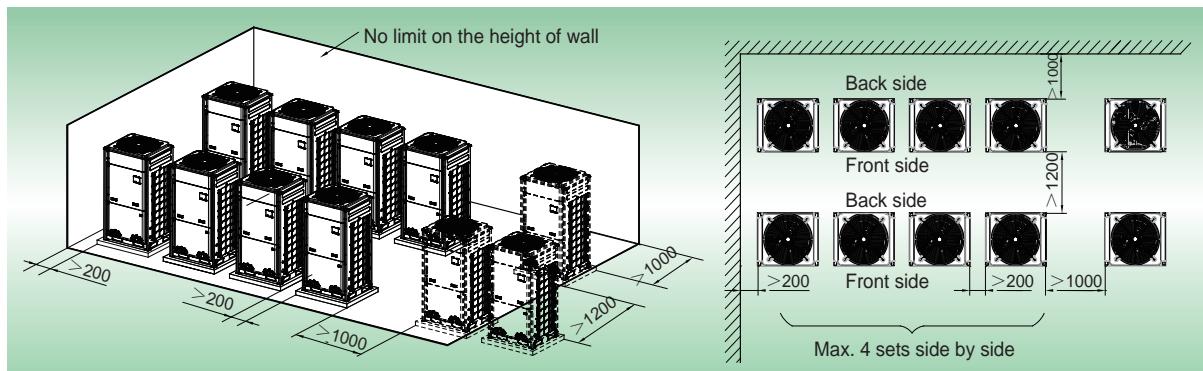


3) Considering the seasonal wind in outdoor unit installation

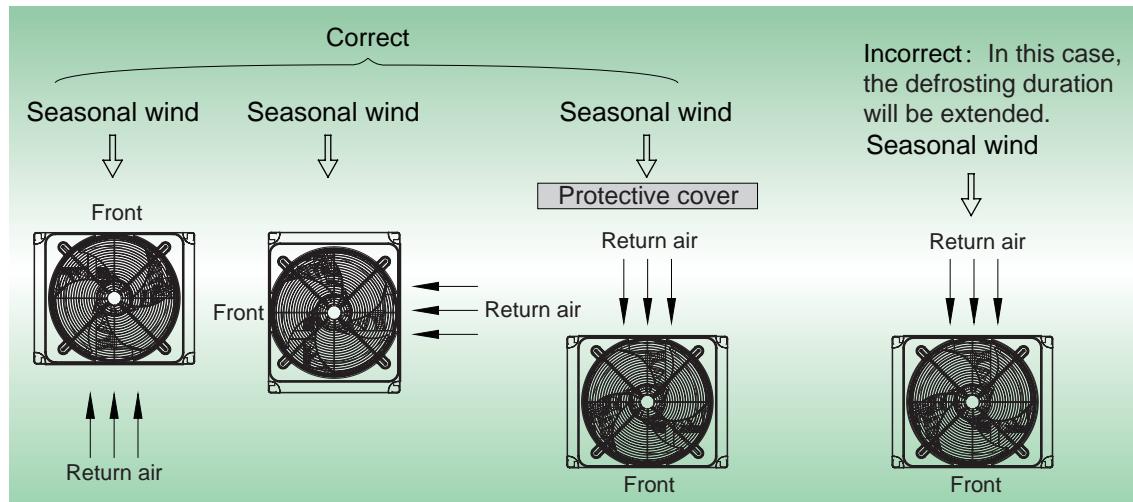

4) Considering snow in outdoor unit installation


CHV5 DC Inverter VRF Units Technical Sales Guide

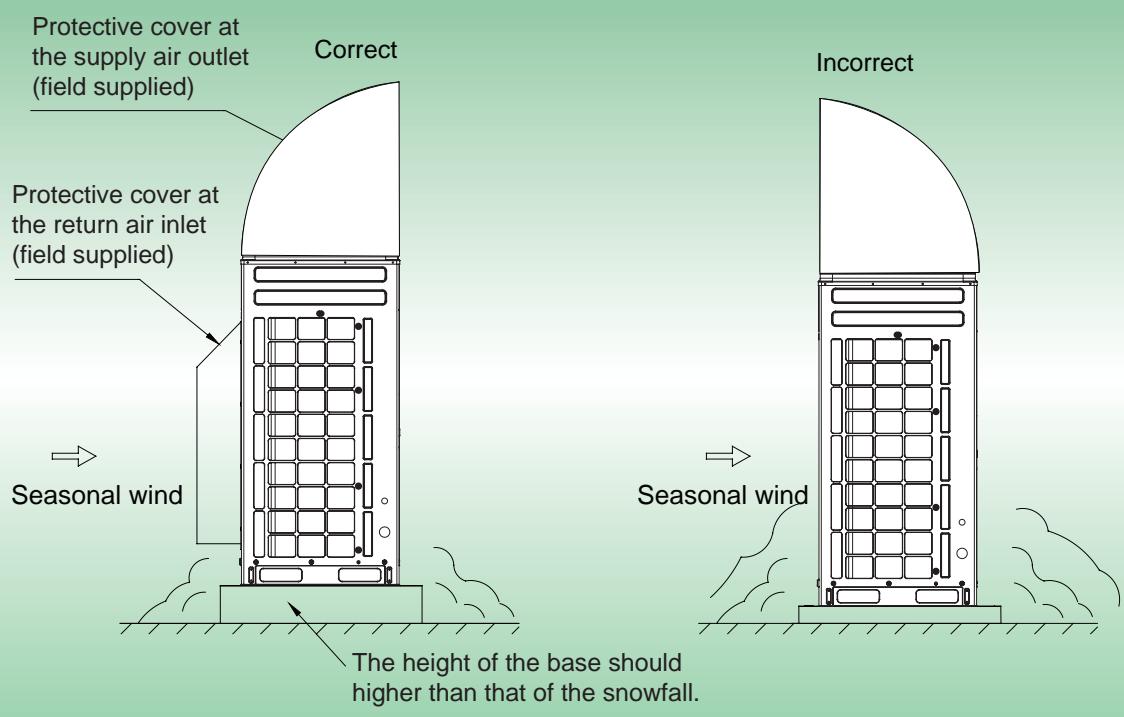

- 5) When the outdoor unit is installed on equipment, an air exhaust pipe should be connected, the aperture opening ratio of the louver cannot be smaller than 80%, and the included angle between the louver and the horizontal plane should be smaller than 20°.


10 MODEL SELECTION FOR UNIT PIPING

10.1 Schematic Diagram of Piping Connection

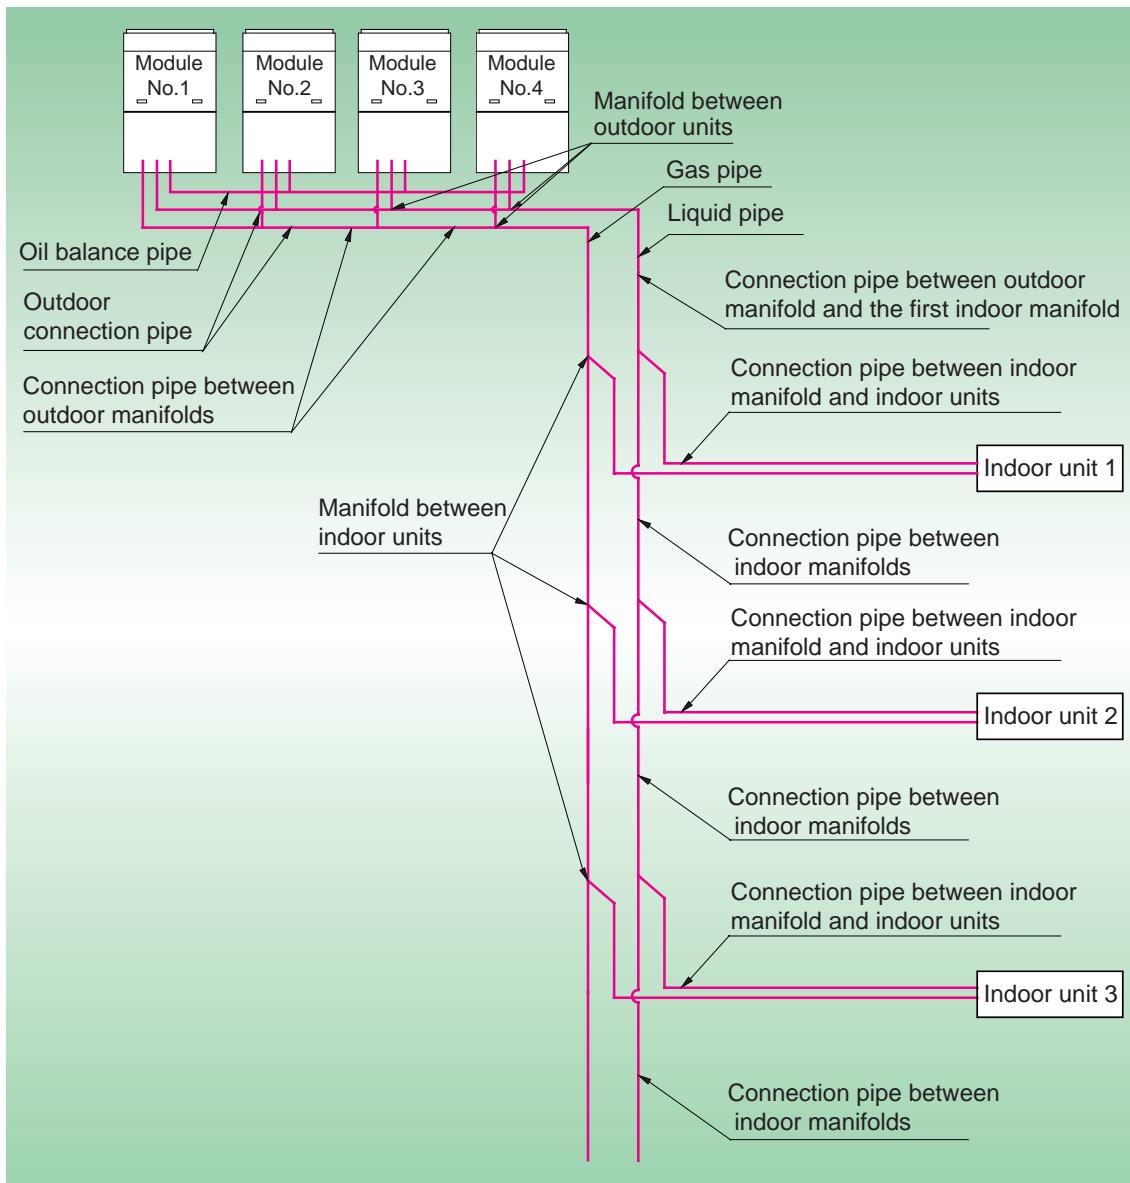


CHV5 DC Inverter VRF Units Technical Sales Guide

Schematic Diagram of Piping Sequence
CHV-5S224NMX and CHV-5S280NMX

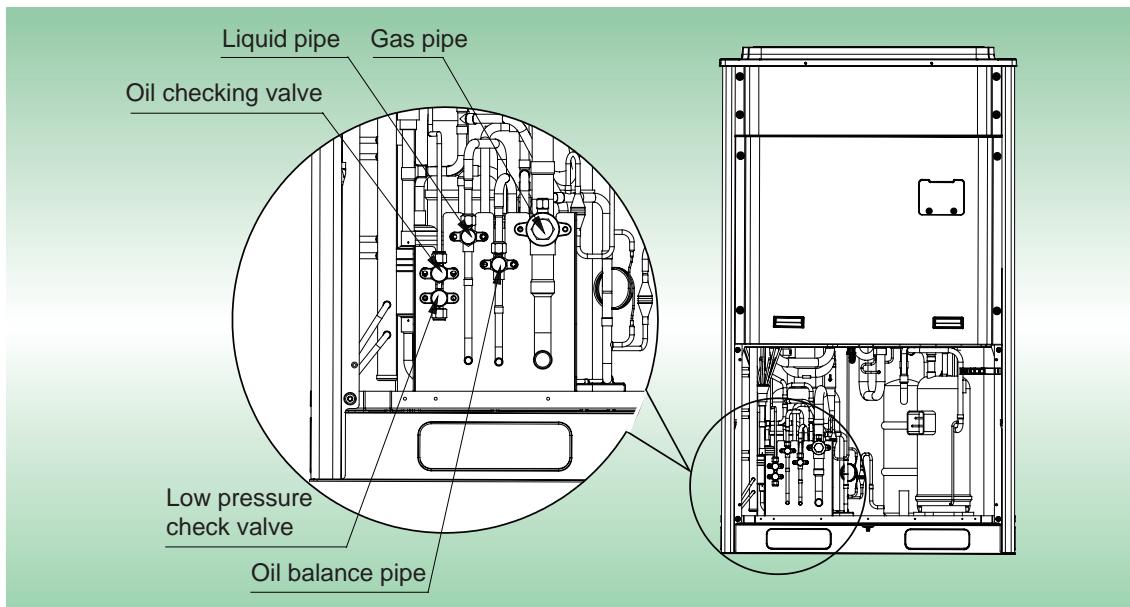


CHV-5S335NMX, CHV-5S400NMX and CHV-5S450NMX, CHV-5S504NMX , CHV-5S560NMX and CHV-5S615NMX

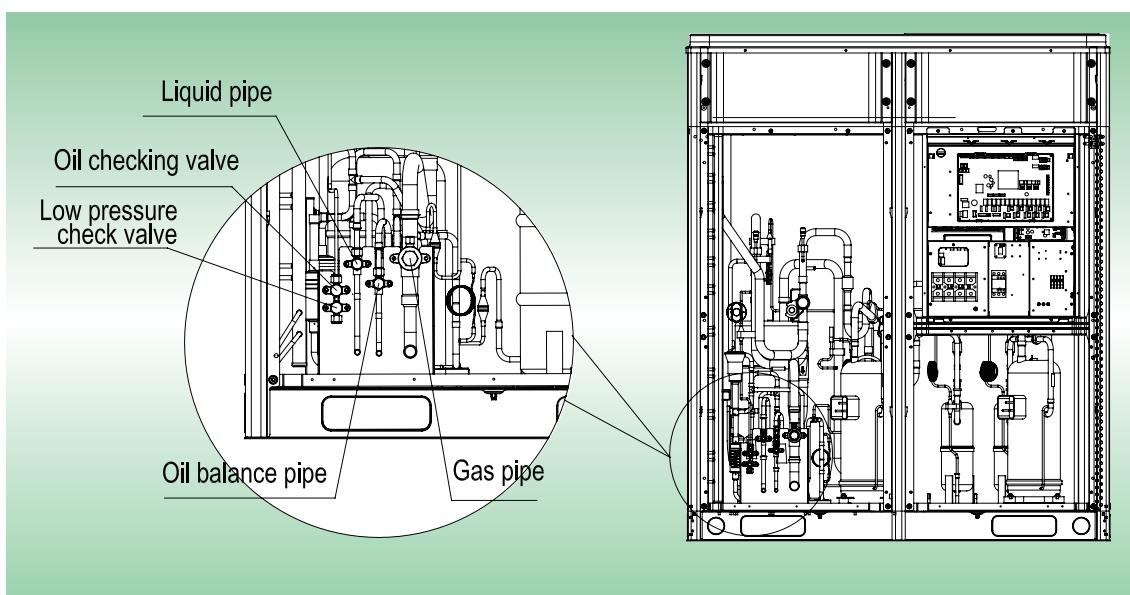

10.2 Allowable pipe length and drop height among indoor and outdoor units

Y type branch joint is adopted to connect indoor and outdoor units. Connecting method is shown in the figure below.

Remark: Equivalent length of one Y-type manifold is about 0.5m.

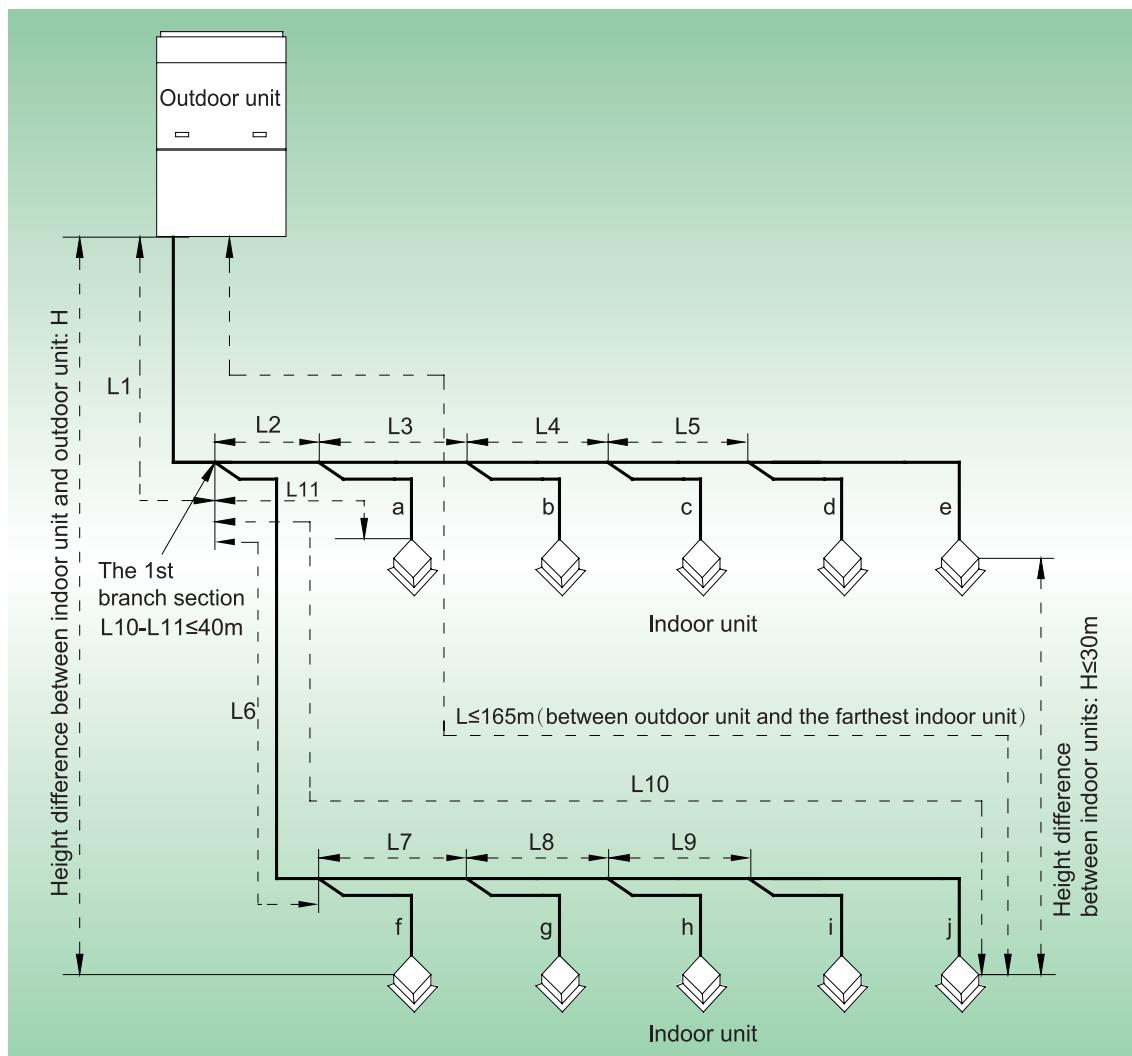

L10: Length from the first branch to the farthest IDU; L11: Length from the first branch to the nearest IDU;
 Equivalent length of branch of IDU is 0.5m

| R410A Refrigerant System | | Allowable Value | Fitting Pipe |
|---|-----------------------|-----------------|---|
| Total length (actual length) of fitting pipe | | ≤ 1000 | $L_1 + L_2 + L_3 + L_4 + \dots + L_9 + a + b + \dots + i + j$ |
| Length of farthest fitting pipe(m) | Actual length | ≤ 165 | $L_1 + L_6 + L_7 + L_8 + L_9 + j$ |
| | Equivalent length | ≤ 190 | |
| Difference between the pipe length from the first branch of IDU to the farthest IDU and the pipe length from the first branch of IDU to the nearest IDU | | ≤ 40 | $L_{10} - L_{11}$ |
| Equivalent length from the first branch to the furthest piping (1) | | ≤ 40 | $L_6 + L_7 + L_8 + L_9 + j$ |
| Height difference between outdoor unit and indoor unit | Outdoor unit at upper | ≤ 90 | — |
| | Outdoor unit at lower | ≤ 90 | — |

CHV5 DC Inverter VRF Units Technical Sales Guide

| | | |
|--|-----------|---------------------|
| Height difference between indoor units (m) | ≤ 30 | — |
| Maximum length of Main pipe(2) | ≤ 90 | L1 |
| From IDU to its nearest branch (3) | ≤ 10 | a,b,c,d,e,f,g,h,i,j |

NOTES:

- (1) Normally, the pipe length from the first branch of IDU to the farthest IDU is 40m. When those three conditions as below are satisfied, the length can reached 90m.

 - ① Actual length of pipe in total: $L1+L2x2+L3x2+L4x2+\dots+L9x2+a+b+\dots+i+j \leq 1000\text{m}$;
 - ② Length between each IDU and its nearest branch $a, b, c, d, e, f, g, h, i, j \leq 40\text{m}$;
 - ③ Difference between the pipe length from the first branch of IDU to the farthest IDU and the pipe length from the first branch of IDU to the nearest IDU: $L10-L11 \leq 40\text{m}$.



(2) When the maximum length of the main pipe from ODU to the first branch of IDU is $\geq 90\text{m}$, then adjust the pipe size of the gas pipe and liquid pipe of main pipe according to the following table.

| Outdoor Model | Gas pipe size(mm) | Liquid pipe size(mm) |
|---------------|------------------------------|------------------------------|
| CHV-5S224NMX | No need to enlarge pipe size | No need to enlarge pipe size |
| CHV-5S280NMX | No need to enlarge pipe size | Φ 12.7 |
| CHV-5S335NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S400NMX | Φ 31.8 | Φ 15.9 |
| CHV-5S450NMX | Φ 31.8 | Φ 15.9 |
| CHV-5S504NMX | Φ 34.9 | Φ 19.05 |
| CHV-5S560NMX | Φ 34.9 | Φ 19.05 |
| CHV-5S615NMX | Φ 34.9 | Φ 19.05 |
| CHV-5S680NMX | No need to enlarge pipe size | Φ 19.05 |
| CHV-5S730NMX | Φ 38.1 | Φ 22.2 |
| CHV-5S785NMX | Φ 38.1 | Φ 22.2 |
| CHV-5S850NMX | Φ 38.1 | Φ 22.2 |
| CHV-5S900NMX | Φ 38.1 | Φ 22.2 |
| CHV-5S960NMX | Φ 41.3 | Φ 22.2 |
| CHV-5S1010NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1065NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1130NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1180NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1235NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1300NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1350NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1410NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1460NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1515NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1580NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1630NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1685NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1750NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1800NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1845NMX | Φ 44.5 | Φ 25.4 |
| CHV-5S1908NMX | No need to enlarge pipe size | Φ 25.4 |
| CHV-5S1962NMX | No need to enlarge pipe size | Φ 25.4 |
| CHV-5S2016NMX | No need to enlarge pipe size | Φ 25.4 |

| | | |
|---------------|------------------------------|-------------|
| CHV-5S2072NMX | No need to enlarge pipe size | $\Phi 25.4$ |
| CHV-5S2128NMX | No need to enlarge pipe size | $\Phi 25.4$ |
| CHV-5S2184NMX | No need to enlarge pipe size | $\Phi 25.4$ |
| CHV-5S2240NMX | No need to enlarge pipe size | $\Phi 25.4$ |
| CHV-5S2295NMX | No need to enlarge pipe size | $\Phi 25.4$ |
| CHV-5S2350NMX | No need to enlarge pipe size | $\Phi 25.4$ |
| CHV-5S2405NMX | No need to enlarge pipe size | $\Phi 25.4$ |
| CHV-5S2460NMX | No need to enlarge pipe size | $\Phi 25.4$ |

(3) If the length between an IDU and its nearest branch is above 10m, then increase the size of the liquid pipe of IDU (only for the pipe size that is $\leq 6.35\text{mm}$).


10.3 Connection Pipe among Outdoor Modules

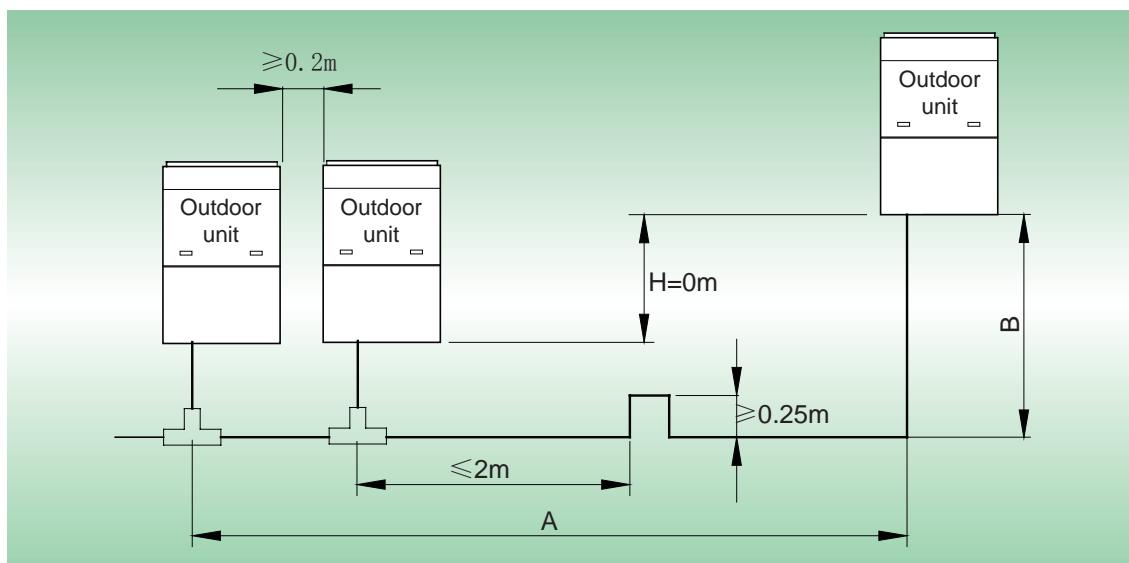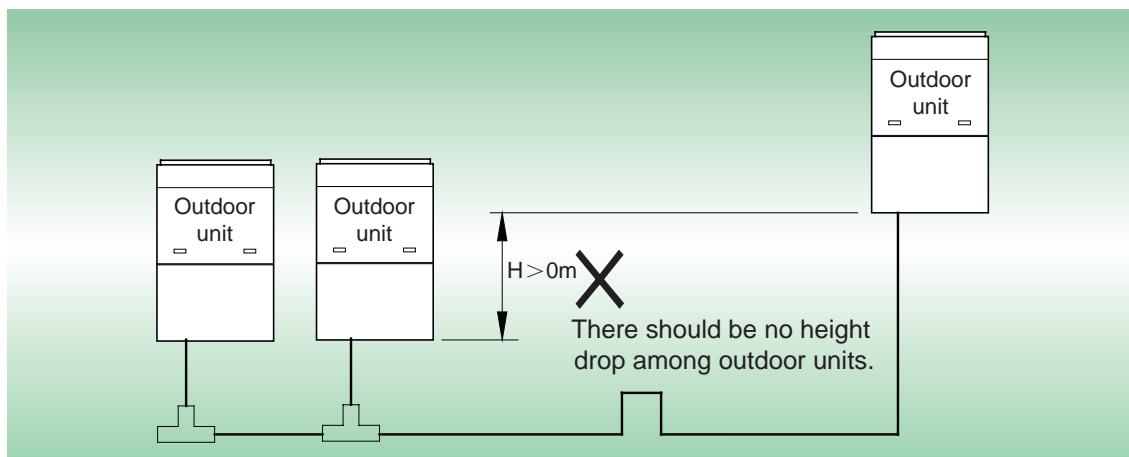

NOTES: When the distance between outdoor units exceeds 2m, U-type oil trap should be added at low-pressure gas pipe. $A+B\leq 10\text{m}$.


The pipeline between outdoor units should be installed as follows:

CHV5 DC Inverter VRF Units Technical Sales Guide

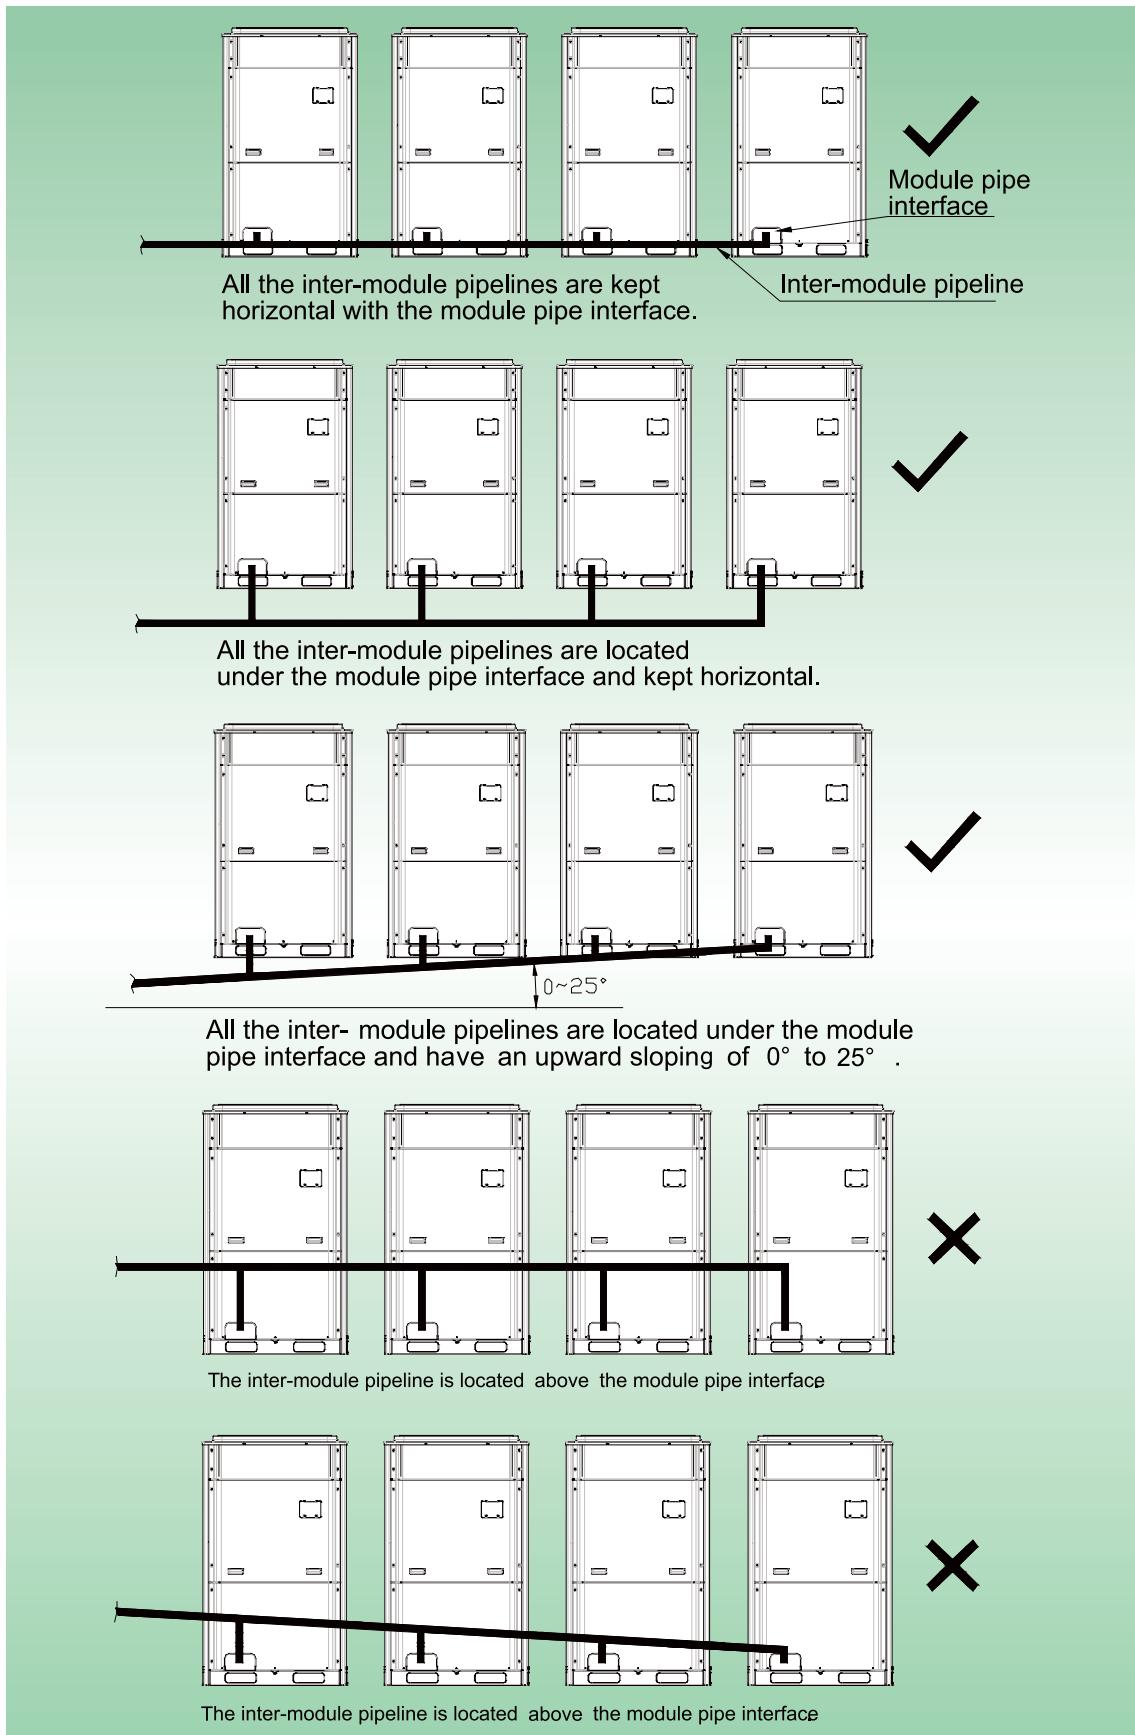

10.4 Fitting pipe between Outdoor Unit and the First Manifold


- 1) For single module system, pipe size (between outdoor unit and the first manifold) is determined by that of outdoor unit.

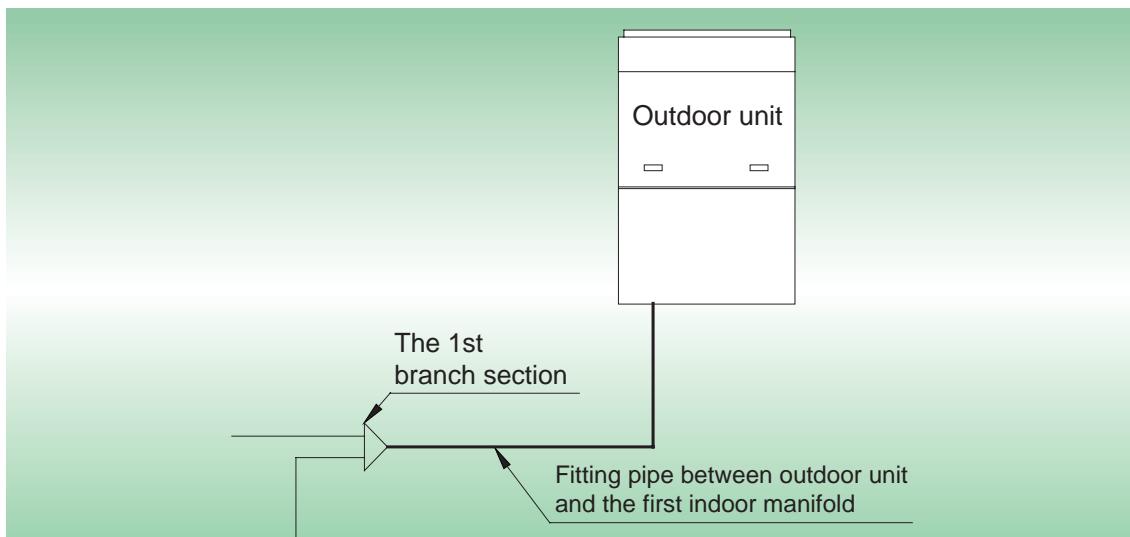

Pipe size of basic outdoor module is shown as follows:

| Basic Module | Pipe between ODU and the first branch of IDU | |
|--------------|--|-----------------|
| | Gas Pipe(mm) | Liquid Pipe(mm) |
| CHV-5S224NMX | Φ 19.05 | Φ 9.52 |
| CHV-5S280NMX | Φ 22.2 | Φ 9.52 |
| CHV-5S335NMX | Φ 25.4 | Φ 12.7 |
| CHV-5S400NMX | Φ 25.4 | Φ 12.7 |
| CHV-5S450NMX | Φ 28.6 | Φ 12.7 |
| CHV-5S504NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S560NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S615NMX | Φ 28.6 | Φ 15.9 |

- 2) For multi-module unit, select appropriate manifold connected to outdoor module as per the pipe size of basic module. Pipe size of basic outdoor module is shown as follows:

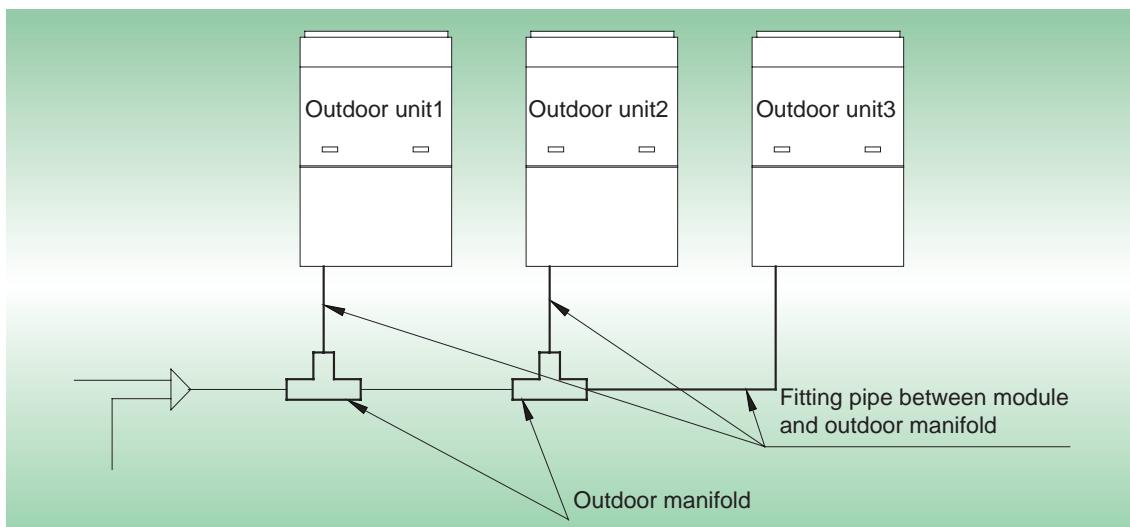

CHV5 DC Inverter VRF Units Technical Sales Guide


| Basic Module | Pipe between module and branch of ODU | |
|--------------|---------------------------------------|-----------------|
| | Gas Pipe(mm) | Liquid Pipe(mm) |
| CHV-5S224NMX | Φ 19.05 | Φ 9.52 |
| CHV-5S280NMX | Φ 22.2 | Φ 9.52 |
| CHV-5S335NMX | Φ 25.4 | Φ 12.7 |
| CHV-5S400NMX | Φ 25.4 | Φ 12.7 |
| CHV-5S450NMX | Φ 28.6 | Φ 12.7 |
| CHV-5S504NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S560NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S615NMX | Φ 28.6 | Φ 15.9 |

Select the branch of outdoor module

| | Module's capacity (C) | Model |
|-------------------------------------|-----------------------|-------|
| Select the branch of outdoor module | 504≤C | CH01N |


3) Fitting pipe between two manifolds from basic modules

Pipe size (between two manifolds from basic modules) is based on the total capacity of upstream modules.

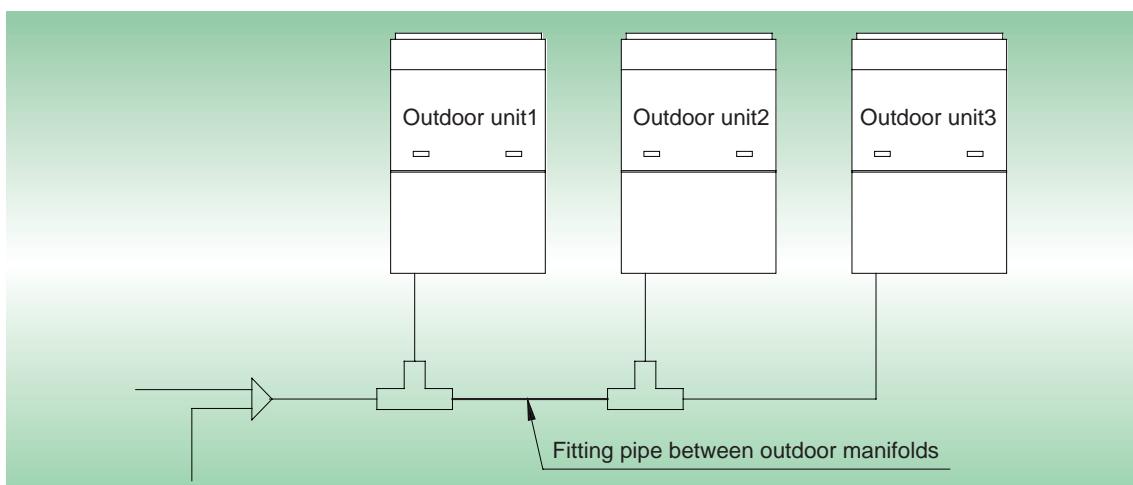


| Total capacity of upstream modules Q(kW) | Pipe size between manifolds | |
|--|-----------------------------|-----------------|
| | Gas Pipe(mm) | Liquid Pipe(mm) |
| 22.4 ≥ Q | Φ 19.05 | Φ 9.52 |
| 28.0 ≥ Q > 22.4 | Φ 22.2 | Φ 9.52 |
| 40.0 ≥ Q > 28.0 | Φ 25.4 | Φ 12.7 |
| 45.0 ≥ Q > 40.0 | Φ 28.6 | Φ 12.7 |
| 68.0 ≥ Q > 45.0 | Φ 28.6 | Φ 15.9 |
| 96.0 ≥ Q > 68.0 | Φ 31.8 | Φ 19.05 |
| 135.0 ≥ Q > 96.0 | Φ 38.1 | Φ 19.05 |
| Q > 135.0 | Φ 44.5 | Φ 22.2 |

- 4) Fitting pipe between the first manifold from indoor unit and the end manifold from outdoor unit
 Single module unit

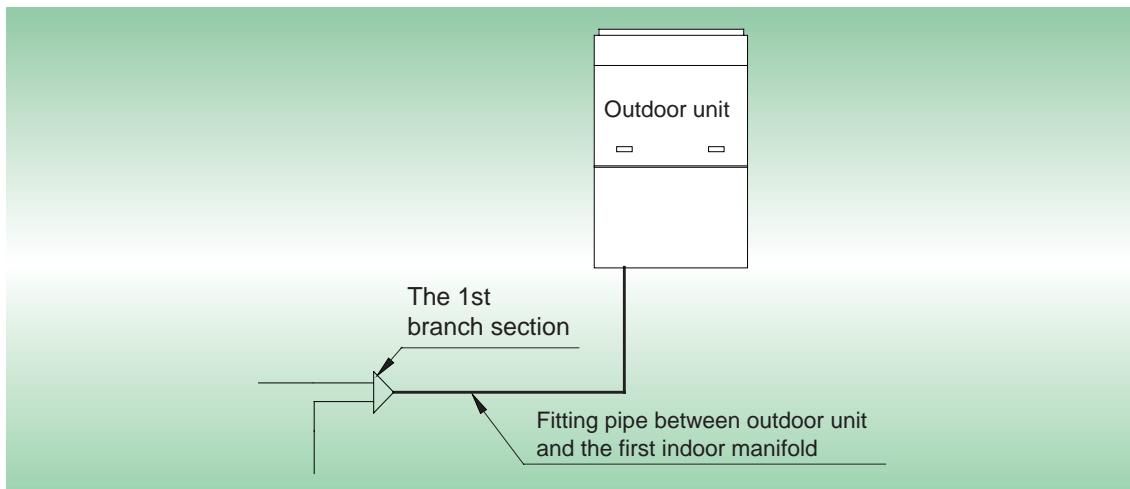

| Basic Module(single module) | Pipe between ODU and the first branch of IDU | |
|-----------------------------|--|-----------------|
| | Gas Pipe(mm) | Liquid Pipe(mm) |
| CHV-5S224NMX | Φ 19.05 | Φ 9.52 |
| CHV-5S280NMX | Φ 22.2 | Φ 9.52 |
| CHV-5S335NMX | Φ 25.4 | Φ 12.7 |
| CHV-5S400NMX | Φ 25.4 | Φ 12.7 |
| CHV-5S450NMX | Φ 28.6 | Φ 12.7 |
| CHV-5S504NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S560NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S615NMX | Φ 28.6 | Φ 15.9 |

For multiple modules, the piping from ODU to the first branch of IDU is based on the total rated capacity of outdoor modules.

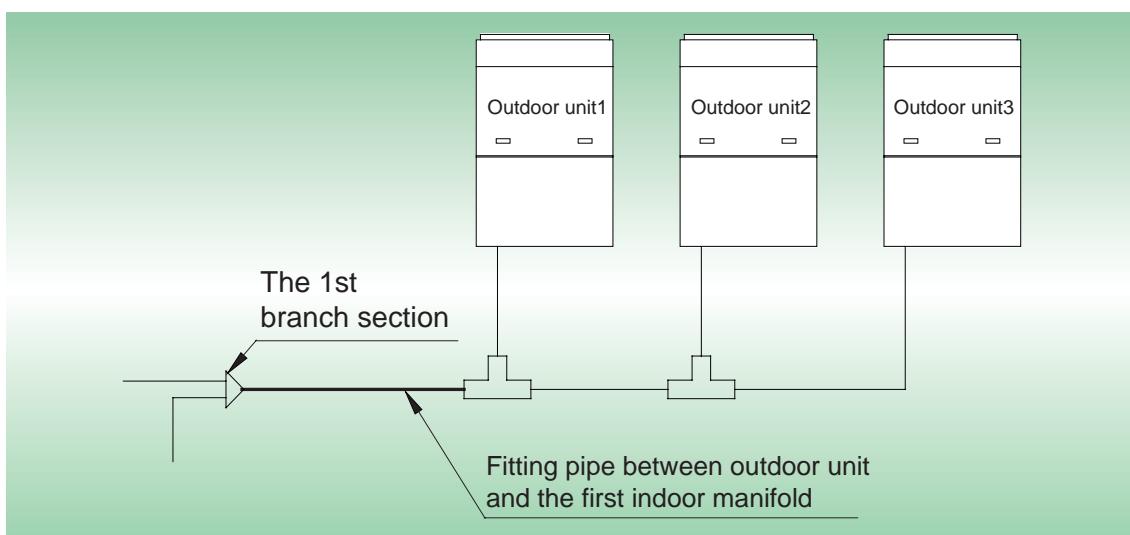


CHV5 DC Inverter VRF Units Technical Sales Guide

| Total rated capacity of outdoor modules (multi-modular system) | Pipe between ODU and the first branch of IDU | |
|--|--|-----------------|
| | Gas Pipe(mm) | Liquid Pipe(mm) |
| CHV-5S504NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S560NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S615NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S680NMX | Φ 28.6 | Φ 15.9 |
| CHV-5S730NMX | Φ 31.8 | Φ 19.05 |
| CHV-5S785NMX | Φ 31.8 | Φ 19.05 |
| CHV-5S850NMX | Φ 31.8 | Φ 19.05 |
| CHV-5S900NMX | Φ 31.8 | Φ 19.05 |
| CHV-5S960NMX | Φ 31.8 | Φ 19.05 |
| CHV-5S1010NMX | Φ 38.1 | Φ 19.05 |
| CHV-5S1065NMX | Φ 38.1 | Φ 19.05 |
| CHV-5S1130NMX | Φ 38.1 | Φ 19.05 |
| CHV-5S1180NMX | Φ 38.1 | Φ 19.05 |
| CHV-5S1235NMX | Φ 38.1 | Φ 19.05 |
| CHV-5S1300NMX | Φ 38.1 | Φ 19.05 |
| CHV-5S1350NMX | Φ 38.1 | Φ 19.05 |
| CHV-5S1410NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1460NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1515NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1580NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1630NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1685NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1750NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1800NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1845NMX | Φ 41.3 | Φ 19.05 |
| CHV-5S1908NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S1962NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2016NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2072NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2128NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2184NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2240NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2295NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2350NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2405NMX | Φ 44.5 | Φ 22.2 |
| CHV-5S2460NMX | Φ 44.5 | Φ 22.2 |

5) Manifold at indoor unit side


Manifold at indoor unit side can be selected as per total capacity of downstream indoor unit(s). Refer to the following table.

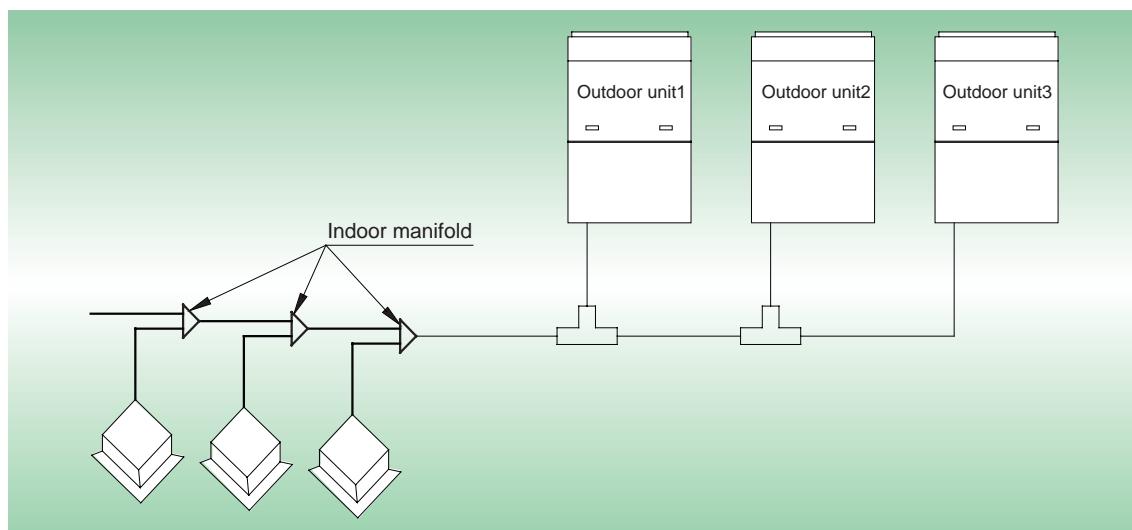

| R410A Refrigerant System | Total capacity of downstream indoor unit(s) C (kW) | Model |
|--------------------------|--|--------|
| Y-type Manifold | $C \leq 20.0$ | CH020N |
| | $20.0 < C \leq 30.0$ | CH030N |
| | $30.0 < C \leq 70.0$ | CH070N |
| | $70.0 < C \leq 135.0$ | CH135N |
| | $135.0 < C$ | CH270N |

6) Fitting pipe between manifolds

Pipe size (between two manifolds at indoor unit side) is based on the total capacity of upstream indoor unit(s).

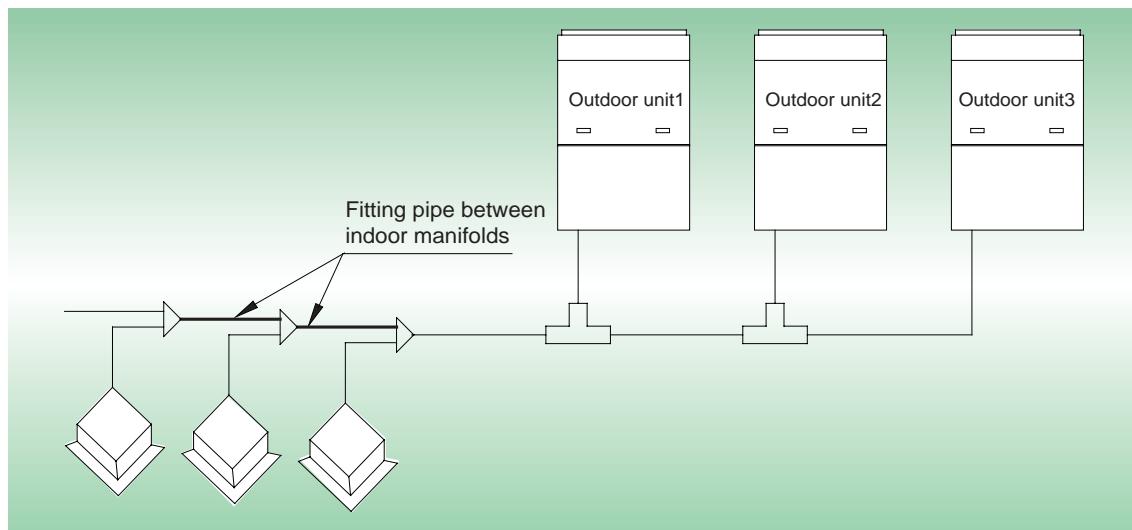


CHV5 DC Inverter VRF Units Technical Sales Guide

| Total capacity of downstream indoor unit(s) C(kW) | Dimension of the pipe of indoor branch | |
|---|--|------------------|
| | Gas Pipe(mm) | Liquid Pipe (mm) |
| $C \leq 5.6$ | $\Phi 12.7$ | $\Phi 6.35$ |
| $5.6 < C \leq 14.2$ | $\Phi 15.9$ | $\Phi 9.52$ |
| $14.2 < C \leq 22.4$ | $\Phi 19.05$ | $\Phi 9.52$ |
| $22.4 < C \leq 28.0$ | $\Phi 22.2$ | $\Phi 9.52$ |
| $28.0 < C \leq 40.0$ | $\Phi 25.4$ | $\Phi 12.7$ |
| $40.0 < C \leq 45.0$ | $\Phi 28.6$ | $\Phi 12.7$ |
| $45.0 < C \leq 68.0$ | $\Phi 28.6$ | $\Phi 15.9$ |
| $68.0 < C \leq 96.0$ | $\Phi 31.8$ | $\Phi 19.05$ |
| $96.0 < C \leq 135.0$ | $\Phi 38.1$ | $\Phi 19.05$ |
| $135.0 < C$ | $\Phi 44.5$ | $\Phi 22.2$ |

7) Fitting pipe between indoor unit and manifold


Manifold should be matched with fitting pipe of indoor unit.

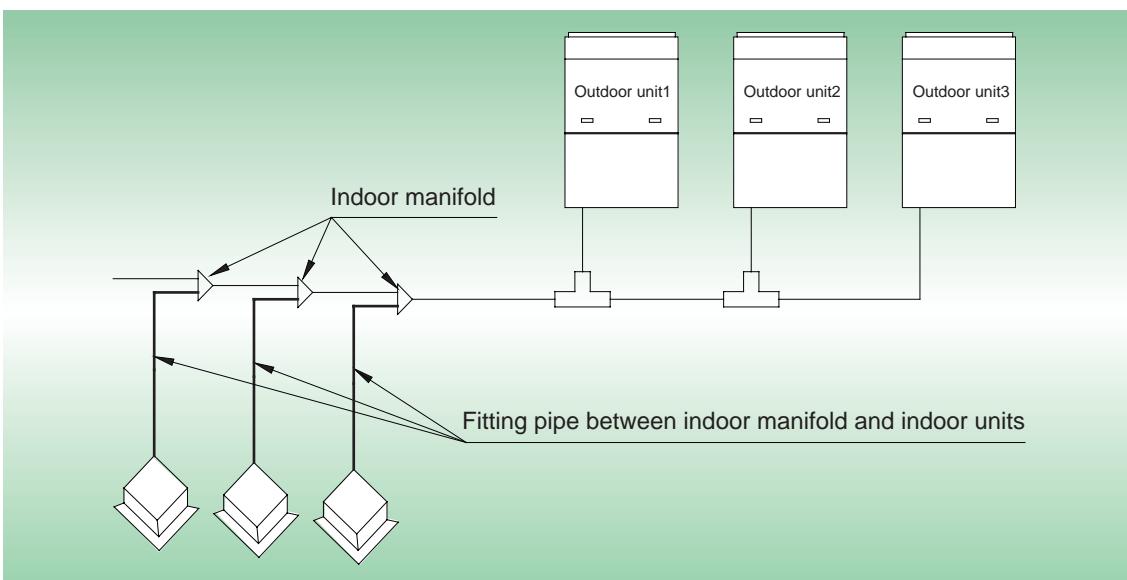

| Rated capacity of indoor unit C(kW) | Pipe between indoor branch and IDU | |
|-------------------------------------|------------------------------------|-----------------|
| | Gas Pipe(mm) | Liquid Pipe(mm) |
| $C \leq 2.8$ | $\Phi 9.52$ | $\Phi 6.35$ |
| $2.8 < C \leq 5.0$ | $\Phi 12.7$ | $\Phi 6.35$ |
| $5.0 < C \leq 14.0$ | $\Phi 15.9$ | $\Phi 9.52$ |
| $14.0 < C \leq 16.0$ | $\Phi 19.05$ | $\Phi 9.52$ |
| $16.0 < C \leq 28.0$ | $\Phi 22.2$ | $\Phi 9.52$ |

11 REQUIREMENTS FOR COMMUNICATION MODE


The CHV5 VRF unit air conditioning system adopts the CAN communication network. Manual dialling and differentiation of the communication cable polarity are not required for the indoor unit, and only functional dialling should be set for the indoor unit.

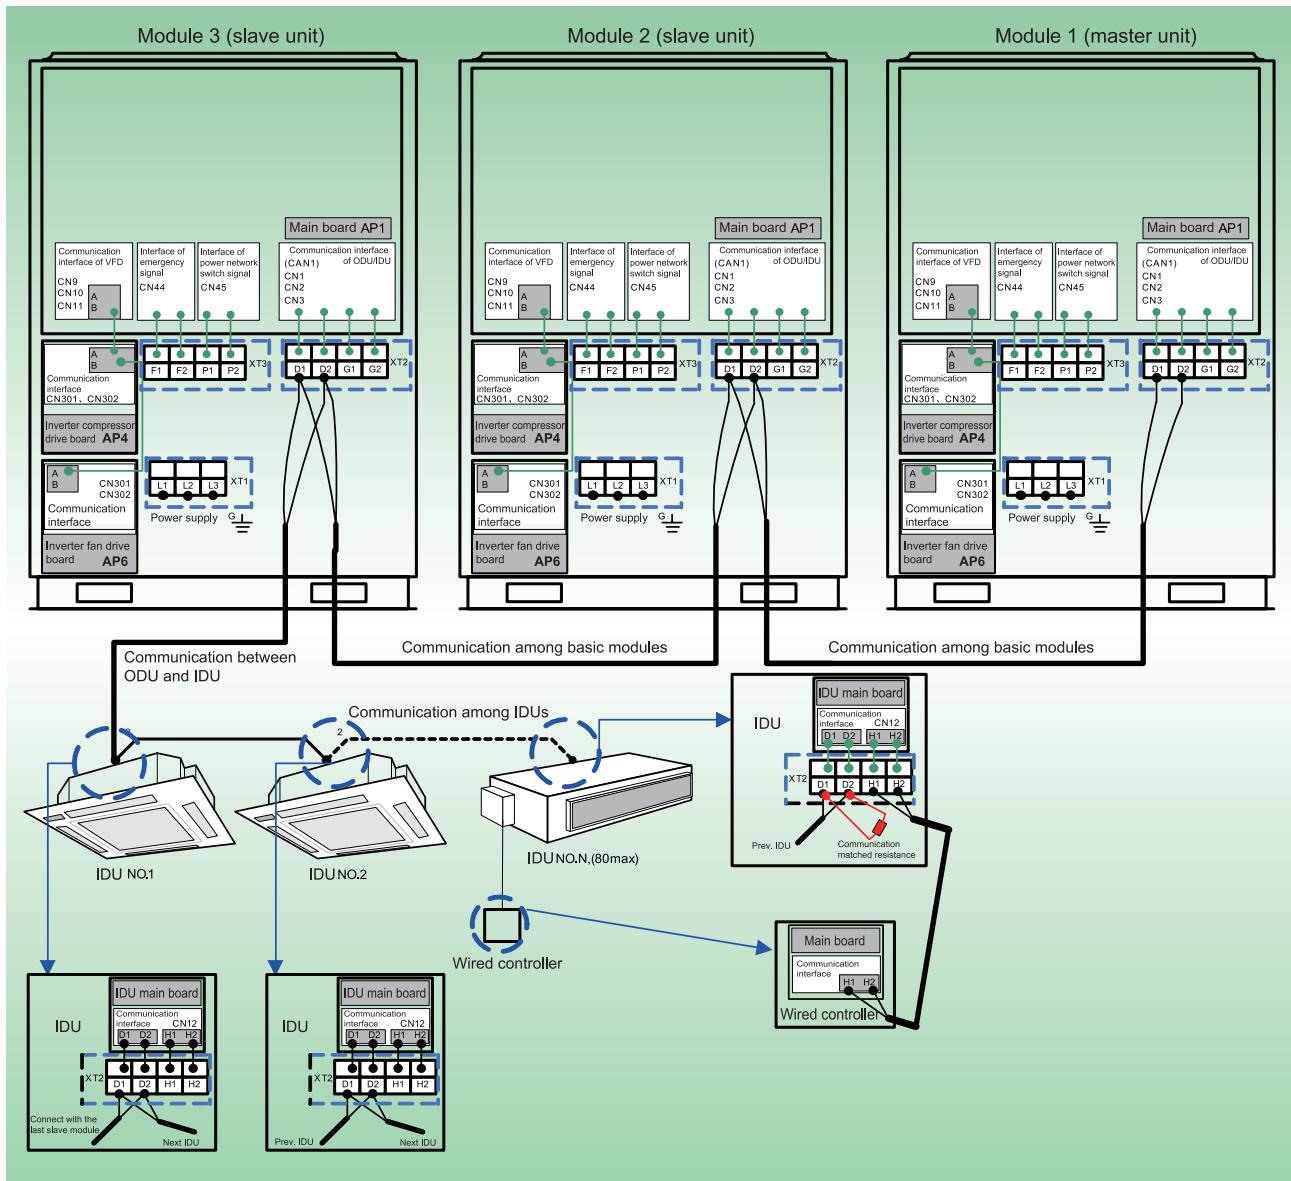

CHV5 DC Inverter VRF Units Technical Sales Guide

11.1 Connection Mode of Connection Line Terminals

All the communication connections of CHV5 are in the screw fastening mode.

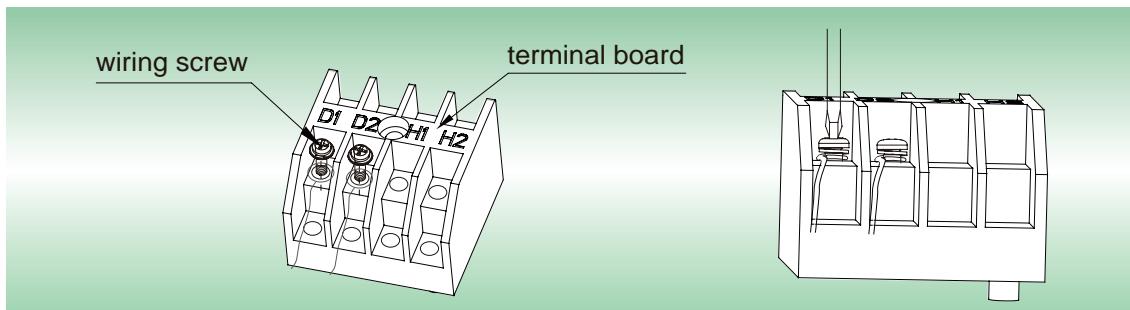

11.2 Communication Cable Material and Wring Mode

11.2.1 Communication Material

Module selection for the communication cables of outdoor unit and indoor unit.

| Material Type | Total Length L(m) of Communication Cable between IDU Unit and IDU (ODU) Unit L(m) | Wire size (mm ²) | Material Standard | Remarks |
|---|--|------------------------------|-------------------|--|
| Light/Ordinary polyvinyl chloride sheathed cord. (60227 IEC 52 /60227 IEC 53) | L≤1000 | ≥2×0.75 | IEC 60227-5:2007 | 1. If the wire diameter is enlarged to 2 × 1 mm ² , the total communication length can reach 1500m. 2. The cord shall be Circular cord (the cores shall be twisted together). 3. If unit is installed in places with intense magnetic field or strong interference, it is necessary to use shielded wire. |




Module selection for the communication cable between the indoor unit and wired controller.

| Material type | Total length of communication line between IDU unit and wired controller L(m) | Wire size (mm ²) | Material standard | Remarks |
|---|---|------------------------------|-------------------|--|
| Light/Ordinary polyvinyl chloride sheathed cord. (60227 IEC 52 /60227 IEC 53) | L≤250 | 2×0.75~2×1.25 | IEC 60227-5:2007 | 1. Total length of communication line can't exceed 250m. 2. The cord shall be Circular cord (the cores shall be twisted together). 3. If unit is installed in places with intense magnetic field or strong interference, it is necessary to use shielded wire. |

NOTES: If the air conditioning units are installed at a place with strong electromagnetic interference, a shielded cable must be used as the communication cable between the indoor unit and wired controller, and a shielded twisted pair must be used as the communication cable between the indoor unit and indoor (outdoor) unit.

11.2.2 Communication Access Mode

The communication bus of CHV5 indoor and outdoor units must be connected in series, and star connection is forbidden. The indoor unit at the end of the communication bus for the indoor units and outdoor units must be connected to a communication matching resistor (which is contained in the packing bag of the outdoor unit).

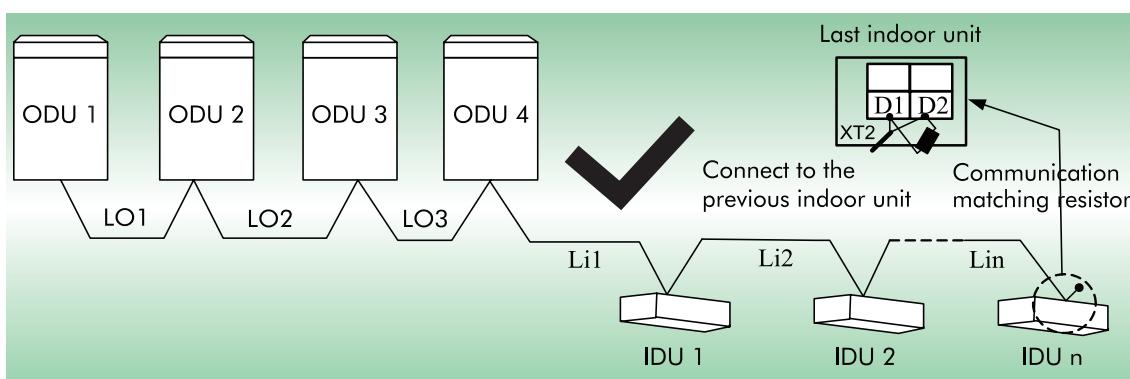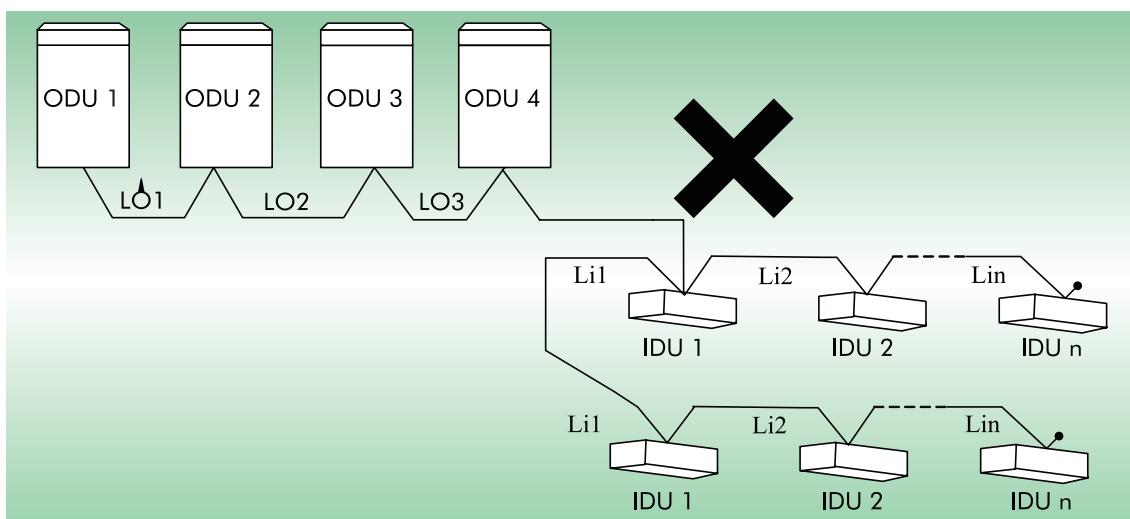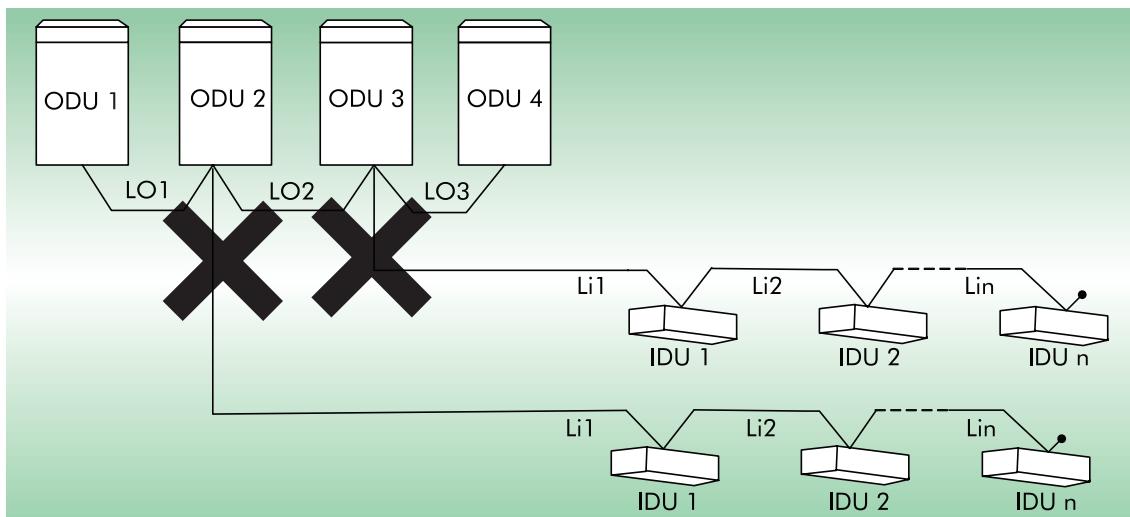


11.3 Connection Method and Procedure of Communication Cable

11.3.1 Communication connection between the indoor unit and outdoor unit


The indoor unit is connected to the outdoor unit through the D1/D2 port of the terminal plate XT2. The figures below show the connection method of the single outdoor unit and connection method of the modular outdoor unit.

CHV5 DC Inverter VRF Units Technical Sales Guide

Communication connection mode of the single module system

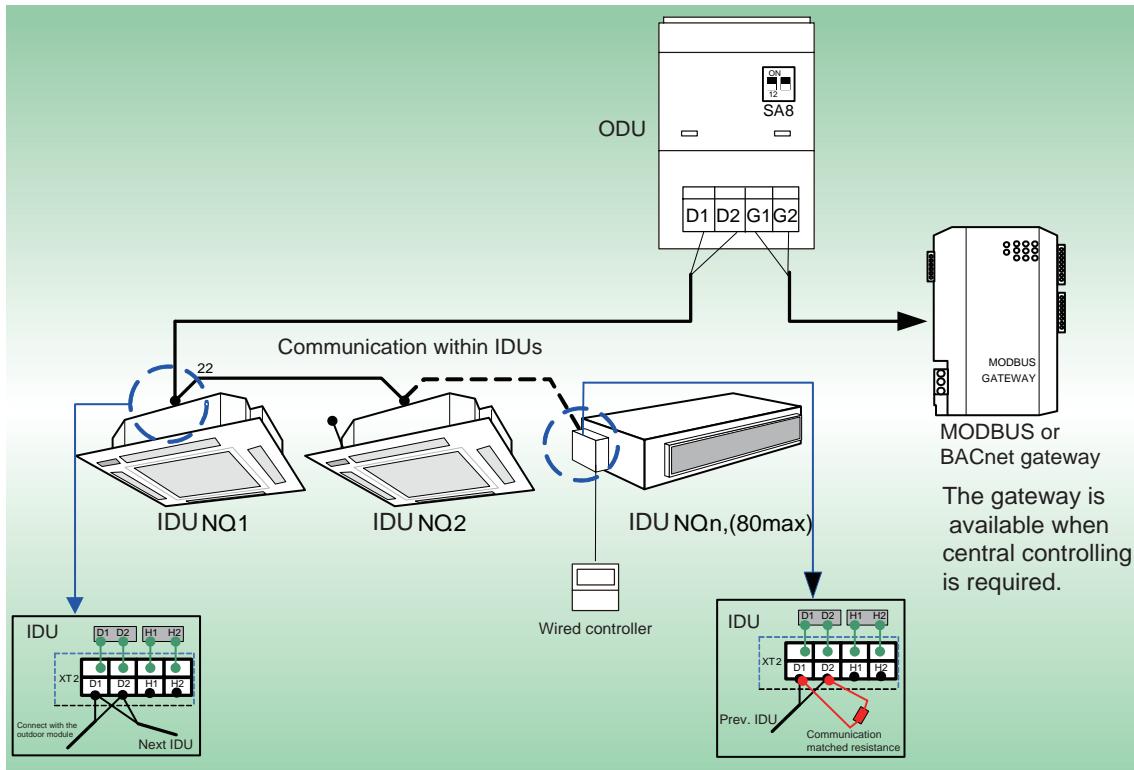

Communication connection mode of the multi-module system

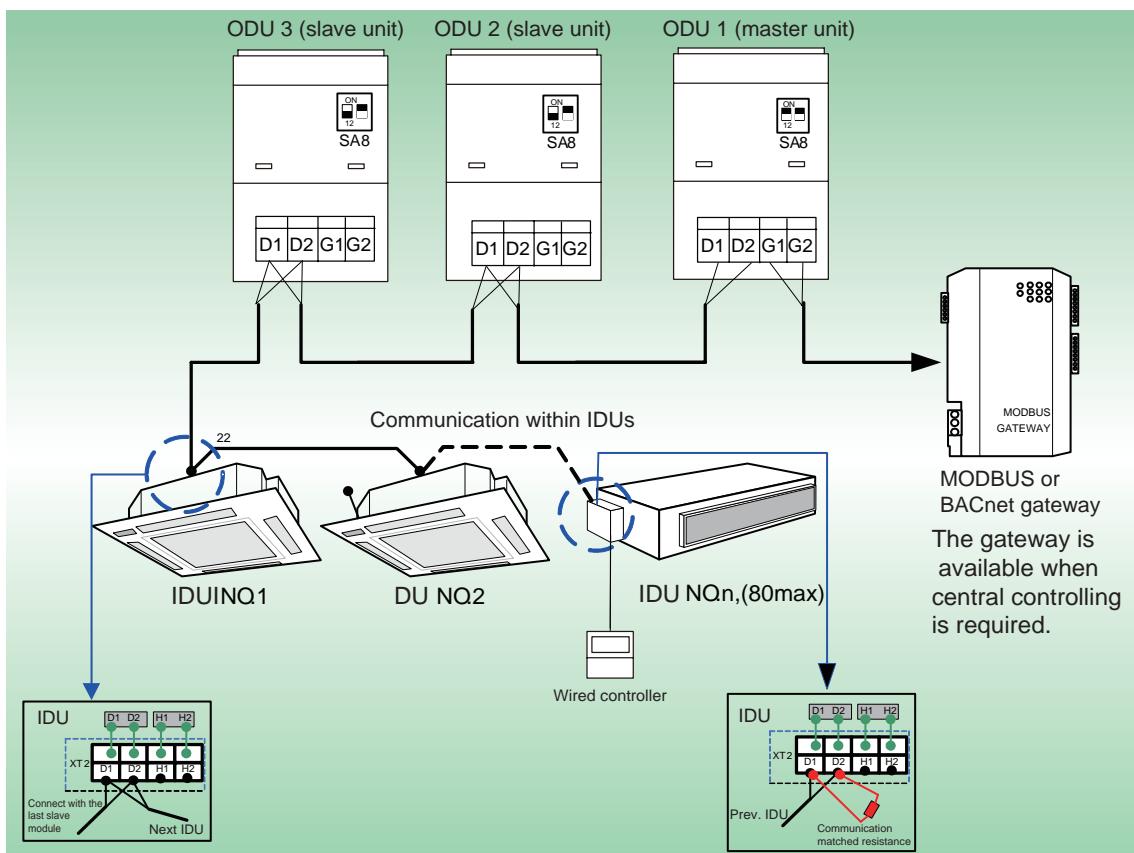

NOTES:

- a. For the modular outdoor unit, if multiple outdoor unit modules are available, the master unit must be the first outdoor unit module on the communication line and cannot be connected to any indoor unit (the master unit is set by SA8 of the main board for outdoor unit).
- b. For the modular outdoor unit, if multiple outdoor unit modules are available, the indoor unit must be connected to the last slave module of outdoor unit (the slave unit is set by SA8 of the main board for outdoor unit).
- c. The communication cable must be wired separately from the power cable to avoid interference.
- d. A proper length of communication cable must be selected, and no joint is allowed.
- e. The indoor units must be connected in series, and the last indoor unit must be connected to a communication matching resistor (which is provided in the list of outdoor unit accessories).

CHV5 DC Inverter VRF Units Technical Sales Guide

12 ELECTRICAL CONNECTION


12.1 External Connection Interfaces

| | | | |
|--------------------------------|-----------------------------------|----------|---------------|
| External connection interfaces | Power supply | Quantity | 5 |
| | | Label | L1 L2 L3 N PE |
| | Indoor/outdoor unit communication | Quantity | 2 |
| | | Label | D1 D2 |
| | Centralized control | Quantity | 2 |
| | | Label | G1 G2 |

12.2 External Connection

Every unit must be configured with a circuit breaker to implement short circuit and abnormal overload protection. Besides, the indoor unit and outdoor unit should be respectively configured with a general circuit breaker, which is used to uniformly connect to or cut off the general power supply for the indoor unit or outdoor unit.


1) External connection diagram of a single unit

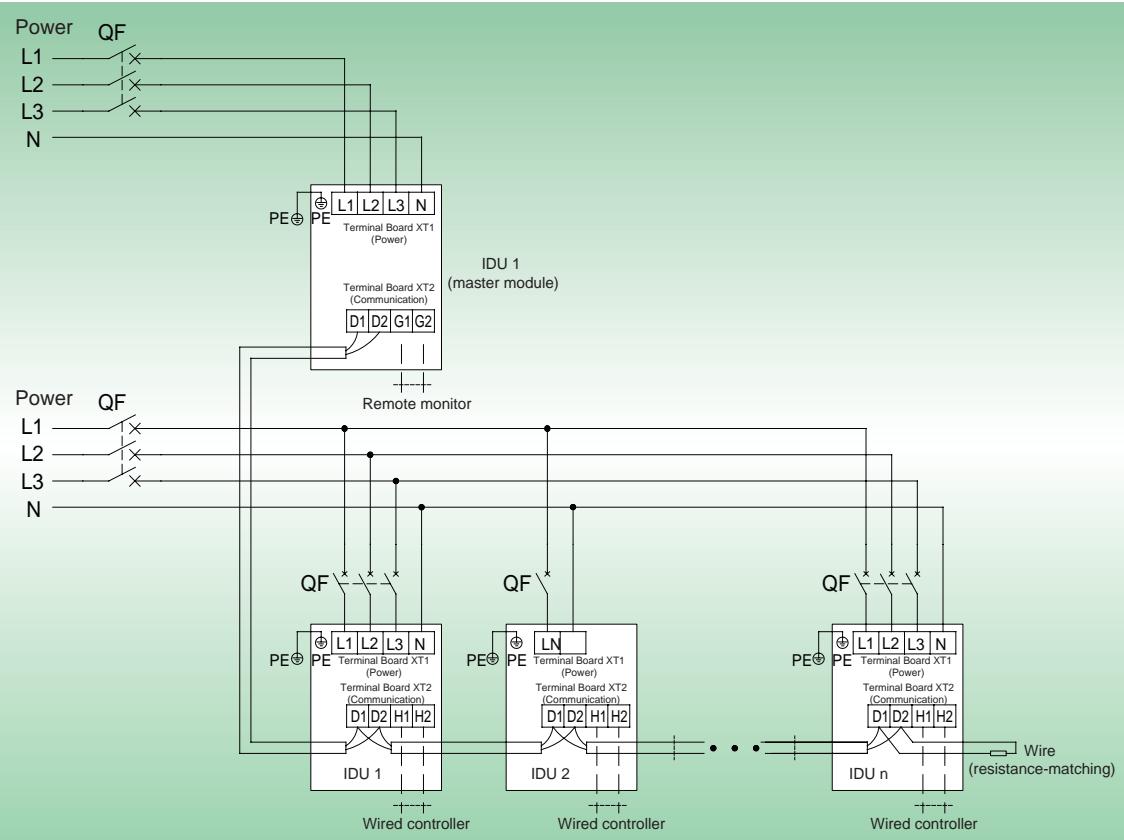

NOTES:

The maximum number n of connected indoor units depends on the outdoor unit capacity. For details, see the content of the introduction to unit combination.

2) External connection diagram of modular connection

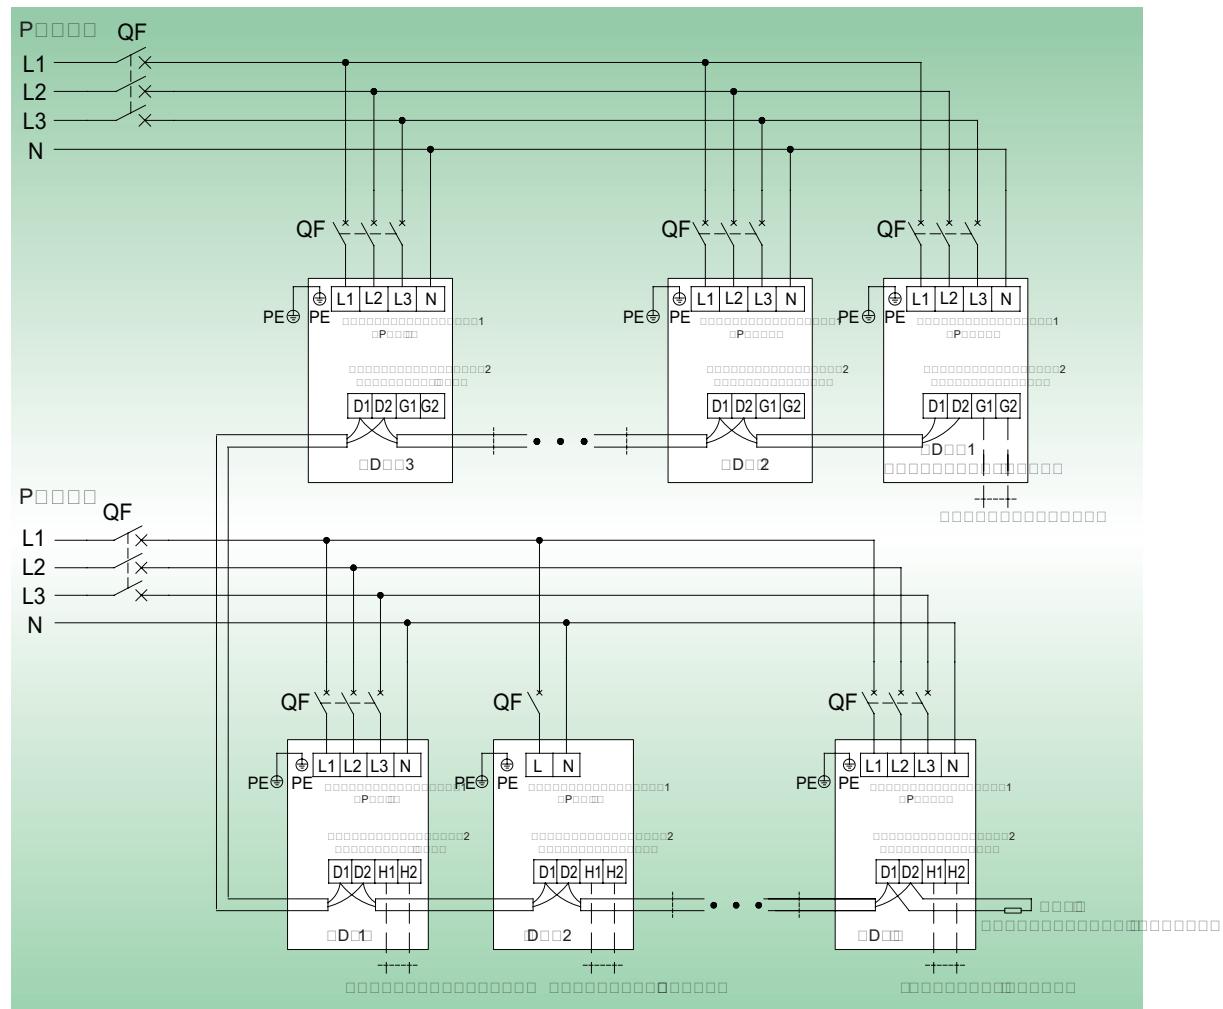
NOTES:

- The maximum number N of connected outdoor units and the maximum number n of connected indoor units depend on the outdoor unit combination form.
- A copper conductor must be used as a power cable. It must comply with the relevant national lead standard and meet the current-carrying capacity requirement of the unit.

CHV5 DC Inverter VRF Units Technical Sales Guide

13 CALCULATION METHOD OF REFRIGERANT ADDED FOR ENGINEERING PIPING

Added refrigerant quantity R = Added refrigerant quantity A for piping + \sum Added refrigerant quantity B for each module

1) Added refrigerant quantity A for piping is calculated as follows:

Added refrigerant quantity A for piping

= \sum Liquid pipe length × Added refrigerant quantity for each meter of liquid pipe

| Liquid pipe diameter (mm) | Φ28.6 | Φ25.4 | Φ22.2 | Φ19.05 | Φ15.9 | Φ12.7 | Φ9.52 | Φ6.35 |
|---------------------------|-------|-------|-------|--------|-------|-------|-------|-------|
| kg/m | 0.680 | 0.520 | 0.350 | 0.250 | 0.170 | 0.110 | 0.054 | 0.022 |

2) \sum Added refrigerant quantity B for each module is calculated as follows:

| Added refrigerant quantity B for each module (2) | | Module capacity (kW) | | | | | | | | |
|---|----------|-----------------------------------|------|------|------|------|------|------|------|------|
| Rated capacity configuration ratio C of outdoor/indoor unit (1) | | Number of configured indoor units | 22.4 | 28.0 | 33.5 | 40.0 | 45.0 | 50.4 | 56.0 | 61.5 |
| 50%≤C≤70% | ≤ 4 sets | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| | > 4 sets | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 1.0 | 1.5 | |
| 70%<C≤90% | ≤ 4 sets | 0.5 | 0.5 | 1 | 1.5 | 1.5 | 1.5 | 2.0 | 2 | |
| | > 4 sets | 1 | 1 | 1.5 | 2 | 2 | 2.5 | 3.0 | 3.5 | |
| 90%<C≤105% | ≤ 4 sets | 1 | 1 | 1.5 | 2 | 2 | 2.5 | 3.0 | 3.5 | |
| | > 4 sets | 2 | 2 | 3 | 3.5 | 3.5 | 4.0 | 4.5 | 5 | |
| 105%<C≤135% | ≤ 4 sets | 2 | 2 | 2.5 | 3 | 3 | 3.5 | 4 | 4 | |
| | > 4 sets | 3.5 | 3.5 | 4 | 5 | 5 | 5.5 | 6 | 6 | |

NOTES:

a. Rated capacity configuration ratio C of outdoor/indoor unit = Rated refrigerating capacity sum of indoor units/Rated refrigerating capacity sum of outdoor units

b. If all the indoor units are CHV-5SA series fresh air indoor units, the added refrigerant quantity B for every module is 0 kg.

Examples:

Example 1:

The outdoor unit consists of the three modules :CHV-5S280NMX, CHV-5S400NMX and CHV-5S450NMX
The indoor units are made up of eight sets of CHV-5SD140NK.

Then, Rated capacity configuration ratio C of outdoor/indoor unit = $140 \times 8 / (280+400+450) = 99\%$, and the number of indoor units is greater than 4. The following results can be obtained by referring to the above table:

Added refrigerant quantity B for CHV-5S280NMX module is 2 kg.

Added refrigerant quantity B for CHV-5S400NMX module is 3.5 kg.

Added refrigerant quantity B for CHV-5S450NMX module is 3.5 kg.

Therefore:

\sum Added refrigerant quantity B for each module = $2+3.5+3.5 = 9$ kg

Suppose: Added refrigerant quantity A for piping

= \sum Liquid pipe length × Added refrigerant quantity for each meter of liquid pipe = 25kg.

Total added refrigerant quantity R for this system = $25 + 9 = 34$ kg.

Example 2:

The outdoor unit consists of one CHV-5S450NMX module, and the indoor unit is one CHV-5SA450N (X4.0)M fresh air indoor unit. Then, the added refrigerant quantity B for this module is 0 kg.

Therefore:

\sum Added refrigerant quantity B for each module = 0 kg.

Suppose: Added refrigerant quantity A for piping

= Liquid pipe length × Added refrigerant quantity for each meter of liquid pipe = 5 kg.

Total added refrigerant quantity R for this system = $5 + 0 = 5$ kg.

14 OPTIONAL COMPONENTS

The CHV5 series VRF units provide the following options:

| | | Model | Remarks |
|---------------------------------|-----------------------------------|--|--|
| Manifold | Outdoor unit | CH01N | For the model selection method, see the part of pipeline selection. |
| | Indoor unit | CH020N, CH030N, CH070N, CH135N, CH270N | |
| Remote receiving LED panel | | JS03 | Applicable to the air duct-type indoor unit |
| Remote controller for debugging | | YV1L1 | With the debugging function, used to set functions of the indoor unit |
| Classic wired controller | | Wired controller XK46 | Applicable to the air Cassette, Floor Ceiling, Wall-Mounted indoor unit (duct-type indoor unit Standard) |
| Wired controller for hotel | | Wired controller XK49 | With the access control function |
| Ultrathin wired controller | | Wired controller XK62 | |
| Colour screen wired controller | | Wired controller XK55 | |
| Smart zone controller | | CE53-24/F(C) | |
| Debugging software | | DE40-33/A(C) | Applicable to the unit of CAN bus communication technology |
| Remote monitoring system | Software | FC31-00/AD(BM) | Applicable to the unit of CAN bus communication technology |
| | Optoelectronic isolated converter | GD02 | |
| | MODbus gateway | ME30-24/E4(M) | |
| | BACnet gateway | MG30-24/D2(B) | |

Note: If you need the above optional components, please consult your local sales company.

CHV5 DC Inverter VRF Units Technical Sales Guide

15 UNIT OPERATING RANGE

| | |
|---------|------------|
| Cooling | -5°C~52°C |
| Heating | -20°C~24°C |

When the indoor units are all VRF fresh air processor, the unit operating range is as follows:

| | |
|---------|-----------|
| Cooling | 16°C~45°C |
| Heating | -7°C~16°C |

If the temperature is beyond the range, the safety protection measure of the unit may take effect, and the air conditioning unit will stop.

